6G04 | apo 34247 / holo 34248

HN CSP ROC | 151 eligible residues

Binding site: 22 | Distal: 129

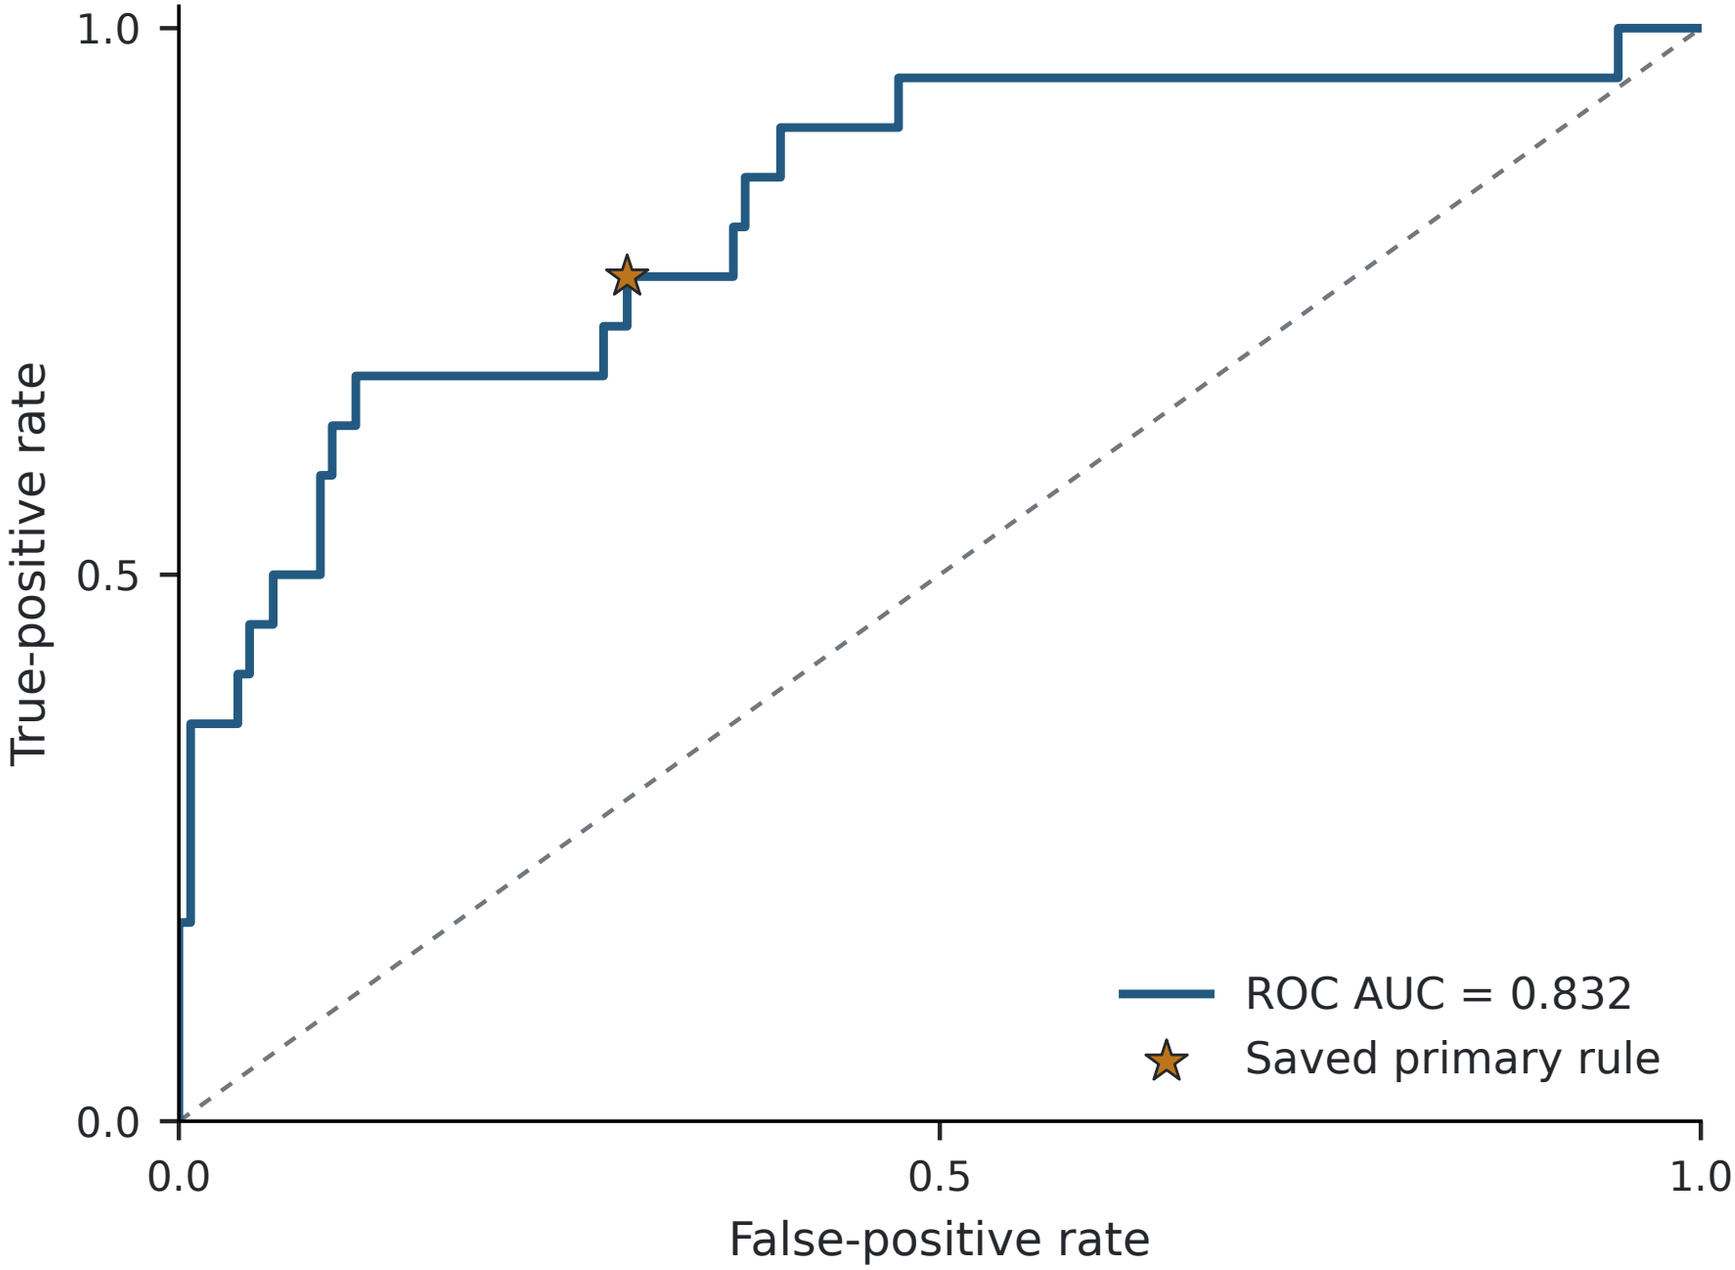

Primary cutoff: 0.0500 ppm

TP 17 | FP 38 | TN 91 | FN 5

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.