6IVU | apo 36220 / holo 36221

HN CSP ROC | 51 eligible residues

Binding site: 17 | Distal: 34

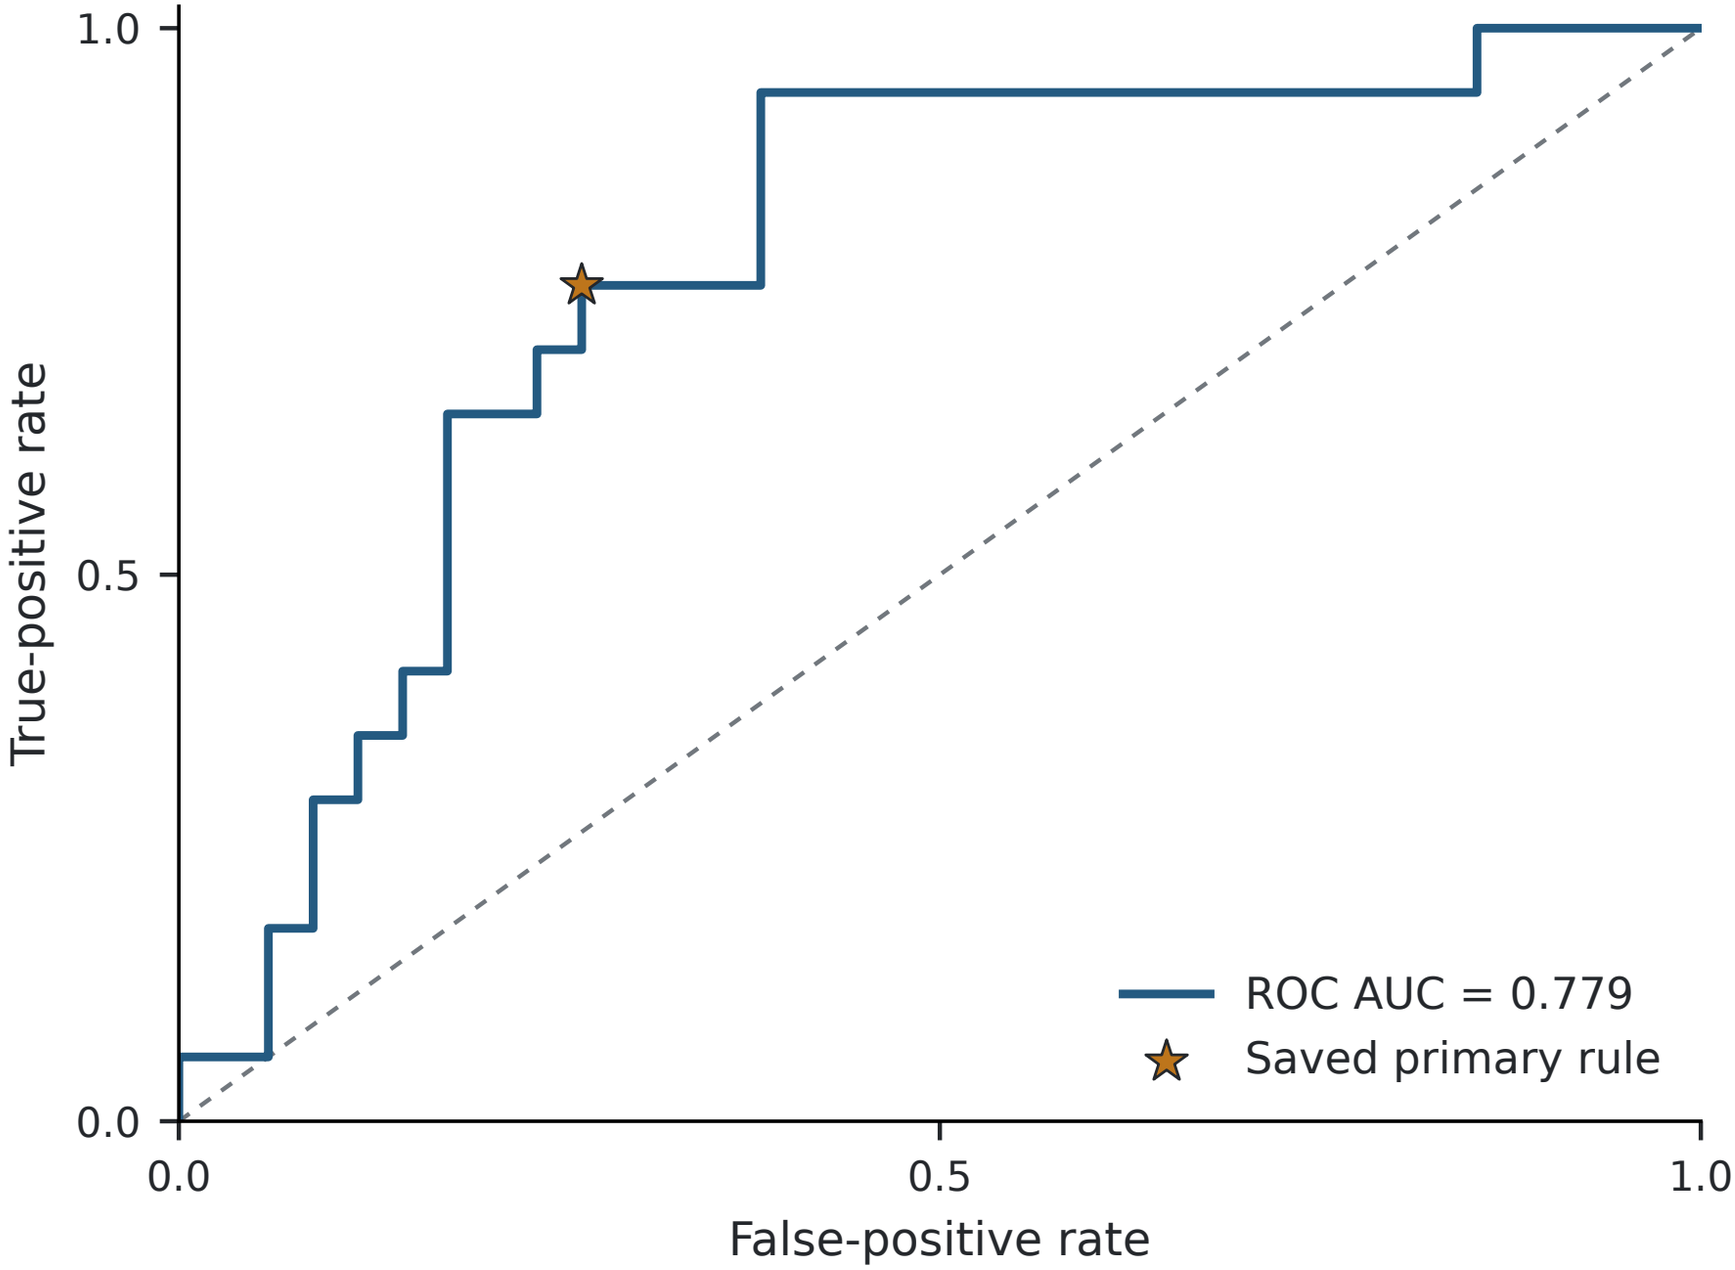

Primary cutoff: 0.2025 ppm

TP 13 | FP 9 | TN 25 | FN 4

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.