6OQJ | apo 30599 / holo 30605

HN CSP ROC | 49 eligible residues

Binding site: 10 | Distal: 39

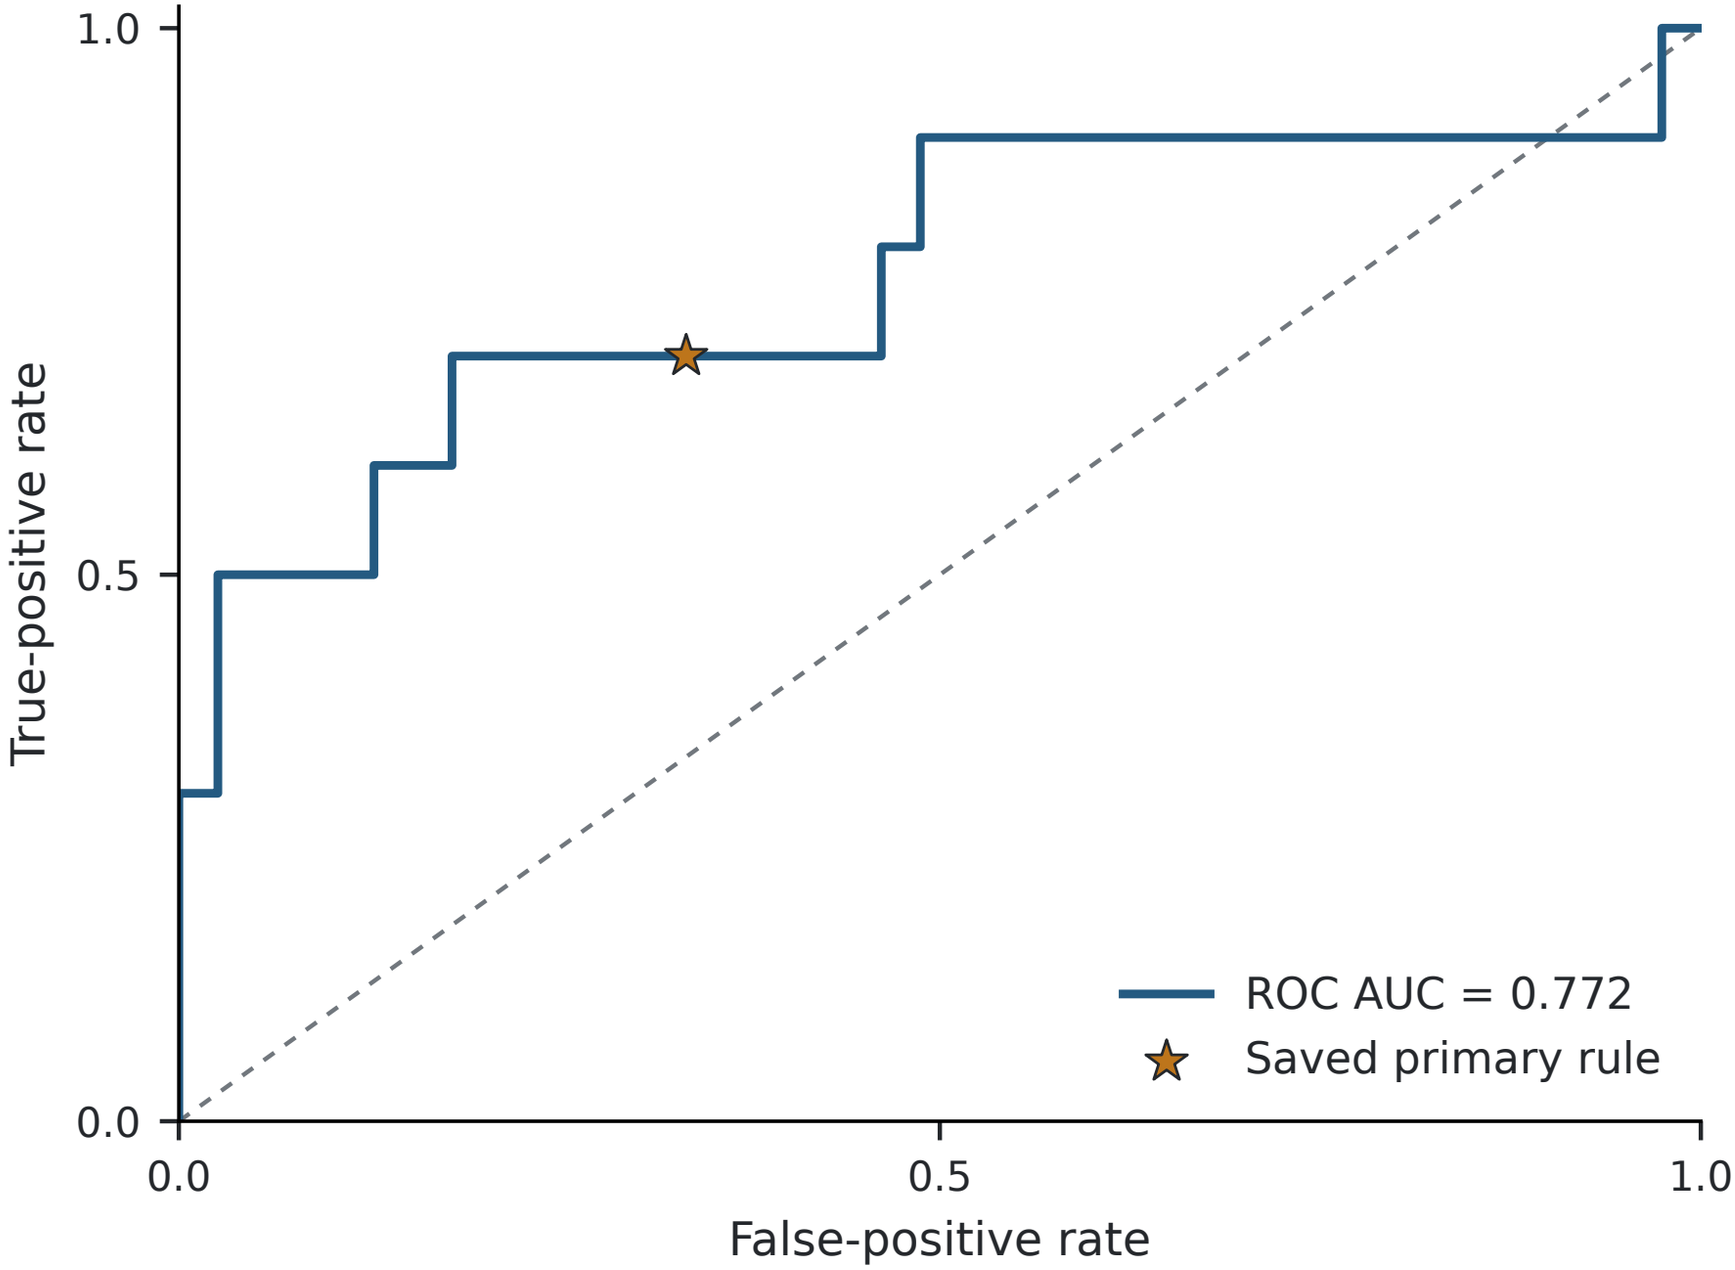

Primary cutoff: 0.1134 ppm

TP 7 | FP 13 | TN 26 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.