6QXZ | apo 27250 / holo 27251

HN CSP ROC | 74 eligible residues

Binding site: 24 | Distal: 50

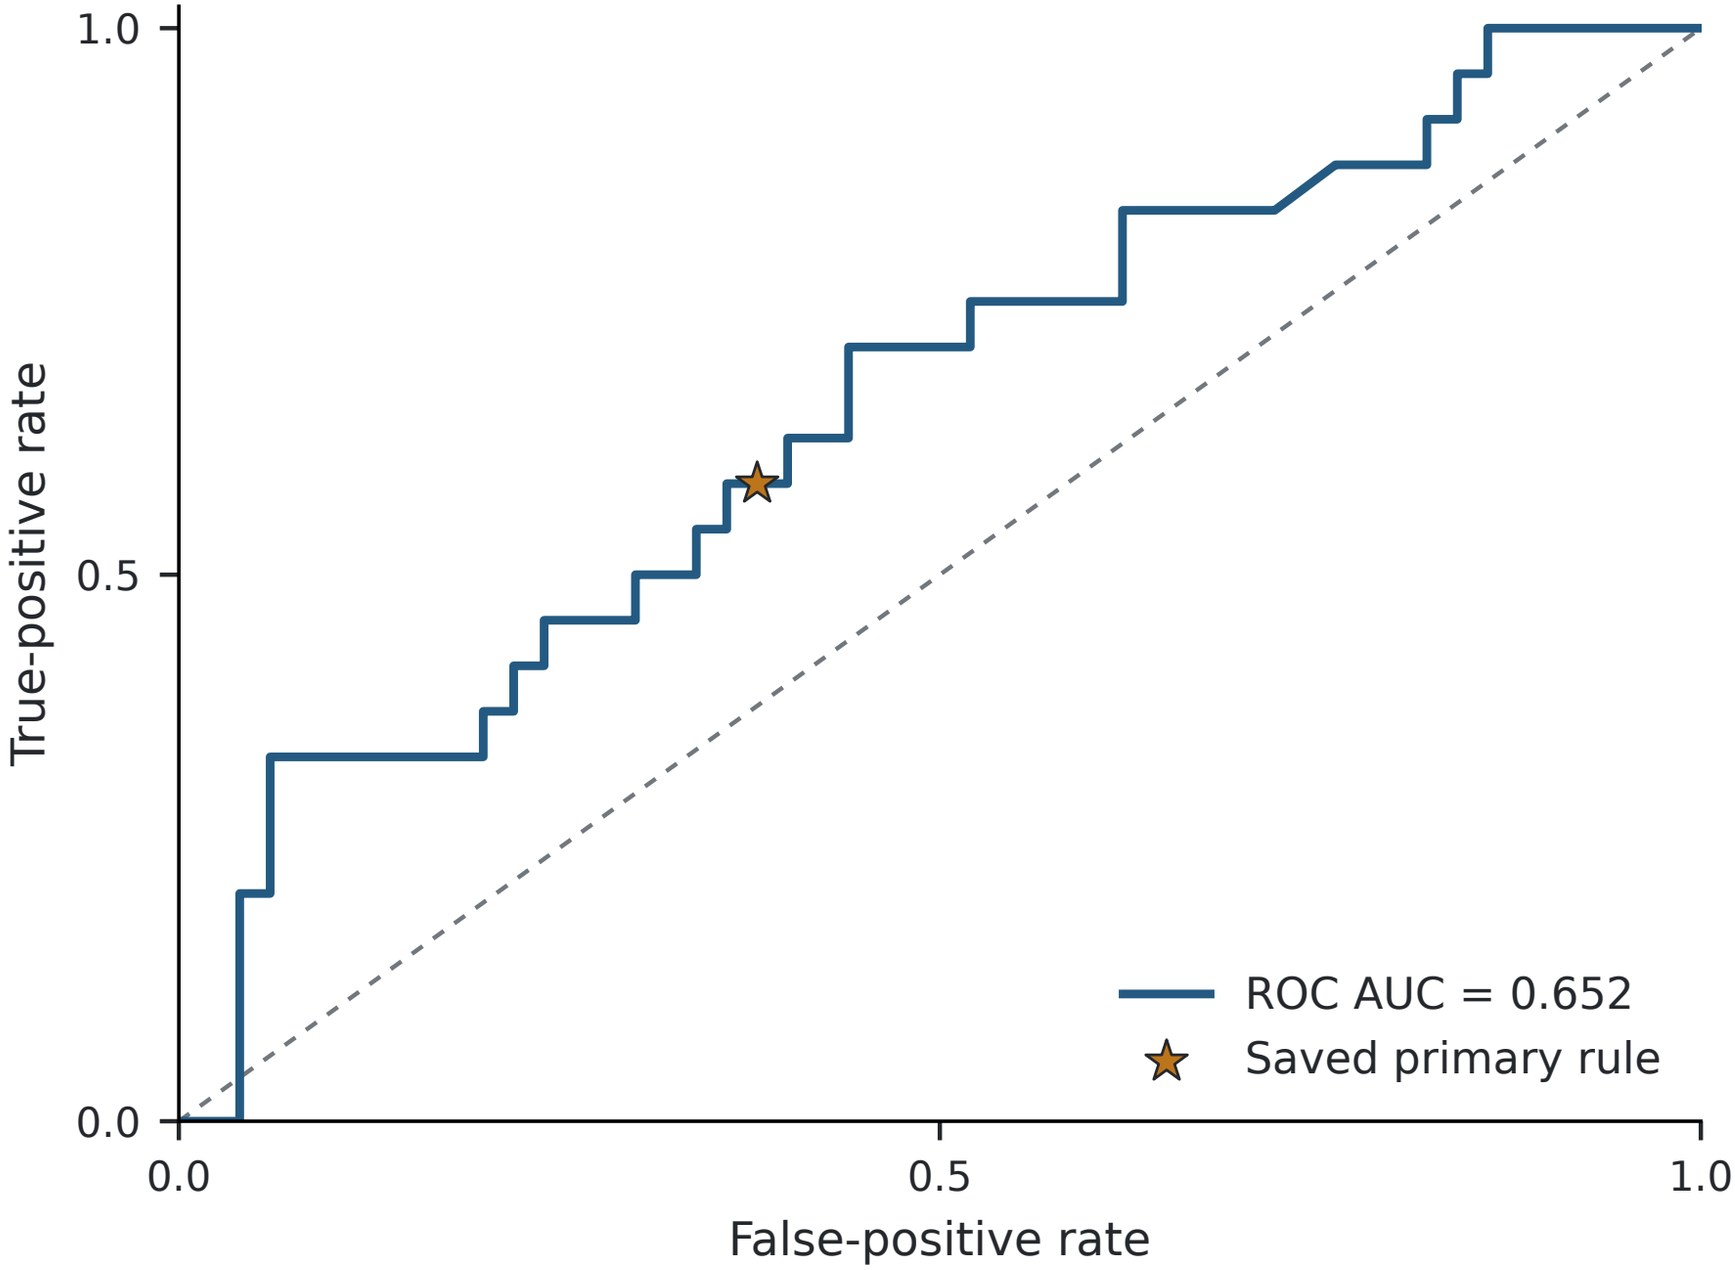

Primary cutoff: 0.0898 ppm

TP 14 | FP 19 | TN 31 | FN 10

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.