# 6U19 | apo 16620 / holo 27875

HN CSP ROC | 55 eligible residues

Binding site: 13 | Distal: 42

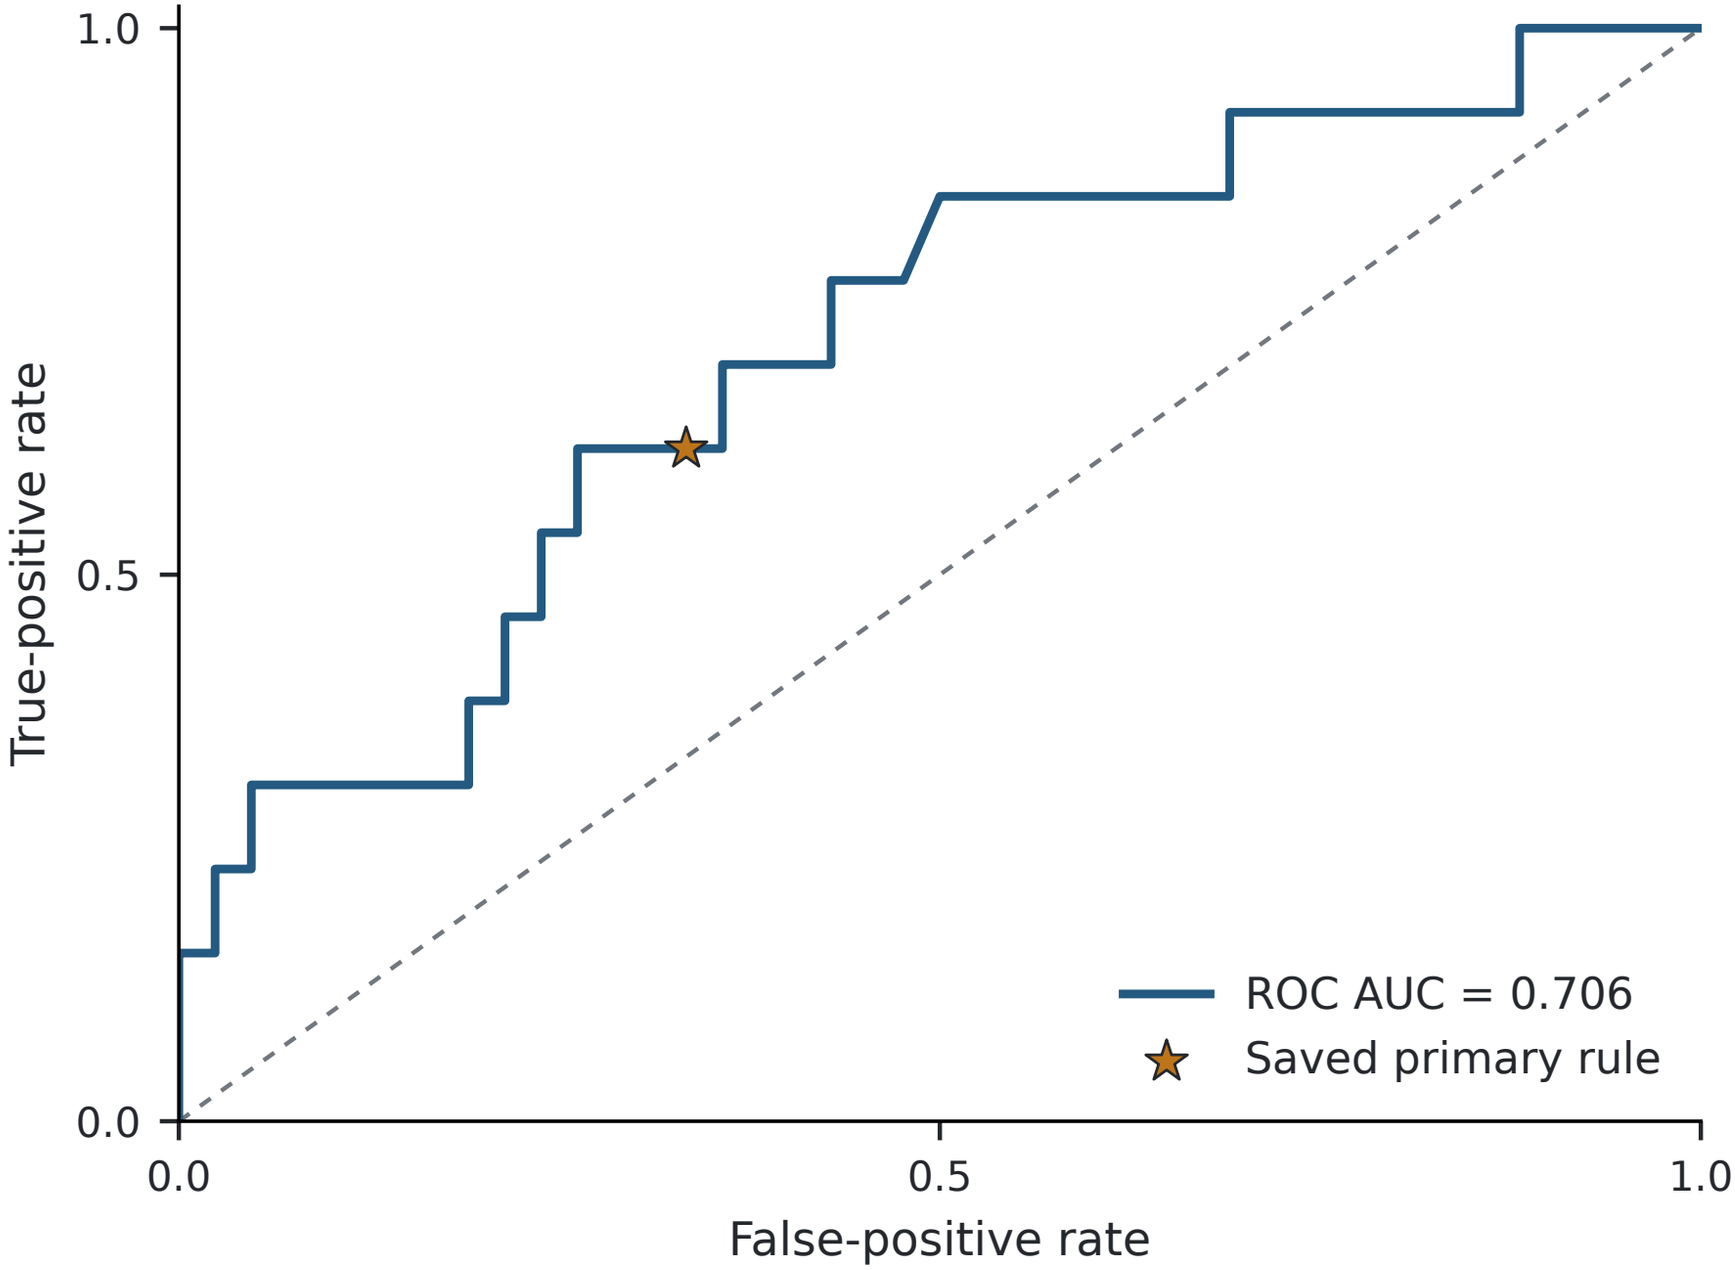


Primary cutoff: 0.1020 ppm

TP 8 | FP 14 | TN 28 | FN 5

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.