7SFT | apo 36097 / holo 30958

HN CSP ROC | 72 eligible residues

Binding site: 18 | Distal: 54

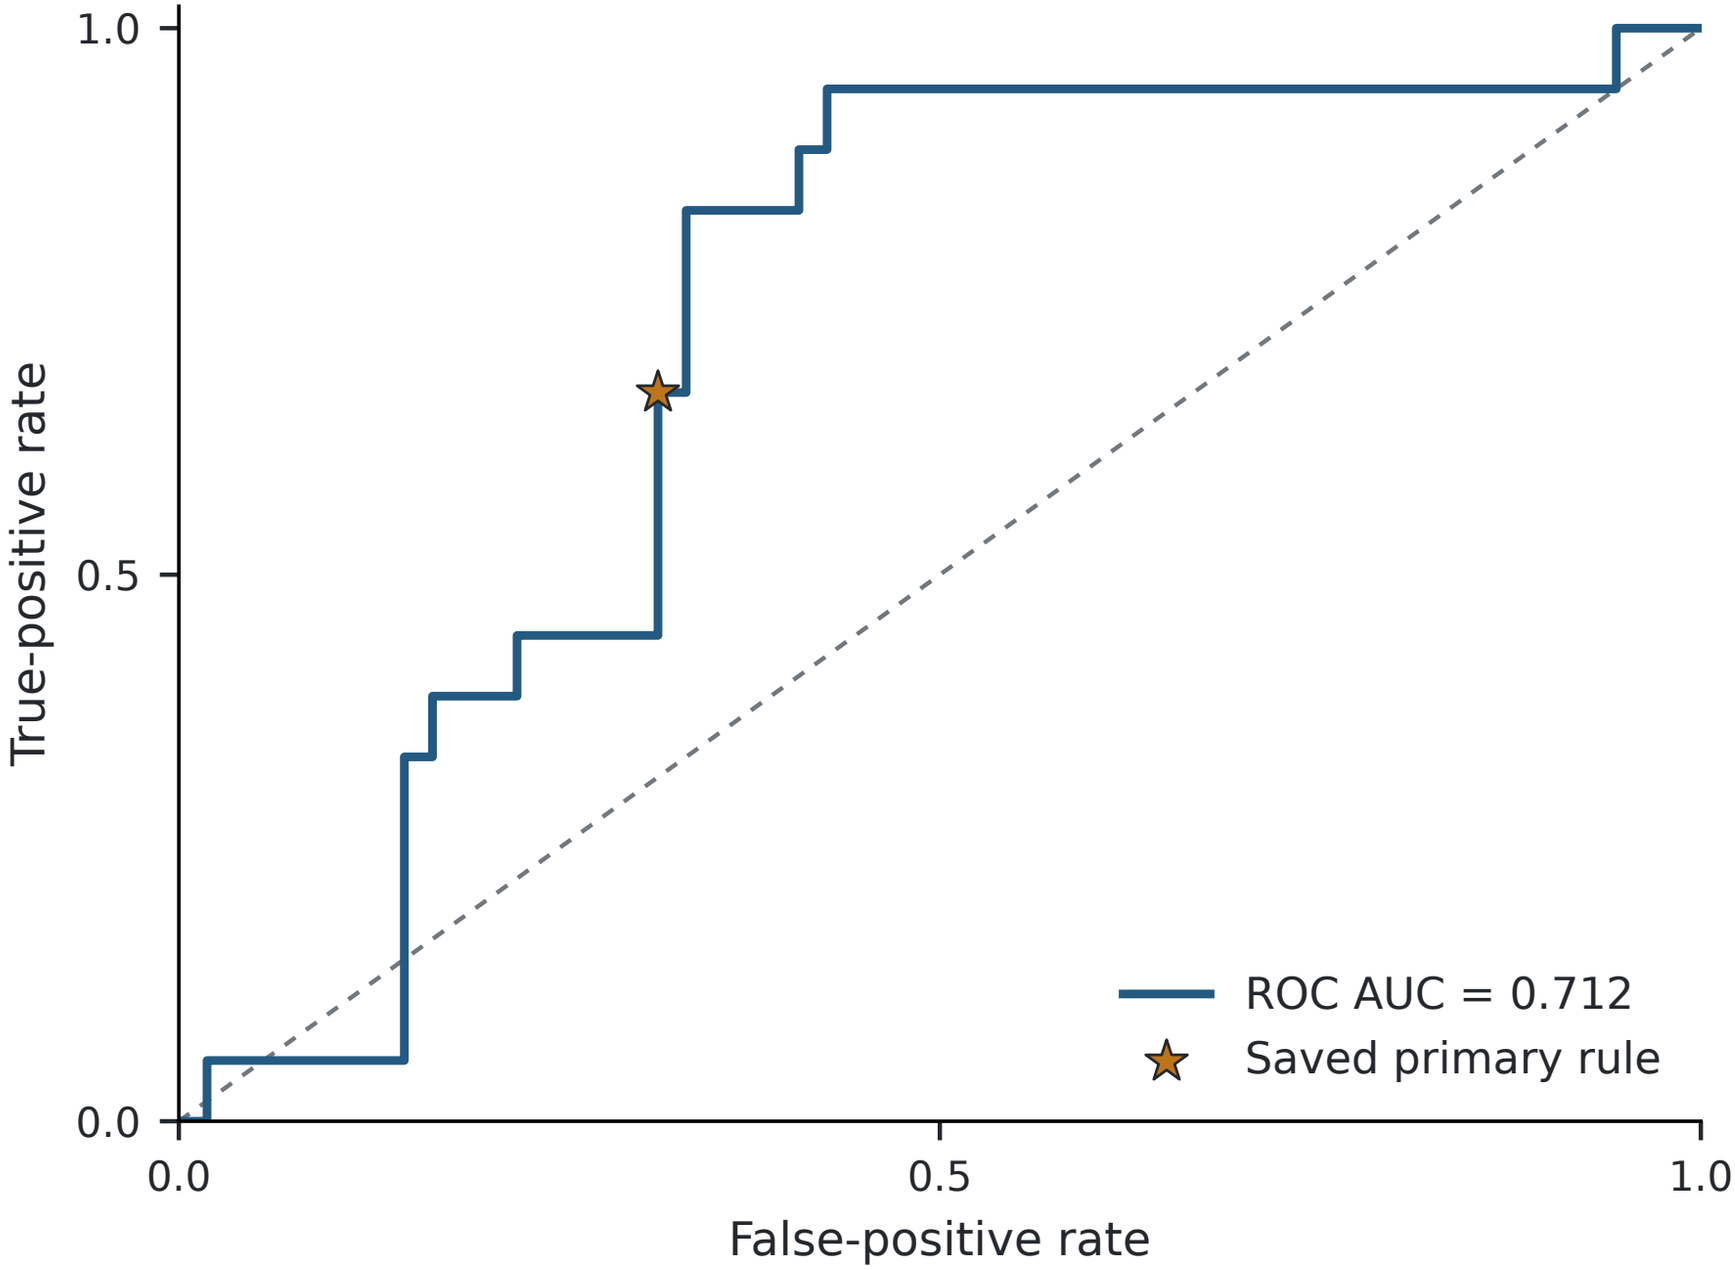

Primary cutoff: 0.0907 ppm

TP 12 | FP 17 | TN 37 | FN 6

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.