9QLM | apo 15670 / holo 34986

HN CSP ROC | 63 eligible residues

Binding site: 24 | Distal: 39

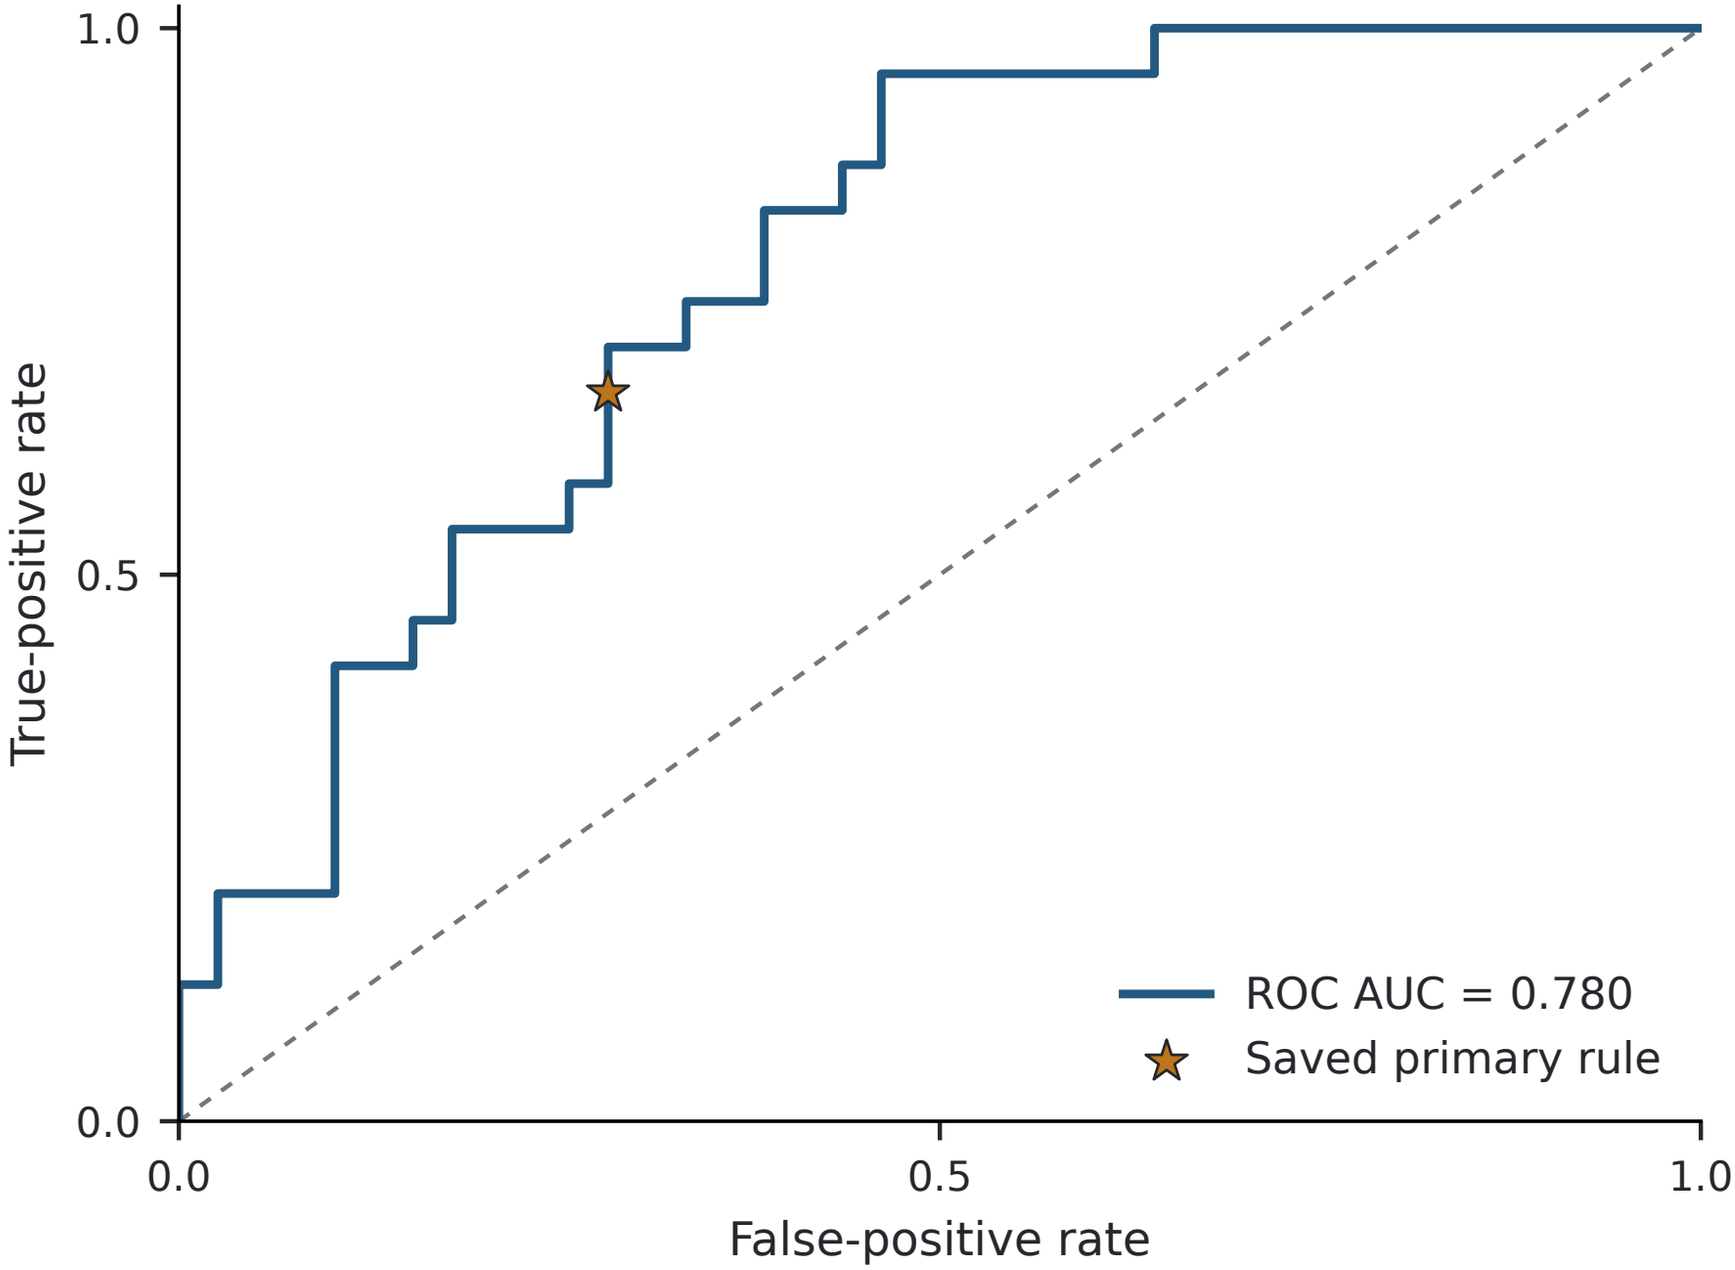

Primary cutoff: 0.0877 ppm

TP 16 | FP 11 | TN 28 | FN 8

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.