


ROOF -1



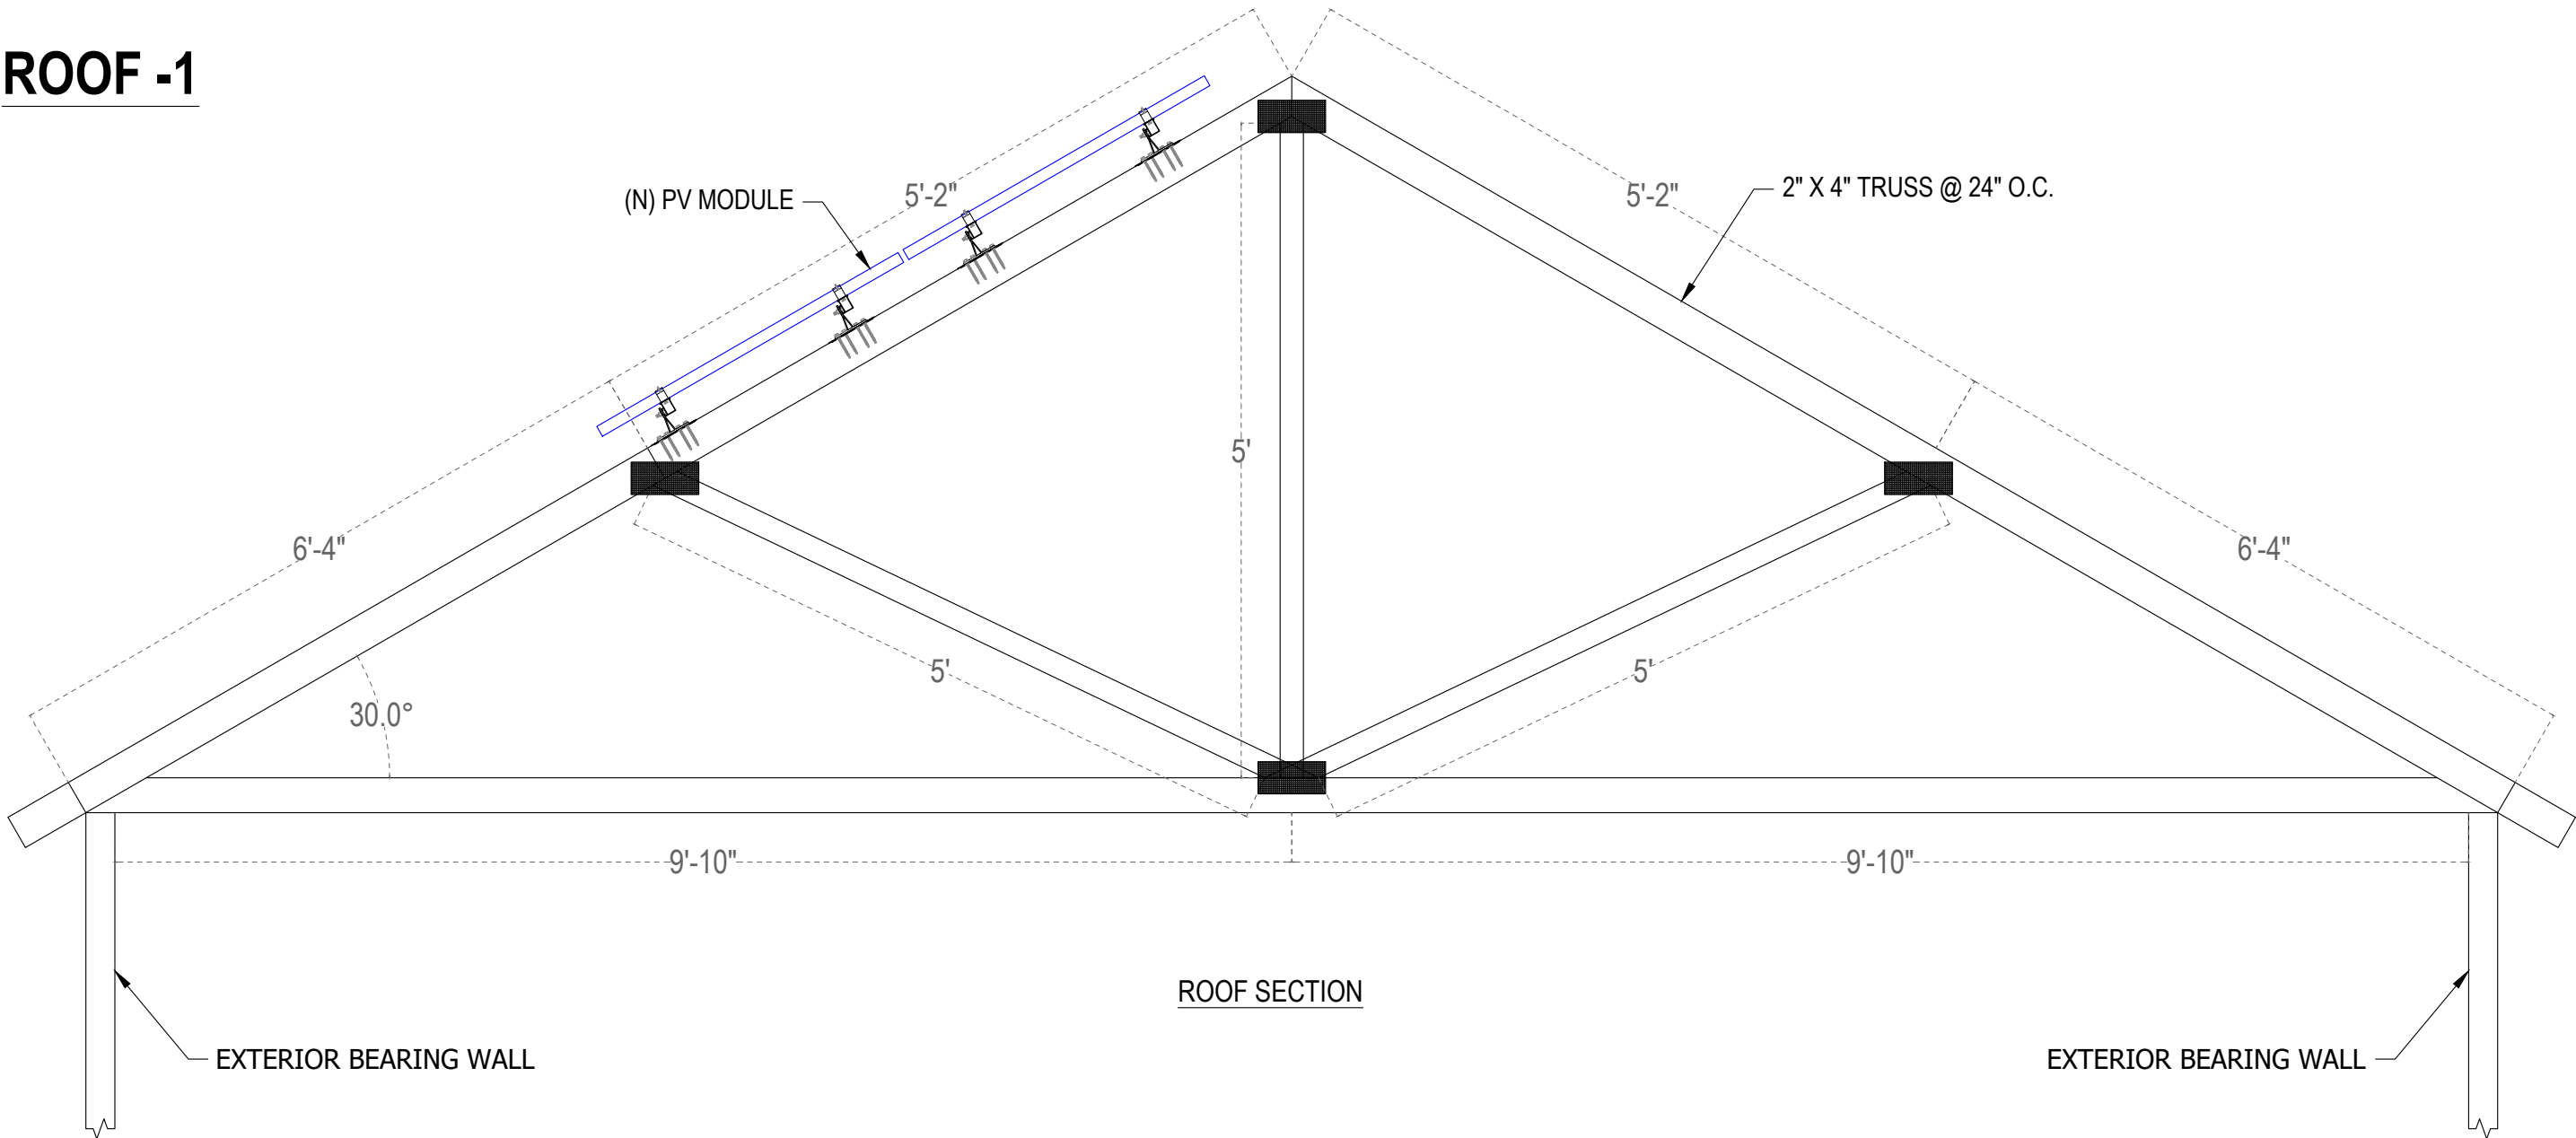

infinitysolar

INFINITY HOME SOLUTIONS
6405 E MILL PLAIN
VANCOUVER WA 98661
PHONE: 1-800-818-0598
INFINITY SOLAR.COM

REVISIONS		
Description	Date	Rev
Initial Design	6/16/26	00

Signature with Seal

Project Name & Address
KEVIN GONZALEZ RESIDENCE
925 N GRANT ST
LAFAYETTE, OR 97127
PHONE:- N/A
EMAIL:- N/A

Sheet Name
ROOF SECTION


Sheet Size
ANSI B
11" X 17"

Sheet Number
PV 1.2


GENERAL STRUCTURAL NOTES:

THE SOLAR PANELS ARE TO BE MOUNTED TO THE ROOF FRAMING USING THE CHIKO RACKING SYSTEM WITH CHIKO AL ROOF HOOK #167 CK-FTS-167RT2 ATTACHMENTS. THE MOUNTING FEET ARE TO BE SPACED AS SHOWN IN THE DETAILS, AND MUST BE STAGGERED TO ADJACENT FRAMING MEMBERS TO SPREAD OUT THE ADDITIONAL LOAD.

- 1. THE PROPOSED PV SYSTEM ADDS 2.77 PSF TO THE ROOF FRAMING SYSTEM.
- 2. ROOF LIVE LOAD = 20 PSF TYPICAL, 0 PSF UNDER NEW PV SYSTEM.
- 3. GROUND SNOW LOAD = 20 PSF
- 4. WIND SPEED = 110 MPH
- 5. EXPOSURE CATEGORY = C
- 6. RISK CATEGORY = II

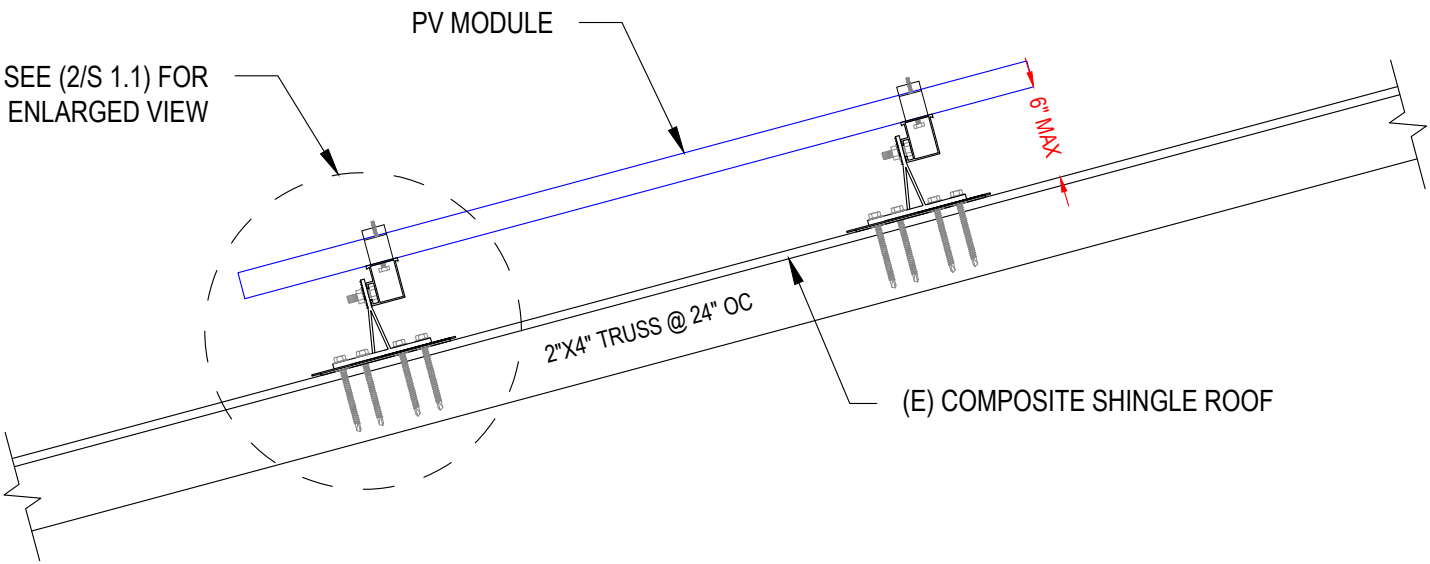

1 ATTACHMENT DETAIL (SIDE VIEW)
S 1.1 SCALE: NTS

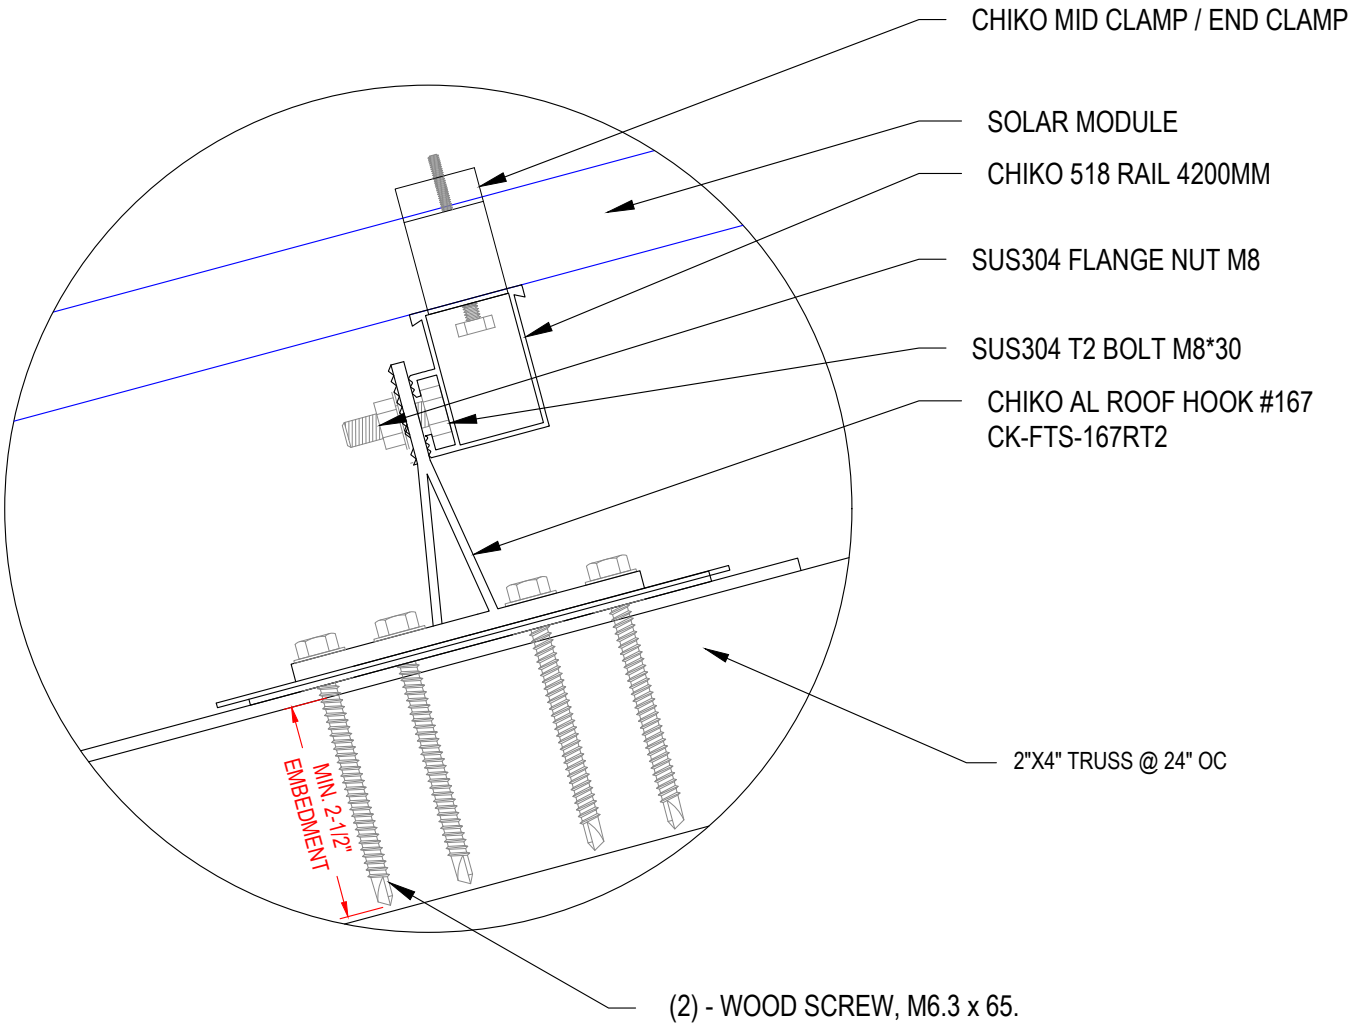

NOTE: - A PANELS WILL NOT MOUNT HIGHER THAN 12 INCHES ABOVE THE SURFACE OF THE ROOF TOP WHICH THEY ARE MOUNTED.

2 ATTACHMENT DETAIL ENLARGED VIEW
S 1.1 SCALE: NTS



infinity solar

INFINITY HOME SOLUTIONS
6405 E MILL PLAIN
VANCOUVER WA 98661
PHONE: 1-800-818-0598
INFINITY SOLAR.COM

REVISIONS		
Description	Date	Rev
Initial Design	6/16/26	00

Signature with Seal

Project Name & Address

KEVIN GONZALEZ RESIDENCE

925 N GRANT ST
LAFAYETTE, OR 97127
PHONE:- N/A
EMAIL:- N/A

Sheet Name

MOUNT DETAIL

Sheet Size

ANSI B
11" X 17"

Sheet Number

S 1.1

SITE NOTES:

- 1. A LADDER WILL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- 2. THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES.
- 3. THE SOLAR PV INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.
- 4. PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION NEC 110.26.
- 5. ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SERVES TO PROTECT THE BUILDING OR STRUCTURE.

EQUIPMENT LOCATIONS:

- 1. ALL EQUIPMENT SHALL MEET MINIMUM SETBACKS AS REQUIRED BY NEC 110.26.
- 2. WIRING SYSTEMS INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY NEC 690.31 (A),(C) AND NEC TABLES 310.15 (B)(1) AND 310.15 (B)(2).
- 3. JUNCTION AND PULL BOXES PERMITTED INSTALLED UNDER PV MODULES ACCORDING TO NEC 690.34.
- 4. ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT. 2.2.6 ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO NEC APPLICABLE CODES.
- 5. ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

STRUCTURAL NOTES:

- 1. RACKING SYSTEM & PV ARRAY WILL BE INSTALLED ACCORDING TO CODE-COMPLIANT INSTALLATION MANUAL. TOP CLAMPS REQUIRE A DESIGNATED SPACE BETWEEN MODULES, AND RAILS MUST ALSO EXTEND A MINIMUM DISTANCE BEYOND EITHER EDGE OF THE ARRAY / SUBARRAY, ACCORDING TO RAI MANUFACTURER'S INSTRUCTIONS.
- 2. JUNCTION BOX WILL BE INSTALLED PER MANUFACTURERS' SPECIFICATIONS. IF ROOF-PENETRATING TYPE, IT SHALL BE FLASHED & SEALED PER LOCAL REQUIREMENTS.
- 3. ROOFTOP PENETRATIONS FOR PV RACEWAY WILL BE COMPLETED AND SEALED W/ APPROVED CHEMICAL SEALANT PER CODE BY A LICENSED CONTRACTOR.
- 4. ALL PV RELATED ROOF ATTACHMENTS TO BE SPACED NO GREATER THAN THE SPAN DISTANCE SPECIFIED BY THE RACKING MANUFACTURER. 2.3.6 WHEN POSSIBLE, ALL PV RELATED RACKING ATTACHMENTS WILL BE STAGGERED AMONGST THE ROOF FRAMING MEMBERS.

WIRING & CONDUIT NOTES:

- 1. ALL CONDUIT AND WIRE WILL BE LISTED AND APPROVED FOR THEIR PURPOSE. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING.
- 2. CONDUCTORS SIZED ACCORDING TO NEC 690.8, NEC 690.7.
- 3. VOLTAGE DROP LIMITED TO 2%.
- 4. DC WIRING LIMITED TO MODULE FOOTPRINT. MICRO INVERTER WIRING SYSTEMS SHALL BE LOCATED AND SECURED UNDER THE ARRAY W/ SUITABLE WIRING CLIPS.
- 5. AC CONDUCTORS COLORED OR MARKED AS FOLLOWS: PHASE A OR L1- BLACK PHASE B OR L2- RED, OR OTHER CONVENTION IF THREE PHASE PHASE C OR L3- BLUE, YELLOW, ORANGE**, OR OTHER CONVENTION NEUTRAL- WHITE OR GREY IN 4-WIRE DELTA CONNECTED SYSTEMS THE PHASE WITH HIGHER VOLTAGE TO BE MARKED ORANGE [NEC 110.15].

GROUNDING NOTES:

- 1. GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVICES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR SUCH USE.
- 2. PV EQUIPMENT SHALL BE GROUNDED ACCORDING TO NEC 690.43 AND MINIMUM NEC TABLE 250.122.
- 3. METAL PARTS OF MODULE FRAMES, MODULE RACKING, AND ENCLOSURES CONSIDERED GROUNDED IN ACCORD WITH 250.134 AND 250.136.
- 4. EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZED ACCORDING TO NEC 690.45 AND MICRO INVERTER MANUFACTURERS' INSTRUCTIONS.
- 5. EACH MODULE WILL BE GROUNDED USING WEEB GROUNDING CLIPS AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ. IF WEEBS ARE NOT USED, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE SPECIFIED GROUNDING LUG HOLES PER THE MANUFACTURERS' INSTALLATION REQUIREMENTS.
- 6. THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDING CONDUCTOR TO ANOTHER MODULE.
- 7. GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLORED GREEN OR MARKED GREEN IF #4 AWG OR LARGER [NEC 250.119]
- 8. THE GROUNDING ELECTRODE SYSTEM COMPLIES WITH NEC 690.47 AND NEC 250.50 THROUGH 250.106. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, A GROUNDING ELECTRODE SYSTEM PROVIDED ACCORDING TO NEC 250, NEC 690.47 AND AHJ.
- 9. GROUND-FAULT DETECTION SHALL COMPLY WITH NEC 690.41(B)(1) AND (2) TO REDUCE FIRE HAZARDS

DISCONNECTION AND OVER-CURRENT PROTECTION NOTES:

- 1. DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING ENERGIZED ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS).
- 2. DISCONNECTS TO BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH
- 3. PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION TO REDUCE SHOCK HAZARD FOR EMERGENCY RESPONDERS IN ACCORDANCE WITH 690.12(A) THROUGH (D).
- 4. ALL OCPD RATINGS AND TYPES SPECIFIED ACCORDING TO NEC 690.8, 690.9, AND 240.
- 5. MICRO INVERTER BRANCHES CONNECTED TO A SINGLE BREAKER OR GROUPED FUSES IN ACCORDANCE WITH NEC 110.3(B).
- 6. IF REQUIRED BY AHJ, SYSTEM WILL INCLUDE ARC-FAULT CIRCUIT PROTECTION ACCORDING TO NEC 690.11 AND UL1699B.

INTERCONNECTION NOTES:

- 1. LOAD-SIDE INTERCONNECTION SHALL BE IN ACCORDANCE WITH [NEC 705.12]
- 2. THE SUM OF THE UTILITY OCPD AND INVERTER CONTINUOUS OUTPUT MAY NOT EXCEED 120% OF BUS BAR RATING [NEC 705.12(B)(3)(2)].
- 3. THE SUM OF 125 PERCENT OF THE POWER SOURCE(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUS BAR SHALL NOT EXCEED 120 PERCENT OF THE AMPACITY OF THE BUS BAR, PV DEDICATED BACKFEED BREAKERS MUST BE LOCATED OPPOSITE END OF THE BUS FROM THE UTILITY SOURCE OCPD [NEC 705.12(B)(3)(1)].
- 4. AT MULTIPLE ELECTRIC POWER SOURCES OUTPUT COMBINER PANEL, TOTAL RATING OF ALL OVERCURRENT DEVICES SHALL NOT EXCEED AMPACITY OF BUSBAR. HOWEVER, THE COMBINED OVERCURRENT DEVICE MAY BE EXCLUDED ACCORDING TO NEC 705.12 (B)(3)(3).
- 5. FEEDER TAP INTERCONNECTION (LOADSIDE) ACCORDING TO NEC 705.12 (B)(1)
- 6. SUPPLY SIDE TAP INTERCONNECTION ACCORDING TO NEC 705.11 WITH SERVICE ENTRANCE CONDUCTORS IN ACCORDANCE WITH NEC 230.42 2.7.8BACKFEEDING BREAKER FOR ELECTRIC POWER SOURCES OUTPUT IS EXEMPT FROM ADDITIONAL FASTENING [NEC 705.12 (E)].



infinitysolar

INFINITY HOME SOLUTIONS
6405 E MILL PLAIN
VANCOUVER WA 98661
PHONE: 1-800-818-0598
INFINITY SOLAR.COM

REVISIONS		
Description	Date	Rev
Initial Design	6/16/26	00

Signature with Seal

Project Name & Address

KEVIN GONZALEZ RESIDENCE

925 N GRANT ST
LAFAYETTE, OR 97127
PHONE:- N/A
EMAIL:- N/A

Sheet Name
NOTES

Sheet Size
ANSI B
11" X 17"

Sheet Number
E 1.2