


Controlled mixer ablation (MAE), lookback/horizon = 96
(y-axis zoomed; NLinear-only omitted for scale)

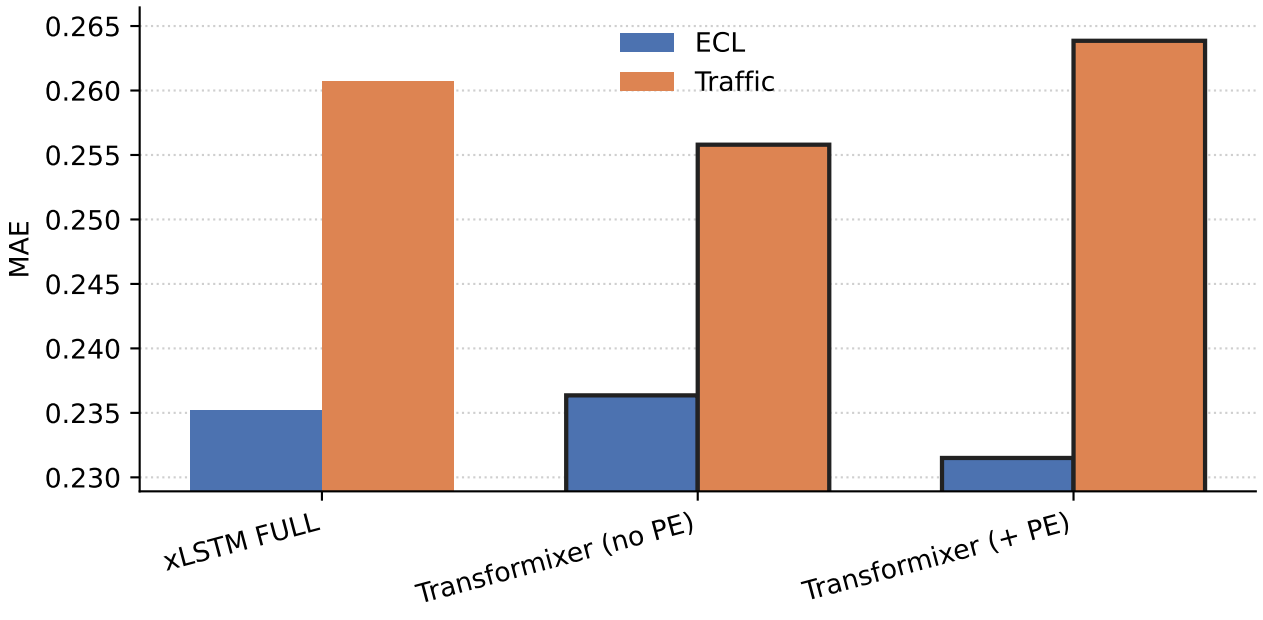

0.2352

0.2607

0.2364

0.2558

0.2315

0.2639