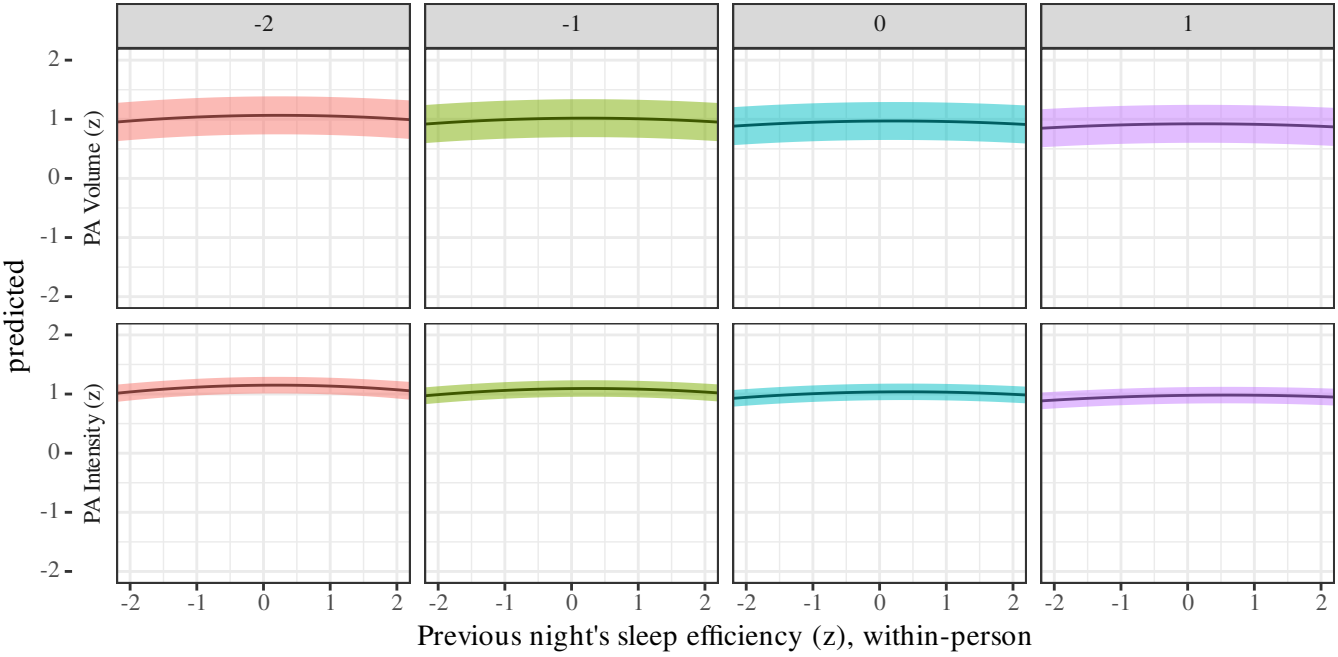
-2
-1
0
1
predicted
PA Volume (z)
PA Intensity (z)
2
1
0
-1
-2
Previous night's sleep efficiency (z), within-person