



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy  
N/A kWh

Apparent Energy  
N/A kVAh

Meter Name : RASKOG NEW PANL

Avg PF  
N/A

Maximum Demand  
kVA

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | N/A V     | N/A V     | N/A V     |
| Voltage YB     | N/A V     | N/A V     | N/A V     |
| Voltage RB     | N/A V     | N/A V     | N/A V     |
| Current R      | N/A A     | N/A A     | N/A A     |
| Current Y      | N/A A     | N/A A     | N/A A     |
| Current B      | N/A A     | N/A A     | N/A A     |
| Active Power   | N/A kW    | N/A kW    | N/A kW    |
| Apparent Power | N/A kVA   | N/A kVA   | N/A kVA   |
| Power Factor   | N/A       | N/A       | N/A       |





by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
124.93 kWh

Apparent Energy  
137.67 kVAh


### Meter Name : Chiller Plating Plant

Avg PF  
0.907

Maximum Demand  
9.07 kVA 15:57:50

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 375.45 V  | 432.99 V  | 409.25 V  |
| Voltage YB     | 372.69 V  | 428.92 V  | 405.75 V  |
| Voltage RB     | 375.51 V  | 429.71 V  | 407.83 V  |
| Current R      | 0.00 A    | 11.28 A   | 7.05 A    |
| Current Y      | 0.00 A    | 12.48 A   | 7.73 A    |
| Current B      | 0.00 A    | 15.68 A   | 9.95 A    |
| Active Power   | 0.00 kW   | 8.38 kW   | 5.19 kW   |
| Apparent Power | 0.00 kVA  | 9.24 kVA  | 5.73 kVA  |
| Power Factor   | -0.94     | 0.00      | -0.617    |

Active Power Apparent Power PF

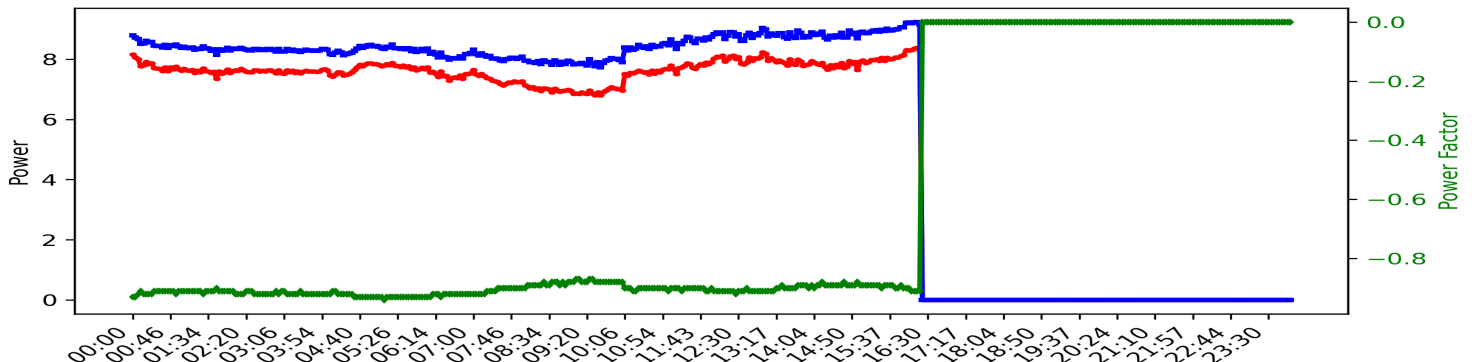



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy  
N/A kWh

Apparent Energy  
N/A kVAh

Meter Name : Main Incomer Meter

Avg PF  
N/A

Maximum Demand  
kVA

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | N/A V     | N/A V     | N/A V     |
| Voltage YB     | N/A V     | N/A V     | N/A V     |
| Voltage RB     | N/A V     | N/A V     | N/A V     |
| Current R      | N/A A     | N/A A     | N/A A     |
| Current Y      | N/A A     | N/A A     | N/A A     |
| Current B      | N/A A     | N/A A     | N/A A     |
| Active Power   | N/A kW    | N/A kW    | N/A kW    |
| Apparent Power | N/A kVA   | N/A kVA   | N/A kVA   |
| Power Factor   | N/A       | N/A       | N/A       |





by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
3183.94 kWh

Apparent Energy  
3206.52 kVAh


### Meter Name : Old LT Panel Main Incomer

Avg PF  
0.993

Maximum Demand  
332.35 kVA 06:59:49

| Parameter Name | Min Value | Max Value  | Avg Value  |
|----------------|-----------|------------|------------|
| Voltage RY     | 417.86 V  | 439.78 V   | 427.84 V   |
| Voltage YB     | 413.16 V  | 436.48 V   | 423.83 V   |
| Voltage RB     | 414.94 V  | 437.76 V   | 425.75 V   |
| Current R      | 106.60 A  | 448.33 A   | 291.87 A   |
| Current Y      | 103.73 A  | 454.67 A   | 280.19 A   |
| Current B      | 96.73 A   | 458.73 A   | 269.67 A   |
| Active Power   | 53.32 kW  | 219.98 kW  | 136.38 kW  |
| Apparent Power | 74.62 kVA | 332.35 kVA | 207.49 kVA |
| Power Factor   | -1.00     | 1.00       | -0.479     |

Active Power Apparent Power PF

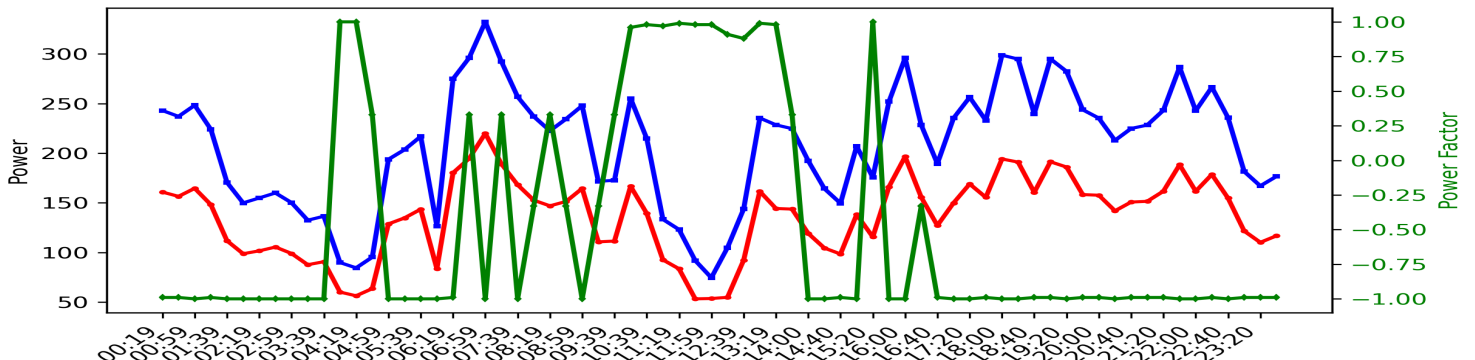



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
466.56 kWh

Apparent Energy  
487.34 kVAh


### Meter Name : Packing & Sticking Line

Avg PF  
0.957

Maximum Demand  
44.49 kVA 18:00:11

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 416.91 V  | 439.49 V  | 427.36 V  |
| Voltage YB     | 413.37 V  | 435.94 V  | 423.23 V  |
| Voltage RB     | 414.14 V  | 437.25 V  | 425.14 V  |
| Current R      | 0.00 A    | 70.78 A   | 34.24 A   |
| Current Y      | 0.00 A    | 48.12 A   | 18.76 A   |
| Current B      | 9.17 A    | 63.67 A   | 32.05 A   |
| Active Power   | 2.97 kW   | 44.12 kW  | 20.00 kW  |
| Apparent Power | 3.04 kVA  | 44.49 kVA | 21.12 kVA |
| Power Factor   | -1.00     | 1.00      | 0.811     |

Active Power Apparent Power PF

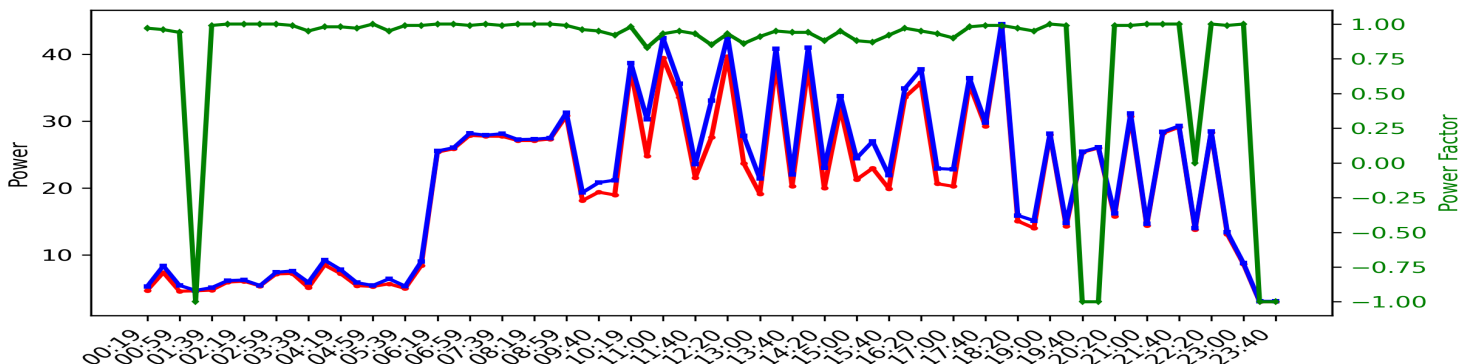



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
171.67 kWh

Apparent Energy  
327.68 kVAh


### Meter Name : Rigga Line Fabrication

Avg PF  
0.524

Maximum Demand  
29.45 kVA 12:20:07

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 416.37 V  | 439.73 V  | 427.45 V  |
| Voltage YB     | 412.22 V  | 436.31 V  | 423.34 V  |
| Voltage RB     | 413.72 V  | 437.77 V  | 425.17 V  |
| Current R      | 0.00 A    | 43.50 A   | 20.16 A   |
| Current Y      | 0.00 A    | 42.08 A   | 17.25 A   |
| Current B      | 0.00 A    | 40.92 A   | 17.24 A   |
| Active Power   | 0.00 kW   | 16.37 kW  | 6.93 kW   |
| Apparent Power | 0.00 kVA  | 29.45 kVA | 13.60 kVA |
| Power Factor   | 0.00      | 1.00      | 0.419     |

Active Power Apparent Power PF

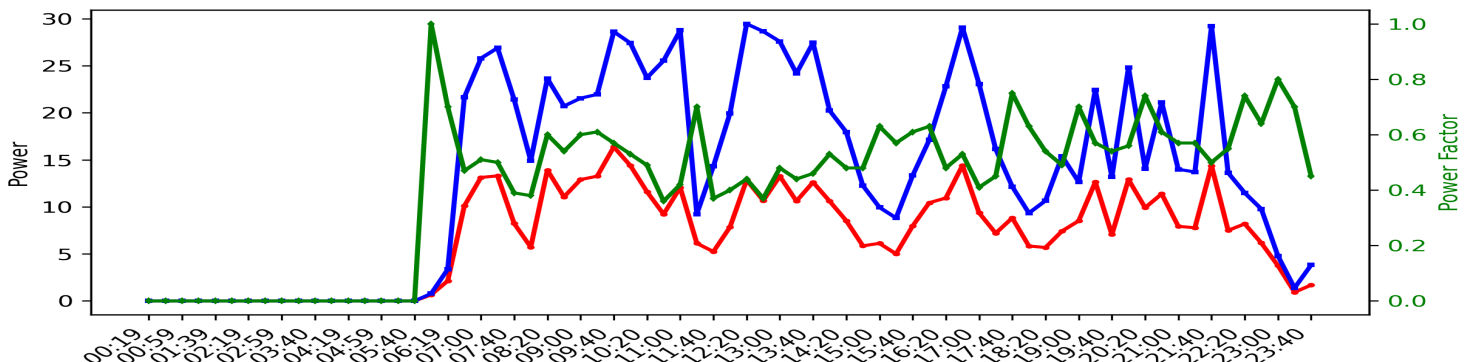



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
1059.49 kWh

Apparent Energy  
1943.16 kVAh


### Meter Name : Press & Fabrication

Avg PF  
0.545

Maximum Demand  
128.93 kVA 17:00:20

| Parameter Name | Min Value | Max Value  | Avg Value |
|----------------|-----------|------------|-----------|
| Voltage RY     | 415.97 V  | 439.39 V   | 427.25 V  |
| Voltage YB     | 411.84 V  | 435.87 V   | 423.10 V  |
| Voltage RB     | 413.66 V  | 437.29 V   | 425.08 V  |
| Current R      | 46.30 A   | 192.45 A   | 128.48 A  |
| Current Y      | 39.70 A   | 183.50 A   | 121.40 A  |
| Current B      | 25.75 A   | 152.65 A   | 97.58 A   |
| Active Power   | 19.11 kW  | 72.20 kW   | 46.27 kW  |
| Apparent Power | 27.43 kVA | 128.93 kVA | 86.09 kVA |
| Power Factor   | 0.41      | 0.74       | 0.567     |

Active Power Apparent Power PF

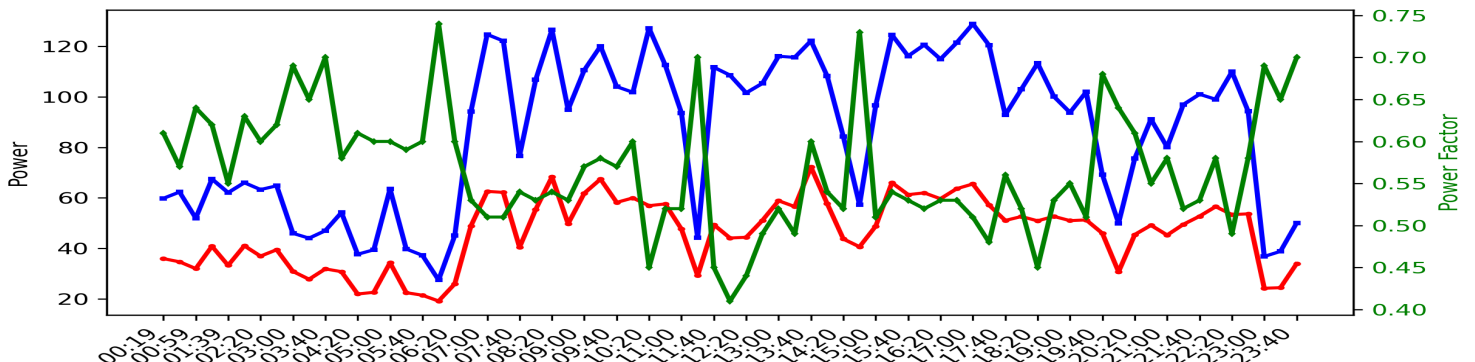



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
1748.36 kWh

Apparent Energy  
2071.93 kVAh


### Meter Name : Powder Coating

Avg PF  
0.844

Maximum Demand  
119.16 kVA 10:20:16

| Parameter Name | Min Value | Max Value  | Avg Value |
|----------------|-----------|------------|-----------|
| Voltage RY     | 416.07 V  | 439.71 V   | 427.15 V  |
| Voltage YB     | 412.16 V  | 436.12 V   | 423.21 V  |
| Voltage RB     | 413.44 V  | 437.54 V   | 424.98 V  |
| Current R      | 9.84 A    | 160.92 A   | 117.61 A  |
| Current Y      | 8.56 A    | 157.88 A   | 115.92 A  |
| Current B      | 20.56 A   | 163.40 A   | 122.02 A  |
| Active Power   | 8.88 kW   | 100.50 kW  | 72.67 kW  |
| Apparent Power | 9.53 kVA  | 119.16 kVA | 87.40 kVA |
| Power Factor   | 0.75      | 0.96       | 0.843     |

Active Power Apparent Power PF

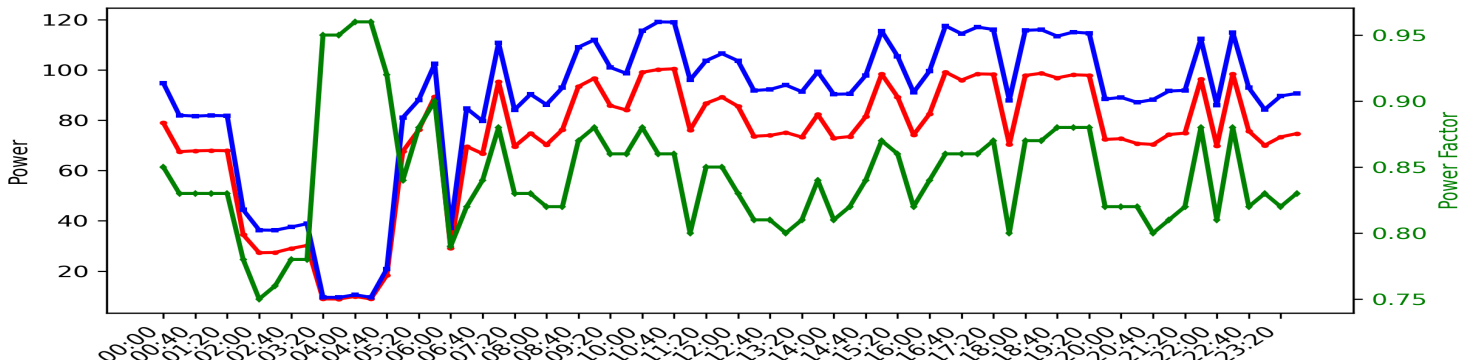



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
0.87 kWh

Apparent Energy  
1.09 kVAh


### Meter Name : New Plating Plant

Avg PF  
0.798

Maximum Demand  
105.95 kVA 14:20:27

| Parameter Name | Min Value | Max Value  | Avg Value |
|----------------|-----------|------------|-----------|
| Voltage RY     | 416.31 V  | 440.11 V   | 427.52 V  |
| Voltage YB     | 411.65 V  | 436.60 V   | 423.15 V  |
| Voltage RB     | 413.63 V  | 437.80 V   | 425.04 V  |
| Current R      | 0.00 A    | 149.64 A   | 63.26 A   |
| Current Y      | 0.00 A    | 153.68 A   | 63.53 A   |
| Current B      | 0.00 A    | 147.04 A   | 67.78 A   |
| Active Power   | 0.00 kW   | 84.90 kW   | 37.45 kW  |
| Apparent Power | 0.00 kVA  | 105.95 kVA | 47.60 kVA |
| Power Factor   | 0.00      | 0.97       | 0.802     |

Active Power Apparent Power PF

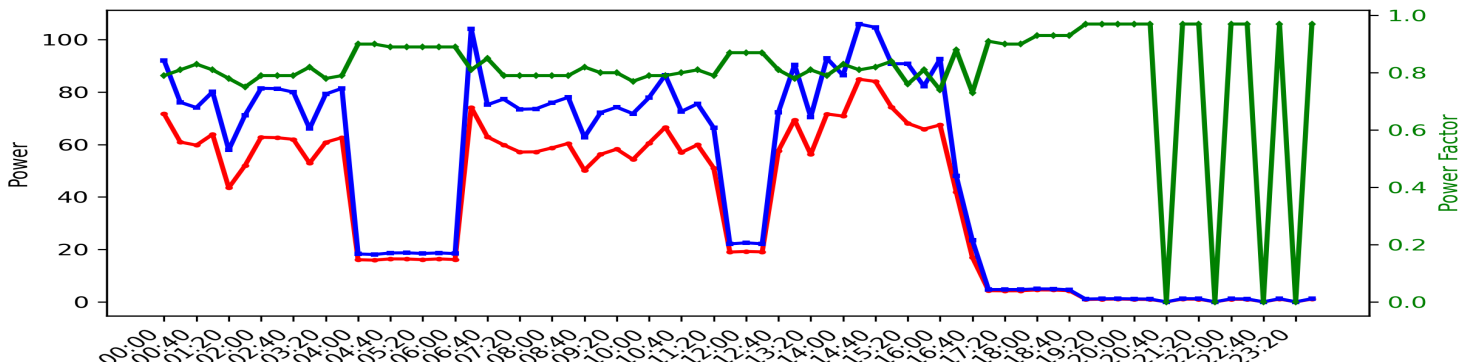



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
3.19 kWh

Apparent Energy  
8.52 kVAh


### Meter Name : Old Plating Plant

Avg PF  
0.374

Maximum Demand  
1.27 kVA 13:00:37

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 416.78 V  | 439.99 V  | 427.47 V  |
| Voltage YB     | 412.83 V  | 436.90 V  | 423.49 V  |
| Voltage RB     | 414.10 V  | 437.87 V  | 425.29 V  |
| Current R      | 0.00 A    | 0.00 A    | 0.00 A    |
| Current Y      | 0.00 A    | 4.96 A    | 0.86 A    |
| Current B      | 0.00 A    | 0.00 A    | 0.00 A    |
| Active Power   | 0.00 kW   | 0.56 kW   | 0.09 kW   |
| Apparent Power | 0.00 kVA  | 1.27 kVA  | 0.22 kVA  |
| Power Factor   | -0.52     | 0.00      | -0.097    |

Active Power Apparent Power PF

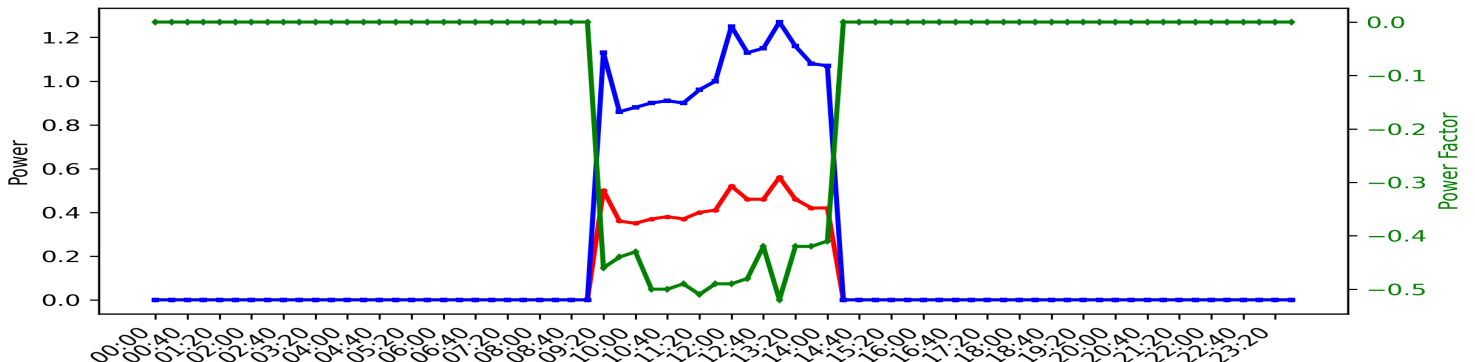



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy

796.28 kWh

Apparent Energy

948.03 kVAh

Meter Name : Kaeser ASD 60 40HP Air Compressor

Avg PF


0.840

Maximum Demand

41.64 kVA 04:40:25

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 414.64 V  | 438.78 V  | 425.52 V  |
| Voltage YB     | 411.16 V  | 435.58 V  | 422.65 V  |
| Voltage RB     | 409.23 V  | 434.55 V  | 420.96 V  |
| Current R      | 37.24 A   | 58.76 A   | 56.93 A   |
| Current Y      | 36.84 A   | 57.36 A   | 54.86 A   |
| Current B      | 33.04 A   | 53.84 A   | 51.64 A   |
| Active Power   | 16.26 kW  | 35.16 kW  | 33.46 kW  |
| Apparent Power | 24.16 kVA | 41.64 kVA | 39.93 kVA |
| Power Factor   | 0.67      | 0.86      | 0.838     |

Active Power Apparent Power PF

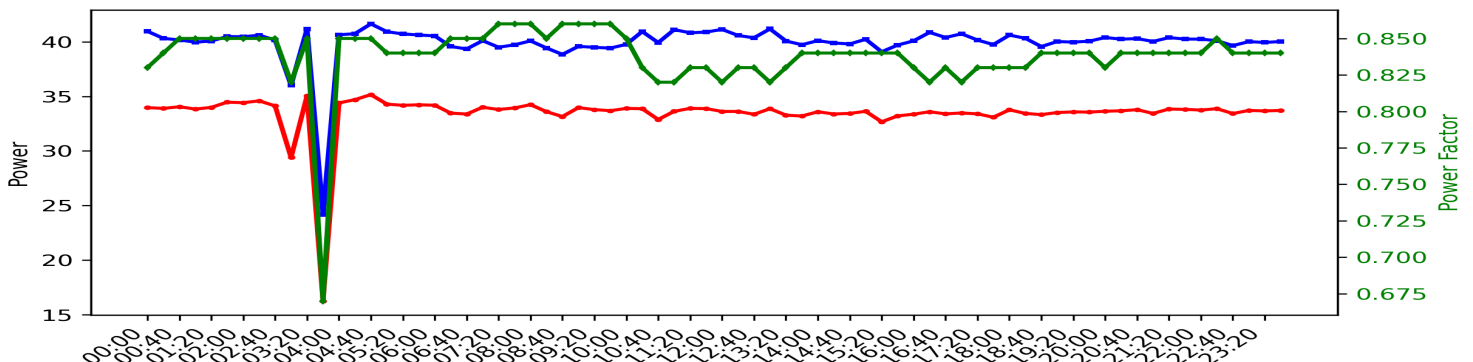



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
0.05 kWh

Apparent Energy  
0.09 kVAh


### Meter Name : ELGI E18 25HP Air Compressor

Avg PF  
0.556

Maximum Demand  
0.00 kVA 00:00:24

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 414.03 V  | 439.06 V  | 425.36 V  |
| Voltage YB     | 410.20 V  | 435.02 V  | 420.94 V  |
| Voltage RB     | 411.15 V  | 436.27 V  | 422.86 V  |
| Current R      | 0.00 A    | 0.00 A    | 0.00 A    |
| Current Y      | 0.00 A    | 0.00 A    | 0.00 A    |
| Current B      | 0.00 A    | 0.00 A    | 0.00 A    |
| Active Power   | 0.00 kW   | 0.00 kW   | 0.00 kW   |
| Apparent Power | 0.00 kVA  | 0.00 kVA  | 0.00 kVA  |
| Power Factor   | 0.00      | 0.00      | 0.000     |

Active Power Apparent Power PF

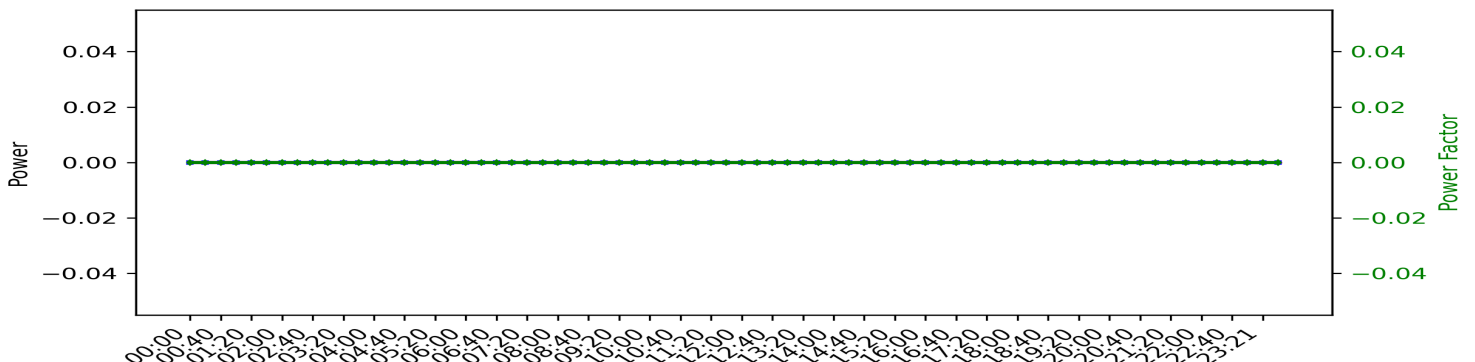



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
943.66 kWh


Apparent Energy  
1142.55 kVAh

### Meter Name : ELGI E45 60HP Air Compressor

Avg PF  
0.826

Maximum Demand  
59.86 kVA 12:00:46

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 413.72 V  | 438.39 V  | 425.27 V  |
| Voltage YB     | 409.37 V  | 434.60 V  | 420.79 V  |
| Voltage RB     | 410.78 V  | 436.20 V  | 422.97 V  |
| Current R      | 0.00 A    | 83.64 A   | 68.20 A   |
| Current Y      | 0.00 A    | 84.68 A   | 68.76 A   |
| Current B      | 0.00 A    | 76.24 A   | 62.05 A   |
| Active Power   | 0.00 kW   | 49.82 kW  | 40.30 kW  |
| Apparent Power | 0.00 kVA  | 59.86 kVA | 48.84 kVA |
| Power Factor   | 0.00      | 0.86      | 0.718     |

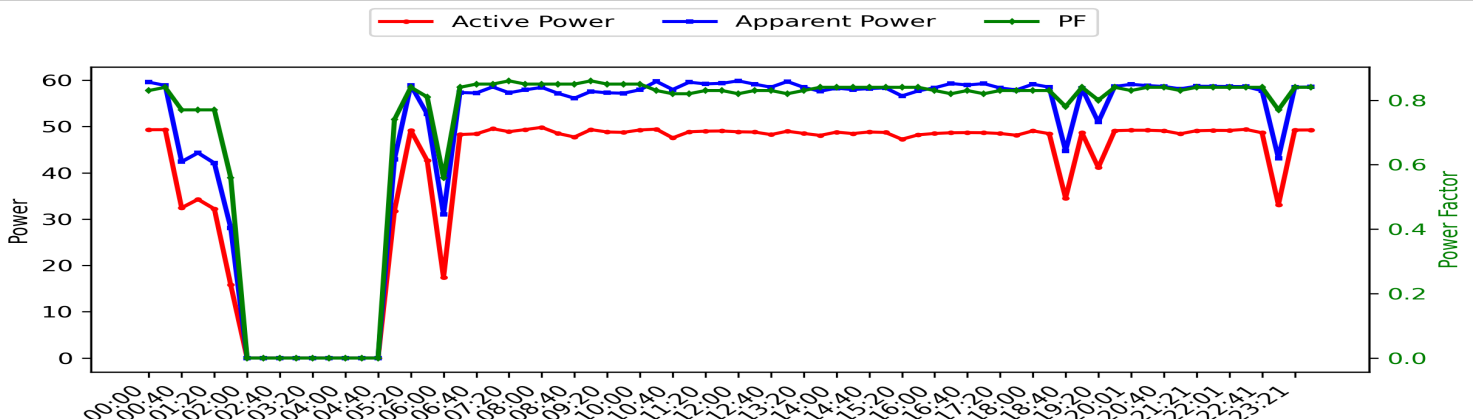



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy  
N/A kWh

Apparent Energy  
N/A kVAh

Meter Name : 60 HP Compressor

Avg PF  
N/A

Maximum Demand  
kVA

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | N/A V     | N/A V     | N/A V     |
| Voltage YB     | N/A V     | N/A V     | N/A V     |
| Voltage RB     | N/A V     | N/A V     | N/A V     |
| Current R      | N/A A     | N/A A     | N/A A     |
| Current Y      | N/A A     | N/A A     | N/A A     |
| Current B      | N/A A     | N/A A     | N/A A     |
| Active Power   | N/A kW    | N/A kW    | N/A kW    |
| Apparent Power | N/A kVA   | N/A kVA   | N/A kVA   |
| Power Factor   | N/A       | N/A       | N/A       |





by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
0.06 kWh

Apparent Energy  
0.45 kVAh


### Meter Name : DIPP\_PT\_PANEL

Avg PF  
0.133

Maximum Demand  
5.27 kVA 12:59:59

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 412.24 V  | 436.34 V  | 424.45 V  |
| Voltage YB     | 406.92 V  | 432.10 V  | 419.91 V  |
| Voltage RB     | 409.05 V  | 433.58 V  | 421.80 V  |
| Current R      | 0.00 A    | 11.36 A   | 5.14 A    |
| Current Y      | 0.00 A    | 10.52 A   | 5.69 A    |
| Current B      | 0.00 A    | 10.45 A   | 4.47 A    |
| Active Power   | -0.93 kW  | 0.06 kW   | -0.29 kW  |
| Apparent Power | 0.00 kVA  | 7.50 kVA  | 3.75 kVA  |
| Power Factor   | -1.00     | 1.00      | -0.371    |

Active Power Apparent Power PF

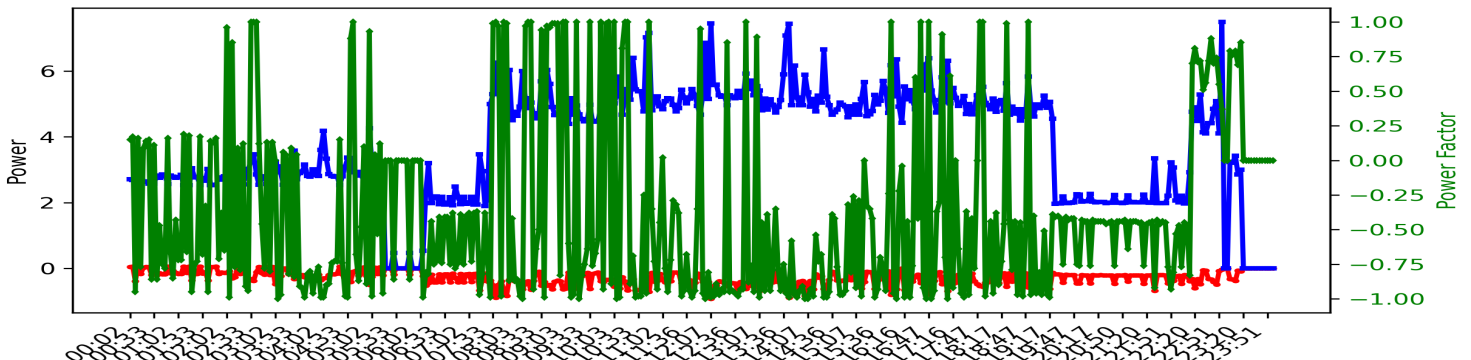



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
217.93 kWh

Apparent Energy  
237.2 kVAh


### Meter Name : DUST\_COLLECTOR

Avg PF  
0.919

Maximum Demand  
36.14 kVA 05:13:38

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 398.23 V  | 423.72 V  | 412.07 V  |
| Voltage YB     | 399.50 V  | 424.92 V  | 413.82 V  |
| Voltage RB     | 404.22 V  | 429.34 V  | 417.81 V  |
| Current R      | 0.00 A    | 57.52 A   | 44.80 A   |
| Current Y      | 0.00 A    | 52.32 A   | 40.36 A   |
| Current B      | 0.00 A    | 54.68 A   | 42.92 A   |
| Active Power   | 0.00 kW   | 11.50 kW  | 9.10 kW   |
| Apparent Power | 0.00 kVA  | 38.38 kVA | 30.63 kVA |
| Power Factor   | 0.00      | 0.94      | 0.790     |

Active Power Apparent Power PF

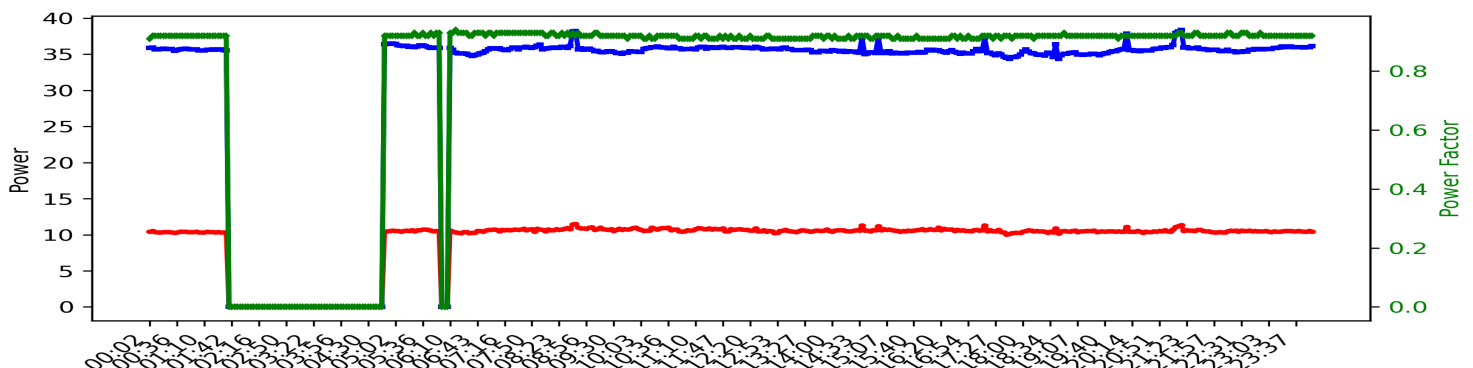



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
22.85 kWh

Apparent Energy  
38.86 kVAh


### Meter Name : SPRAY\_PT\_PANEL

Avg PF  
0.588

Maximum Demand  
66.89 kVA 16:23:23

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 404.35 V  | 429.63 V  | 417.37 V  |
| Voltage YB     | 409.56 V  | 433.98 V  | 422.19 V  |
| Voltage RB     | 404.84 V  | 430.27 V  | 418.60 V  |
| Current R      | 0.00 A    | 99.00 A   | 62.53 A   |
| Current Y      | 0.00 A    | 90.56 A   | 59.36 A   |
| Current B      | 4.56 A    | 91.80 A   | 59.54 A   |
| Active Power   | -2.14 kW  | 2.52 kW   | 0.83 kW   |
| Apparent Power | 1.90 kVA  | 69.12 kVA | 44.02 kVA |
| Power Factor   | -1.00     | 1.00      | -0.014    |

Active Power Apparent Power PF

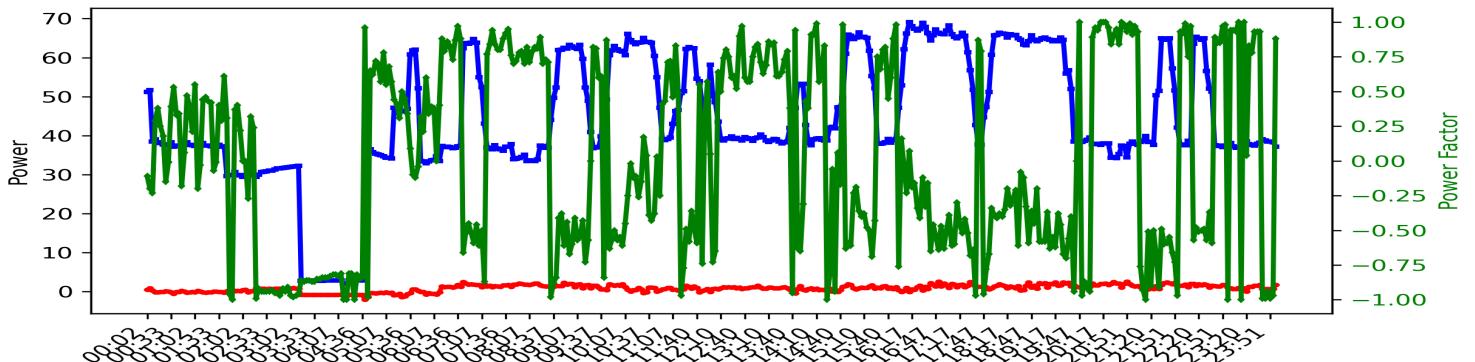



by Navy Blue Energy

sales@nbri.in

From  
10 Sep 2026  
To  
11 Sep 2026



Savera auto comps pvt ltd

### Total Energy Consumption

Active Energy  
187.77 kWh

Apparent Energy  
215.0 kVAh

### Meter Name : DM Plant

Avg PF  
0.873

Maximum Demand  
15.62 kVA 19:15:11

| Parameter Name | Min Value | Max Value | Avg Value |
|----------------|-----------|-----------|-----------|
| Voltage RY     | 363.96 V  | 425.86 V  | 406.04 V  |
| Voltage YB     | 370.76 V  | 427.94 V  | 407.47 V  |
| Voltage RB     | 363.43 V  | 425.64 V  | 405.50 V  |
| Current R      | 2.78 A    | 37.21 A   | 11.90 A   |
| Current Y      | 3.50 A    | 30.56 A   | 10.99 A   |
| Current B      | 7.94 A    | 32.70 A   | 16.49 A   |
| Active Power   | 2.89 kW   | 17.01 kW  | 7.79 kW   |
| Apparent Power | 3.54 kVA  | 20.33 kVA | 9.17 kVA  |
| Power Factor   | 0.81      | 0.96      | 0.882     |

Active Power Apparent Power PF

