



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
N/A kWh

Apparent Energy
N/A kVAh

Meter Name : RASKOG NEW PANL

Avg PF
N/A

Maximum Demand
kVA

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	N/A V	N/A V	N/A V
Voltage YB	N/A V	N/A V	N/A V
Voltage RB	N/A V	N/A V	N/A V
Current R	N/A A	N/A A	N/A A
Current Y	N/A A	N/A A	N/A A
Current B	N/A A	N/A A	N/A A
Active Power	N/A kW	N/A kW	N/A kW
Apparent Power	N/A kVA	N/A kVA	N/A kVA
Power Factor	N/A	N/A	N/A





by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
141.35 kWh

Apparent Energy
156.27 kVAh


Meter Name : Chiller Plating Plant

Avg PF
0.905

Maximum Demand
9.53 kVA 19:47:50

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	387.18 V	427.16 V	410.14 V
Voltage YB	382.67 V	423.07 V	405.95 V
Voltage RB	386.03 V	426.26 V	408.70 V
Current R	0.00 A	11.64 A	7.58 A
Current Y	0.00 A	12.64 A	8.39 A
Current B	0.00 A	15.60 A	10.60 A
Active Power	0.00 kW	8.86 kW	5.61 kW
Apparent Power	0.00 kVA	9.57 kVA	6.22 kVA
Power Factor	-0.93	0.00	-0.633

Active Power Apparent Power PF

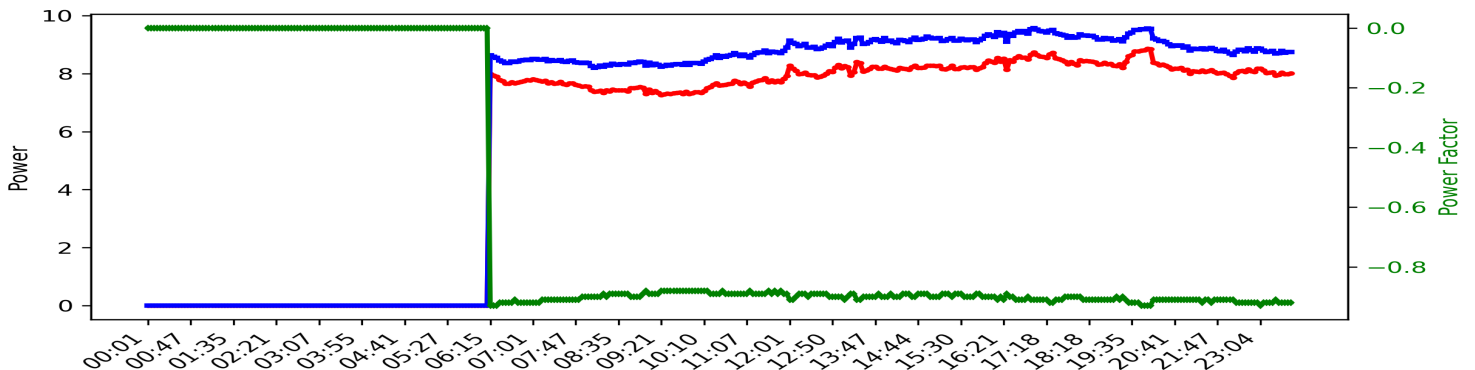



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
0.0 kWh

Apparent Energy
0.0 kVAh


Meter Name : Main Incomer Meter

Avg PF
0.000

Maximum Demand
0.00 kVA 15:08:35

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	408.32 V	411.40 V	410.02 V
Voltage YB	407.64 V	410.33 V	409.02 V
Voltage RB	408.65 V	411.52 V	410.23 V
Current R	0.00 A	0.00 A	0.00 A
Current Y	0.00 A	0.00 A	0.00 A
Current B	0.00 A	0.00 A	0.00 A
Active Power	0.00 kW	0.00 kW	0.00 kW
Apparent Power	0.00 kVA	0.00 kVA	0.00 kVA
Power Factor	0.00	0.00	0.000

Active Power Apparent Power PF

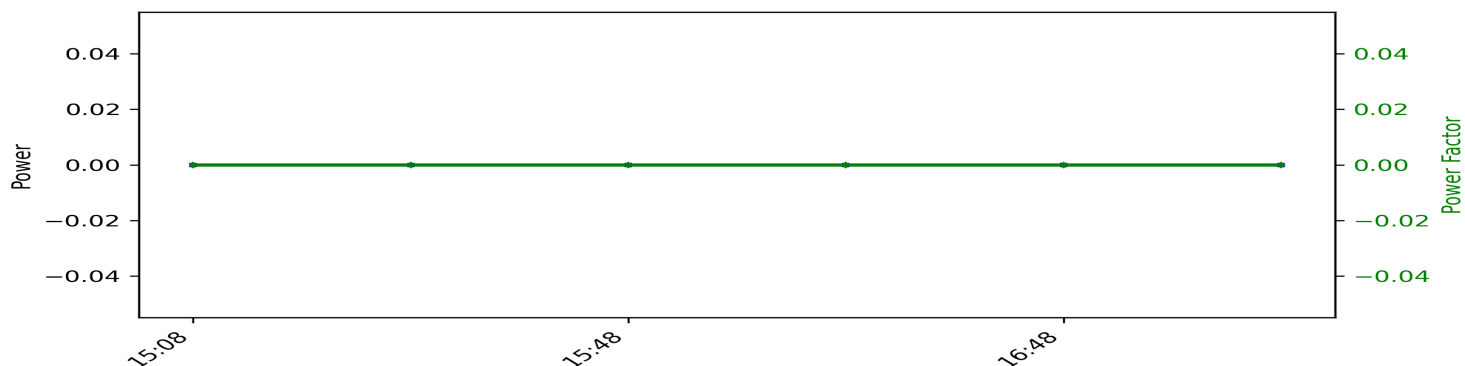



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
3165.92 kWh

Apparent Energy
3186.18 kVAh


Meter Name : Old LT Panel Main Incomer

Avg PF
0.994

Maximum Demand
328.13 kVA 19:12:05

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	407.74 V	438.06 V	421.57 V
Voltage YB	406.51 V	434.63 V	419.08 V
Voltage RB	407.60 V	435.78 V	419.95 V
Current R	0.00 A	466.27 A	278.72 A
Current Y	0.00 A	498.40 A	286.52 A
Current B	0.00 A	433.80 A	265.38 A
Active Power	0.00 kW	218.25 kW	131.63 kW
Apparent Power	0.00 kVA	328.13 kVA	201.53 kVA
Power Factor	-1.00	1.00	-0.401

Active Power Apparent Power PF

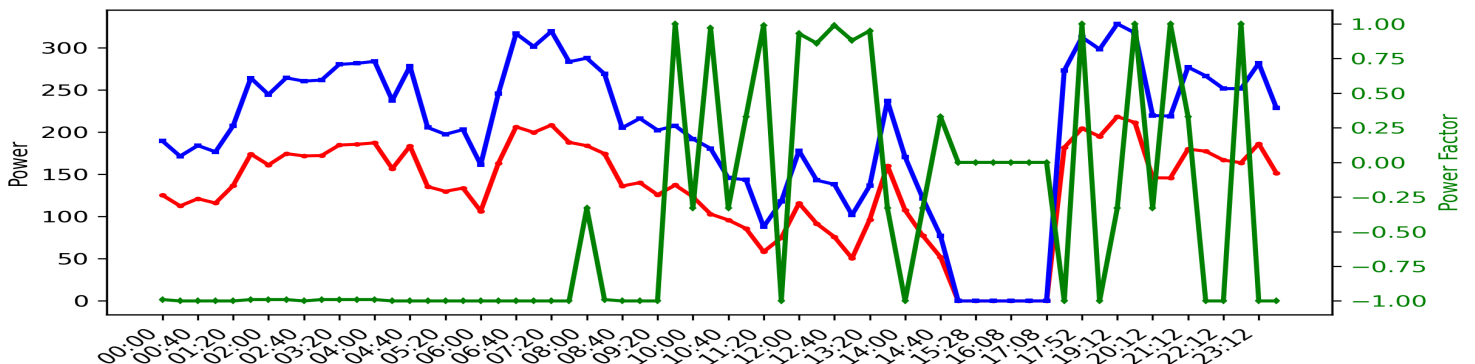



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
477.82 kWh

Apparent Energy
496.98 kVAh


Meter Name : Packing & Sticking Line

Avg PF
0.961

Maximum Demand
53.79 kVA 15:08:51

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	406.47 V	437.65 V	421.18 V
Voltage YB	405.33 V	433.29 V	418.51 V
Voltage RB	406.34 V	435.67 V	419.39 V
Current R	0.00 A	82.60 A	30.82 A
Current Y	0.00 A	59.62 A	17.68 A
Current B	9.55 A	85.25 A	33.72 A
Active Power	2.93 kW	52.66 kW	18.93 kW
Apparent Power	3.00 kVA	53.79 kVA	20.12 kVA
Power Factor	-1.00	1.00	0.403

Active Power Apparent Power PF

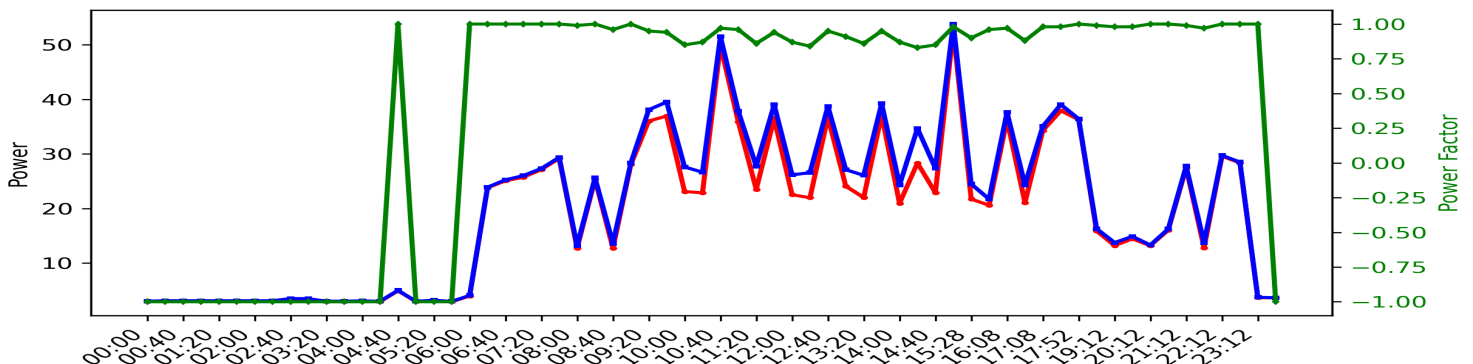



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
179.22 kWh

Apparent Energy
357.98 kVAh


Meter Name : Rigga Line Fabrication

Avg PF
0.501

Maximum Demand
50.18 kVA 12:20:43

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	405.92 V	438.21 V	421.21 V
Voltage YB	404.79 V	434.62 V	418.71 V
Voltage RB	405.43 V	435.60 V	419.37 V
Current R	0.00 A	72.00 A	23.33 A
Current Y	0.00 A	65.97 A	21.84 A
Current B	0.00 A	64.12 A	22.21 A
Active Power	0.00 kW	21.35 kW	8.08 kW
Apparent Power	0.00 kVA	50.18 kVA	16.43 kVA
Power Factor	0.00	0.81	0.518

Active Power Apparent Power PF

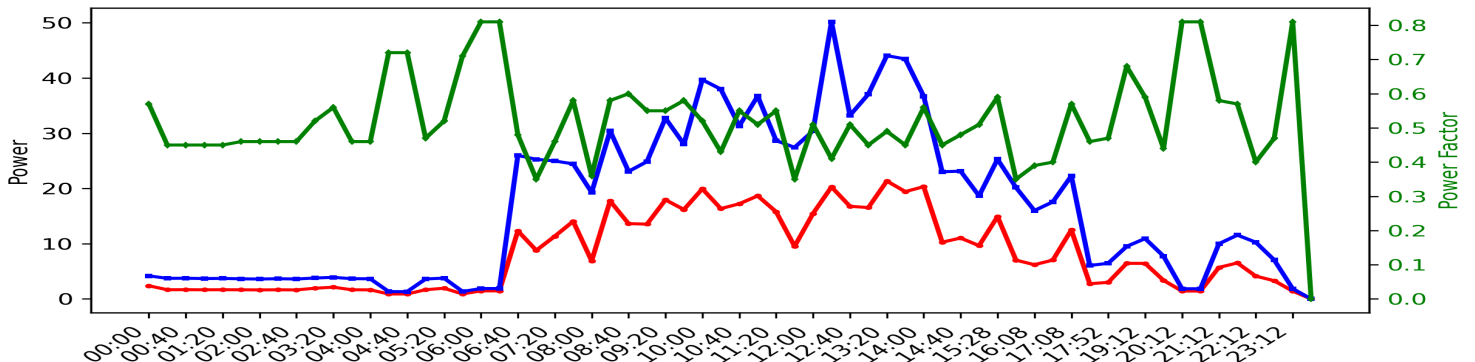



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
1009.43 kWh

Apparent Energy
1806.32 kVAh


Meter Name : Press & Fabrication

Avg PF
0.559

Maximum Demand
140.1 kVA 12:40:48

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	406.53 V	437.54 V	421.00 V
Voltage YB	405.09 V	433.82 V	418.29 V
Voltage RB	406.39 V	434.75 V	419.27 V
Current R	51.10 A	191.95 A	117.39 A
Current Y	42.50 A	193.50 A	111.72 A
Current B	26.20 A	153.70 A	90.34 A
Active Power	19.34 kW	71.25 kW	42.69 kW
Apparent Power	28.81 kVA	140.10 kVA	77.67 kVA
Power Factor	0.43	0.77	0.588

Active Power Apparent Power PF

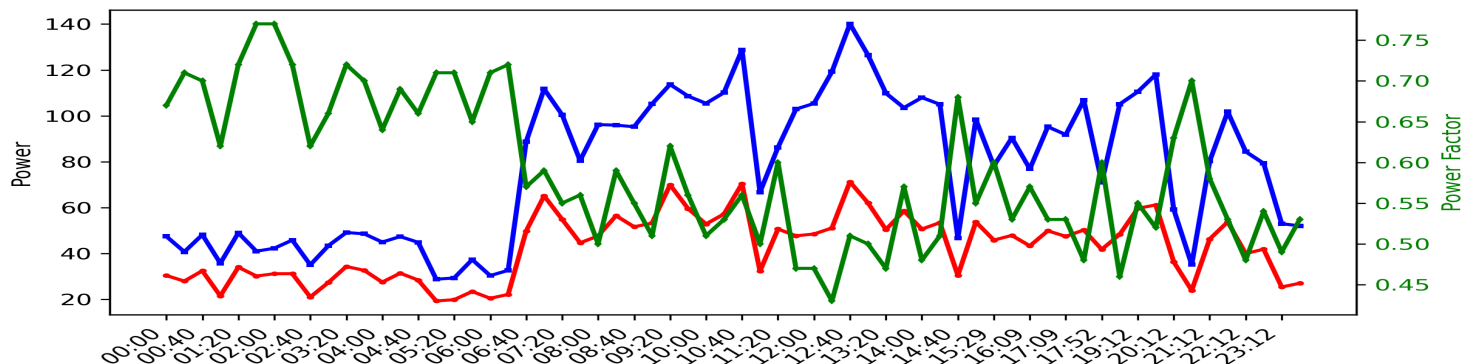



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
2018.03 kWh

Apparent Energy
2344.85 kVAh


Meter Name : Powder Coating

Avg PF
0.861

Maximum Demand
130.98 kVA 03:20:41

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	406.65 V	437.59 V	420.74 V
Voltage YB	405.63 V	433.69 V	418.29 V
Voltage RB	406.36 V	435.34 V	419.00 V
Current R	99.60 A	184.52 A	142.14 A
Current Y	88.92 A	178.16 A	138.89 A
Current B	99.48 A	182.56 A	146.18 A
Active Power	57.81 kW	119.01 kW	87.84 kW
Apparent Power	70.34 kVA	130.98 kVA	103.54 kVA
Power Factor	0.80	0.93	0.862

Active Power Apparent Power PF

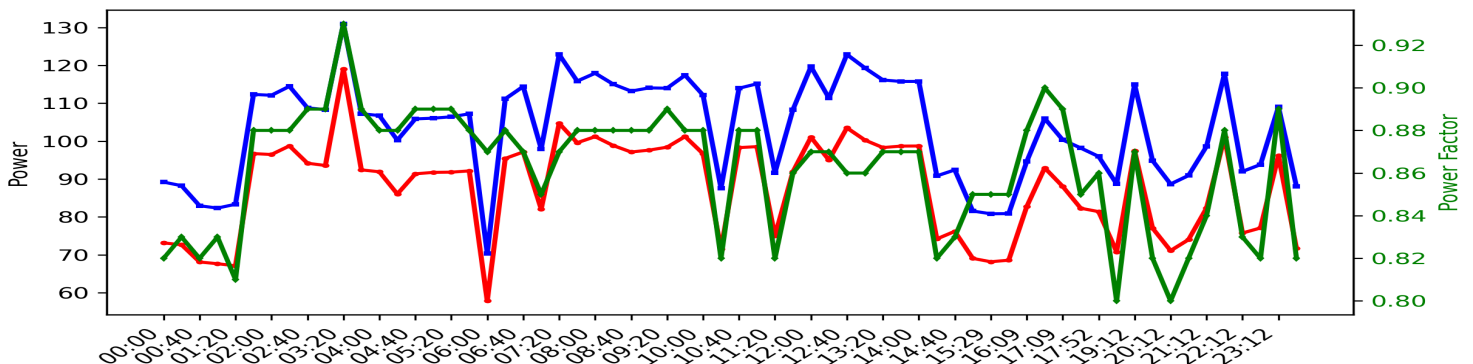



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
1.21 kWh

Apparent Energy
1.47 kVAh


Meter Name : New Plating Plant

Avg PF
0.823

Maximum Demand
111.20 kVA 18:32:32

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	407.06 V	438.17 V	421.11 V
Voltage YB	405.43 V	434.11 V	418.26 V
Voltage RB	406.15 V	435.40 V	418.96 V
Current R	3.44 A	155.80 A	84.99 A
Current Y	0.00 A	164.48 A	88.17 A
Current B	0.00 A	142.08 A	96.73 A
Active Power	0.94 kW	83.01 kW	52.49 kW
Apparent Power	1.10 kVA	111.20 kVA	65.34 kVA
Power Factor	0.74	1.00	0.846

Active Power Apparent Power PF

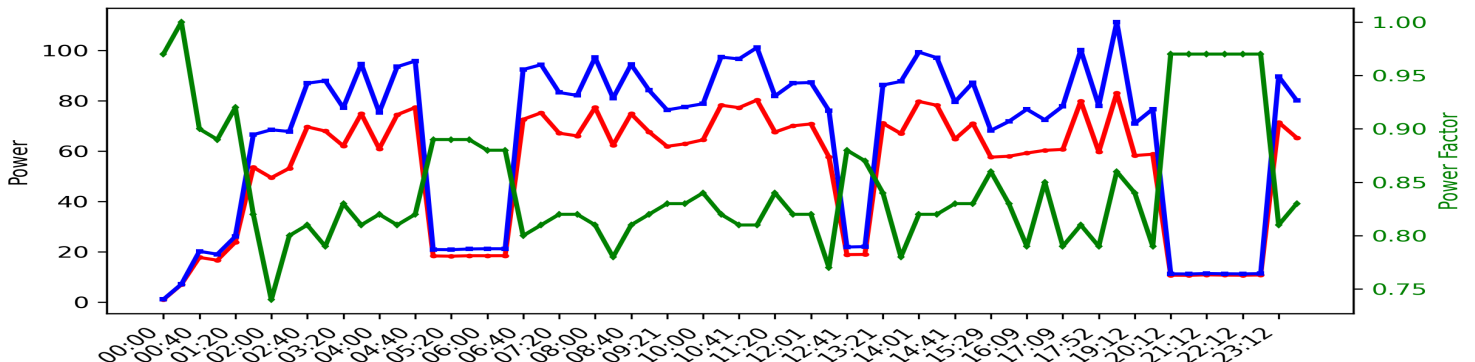



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
2.6 kWh

Apparent Energy
6.71 kVAh


Meter Name : Old Plating Plant

Avg PF
0.387

Maximum Demand
1.25 kVA 13:01:06

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	406.53 V	437.77 V	421.10 V
Voltage YB	405.26 V	434.25 V	418.52 V
Voltage RB	405.93 V	435.22 V	419.29 V
Current R	0.00 A	0.00 A	0.00 A
Current Y	0.00 A	4.88 A	0.83 A
Current B	0.00 A	0.00 A	0.00 A
Active Power	0.00 kW	0.54 kW	0.09 kW
Apparent Power	0.00 kVA	1.25 kVA	0.21 kVA
Power Factor	-0.51	0.00	-0.094

Active Power Apparent Power PF

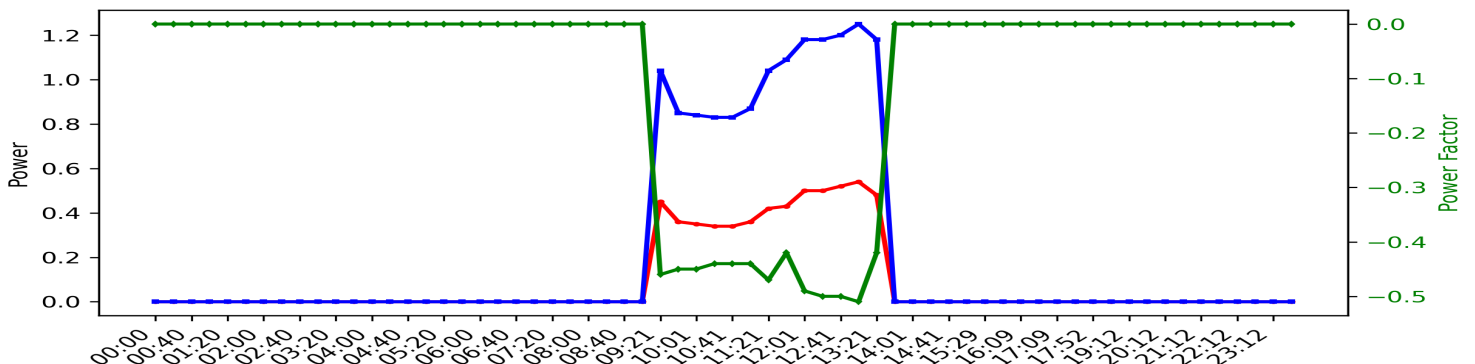



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy

776.61 kWh

Apparent Energy

916.83 kVAh

Meter Name : Kaeser ASD 60 40HP Air Compressor

Avg PF


0.847

Maximum Demand

40.38 kVA 17:32:42

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	404.84 V	434.85 V	419.25 V
Voltage YB	404.03 V	432.18 V	416.73 V
Voltage RB	403.04 V	431.39 V	416.11 V
Current R	52.44 A	57.88 A	56.60 A
Current Y	50.24 A	56.36 A	54.10 A
Current B	47.72 A	55.88 A	52.56 A
Active Power	30.24 kW	34.16 kW	33.30 kW
Apparent Power	36.99 kVA	40.38 kVA	39.36 kVA
Power Factor	0.81	0.87	0.847

Active Power Apparent Power PF

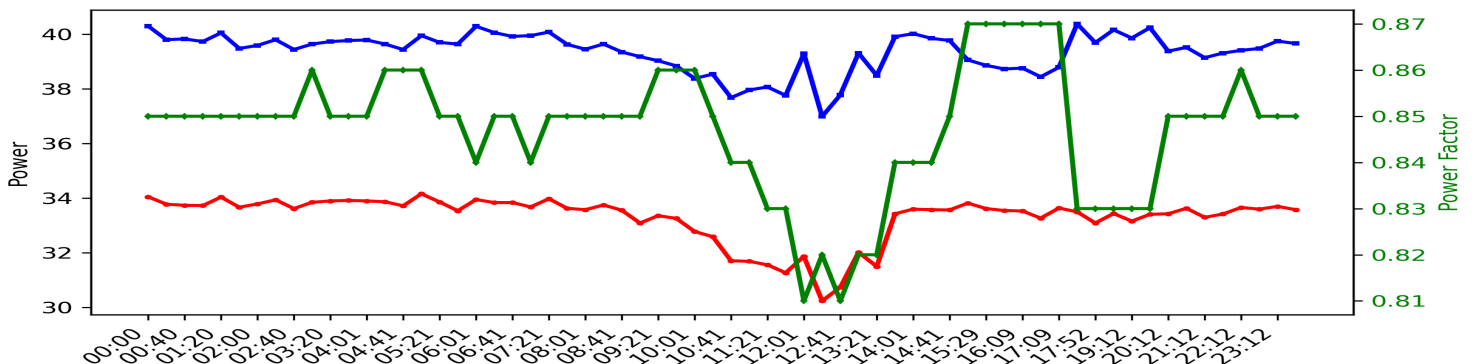



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
0.04 kWh

Apparent Energy
0.05 kVAh


Meter Name : ELGI E18 25HP Air Compressor

Avg PF
0.800

Maximum Demand
0.00 kVA 00:00:59

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	404.57 V	436.23 V	419.05 V
Voltage YB	402.89 V	432.21 V	416.02 V
Voltage RB	403.78 V	433.61 V	416.89 V
Current R	0.00 A	0.00 A	0.00 A
Current Y	0.00 A	0.00 A	0.00 A
Current B	0.00 A	0.00 A	0.00 A
Active Power	0.00 kW	0.00 kW	0.00 kW
Apparent Power	0.00 kVA	0.00 kVA	0.00 kVA
Power Factor	0.00	0.00	0.000

Active Power Apparent Power PF

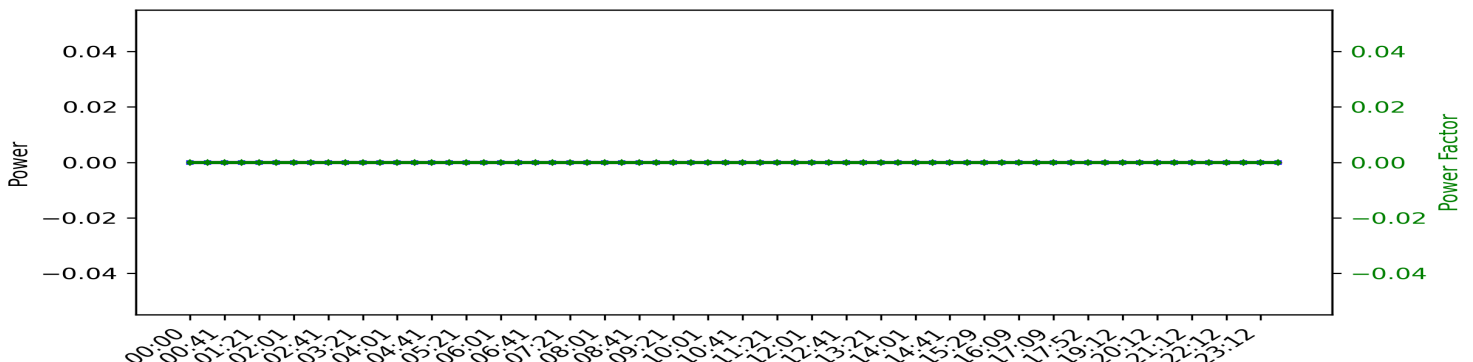



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
1012.75 kWh

Apparent Energy
1224.8 kVAh


Meter Name : ELGI E45 60HP Air Compressor

Avg PF
0.827

Maximum Demand
58.34 kVA 19:32:56

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	403.84 V	436.48 V	418.93 V
Voltage YB	402.28 V	432.45 V	415.89 V
Voltage RB	403.32 V	433.83 V	416.98 V
Current R	43.56 A	83.80 A	74.07 A
Current Y	41.96 A	83.20 A	75.08 A
Current B	37.00 A	79.76 A	69.37 A
Active Power	16.25 kW	49.42 kW	43.22 kW
Apparent Power	30.21 kVA	58.34 kVA	52.46 kVA
Power Factor	0.54	0.87	0.817

Active Power Apparent Power PF

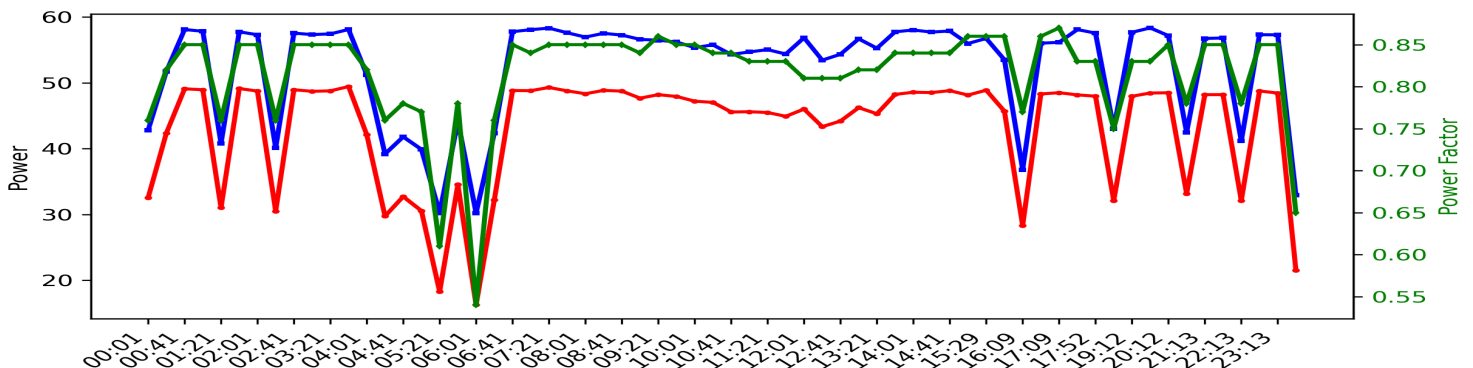



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
N/A kWh

Apparent Energy
N/A kVAh

Meter Name : 60 HP Compressor

Avg PF
N/A

Maximum Demand
kVA

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	N/A V	N/A V	N/A V
Voltage YB	N/A V	N/A V	N/A V
Voltage RB	N/A V	N/A V	N/A V
Current R	N/A A	N/A A	N/A A
Current Y	N/A A	N/A A	N/A A
Current B	N/A A	N/A A	N/A A
Active Power	N/A kW	N/A kW	N/A kW
Apparent Power	N/A kVA	N/A kVA	N/A kVA
Power Factor	N/A	N/A	N/A





by Navy Blue Energy

sales@nbri.in

From

11 Sep 2026

To

12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy

0.17 kWh

Apparent Energy

0.88 kVAh

Meter Name : DIPP_PT_PANEL

Avg PF


0.193

Maximum Demand

7.87 kVA 12:34:27

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	402.21 V	433.71 V	417.97 V
Voltage YB	400.51 V	430.11 V	415.24 V
Voltage RB	401.42 V	430.49 V	415.58 V
Current R	0.00 A	11.67 A	5.79 A
Current Y	0.00 A	12.12 A	6.68 A
Current B	0.00 A	12.54 A	5.27 A
Active Power	-0.78 kW	0.34 kW	-0.25 kW
Apparent Power	0.00 kVA	8.56 kVA	4.28 kVA
Power Factor	-1.00	1.00	-0.448

Active Power Apparent Power PF

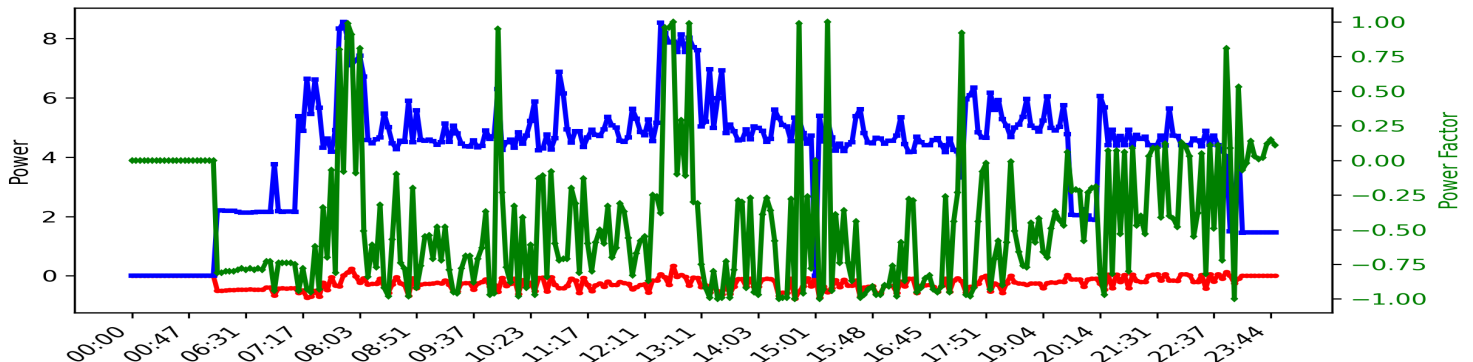



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
251.5 kWh

Apparent Energy
276.56 kVAh


Meter Name : DUST_COLLECTOR

Avg PF
0.909

Maximum Demand
35.80 kVA 07:20:41

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	390.42 V	421.42 V	404.77 V
Voltage YB	391.23 V	420.68 V	405.41 V
Voltage RB	393.78 V	425.78 V	409.33 V
Current R	0.00 A	56.64 A	52.06 A
Current Y	0.00 A	53.52 A	47.97 A
Current B	0.00 A	54.76 A	49.54 A
Active Power	0.00 kW	11.94 kW	10.61 kW
Apparent Power	0.00 kVA	37.90 kVA	35.12 kVA
Power Factor	0.00	0.93	0.908

Active Power Apparent Power PF

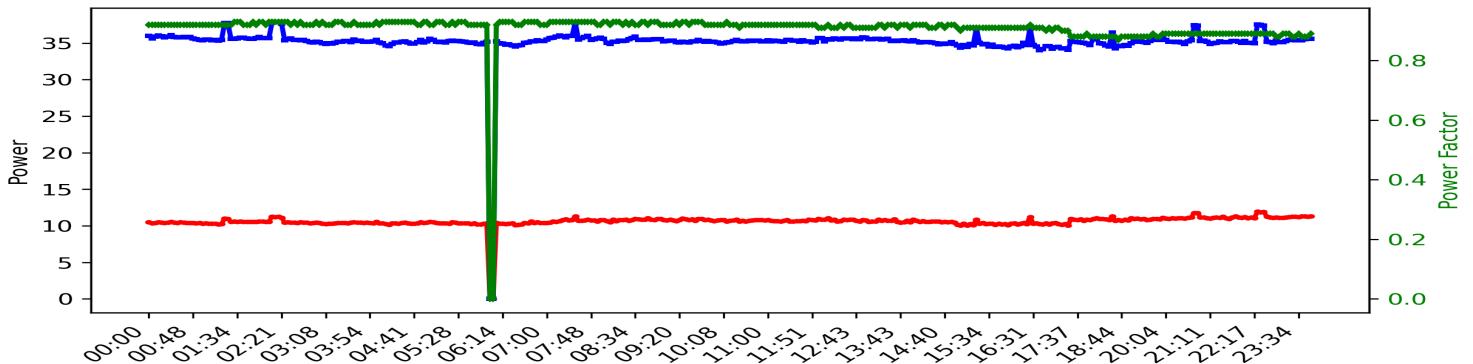



by Navy Blue Energy

sales@nbri.in

From
11 Sep 2026
To
12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy
9.19 kWh

Apparent Energy
42.48 kVAh


Meter Name : SPRAY_PT_PANEL

Avg PF
0.216

Maximum Demand
65.40 kVA 12:11:37

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	397.15 V	427.46 V	411.00 V
Voltage YB	399.54 V	431.55 V	414.45 V
Voltage RB	397.36 V	427.55 V	411.07 V
Current R	44.32 A	103.68 A	78.07 A
Current Y	46.24 A	95.16 A	72.60 A
Current B	45.52 A	93.44 A	73.21 A
Active Power	-1.23 kW	1.89 kW	0.30 kW
Apparent Power	33.30 kVA	68.48 kVA	53.28 kVA
Power Factor	-1.00	0.99	-0.006

Active Power Apparent Power PF

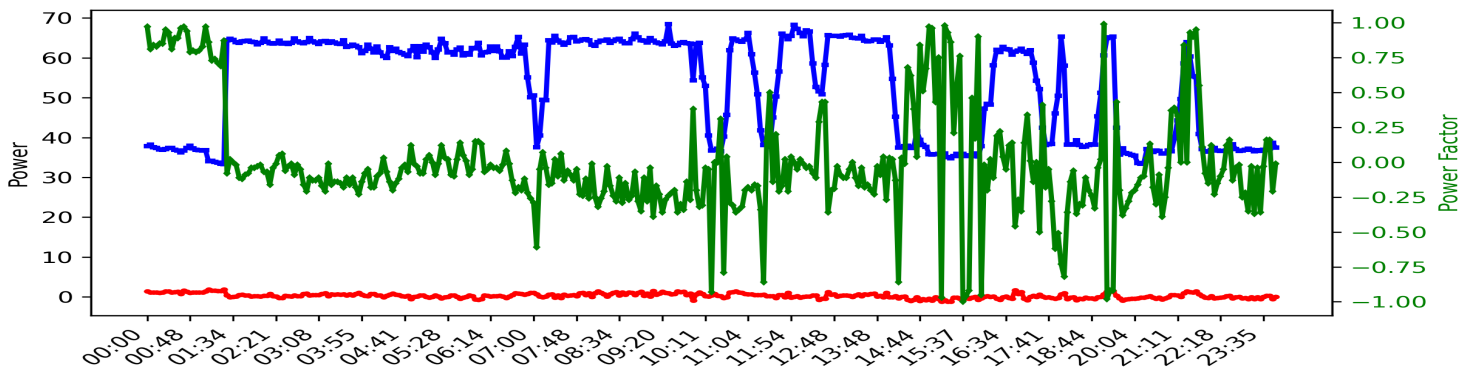



by Navy Blue Energy

sales@nbri.in

From

11 Sep 2026

To

12 Sep 2026



Savera auto comps pvt ltd

Total Energy Consumption

Active Energy

160.99 kWh

Apparent Energy

183.87 kVAh

Meter Name : DM Plant

Avg PF

0.876

Maximum Demand

16.46 kVA 18:05:33

Parameter Name	Min Value	Max Value	Avg Value
Voltage RY	374.85 V	428.66 V	407.02 V
Voltage YB	381.59 V	429.11 V	410.20 V
Voltage RB	374.47 V	429.46 V	407.36 V
Current R	2.72 A	37.01 A	11.05 A
Current Y	3.46 A	28.24 A	9.32 A
Current B	4.12 A	32.89 A	12.75 A
Active Power	2.04 kW	23.55 kW	6.59 kW
Apparent Power	2.45 kVA	28.34 kVA	7.72 kVA
Power Factor	0.79	0.96	0.875

Active Power Apparent Power PF

