


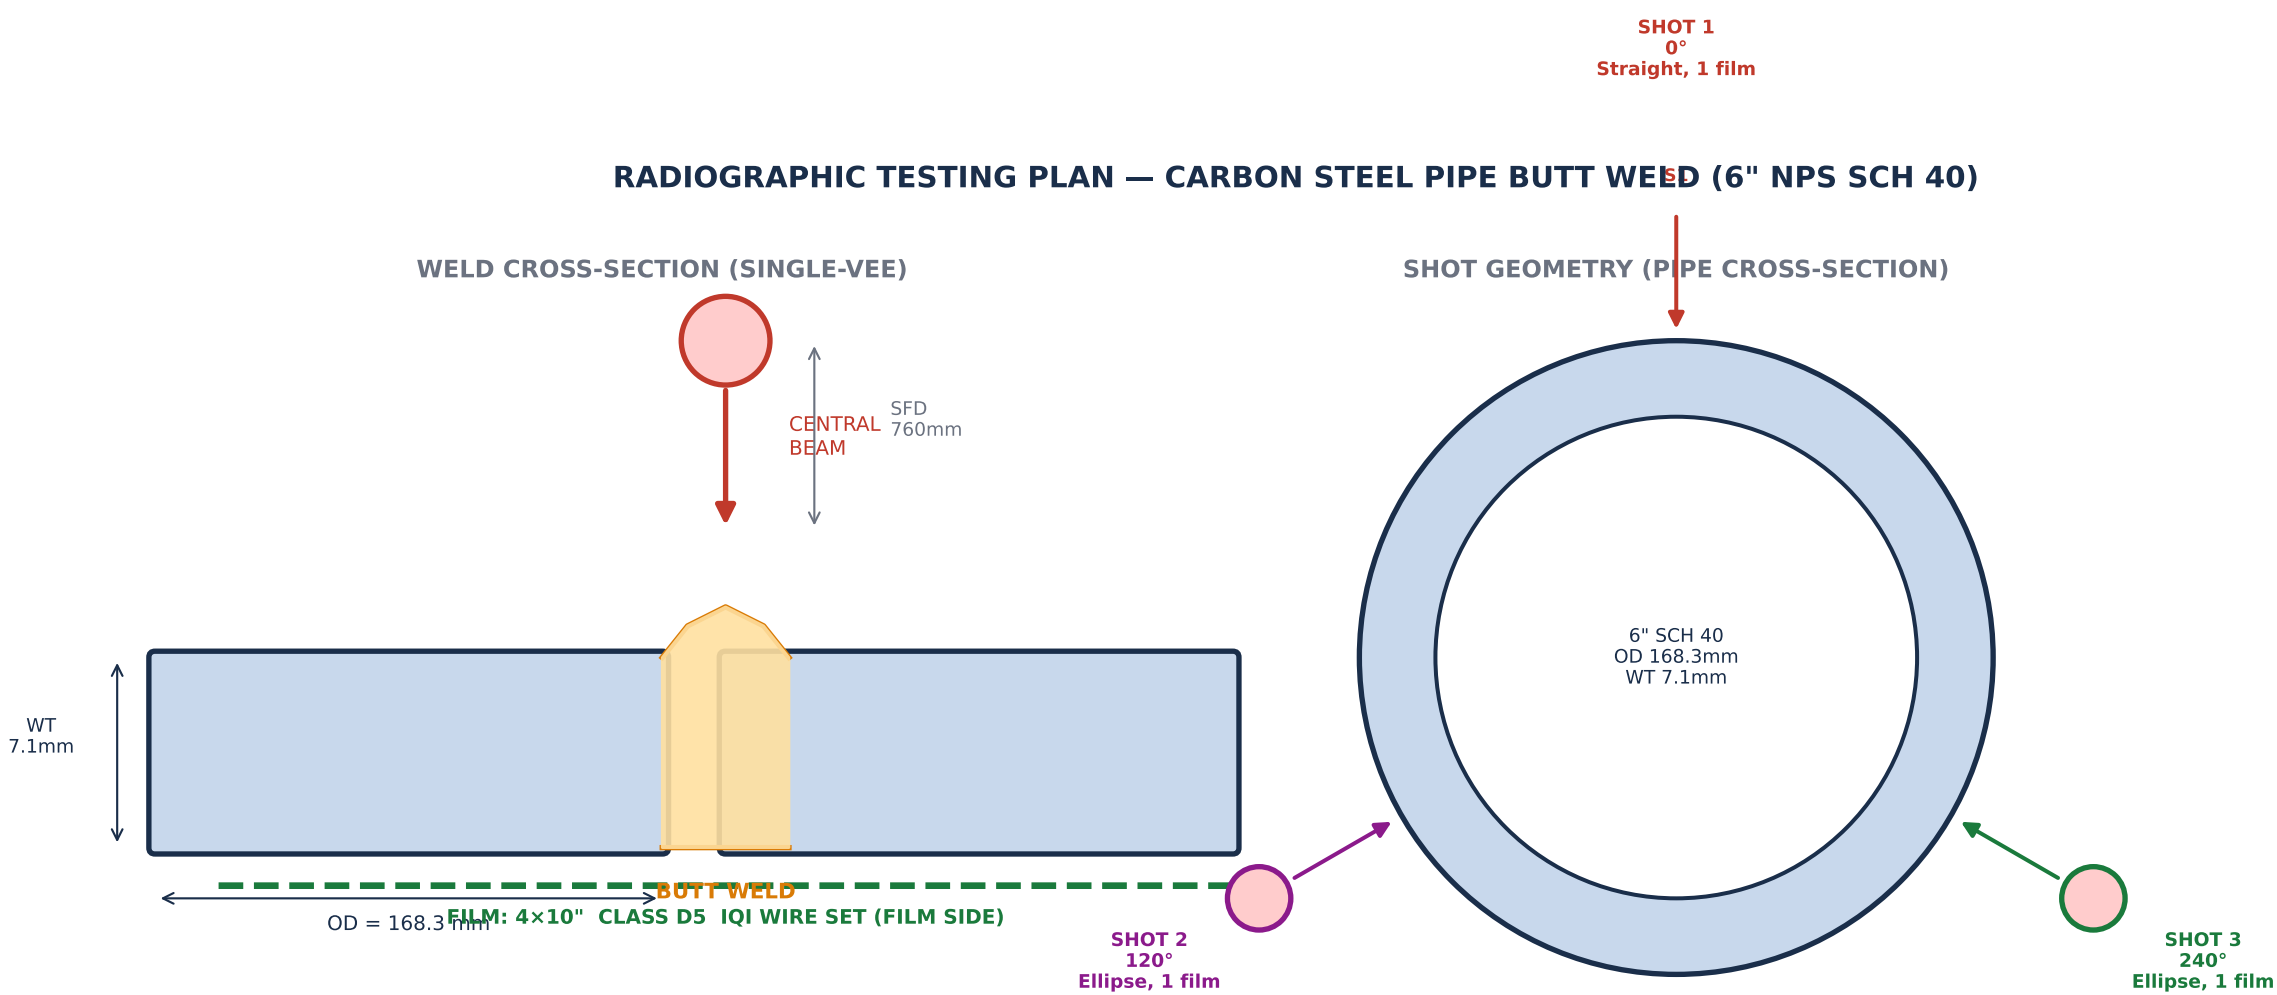

EXPOSURE SCHEDULE

SHOT	ANGLE	TECHNIQUE	kV	mA	SFD(mm)	FILM	TIME(min)
1	0°	STRAIGHT	120	4.0	760	4×10 D5	8
2	120°	ELLIPSE	120	4.0	760	4×10 D5	10
3	240°	ELLIPSE	120	4.0	760	4×10 D5	10

NOTES:
1. Per ASME B31.3 Process Piping — 100% RT required on welds
2. Material: ASTM A106 Gr.B Carbon Steel pipe
3. Film density range: 2.0 – 3.5 (ASTM E94)
4. IQI: ASTM E747 wire penetrameter, 2T sensitivity
5. Complete all 3 shots in same session — no interruption
6. Geometric Ug ≤ 0.51mm, focal spot 1.5mm @ 760mm SFD

NDT INSPECTION SERVICES

6" NPS SCH 40 Carbon Steel Pipe
Butt Weld RT Plan — 3 Shot Positions

ACCEPTANCE STD: ASME B31.3

Date: 2025-02-10 Rev: A

DRAWING NUMBER

RT-TEST-PIPE-6NPS-001

MATERIAL: ASTM A106 Gr.B

SCALE: 1:5 SHEET: 1 of 1

NDT STANDARD

ASME Sec V Art. 2

ASTM E94

DISTRIBUTION: UNRESTRICTED