



Functional Description

Gas engine-generator sets

GG12V0400A1

with engines B3042L8, E3042L9/LH9 and B3042L9

MS13073/00E

Name	SLU name Model	Engine model	Application group
MTU 12V400 GS	GG12V0400A1	B3042L8	3A, continuous operation, unrestricted
MTU 12V400 GS	GG12V0400A1	E3042L9	3A, continuous operation, unrestricted
MTU 12V400 GS	GG12V0400A1	E3042LH9	3A, continuous operation, unrestricted
MTU 12V400 GS	GG12V0400A1	B3042L9	3A, continuous operation, unrestricted

© 2017 MTU Onsite Energy GmbH, Augsburg

The original document was created in the German language.

This publication including all of its parts is protected by copyright. Each instance of use requires the prior written consent of MTU Onsite Energy GmbH. This applies in particular to duplication, dissemination, editing, translation, microfilming, and storage and/or processing in electronic systems, including databases and online services.

All of the information presented in this publication was current and up-to-date at the time of publishing. MTU Onsite Energy GmbH reserves the right to make changes to, delete, or supplement the provided information and data as needed.

Table of Contents

1 Engine-Generator Set		6.2 Genset - Exhaust system	44
1.1 Application group	4	7 Lube Oil System	
1.2 Nameplate and designation	5	7.1 Lube oil system	47
1.3 Module - With heat supply from cogeneration and integrated exhaust gas heat exchanger	8	7.2 Crankcase breather	51
1.4 Genset - With heat supply from cogeneration	15	8 Cooling System and Heating Water System	
1.5 Genset - Without heat supply from cogeneration	21	8.1 Module - Cooling system with heat supply from cogeneration and integrated exhaust gas heat exchanger	53
2 Engine		8.2 Genset - Cooling system with heat supply from cogeneration	57
2.1 Engine - General description	25	8.3 Genset - Cooling system without heat supply from cogeneration	60
2.2 Engine - Overview	26	8.4 Module - Heating water system	62
2.3 Engine side and cylinder designations	28	8.5 Module - Heating water system with internal mixture cooling	64
2.4 Starting system	29	8.6 Genset - Heating water system	66
2.5 Ignition system	30	8.7 Genset - Heating water system with internal mixture cooling	68
2.6 Speed control	31	8.8 Mixture coolant system	70
3 Generator		8.9 Anti-condensation heating	72
3.1 Generator and coupling	32	9 Technical Data	
4 Monitoring and Control		9.1 Technical data	73
4.1 MMC and MIP control system	33	10 Appendix A	
5 Charge-air System and Gas System		10.1 Index	74
5.1 Mixture formation and supercharging	35		
5.2 Gas train	39		
6 Exhaust System			
6.1 Module - Exhaust system	41		

1 Engine-Generator Set

1.1 Application group

The genset consists of a gas engine and a generator mounted on a common baseframe. Upon demand, the engine will start and drives the generator to generate heat energy and to produce electrical power. On the version without a heat module, no heat energy is generated.

The object of delivery from MTU Onsite Energy complies with the EC Machinery Directive and German specifications and standards.

When the object of delivery is used abroad or in other special regions, MTU Onsite Energy is not responsible for observance of the statutory and other specifications / standards applicable at the place of use.

Application group 3A – Continuous operation, unrestricted (Continuous Power)

Gensets for unrestricted continuous power and heat energy supply are used for:

- Base load generation
- Part of a power supply or the public grid

Continuous operation	Application group 3A
Operating mode	Continuous operation, unrestricted
Rating definition	10% overload capacity (ICXN)
Load factor	< 100 %
Operating hours	Unrestricted

Benefits

- Wide range of standardized gensets to meet customer requirements with regard to power, emission and other characteristics.
- Option of selecting different components:
 - Only current supply
 - Heat supply from cogeneration from engine coolant
 - Heat supply from cogeneration from engine coolant and exhaust gas
- Most recent gas engine technology
- Main components with state-of-the-art technology for high electrical and thermal efficiency and long service life.

1.2 Nameplate and designation

Nameplates

The product has the following nameplates:

- Nameplate of module or genset
- Engine nameplate
- Nameplate of generator

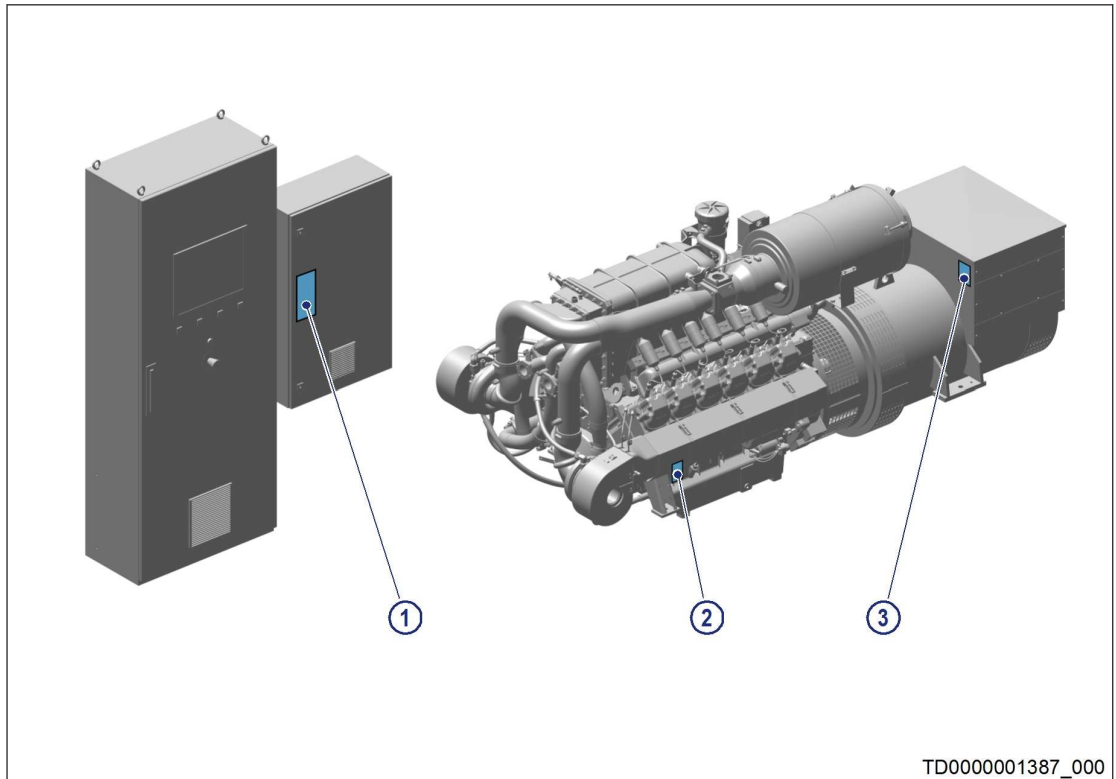


Figure 1: Fitting position of nameplates

1 Nameplate of module or genset

2 Engine nameplate

3 Nameplate of generator

Module or genset – nameplate and designation

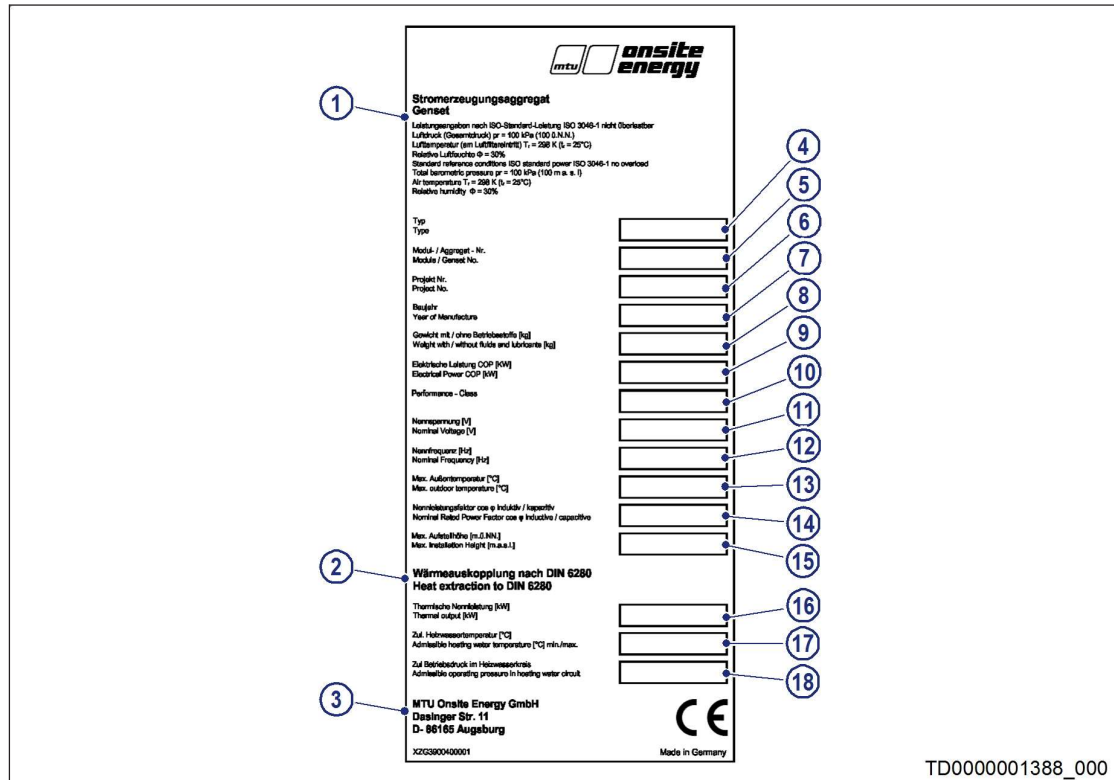


Figure 2: Nameplate of module or genset

Item	Designation
1	Power ratings as per ISO standard power ISO 3046-1 no overload capability Air pressure (total pressure) $p_r = 100 \text{ kPa}$ (100 above sea level) Air temperature (at air filter inlet) $T_r = 298 \text{ K}$ ($t_r = 25^\circ\text{C}$) Relative air humidity $\phi = 30\%$
2	Heat supply from cogeneration as per DIN 6280
3	MTU Onsite Energy Dasinger Str. 11 D-86165 Augsburg
4	Type
5	Module / genset no.
6	Project no.
7	Year of construction
8	Weight with / without fluids and lubricants [kg]
9	Electrical output COP [KW]
10	Performance-Class (performance class of generator)
11	Rated voltage [V]
12	Rated frequency [Hz]
13	Max. outside temperature [°C]
14	Rated power factor cos ϕ inductive / capacitive
15	Max. site altitude [m above sea level]
16	Thermal rated power [kW]

Item	Designation
17	Perm. heating water temperature [°C]
18	Perm. operating pressure in heating water circuit

Explanation of type

Example: MTU 12V400 GS	
MTU	Manufacturer: MTU Onsite Energy
12	Number of cylinders of the engine
V	Cylinder arrangement
400	400 series
GS	Gas system

Explanation of model name (SLU name)

Example: GG12V0400C1	
GG	Product type: Gasgenset
12	Number of cylinders of the engine
V	Cylinder arrangement
0400	400 series
C1	Design/version

1.3 Module – With heat supply from cogeneration and integrated exhaust gas heat exchanger

Description

The module comprises the following main components:

- Engine
- Gas train (not visible on the illustrations)
- Generator and coupling
- Heat supply from cogeneration with exhaust gas heat exchanger
- MMC (MTU Module Control) for plant control, closed-loop control, diagnostics
- MIP (MTU Interface Panel) for engine control, closed-loop control, diagnostics

The energy contained in the fuel is converted into mechanical work and heat in the combustion engine.

The generator, which converts the mechanical work into electrical energy, is flange-mounted on the engine via a resilient coupling. The connecting bell is provided with a service port that permits the replacement of the flexible coupling element without displacing the engine or generator. The engine and generator are joined via resilient, vibration-damped elements to the baseframe.

The heat is transferred via the coolant at several points:

- Lube oil heat
- Engine heat
- Exhaust gas heat

The plate-core heat exchanger represents the interface between the coolant system of the module and the customer-provided heating system. In this connection, it is also referred to as a coolant or heating water heat exchanger.


There are two types of mixture cooling:

- **External mixture cooling**
Mixture coolant dissipates the heat at the mixture cooler via a customer-provided (external) cooler.
- **Internal mixture cooling**
Customer-provided heating water dissipates the heat at the mixture cooler. This heating water (internal) is then directed via the plate-core heat exchanger.

All closed-loop controls, control systems and monitoring systems, including communication options to and from the system, are implemented in the hardware and software in the switch cabinets.

The following components have complete pipework and are installed in the baseframe:

- Plate-core heat exchanger
- Exhaust gas heat exchanger
- Silencer
- Catalytic converter (optional)

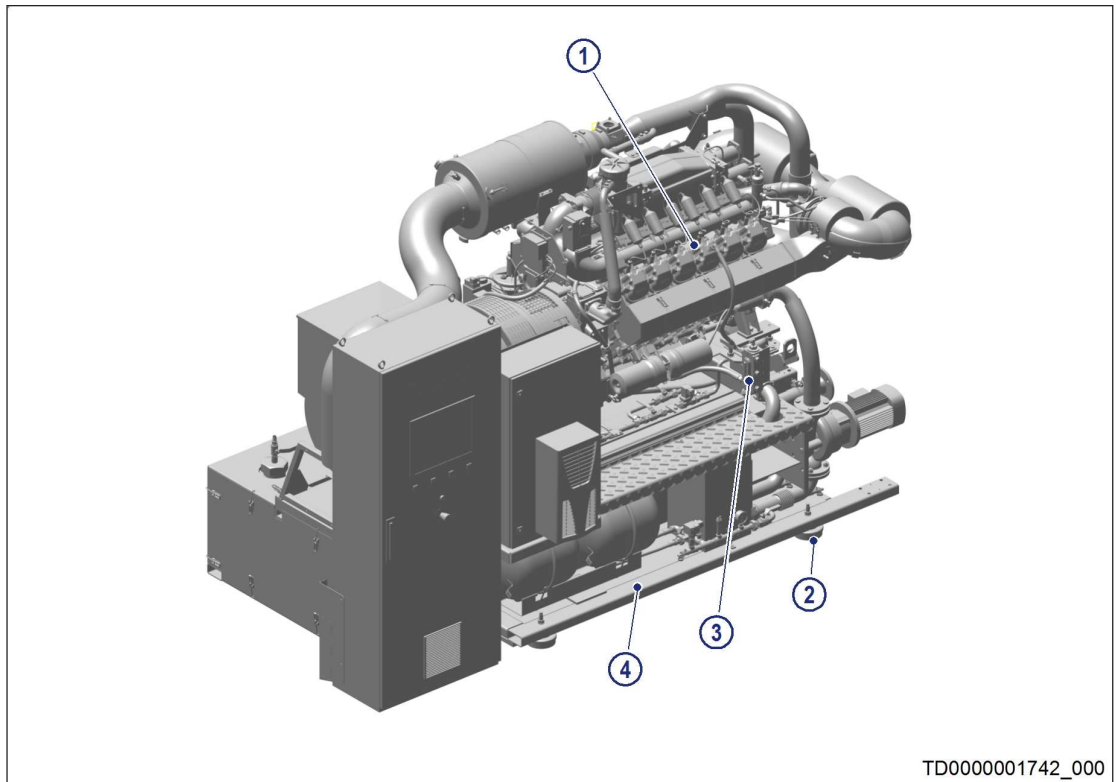

TD0000001742_000

Figure 3: Module, generator side

- | | |
|---------------------------|-------------------|
| 1 Engine | 3 Oil sight glass |
| 2 Machine shoe (optional) | 4 Baseframe |

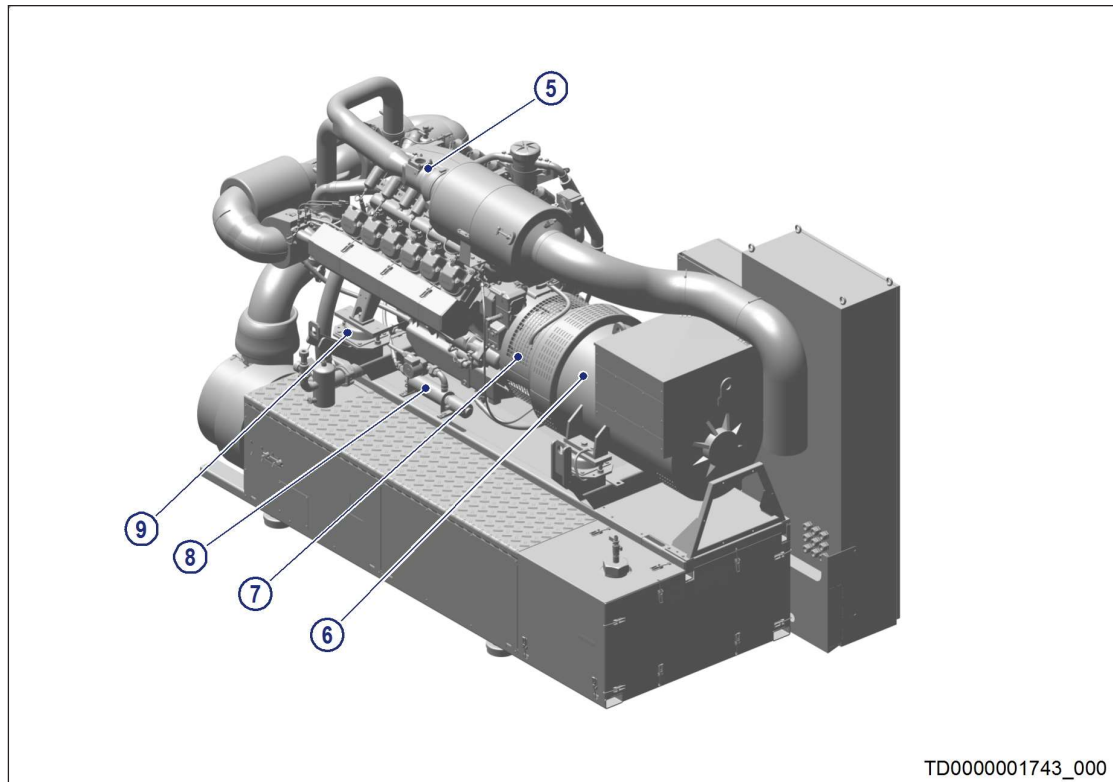


Figure 4: Module, generator side

- | | | |
|------------------------------------|--|-----------------------|
| 5 Gas mixer (gas train connection) | 7 Flange coupling | 9 Bowl-shaped element |
| 6 Generator | 8 Anti-condensation heating (optional) | |