



Functional Description

Gas engine-generator sets

GG06R0400B1

with engine E3066D4

MS13077/00E

Name	SLU name Model	Engine model	Application group
MTU 6R400 GS	GG06R0400B1	E3066D4	3A, continuous operation, unrestricted

© 2017 MTU Onsite Energy GmbH, Augsburg

The original document was created in the German language.

This publication including all of its parts is protected by copyright. Each instance of use requires the prior written consent of MTU Onsite Energy GmbH. This applies in particular to duplication, dissemination, editing, translation, microfilming, and storage and/or processing in electronic systems, including databases and online services.

All of the information presented in this publication was current and up-to-date at the time of publishing. MTU Onsite Energy GmbH reserves the right to make changes to, delete, or supplement the provided information and data as needed.

Table of Contents

1 Engine-Generator Set		5.2 Gas train	24
1.1 Application group	4	6 Exhaust System	
1.2 Nameplate and designation	5	6.1 Module - Exhaust system	25
1.3 Module - With heat supply from cogeneration and integrated exhaust gas heat exchanger	8	7 Lube Oil System	
2 Engine		7.1 Lube oil system	28
2.1 Engine - General description	12	7.2 Crankcase breather	32
2.2 Engine - Overview	13	8 Cooling System and Heating Water System	
2.3 Engine side and cylinder designations	15	8.1 Module - Cooling system with heat supply from cogeneration and integrated exhaust gas heat exchanger	34
2.4 Starting system	16	8.2 Module - Heating water system	37
2.5 Ignition system	17	9 Technical Data	
2.6 Speed control	18	9.1 Technical data	39
3 Generator		10 Appendix A	
3.1 Generator and coupling	19	10.1 Index	40
4 Monitoring and Control			
4.1 MMC control system	20		
5 Gas System			
5.1 Mixture formation	22		

1 Engine-Generator Set

1.1 Application group

The genset consists of a gas engine and a generator mounted on a common baseframe. Upon demand, the engine will start and drives the generator to generate heat energy and to produce electrical power.

There are two options for dissipating heat:

- Heat dissipation at the genset
- Heat dissipation provided by the customer

The object of delivery from MTU Onsite Energy complies with the EC Machinery Directive and German specifications and standards.

When the object of delivery is used abroad or in other special regions, MTU Onsite Energy is not responsible for observance of the statutory and other specifications / standards applicable at the place of use.

Application group 3A – Continuous operation, unrestricted (Continuous Power)

Gensets for unrestricted continuous power and heat energy supply are used for:

- Base load generation
- Part of a power supply or the public grid

Continuous operation	Application group 3A
Operating mode	Continuous operation, unrestricted
Rating definition	10% overload capacity (ICXN)
Load factor	< 100 %
Operating hours	Unrestricted

Benefits

- Wide range of standardized gensets to meet customer requirements with regard to power, emission and other characteristics.
- Option of selecting different components:
 - Only current supply
 - Heat supply from cogeneration from engine coolant
 - Heat supply from cogeneration from engine coolant and exhaust gas
- Most recent gas engine technology
- Components are designed with state-of-the-art technology for high electrical and thermal efficiency and long service life.

1.2 Nameplate and designation

Nameplates

The module has the following nameplates:

- Nameplate of module
- Engine nameplate
- Nameplate of generator

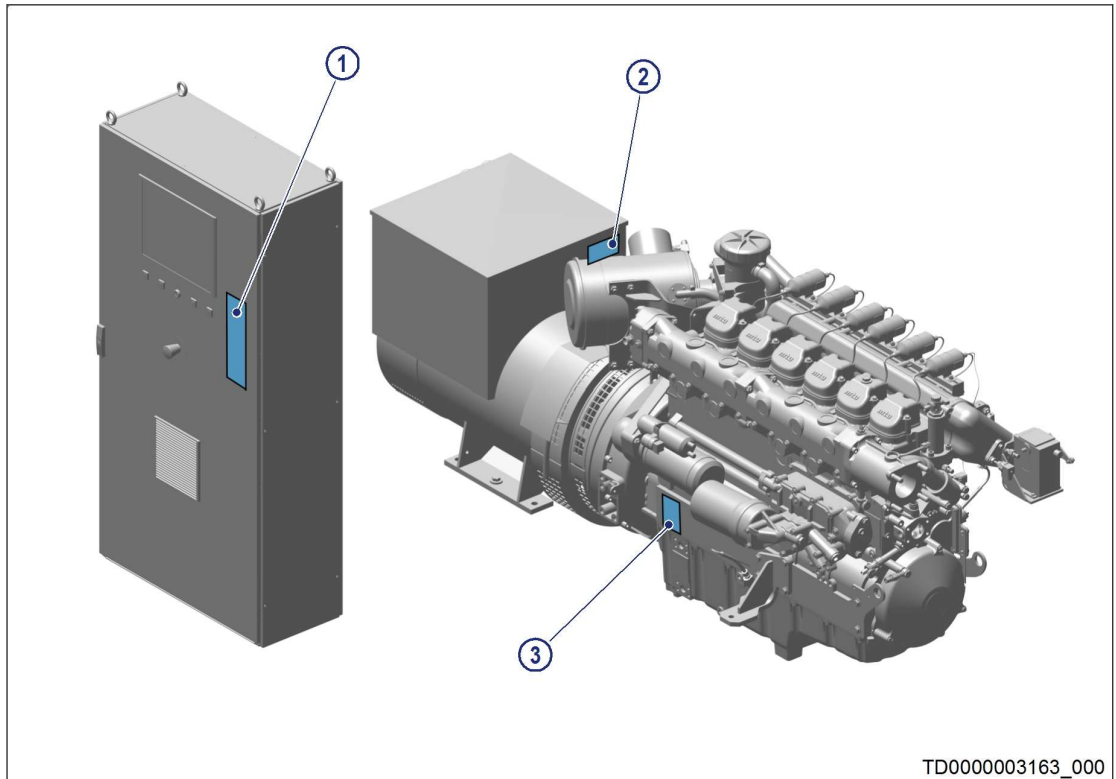


Figure 1: Fitting position of nameplates

1 Nameplate of genset

2 Nameplate of generator

3 Engine nameplate

Genset – nameplate and designation

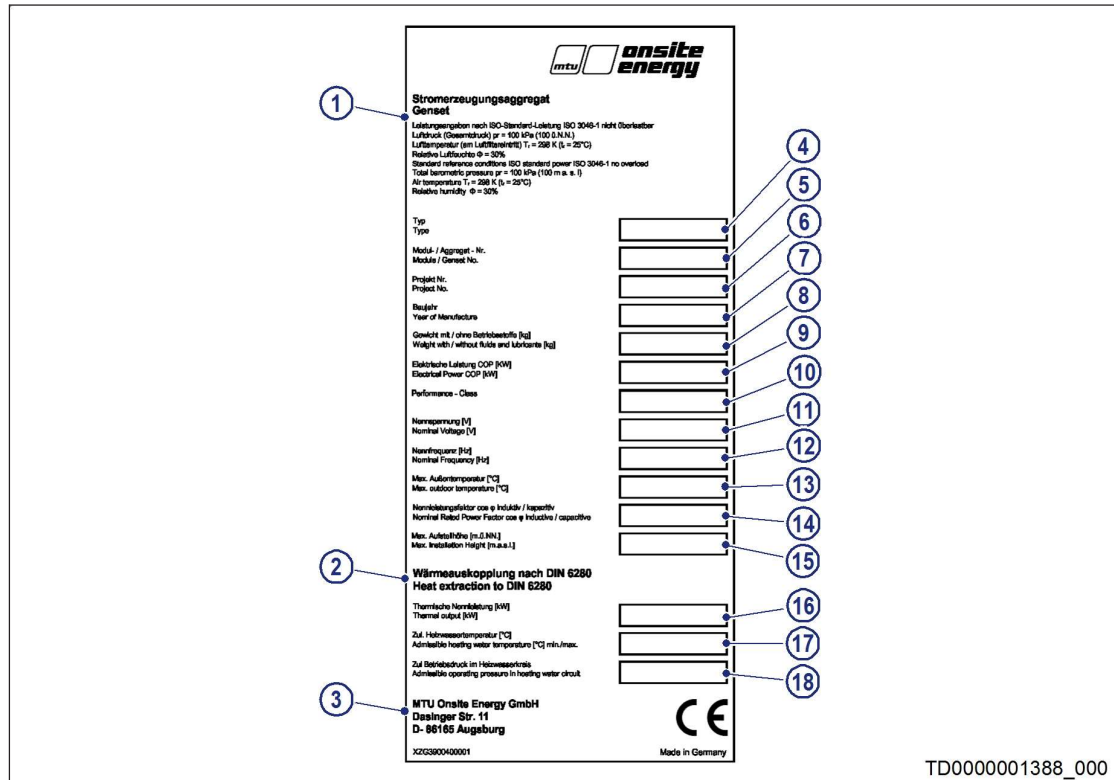


Figure 2: Nameplate of genset

Item	Description
1	Power ratings as per ISO standard power ISO 3046-1 no overload capability Air pressure (total pressure) $p_r = 100 \text{ kPa}$ (100 above sea level) Air temperature (at air filter inlet) $T_r = 298 \text{ K}$ ($t_r = 25^\circ\text{C}$) Relative air humidity $\phi = 30\%$
2	Heat supply from cogeneration as per DIN 6280
3	MTU Onsite Energy Dasinger Str. 11 D-86165 Augsburg
4	Type
5	Module / genset no.
6	Project no.
7	Year of construction
8	Weight with / without fluids and lubricants [kg]
9	Electrical output COP [KW]
10	Performance-Class (performance class of generator)
11	Rated voltage [V]
12	Rated frequency [Hz]
13	Max. outside temperature [°C]
14	Rated power factor cos ϕ inductive / capacitive
15	Max. site altitude [m above sea level]
16	Thermal rated power [kW]

Item	Description
17	Perm. heating water temperature [°C]
18	Perm. operating pressure in heating water circuit

Explanation of type

Example:MTU 6R400 GS	
MTU	Manufacturer: MTU Onsite Energy
6	Number of cylinders of the engine
R	Cylinder arrangement
400	400 series
GS	Gas system

Explanation of model name (SLU name)

Example:GG12V0400B1	
GG	Product type: Gaset
12	Number of cylinders of the engine
V	Cylinder arrangement
400	400 series
B1	Design/version

1.3 Module – With heat supply from cogeneration and integrated exhaust gas heat exchanger

Description

The module comprises the following main components:

- Engine
- Gas train
- Generator and coupling
- Heat supply from cogeneration with exhaust gas heat exchanger
- MMC (MTU Module Control) for plant control, closed-loop control, diagnostics

The energy contained in the fuel is converted into mechanical work and heat in the combustion engine.

The generator, which converts the mechanical work into electrical energy, is flange-mounted on the engine via a resilient coupling. The connecting bell is provided with a service port that permits the replacement of the flexible coupling element without displacing the engine or generator. The engine and generator are joined via resilient, vibration-damped elements to the baseframe.

The heat is transferred via the coolant at several points:

- Lube oil heat
- Engine heat
- Exhaust gas heat

The plate-core heat exchanger represents the interface between the coolant system of the module and the customer-provided heating system. In this connection, it is also referred to as a coolant or heating water heat exchanger.

All closed-loop controls, control systems and monitoring systems, including communication options to and from the system, are implemented in the hardware and software in the control cabinets.

The following components have complete pipework and are installed in the baseframe:

- Plate-core heat exchanger
- Exhaust gas heat exchanger
- Catalytic converter (optional)

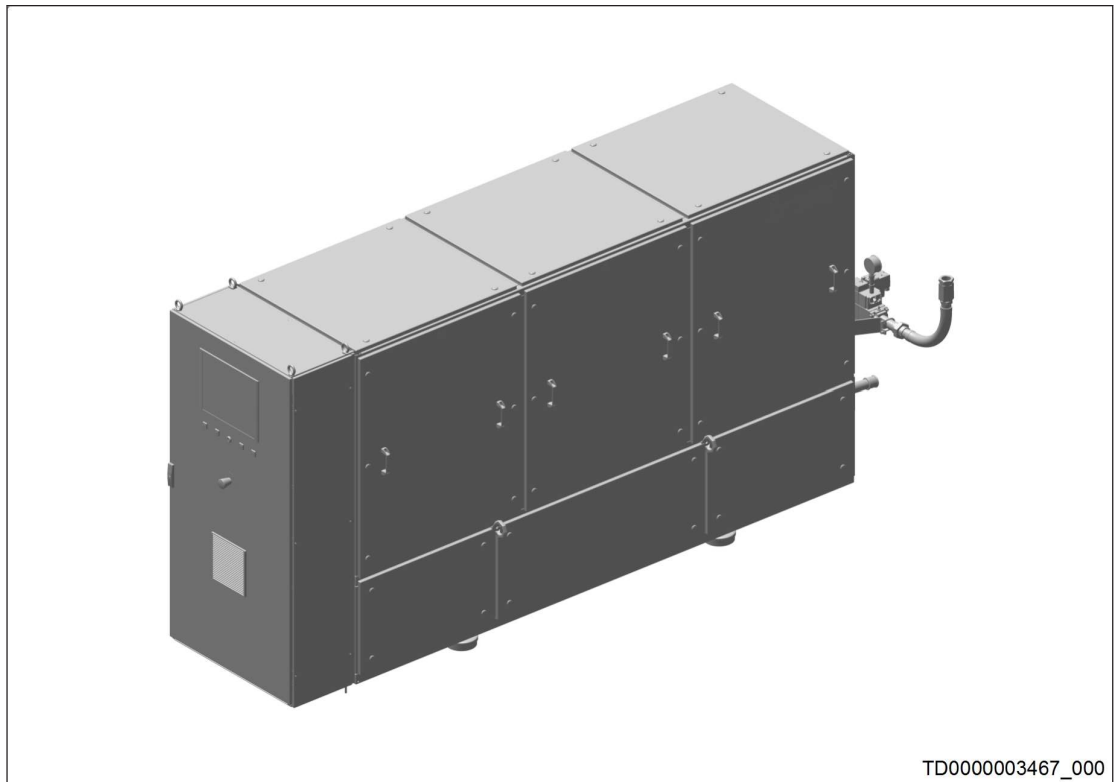


Figure 3: Module with noise insulation

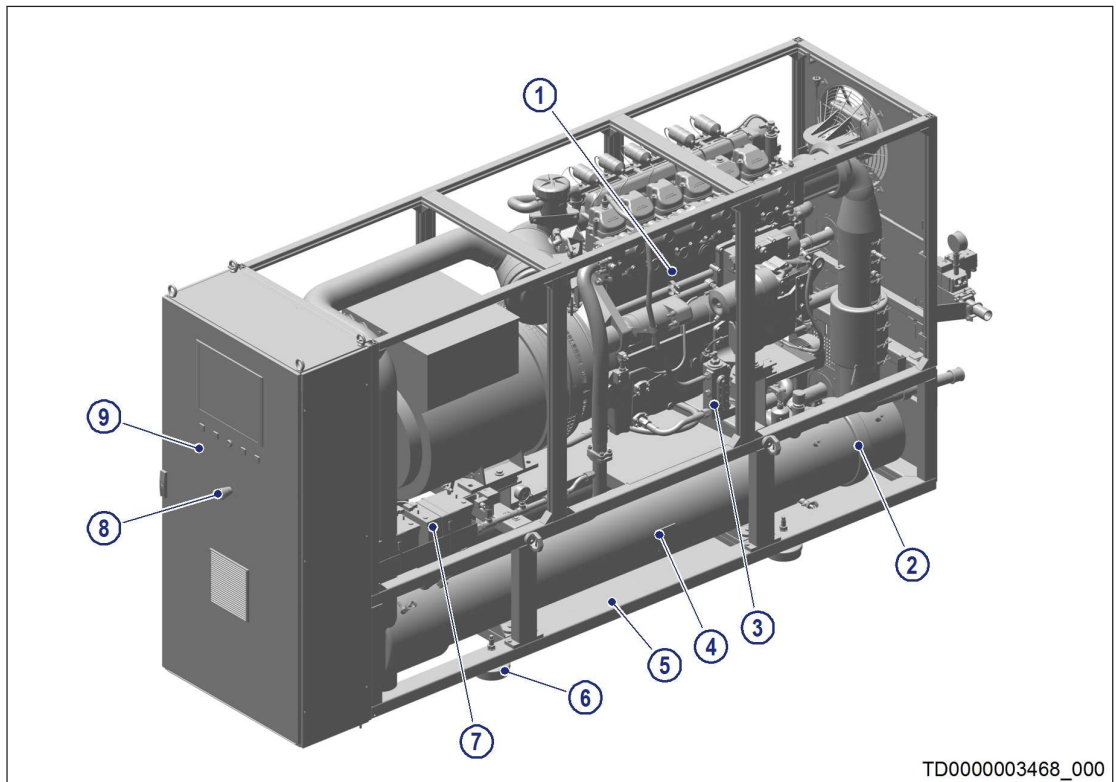


Figure 4: Module, generator side

- | | | |
|-------------------|------------------------------|---|
| 1 Engine | 4 Exhaust gas heat exchanger | 7 Starter battery |
| 2 Catalyst | 5 Baseframe | 8 EMERGENCY-STOP button |
| 3 Oil sight glass | 6 Bowl-shaped element | 9 Control cabinet (MMC)
module control |

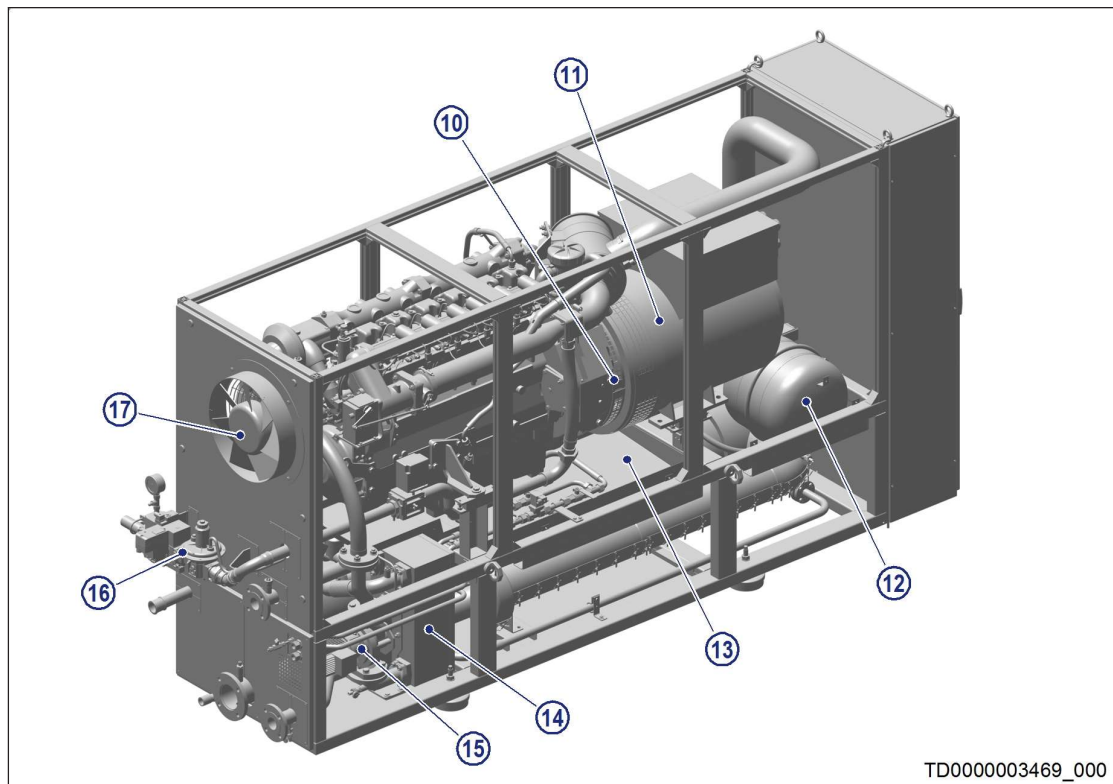


Figure 5: Module, engine side

- | | | |
|---------------------------------------|------------------------------|----------------------|
| 10 Flange coupling / coupling housing | 13 Oil pan | 16 Gas train |
| 11 Generator | 14 Plate-core heat exchanger | 17 Fan (exhaust air) |
| 12 Diaphragm expansion tank | 15 Coolant pump | |