


P-103A/B

SPRAY WATER PUMP
CAPACITY = 60 M3/Hr
HEAD = 50M
POWER = 15 KW

T-103

SPRAY WATER CIRCULATION TANK
CAPACITY = 200 M3
DIM : (L x W x H) 16M x 10M x 1.3M

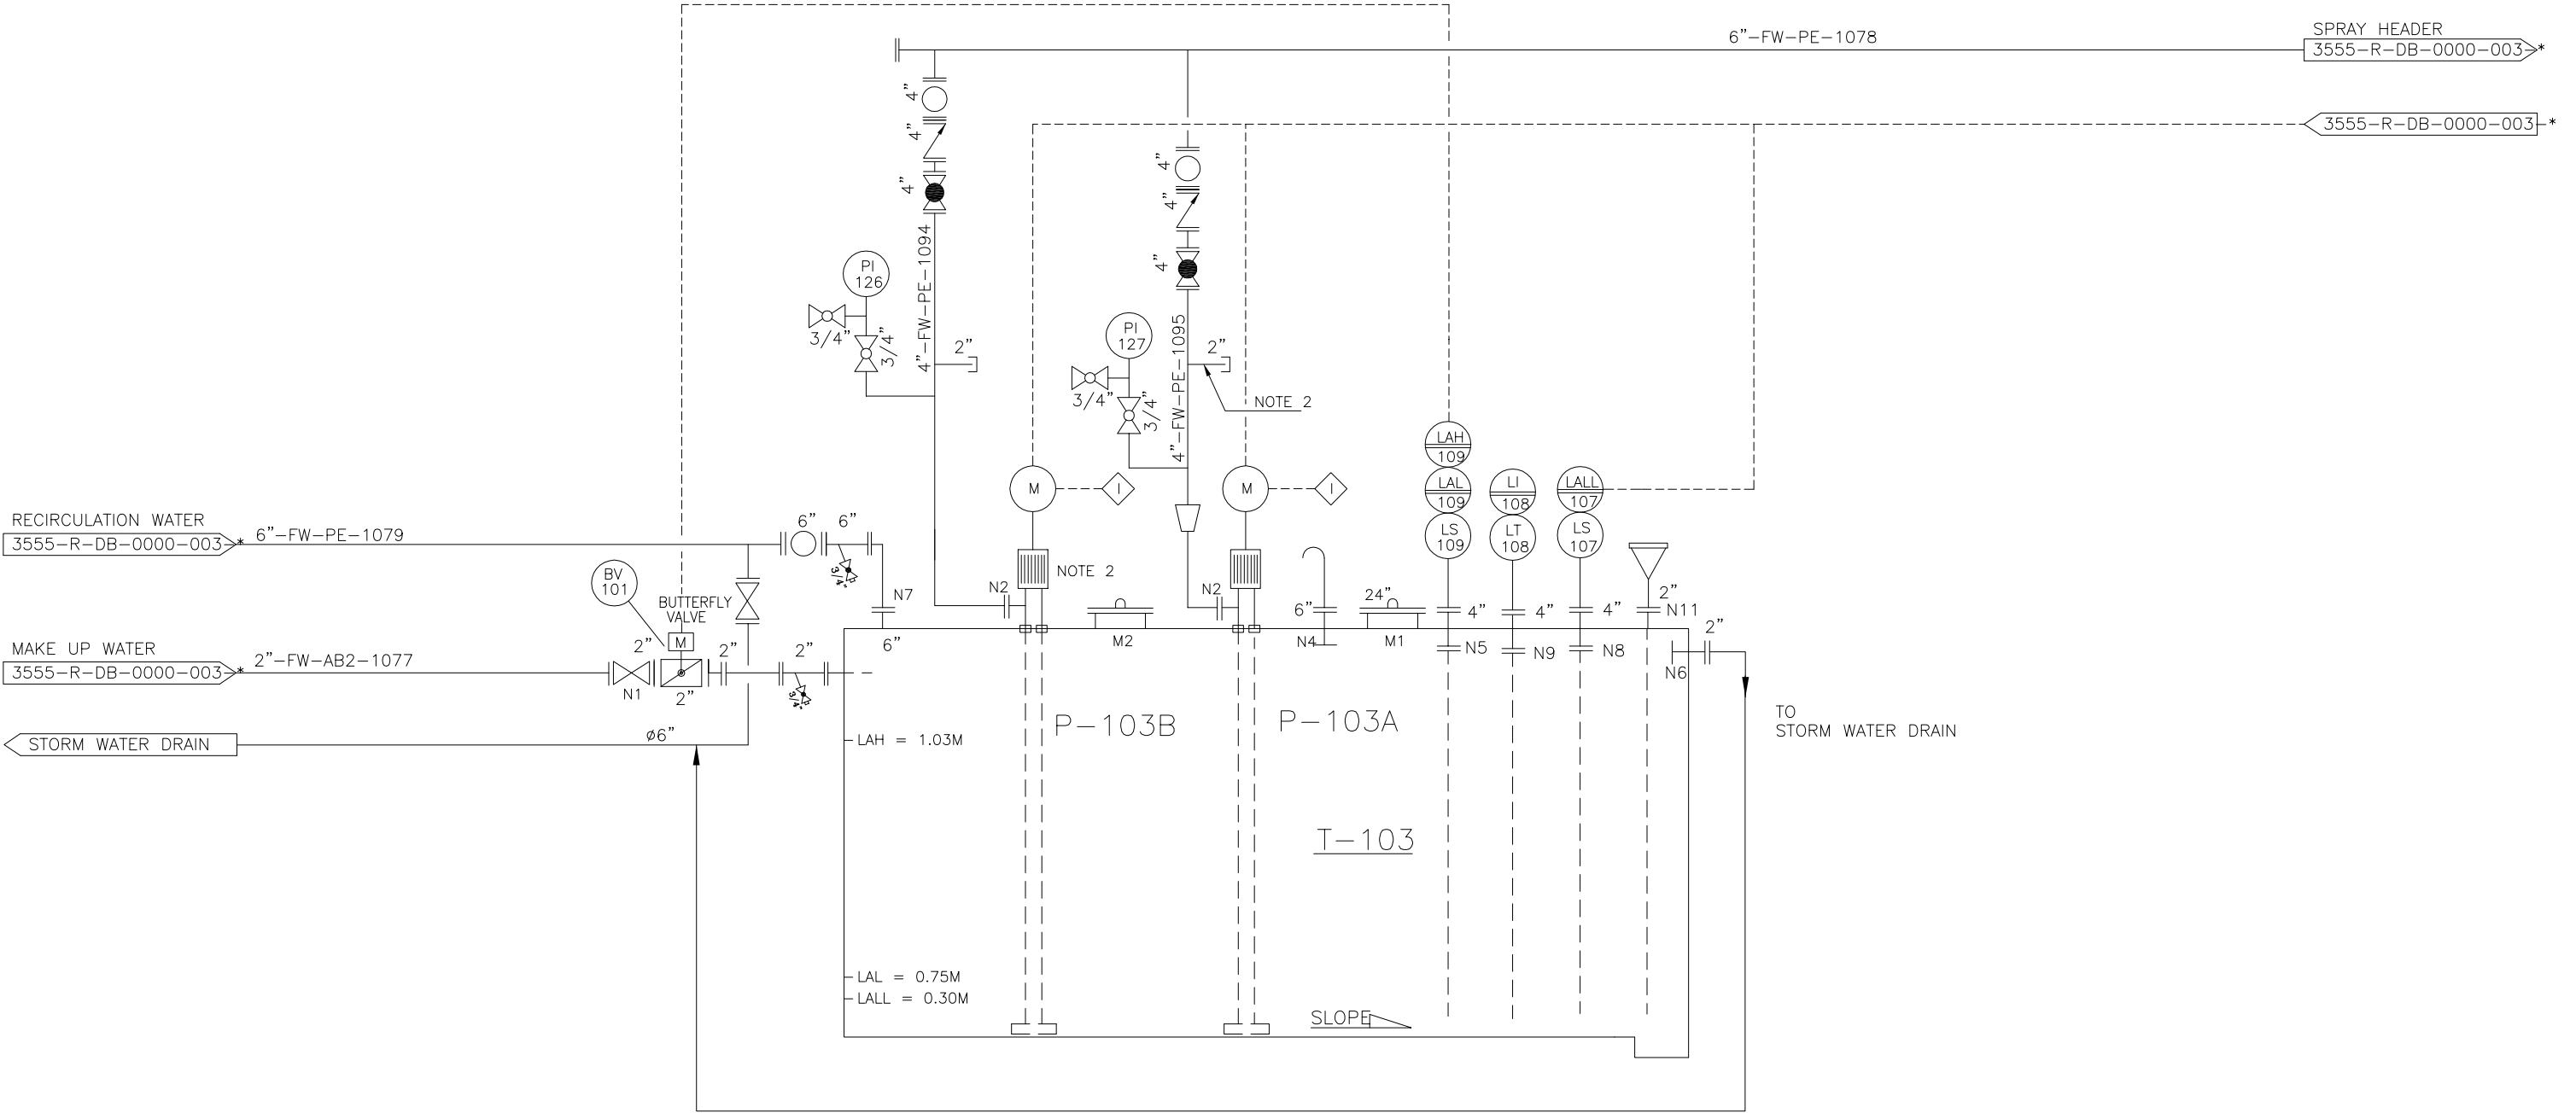

APPROVED
By Ismail at 9:57 am, Dec 17, 2014

NOTES

1. REFER P&ID 3555-R-DB-0000-002-* FOR LEGEND.
2. AFTER CHLORINATION DOZING RATE IS CLEAR-EPTL WILL PROVE IT.

11	24.09.09	AS BUILT	SZH		BIK		-	
10	08-03-05	ADDITION OF STRAINERS INCORPORATED	MAA		IU		SAQ	
9	23-12-03	AS BUILT	MAA		IU		SNR	
8	30-12-99	AS BUILT	RZA		ZM		IA	
7	09-08-99	HAZOP CHANGES INCORPORATED	YM		RZA		ZM	
6	22-06-99	ISSUED FOR CONSTRUCTION	YM		RZA		ZM	
5	28-04-99	ISSUED FOR CONSTRUCTION	YM		RZA		ZM	
REV	DATE	DESCRIPTION	INIT. BY	SIGN	INIT.	SIGN	INIT.	SIGN
REVISIONS								

UNAUTHORIZED REPRODUCTION OF ANY KIND IS PROHIBITED; ALL RIGHTS ARE RESERVED BY DESCON ENGINEERING LIMITED, LAHORE, PAKISTAN




DESCON ENGINEERING LTD.
P.O. BOX 1201, LAHORE 54000, PAKISTAN

ORIGINAL	INIT.	SIGN	DATE
ENGINEER	RZA		30/12
DRAWN	YM		30/12
CHECKED	ZM		30/12
APPROVED	IA		30/12

THIS DOCUMENT HAS BEEN
MODIFIED MANUALLY
☐ YES ☒ NO

EPTL DOC. NO.

DR04908



ENGRO PAKTANK
TERMINALS LTD.

PROJECT VCM STORAGE & HANDLING
FACILITIES

TITLE P & ID
SPRAY WATER STORAGE SYSTEM

DOCUMENT NUMBER

3555-R-DB-0000-049-*

SHEET

NO OF

1 1

REV

10