


V-3302

FOAM TANK

CAPACITY: 2 m³

MATERIAL: SS

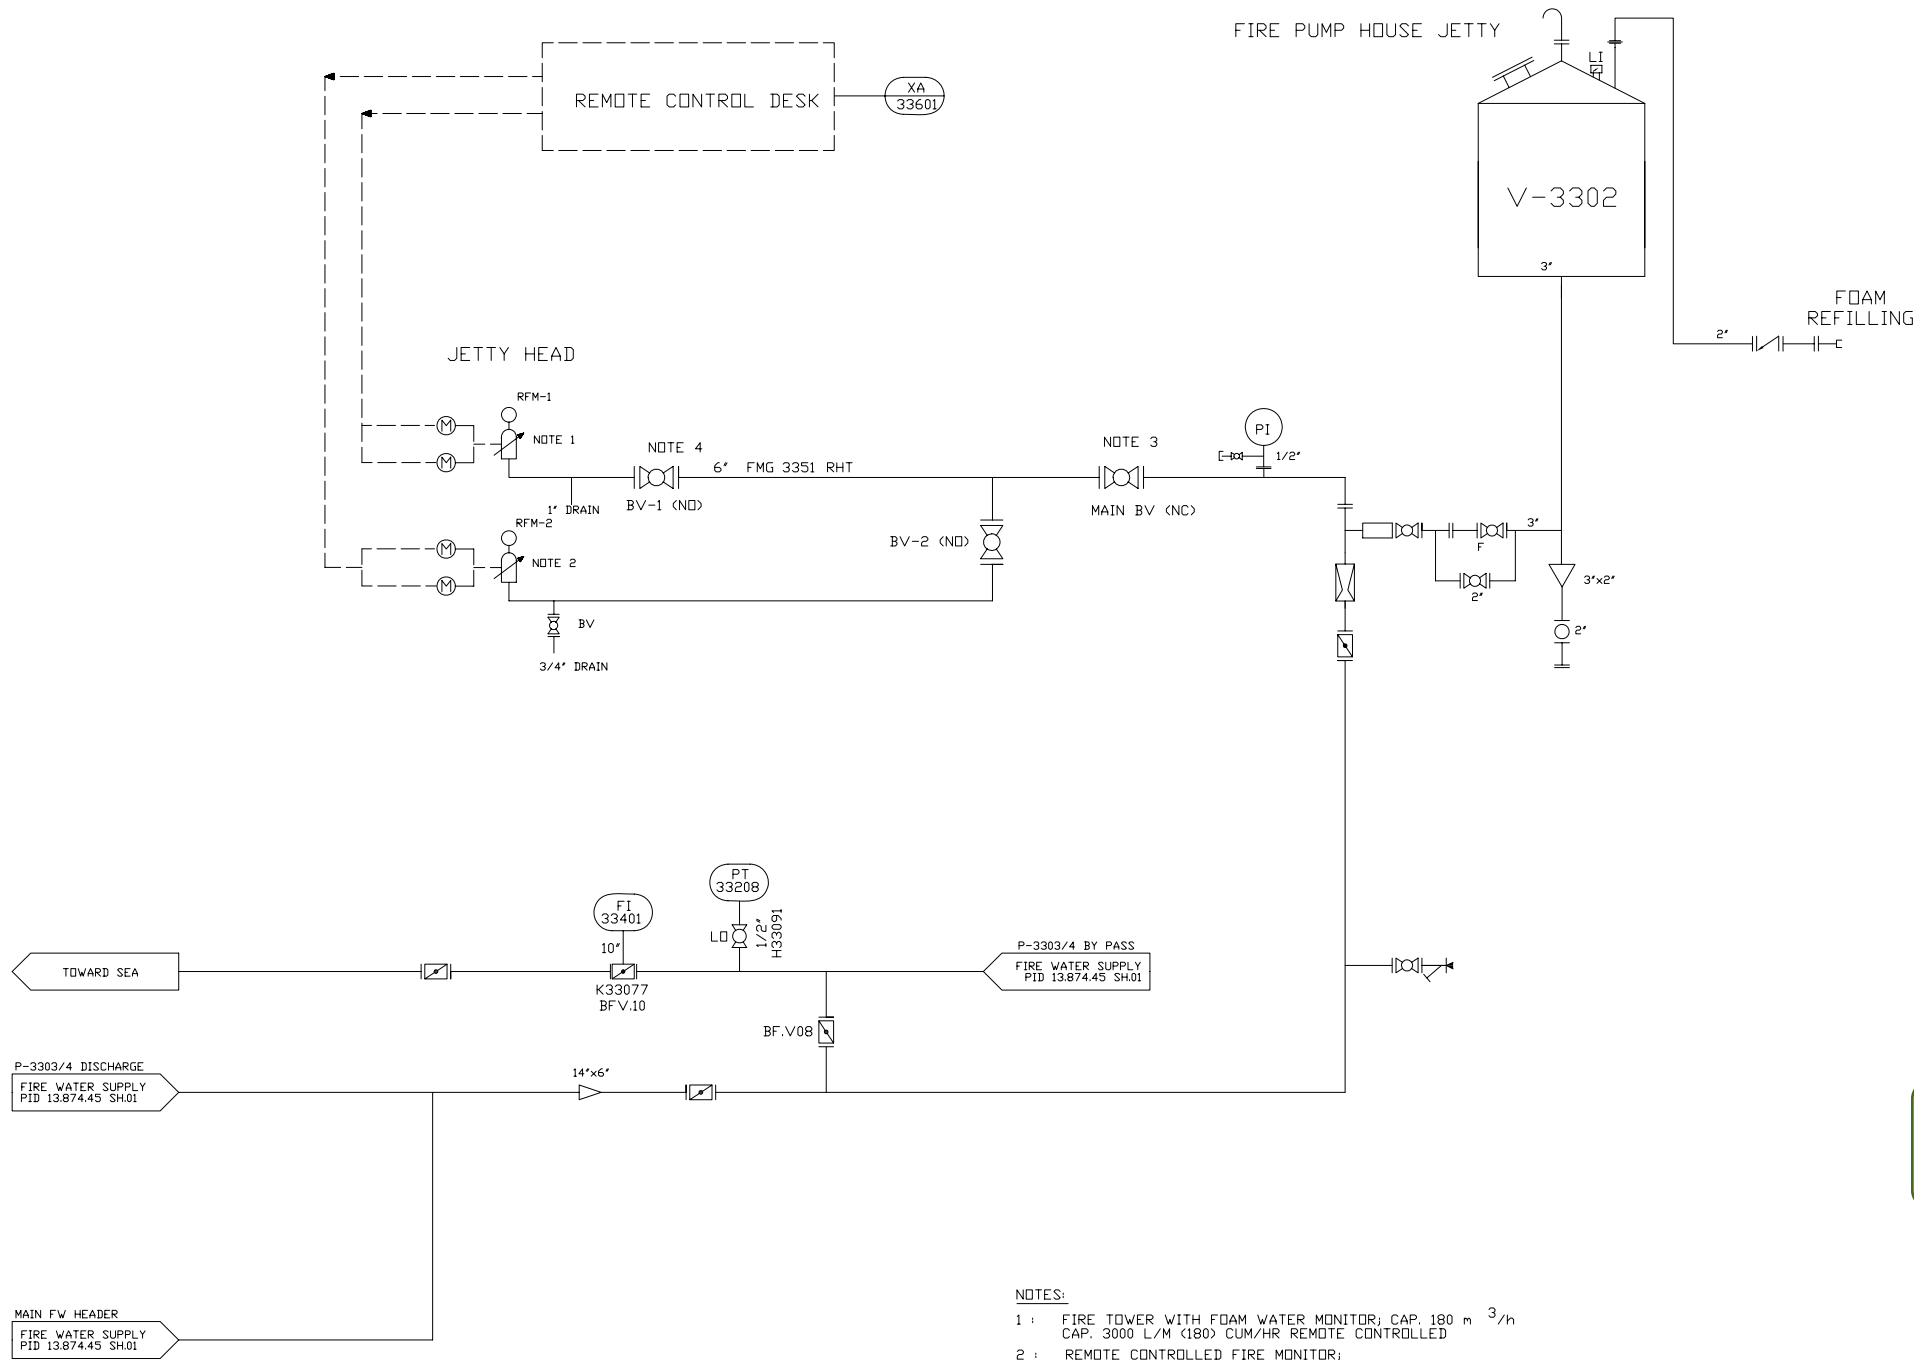

- NOTES:
- 1: FIRE TOWER WITH FOAM WATER MONITOR; CAP. 180 m³/h
CAP. 3000 L/M (180) CUM/HR REMOTE CONTROLLED
 - 2: REMOTE CONTROLLED FIRE MONITOR;
CAP. 5000 L/M (300 CUM/HR)
 - 3: MAIN OPERATING VALVE, LOCATED IN IN FIRE PUMP HOUSE
 - 4: TO COUNTER PROBLEMS OF MALFUNCTION, REMOTE OPERATION
OF CONTROL VALVE CHANGED TO MANUAL (VALID FOR BOTH MONITORS).
 - 5: OPERATING STRATEGY FOR MONITORS.
 - a: ONE MONITOR TO FUNCTION AT TIME.
 - b: MANUALLY OPEN 6" MAIN OPERATING VALVE IN FIRE PUMP HOUSE.
 - c: SUBJECT TO USE, CLOSE VALVE UPSTREAM OF THE OTHER MONITOR.
 - d: DIRECT CONTROL OF REQUIRED MONITOR FROM THE CONTROL DESK.

APPROVED

By Ismail at 10:06 am, Dec 17, 2014

10	24.09.09	SZH	BIK	AS BUILT
09	15.12.03	MAA	IU	THIRD AS BUILT CORRECTED
08	10.9.2K	MIM	IU	SECOND AS BUILT CORRECTED
07	15.05.98	Wey	Go	FIRST AS BUILT CORRECTED
06	09.03.98	Wey	Go	AS BUILT
05	03.09.97	Zahr	Sch	ADD. GENERAL ALARM RCD
04	24.04.97	Zahr	Sch	GENERAL REVISION
03	06.12.96	Zahr	Sch	VENDOR INFORMATION AND COMMENTS OF CLIENT ADDED
02	08.10.96	Zahr	Sch	GENERAL REVISION+DESIGN REVIEW 04.10.96
01	-	-	-	-
rev.	date	made	checked	description of revision

checked	date	name	sign	scale	DIN size	
	18.09.09	BIK		%	A1	
					sheet 02 of 02	

INTEGRATED LIQUID CHEMICAL TERMINAL & STORAGE FARM AT PORT QASIM / PAKISTAN		project no	ident no	dok no	rev
		22071387446	A01	7	1

		ENGRO PAKTANK TERMINAL LTD.			
--	--	-----------------------------	--	--	--

(PID) FOAM SYSTEM MOBILE FOAM TENDER /JETTY				EPTL doc no	rev.
				1000711	1

copyright by Noell-LGA

saved: 240798