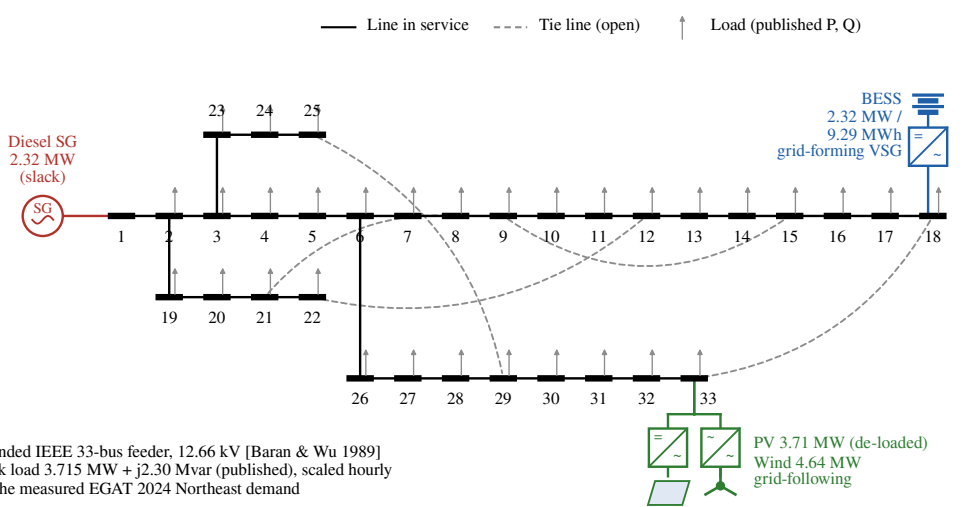

Islanded IEEE 33-bus feeder, 12.66 kV [Baran & Wu 1989]
Peak load 3.715 MW + j2.30 Mvar (published), scaled hourly
by the measured EGAT 2024 Northeast demand