


±660kV LAHORE CONVERTER STATION AC FILTERS

MAIN WIRING DIAGRAM

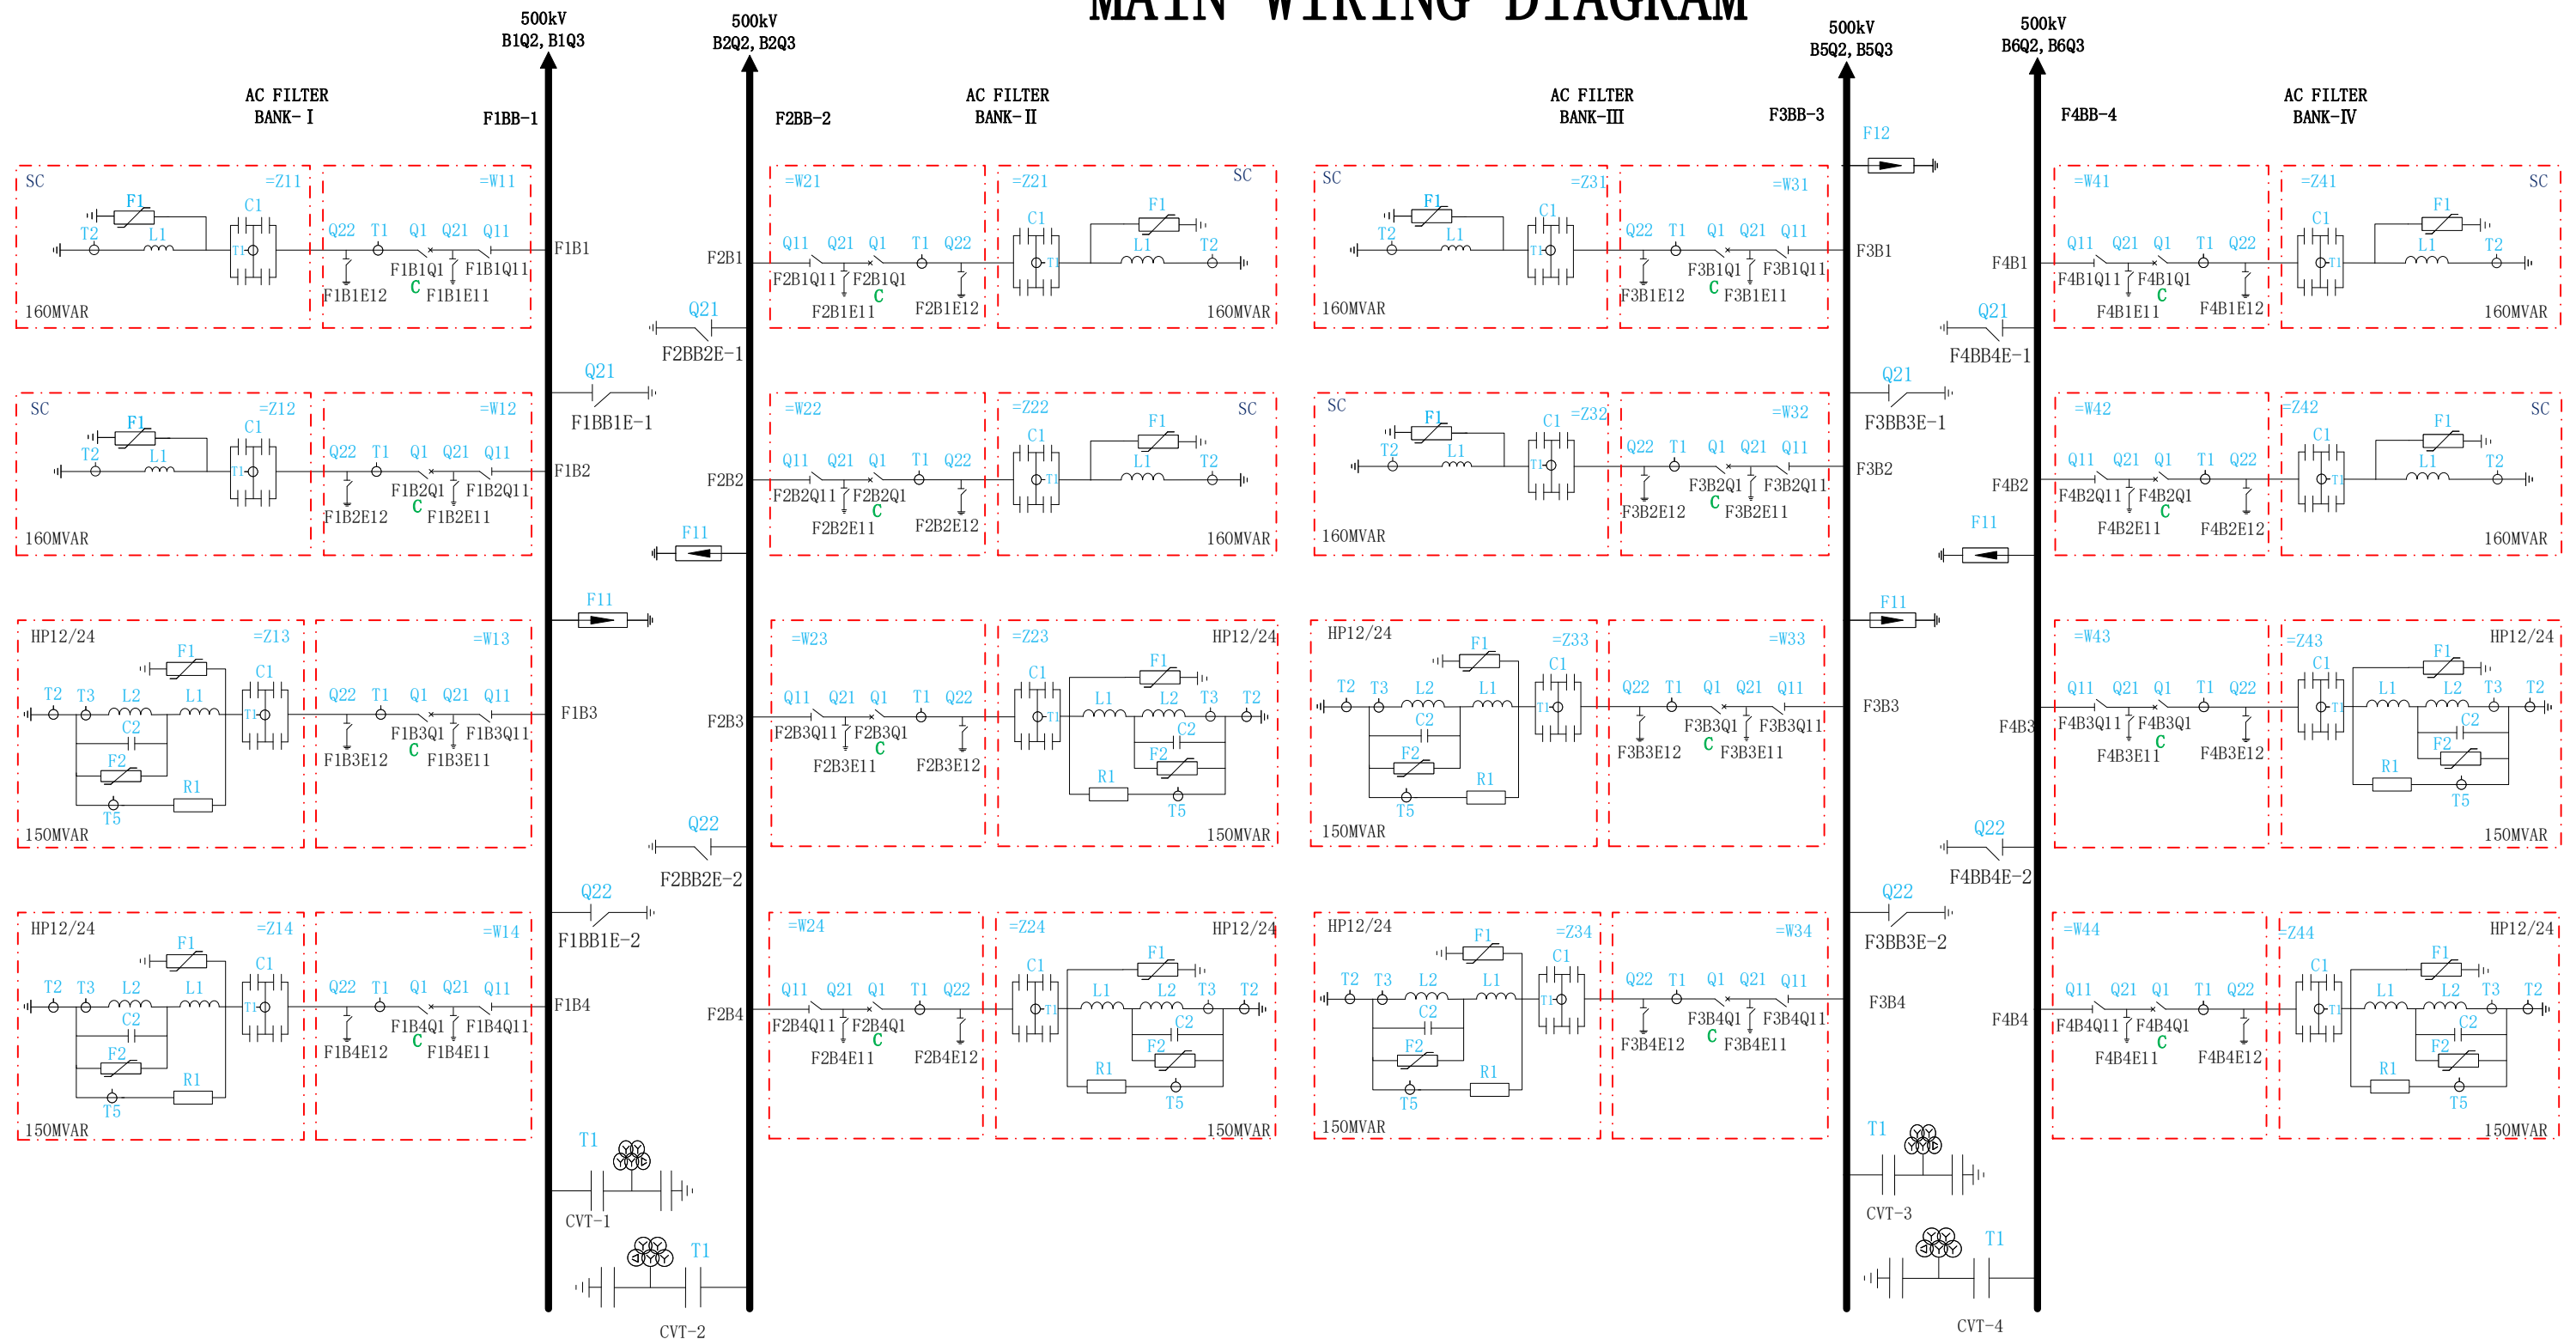

Symbol	Explain	Symbol	Explain
	Circuit breaker		CVT
	Isolator		Arrester
	Earth switch		Arrester
	Electromagnetic CT		inductance
	capacitance		resistance

NORTH



Remarks: The switch marked C refer to a parallel capacitor

Approved	陈大庆	2020.06	±660kV LAHORE CONVERTER STATION	
Audit	吴名星	2020.06	AC FILTERS MAIN WIRING DIAGRAM	
calibration	张鹏	2020.06		
Drawing	袁茂凯	2020.06	Number	003