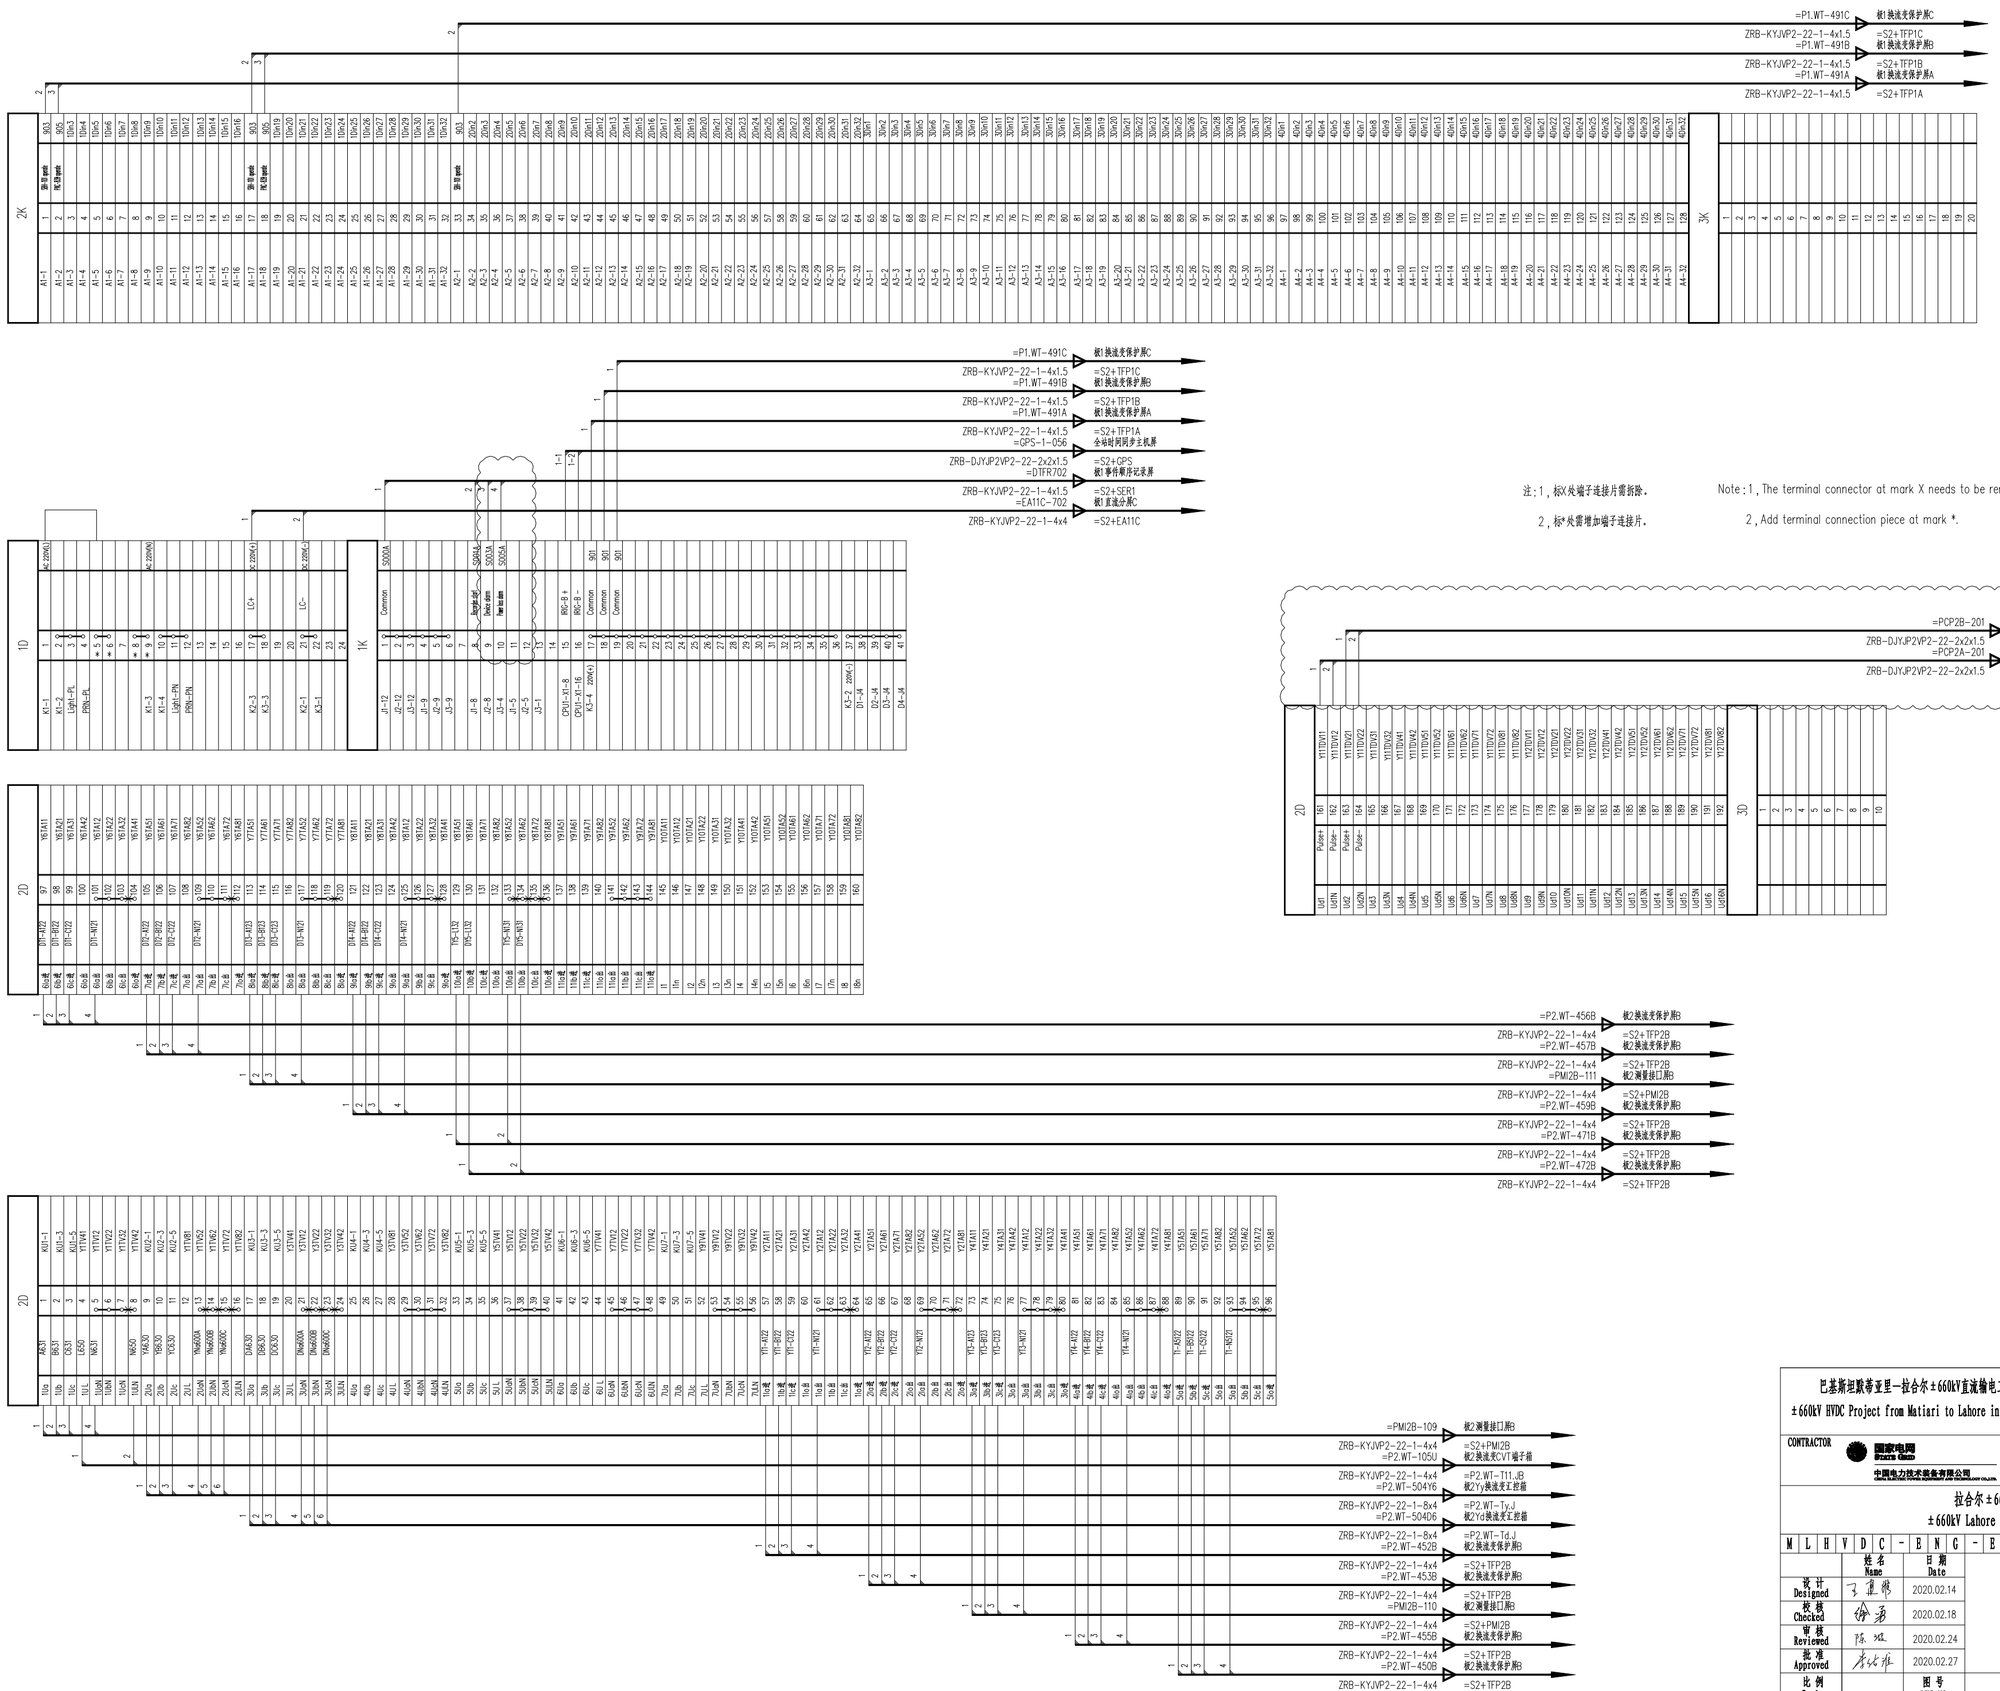

注：1，标X处端子连接片需拆除。

2，标*处需增加端子连接片。

Note：1，The terminal connector at mark X needs to be removed.

2，Add terminal connection piece at mark *.

巴基斯坦默蒂亚里—拉合尔±660kV直流输电工程

±660kV HVDC Project from Matiari to Lahore in Pakistan

NATIONAL TRANSMISSION & DESPATCH COMPANY (NTDC) LIMITED PAKISTAN

CONTRACTOR 国家电网 STATE GRID 中国电力技术装备有限公司 CHINA ELECTRIC POWER EQUIPMENT AND TECHNOLOGY CO.,LTD.

SUBCONTRACTOR East China Electric Power Design Institute Co.,Ltd.

拉合尔±660kV换流站

±660kV Lahore Converter Station

设计阶段 PHASE：施工图 Detail Design

M L H V D C - E N G - E C I - D D - P C - 0 8 0 1 - 0 4 1 A

	姓名 Name	日期 Date
设计 Designed	王建辉	2020.02.14
校核 Checked	徐勇	2020.02.18
审核 Reviewed	陈斌	2020.02.24
批准 Approved	李长胜	2020.02.27

极2换流变故障录波器端子排接线图（DTFR22）
Terminal block diagram(S2+DTFR22)

比例 Scale：

图号 DWG NO.：30-B003701S-D0801-041

版本 REV.：A

594X841