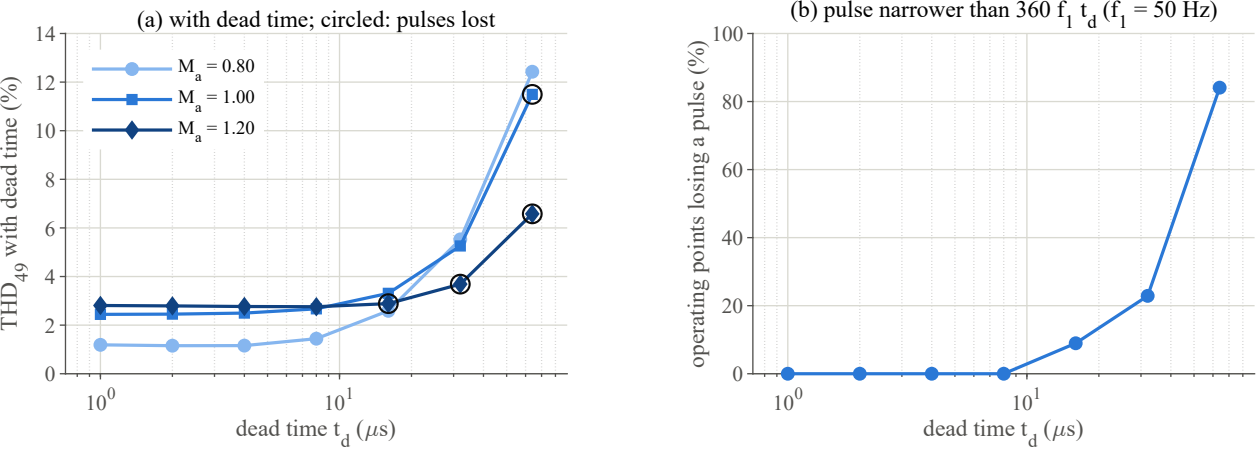
(a) with dead time; circled: pulses lost
THD49 with dead time (%)
dead time td (μs)
Ma = 0.80
Ma = 1.00
Ma = 1.20
(b) pulse narrower than 360 f1 td (f1 = 50 Hz)
operating points losing a pulse (%)
dead time td (μs)