


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 02/11/2025

Reserve Profile for 02-11-2025

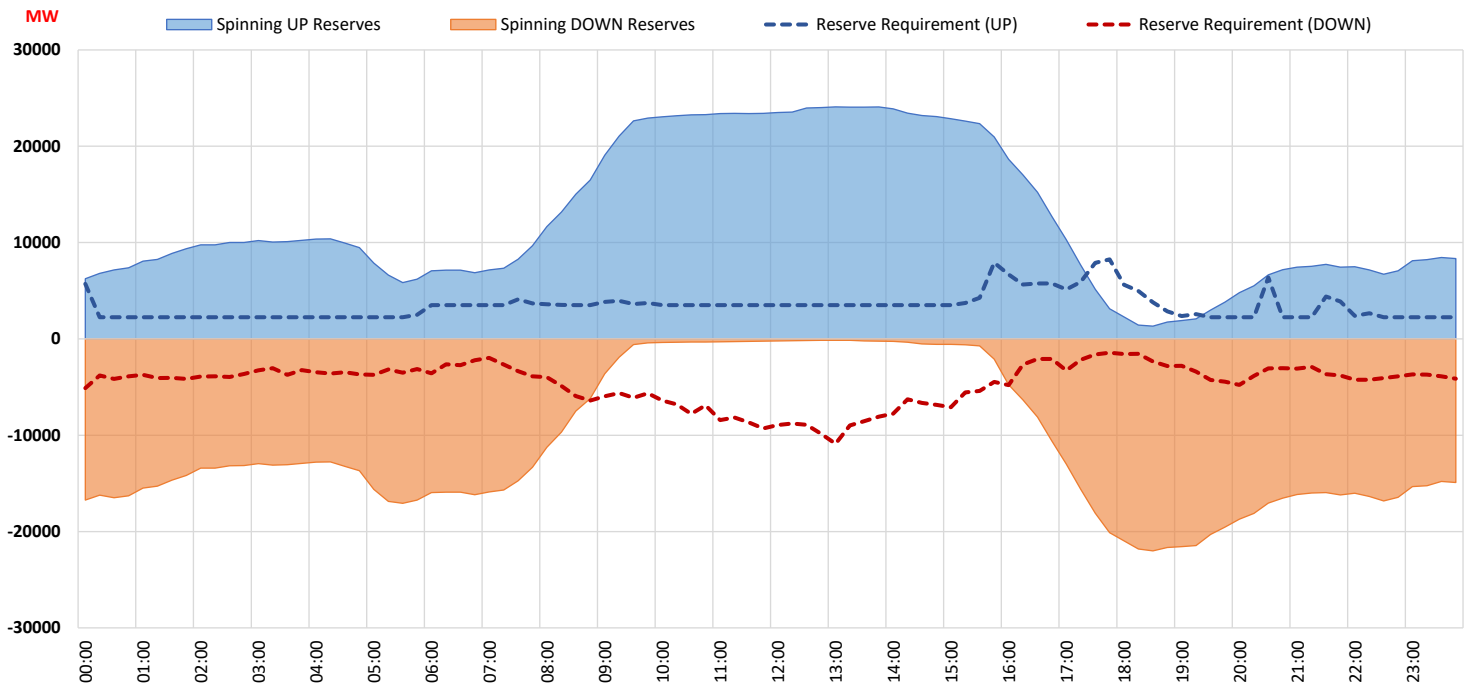


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 02-11-2025

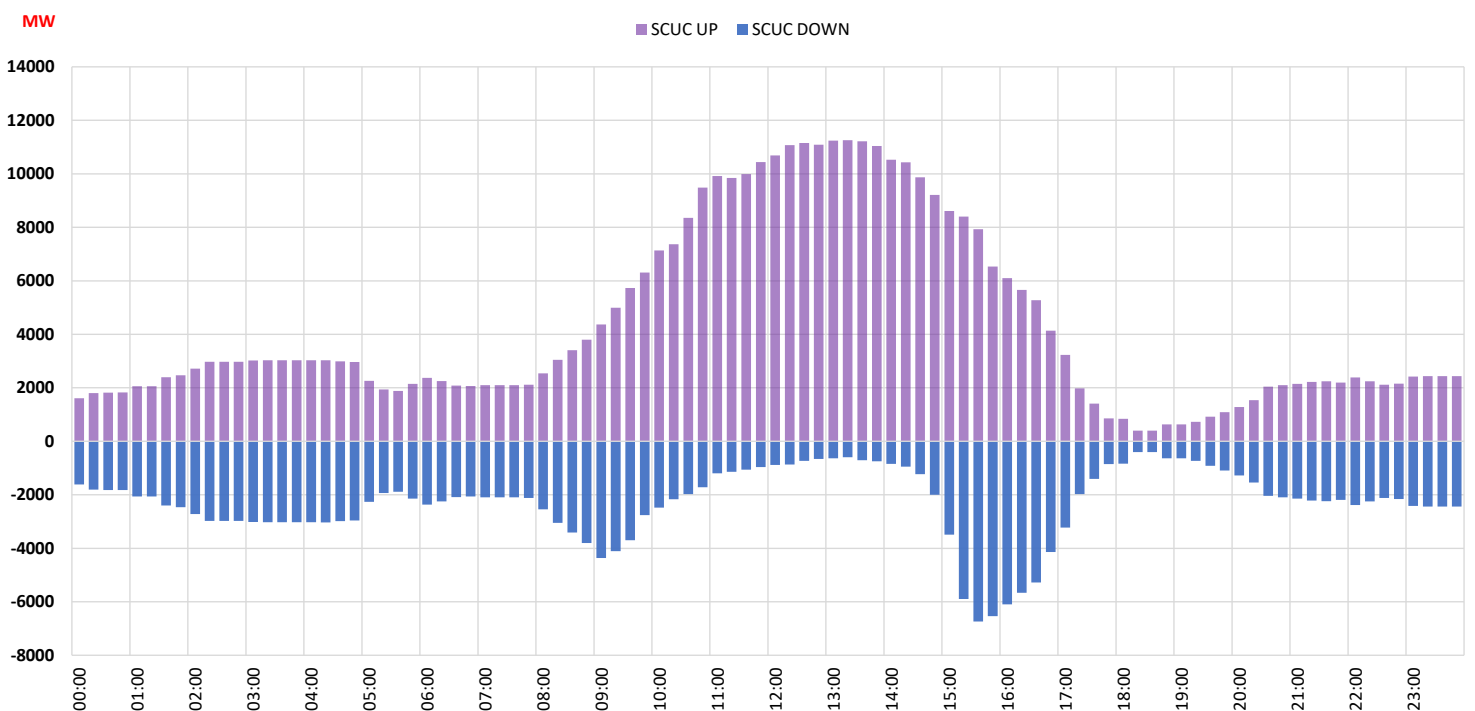


SCUC-Up Scheduled (MWh)	103217
SCUC-Down Scheduled (MWh)	-54953

Tertiary Reserve Ancillary Services (TRAS) Despatched for 02-11-2025

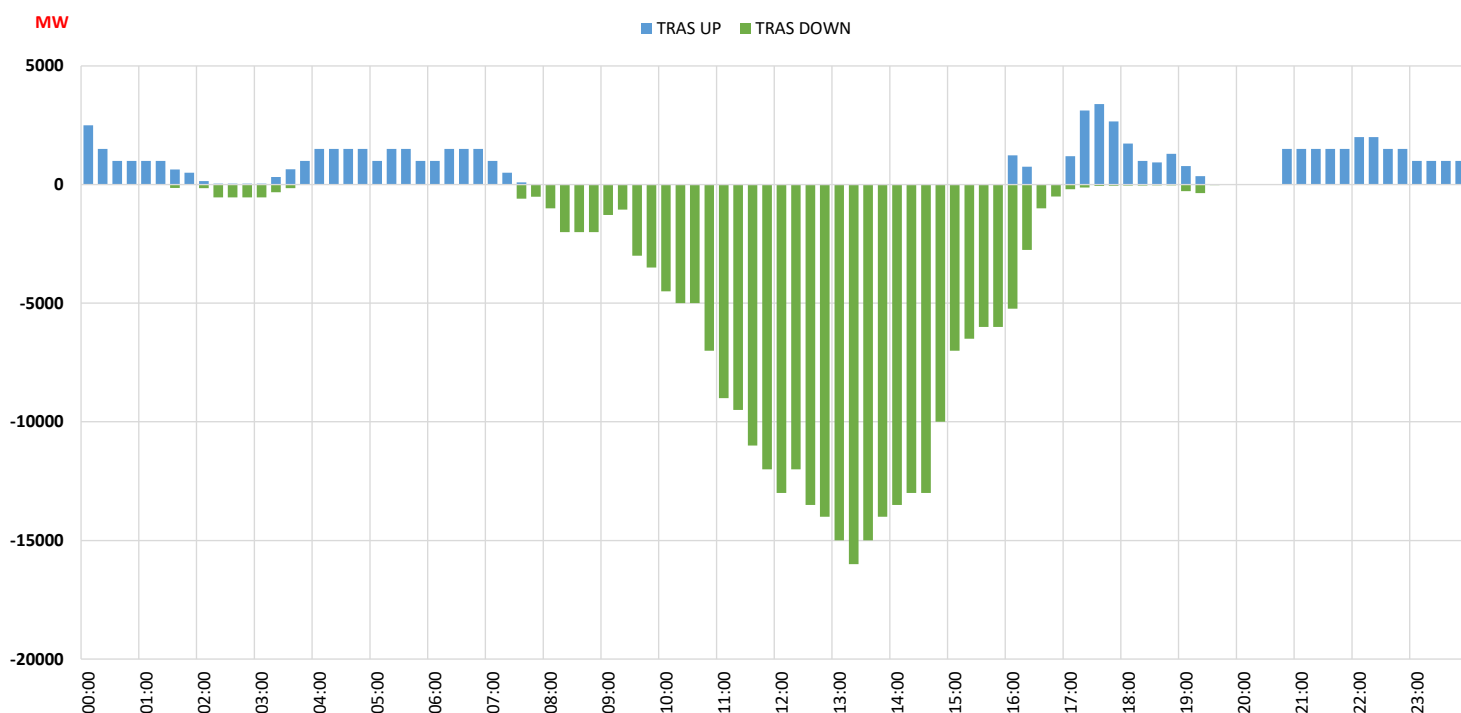

Secondary Reserve Ancillary Services (SRAS) Profile for 02-11-2025

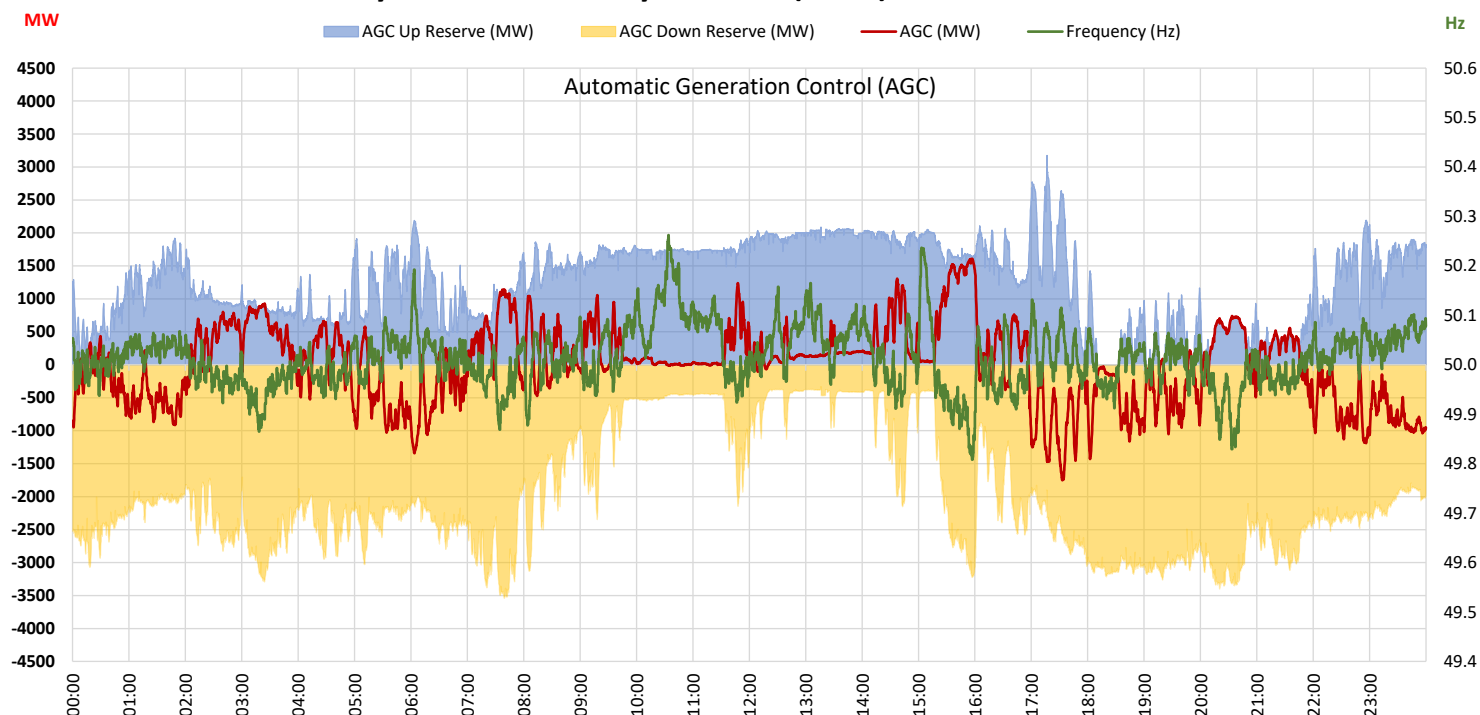

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	5305	-5408	1607	-1751	-4
TRAS:	15559	-69203	3329	-15999	-2235
SRAS+TRAS:	20864	-74612	2980	-15865	-2239