


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 01/11/2025

Reserve Profile for 01-11-2025

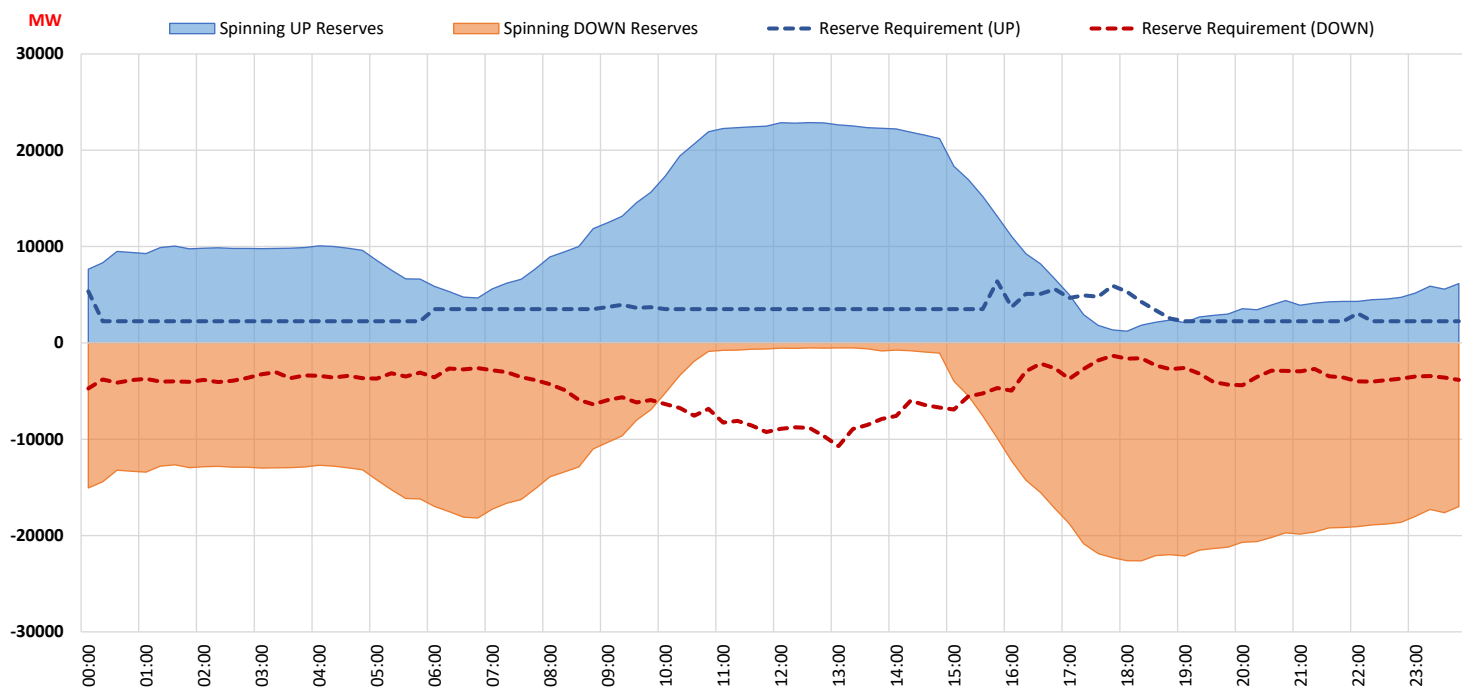


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 01-11-2025

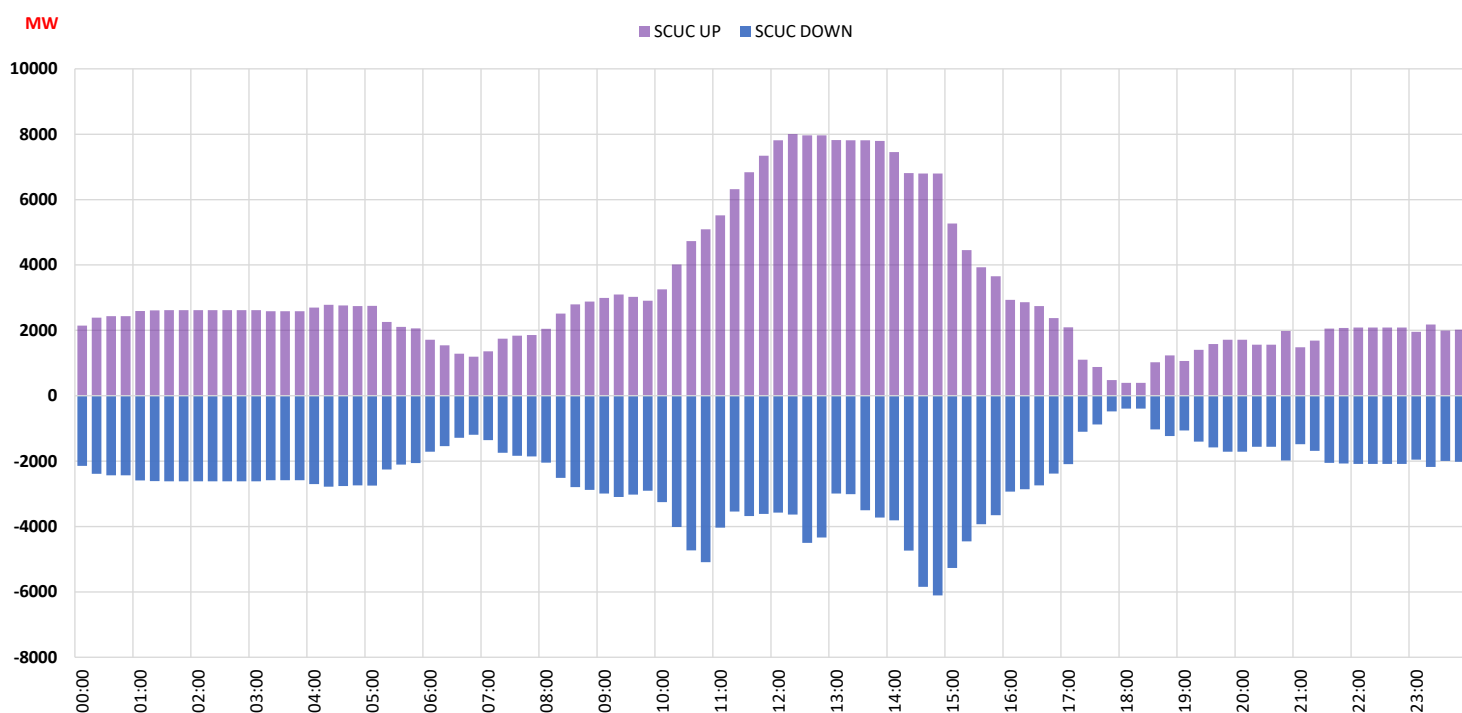


SCUC-Up Scheduled (MWh)	75448
SCUC-Down Scheduled (MWh)	-62396

Tertiary Reserve Ancillary Services (TRAS) Despatched for 01-11-2025

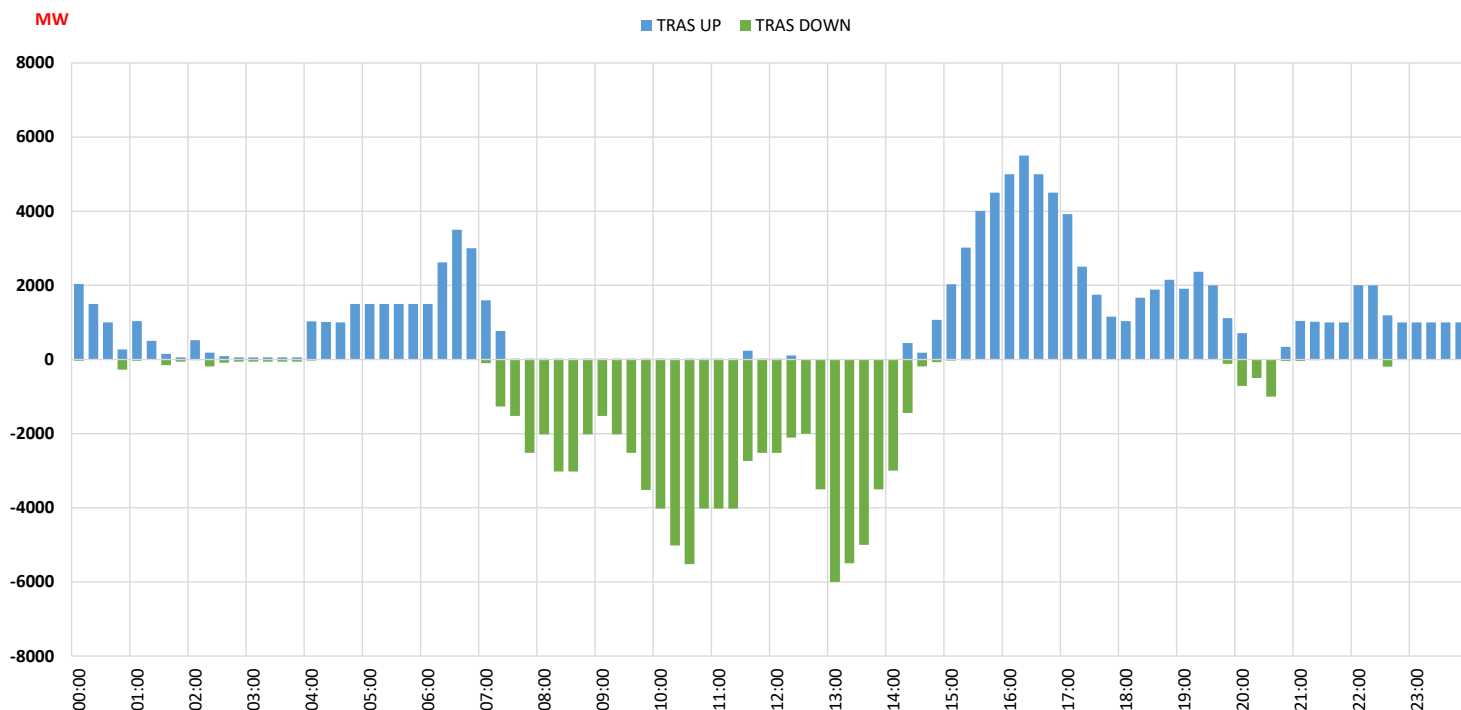

Secondary Reserve Ancillary Services (SRAS) Profile for 01-11-2025

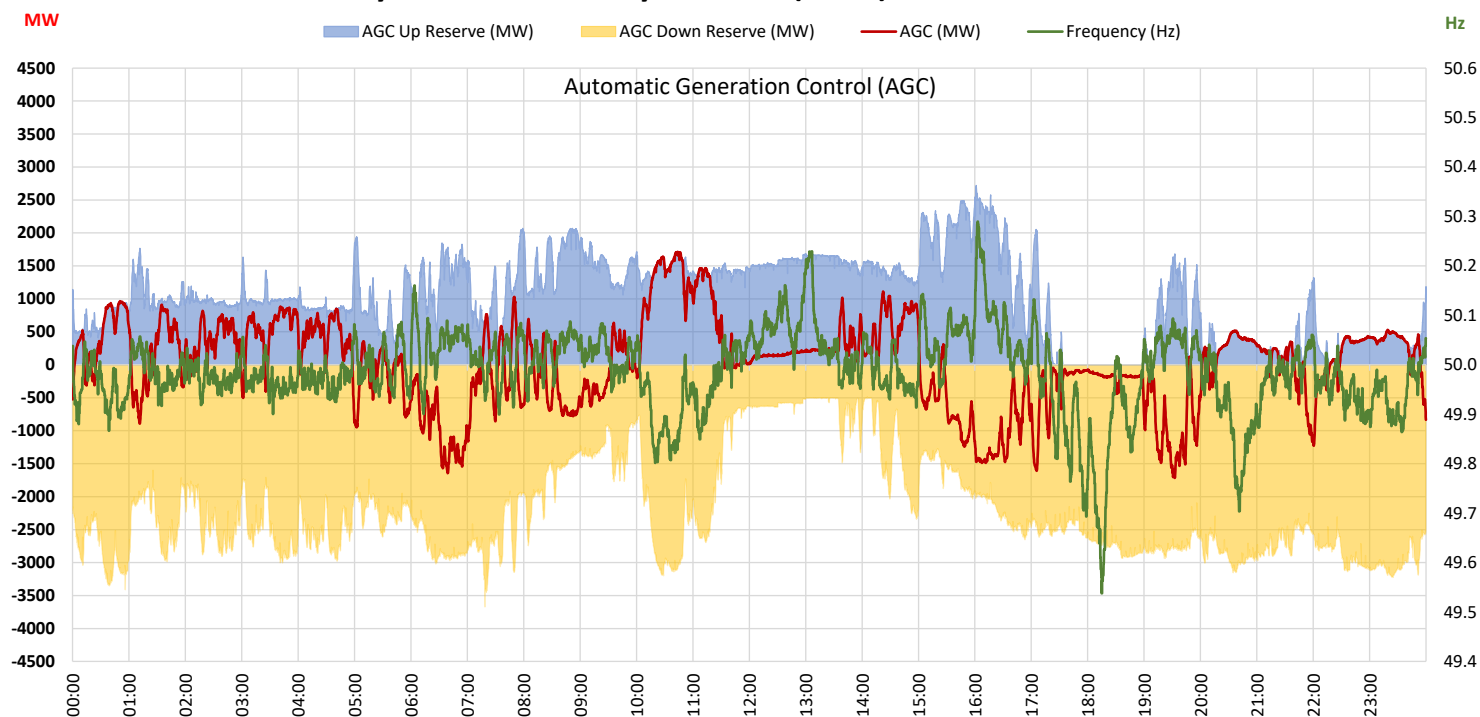

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	6407	-5892	1714	-1716	21
TRAS:	25315	-22748	5500	-5999	107
SRAS+TRAS:	31723	-28640	4823	-5799	128