


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 26/10/2025

Reserve Profile for 26-10-2025

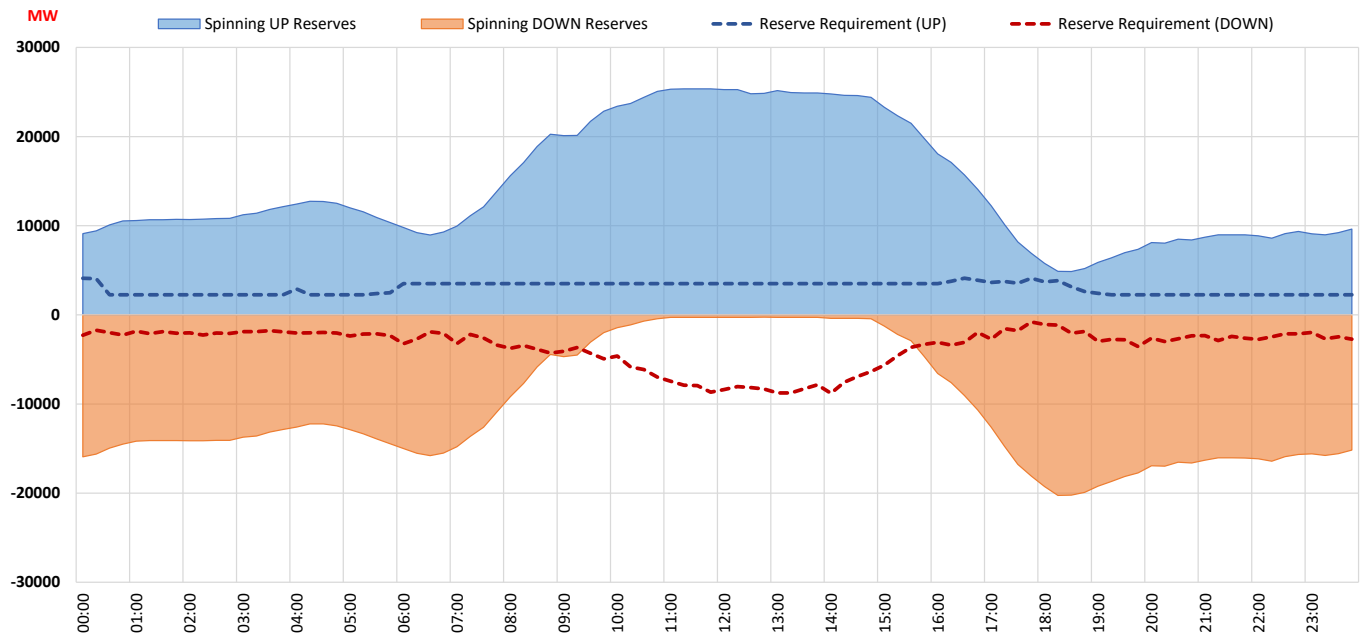


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 26-10-2025

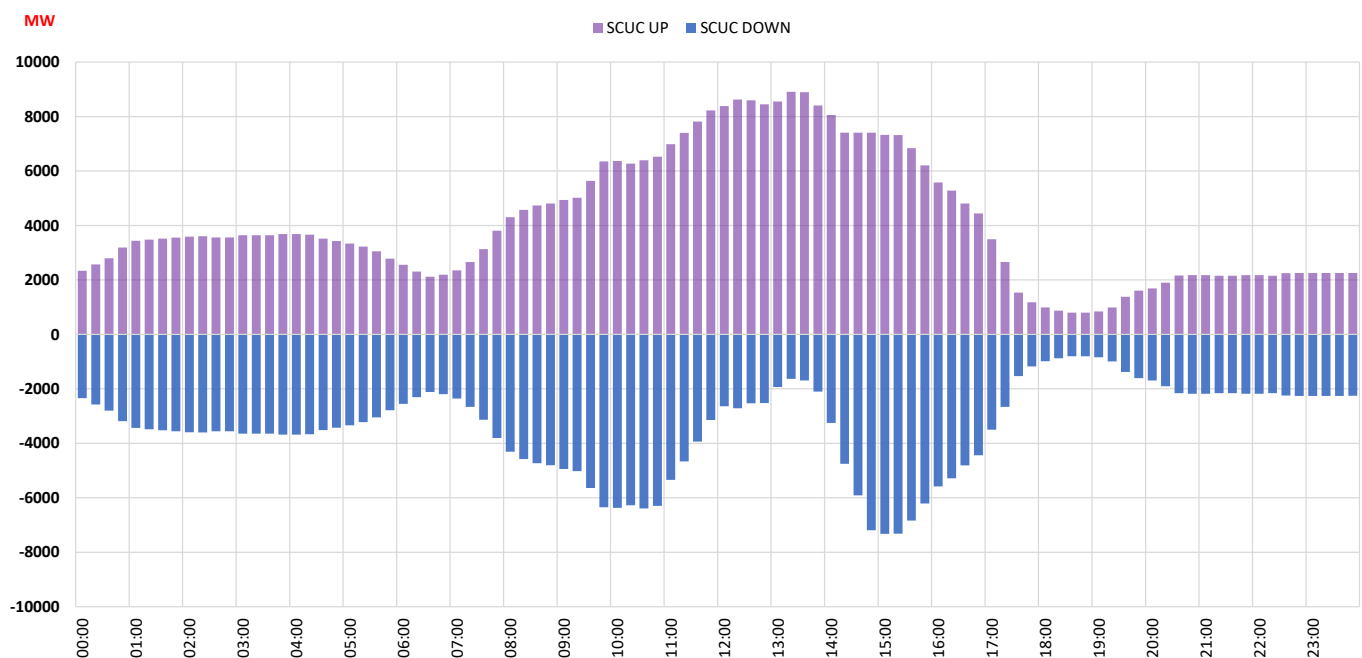


SCUC-Up Scheduled (MWh)	99111
SCUC-Down Scheduled (MWh)	-80663

Tertiary Reserve Ancillary Services (TRAS) Despatched for 26-10-2025

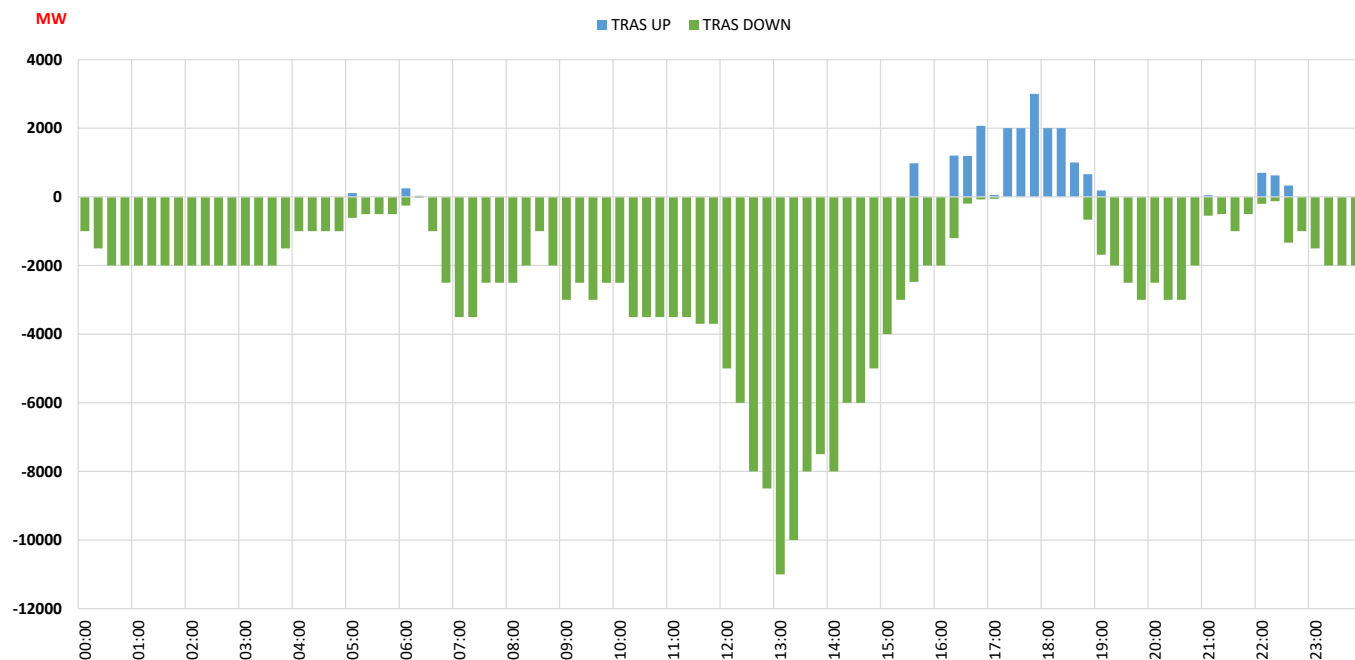

Secondary Reserve Ancillary Services (SRAS) Profile for 26-10-2025

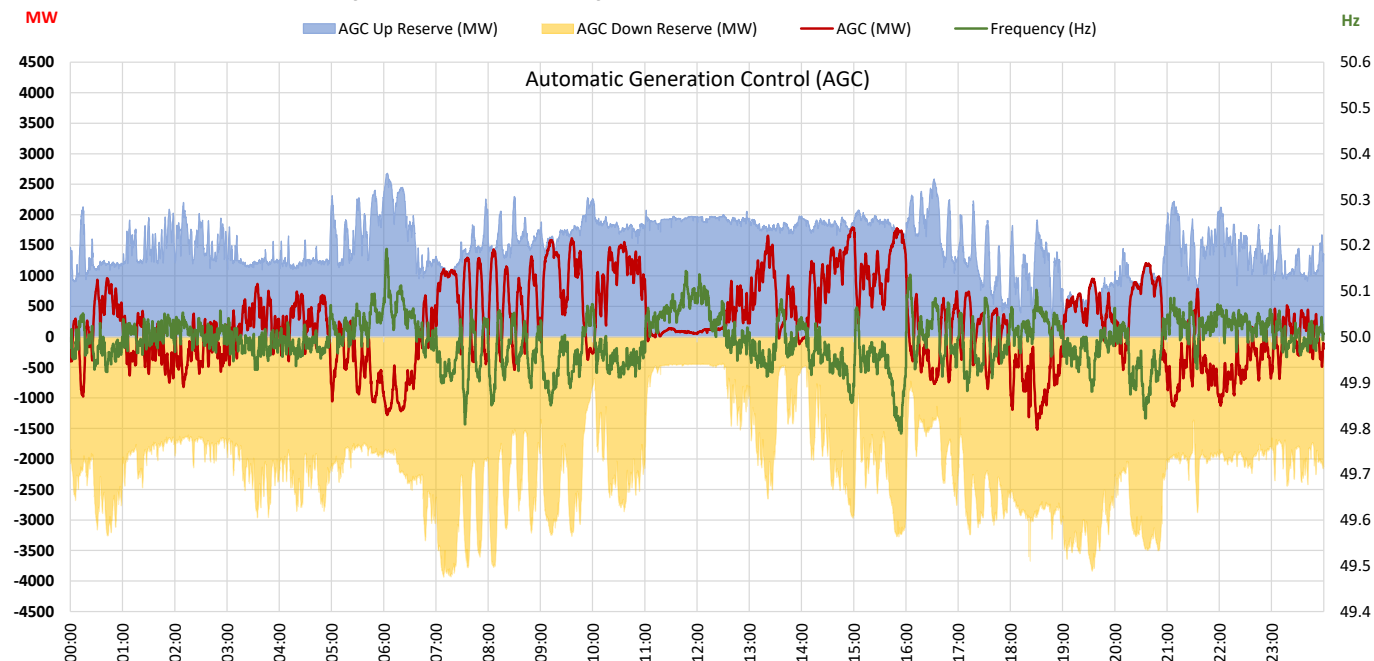

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	9233	-4232	1794	-1520	208
TRAS:	4000	-57595	3000	-10999	-2233
SRAS+TRAS:	13233	-61827	10570	-720	4338