


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 28/10/2025

Reserve Profile for 28-10-2025

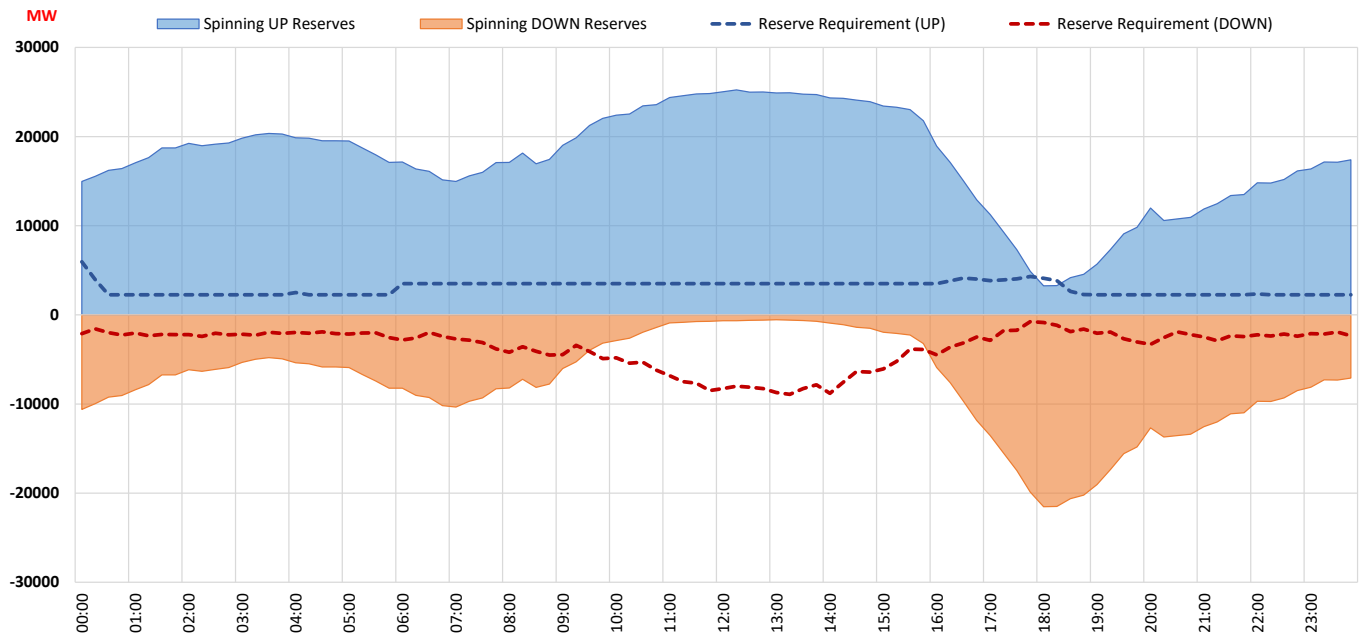


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 28-10-2025

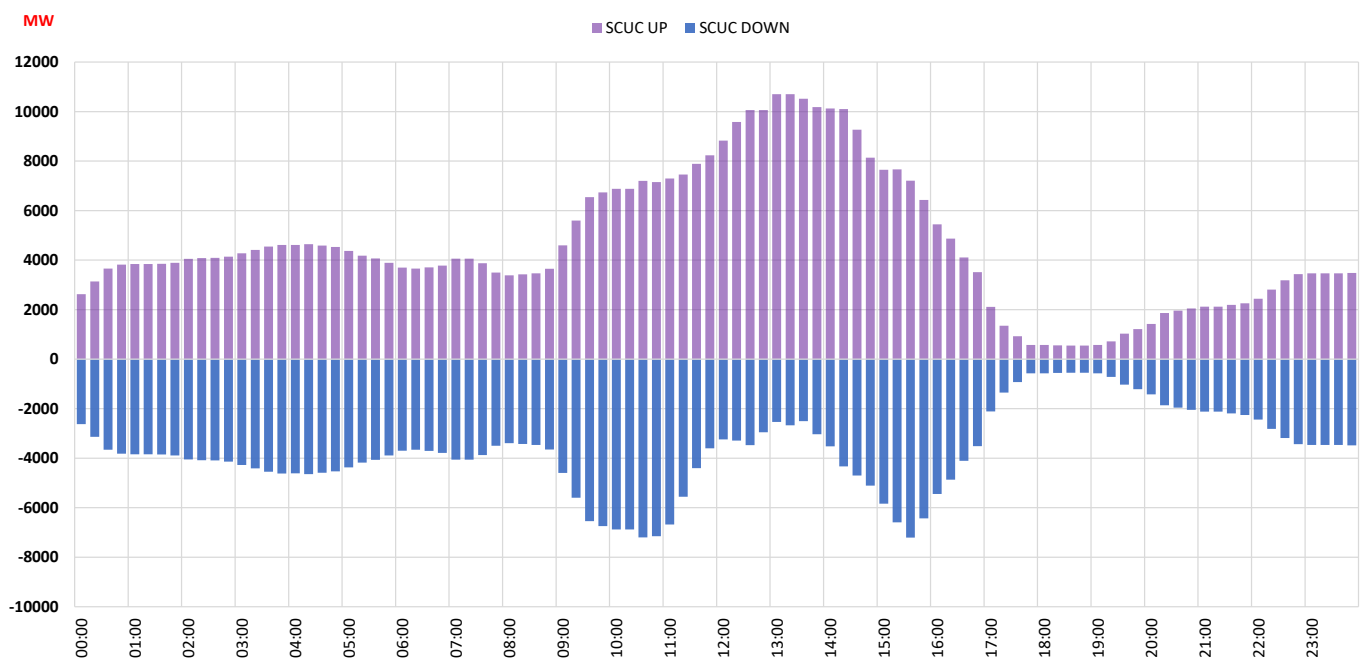


SCUC-Up Scheduled (MWh)	110525
SCUC-Down Scheduled (MWh)	-87911

Tertiary Reserve Ancillary Services (TRAS) Despatched for 28-10-2025

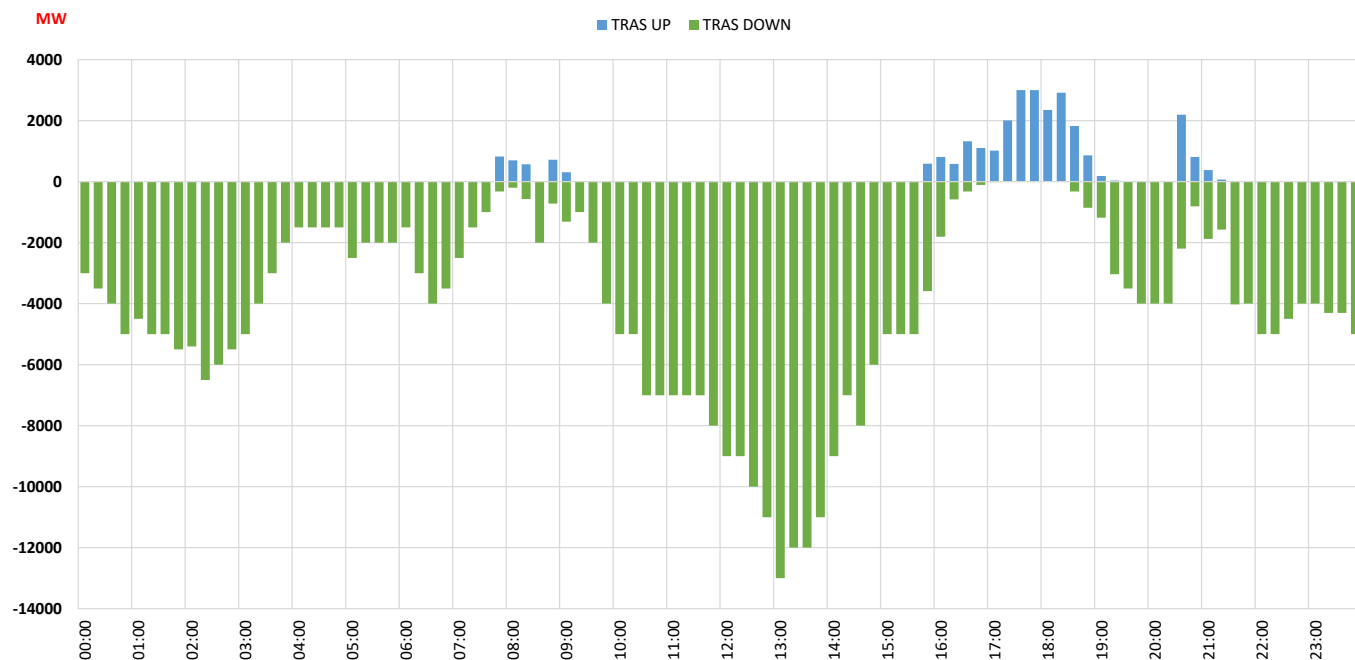

Secondary Reserve Ancillary Services (SRAS) Profile for 28-10-2025

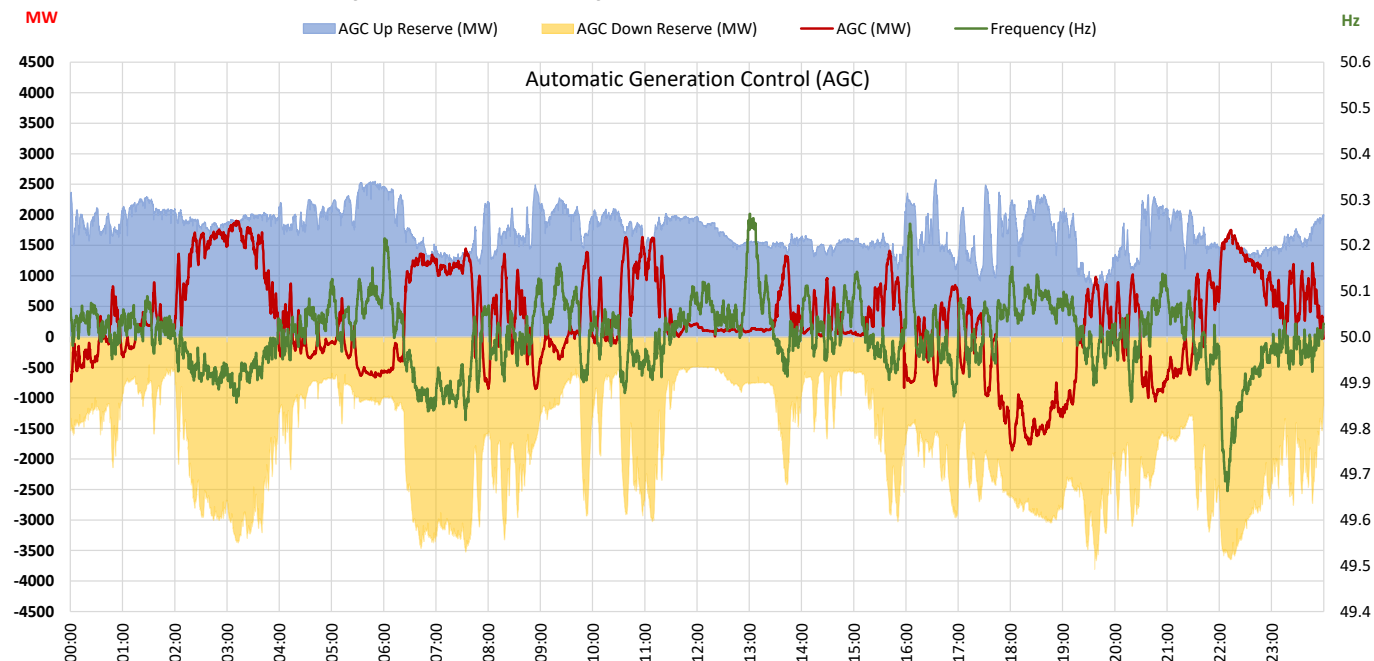

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	10614	-4308	1901	-1857	263
TRAS:	4692	-92496	3000	-12999	-3658
SRAS+TRAS:	15306	-96804	11851	-1285	4868