


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 03/11/2025

Reserve Profile for 03-11-2025

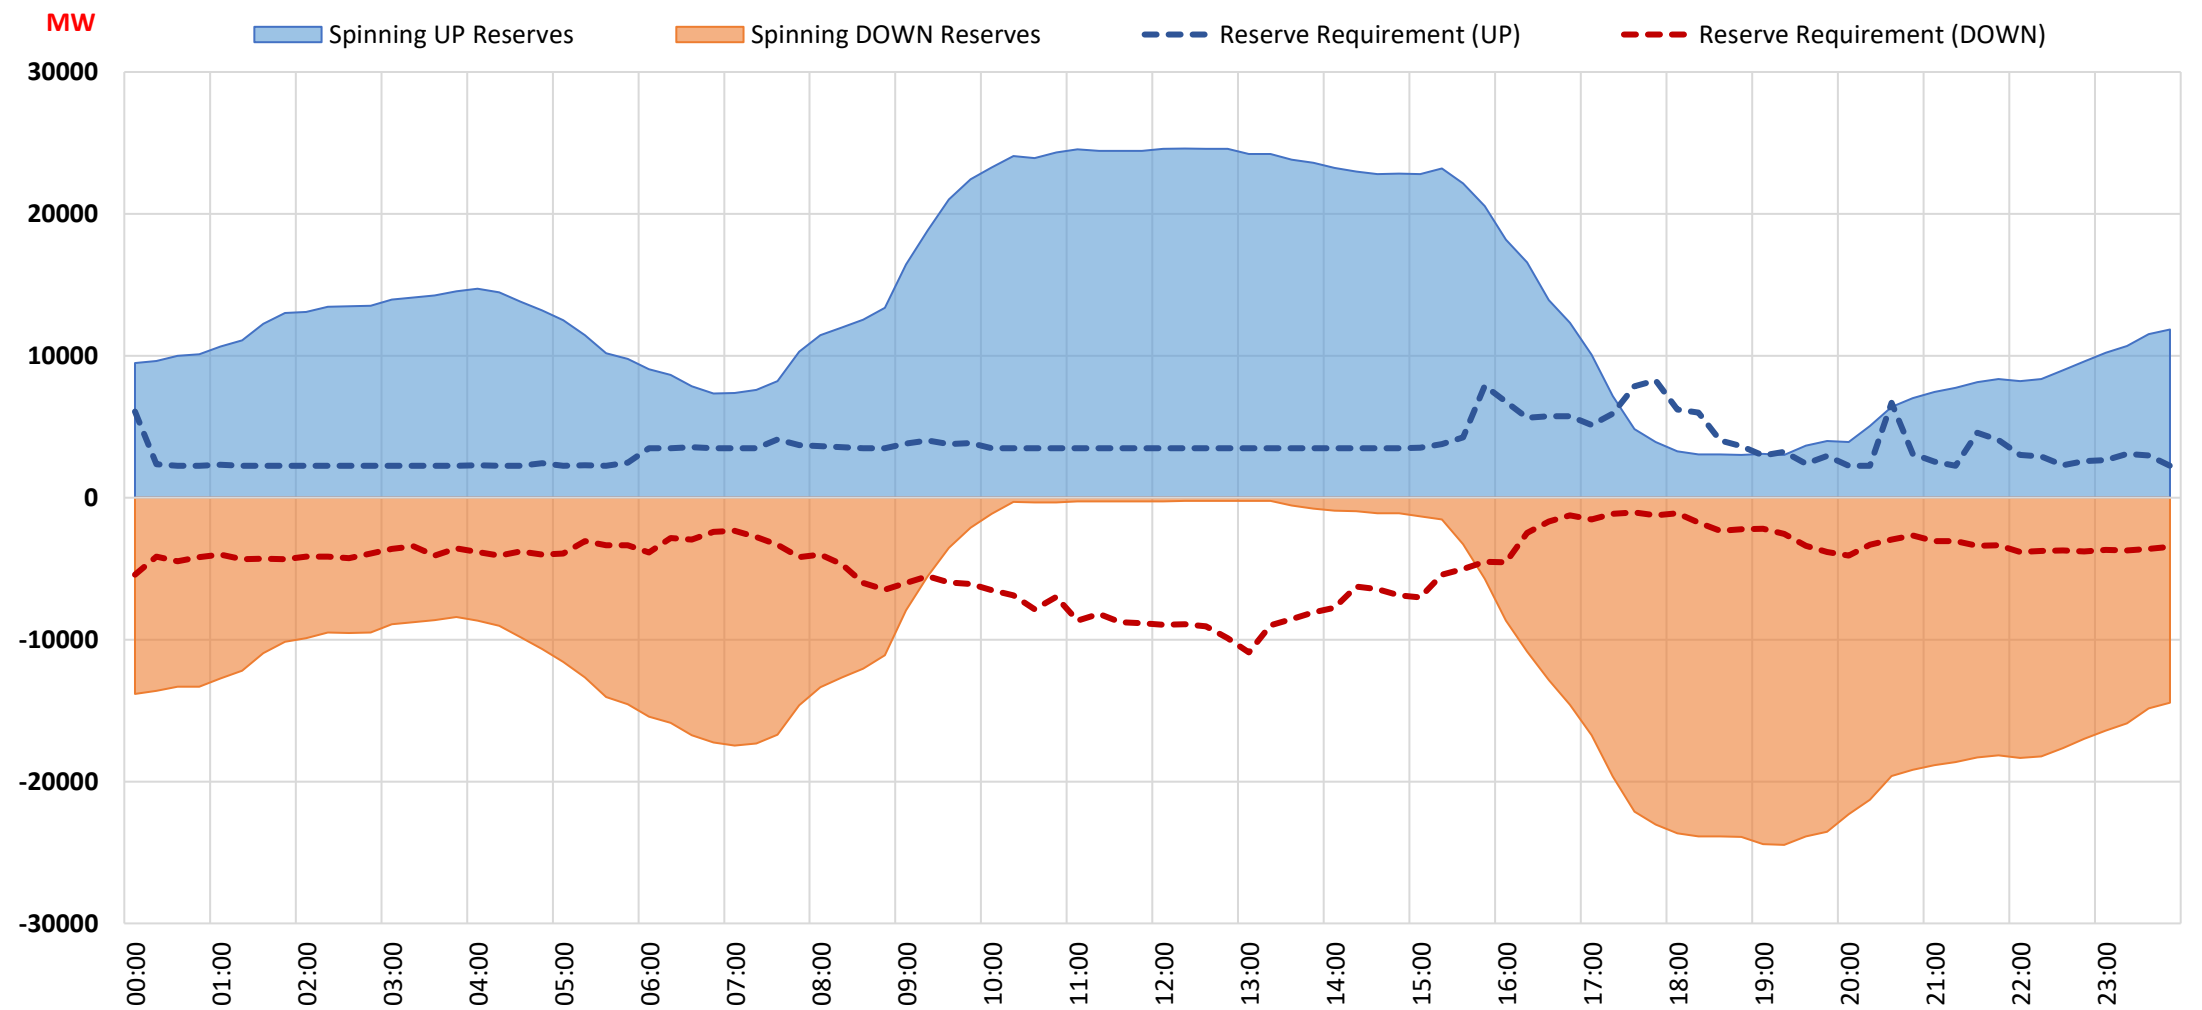


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 03-11-2025

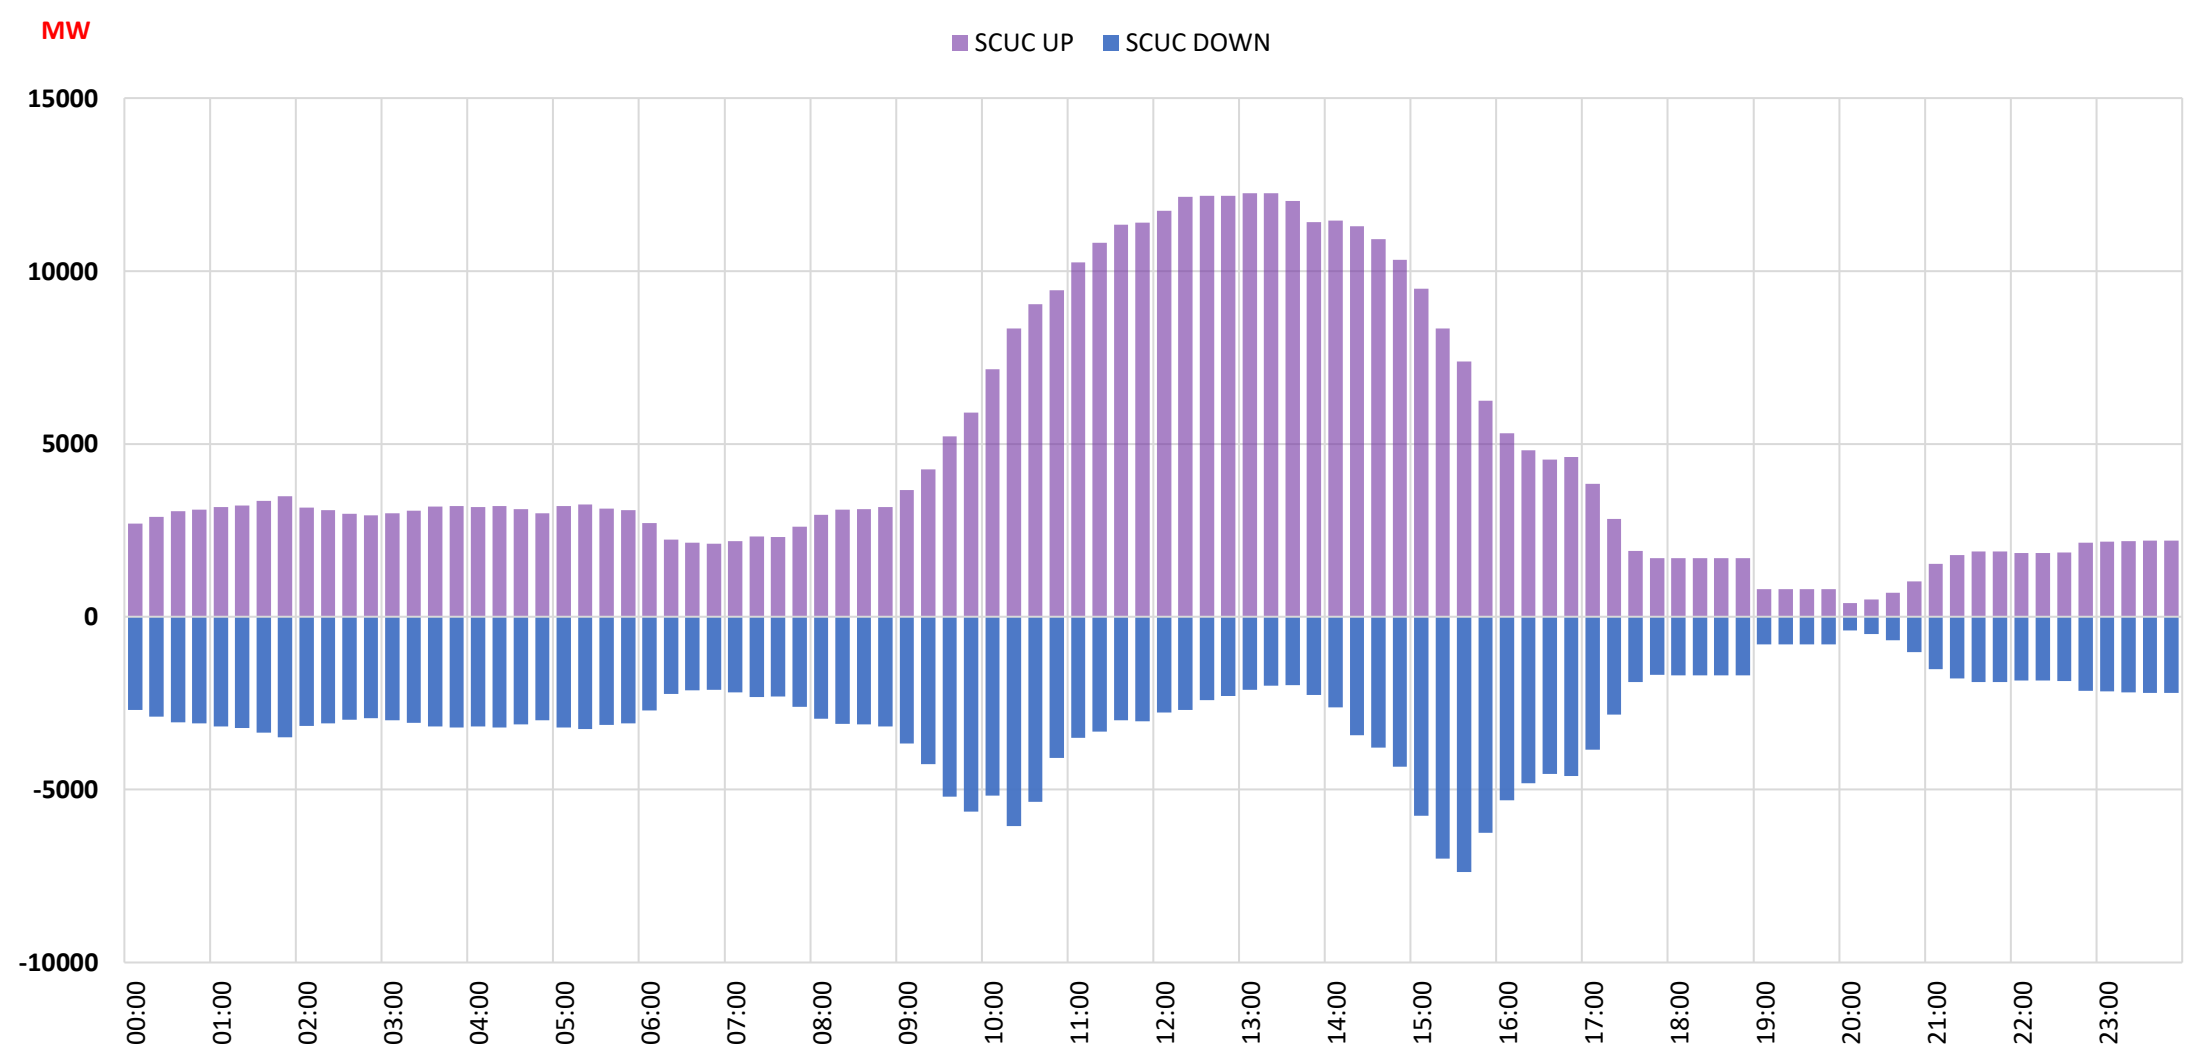


SCUC-Up Scheduled (MWh)	109936
SCUC-Down Scheduled (MWh)	-70676

Tertiary Reserve Ancillary Services (TRAS) Despatched for 03-11-2025

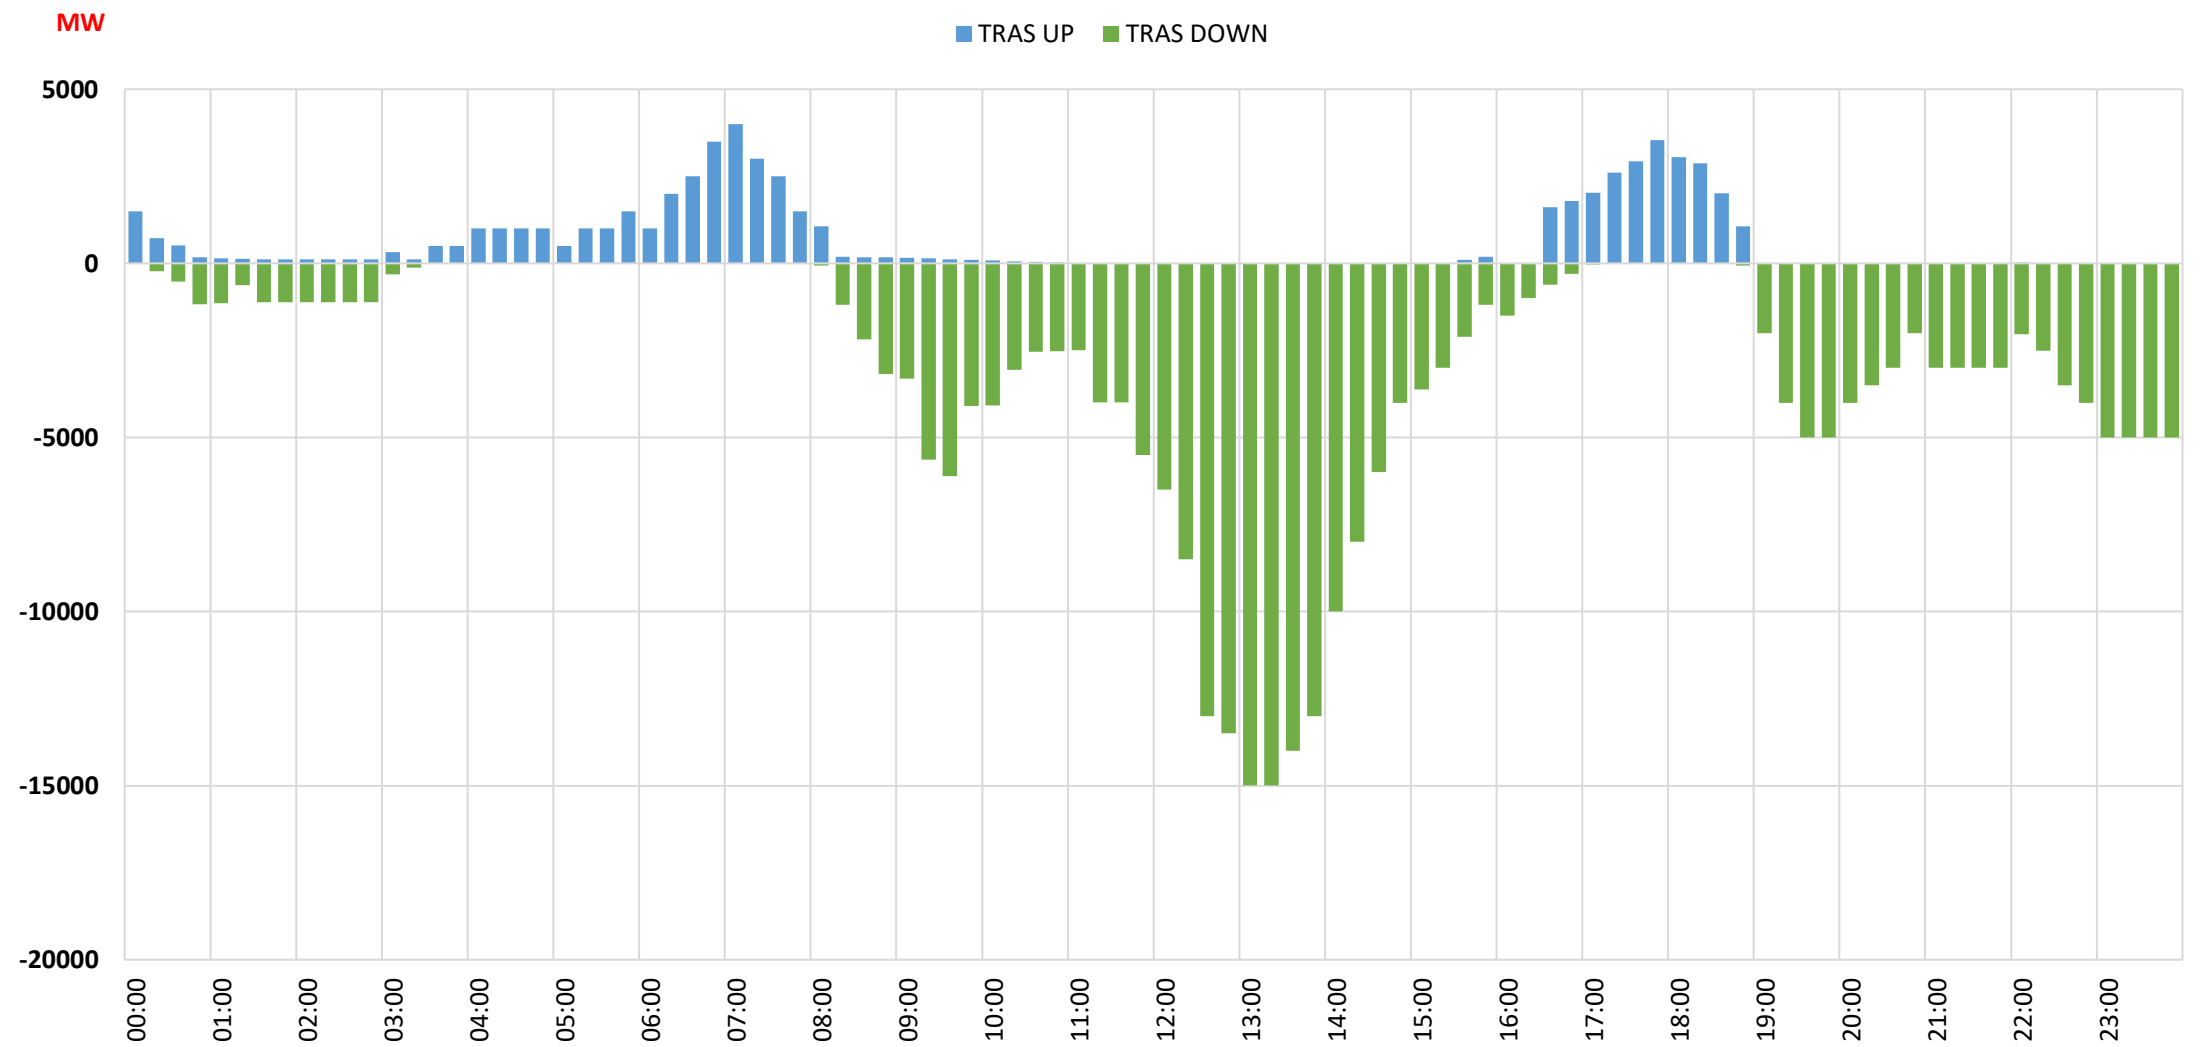

Secondary Reserve Ancillary Services (SRAS) Profile for 03-11-2025

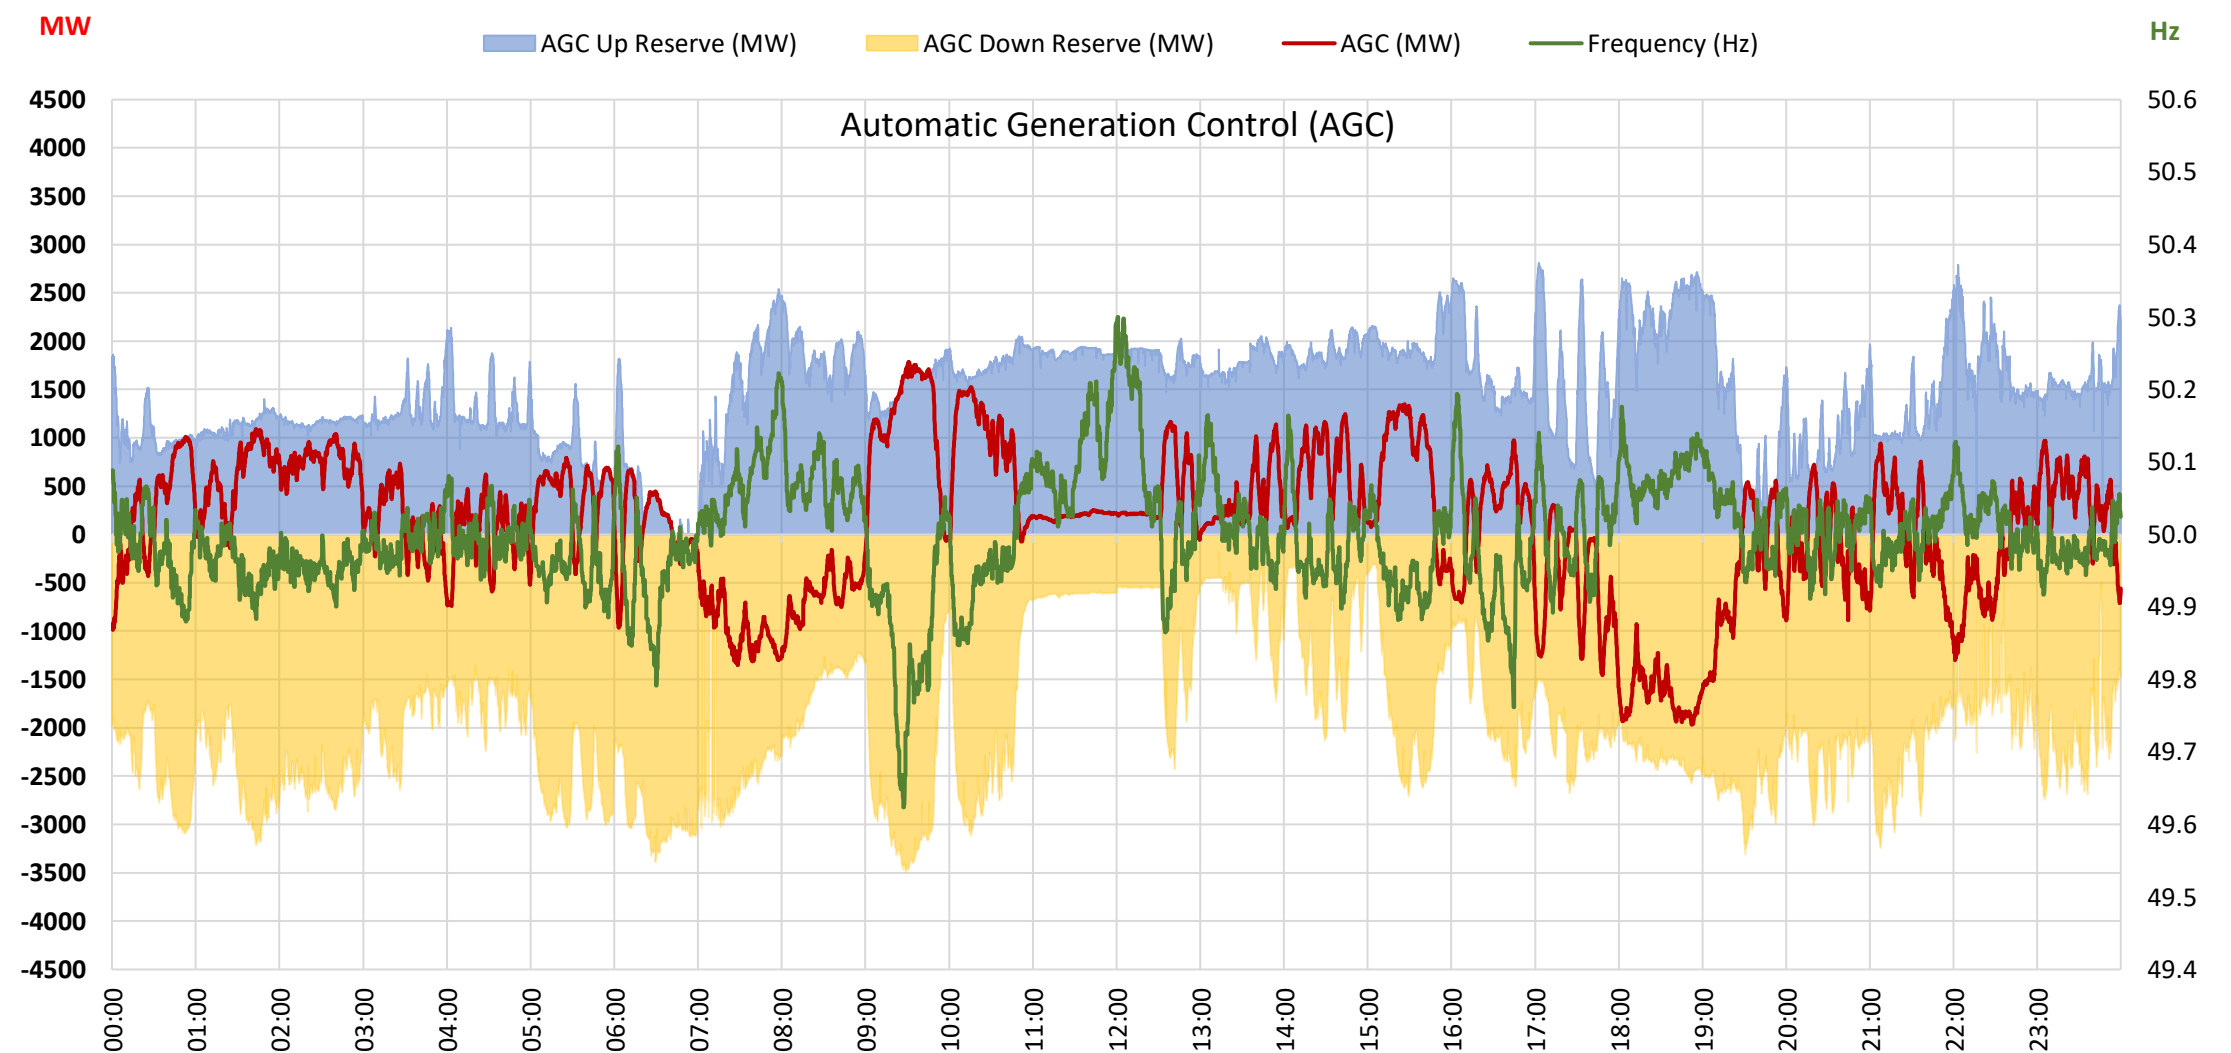

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	8404	-5955	1784	-1970	102
TRAS:	13602	-68062	4000	-14999	-2269
SRAS+TRAS:	22006	-74016	3744	-14993	-2167