


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 30/10/2025

Reserve Profile for 30-10-2025

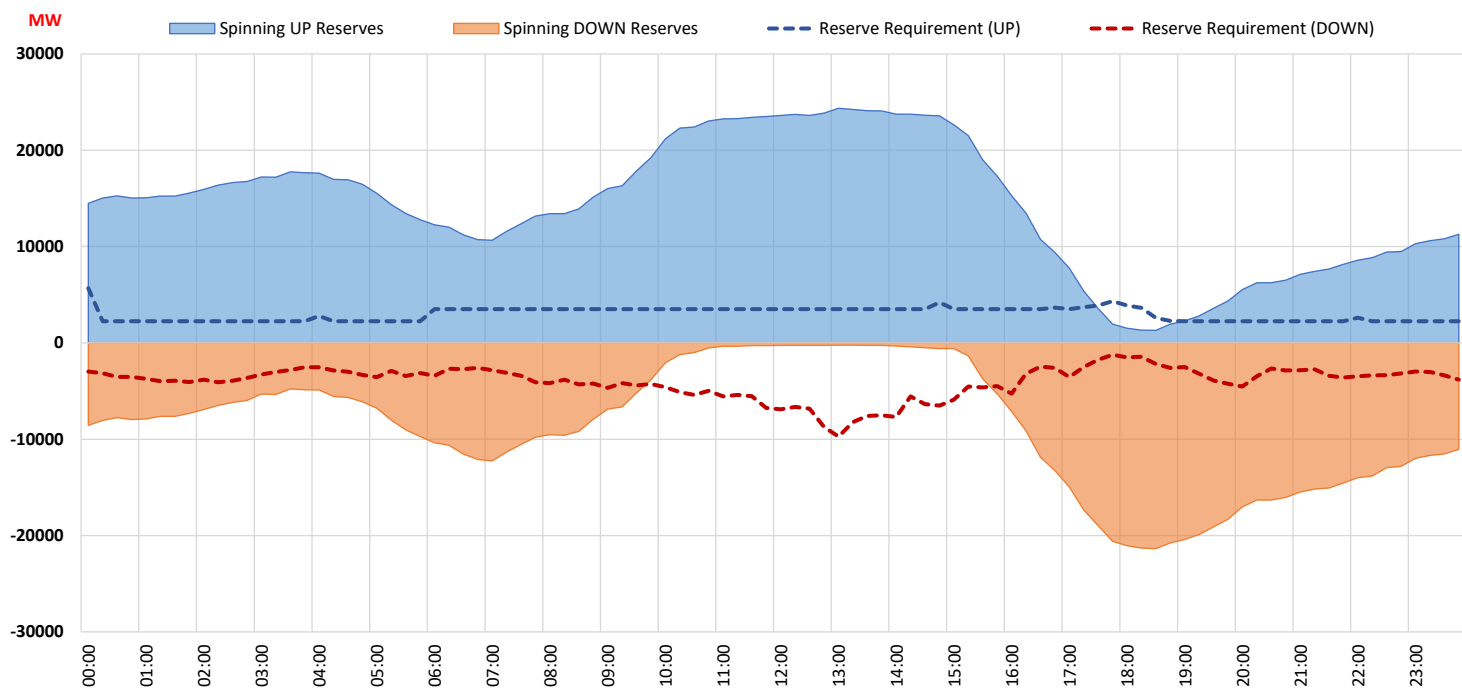


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 30-10-2025

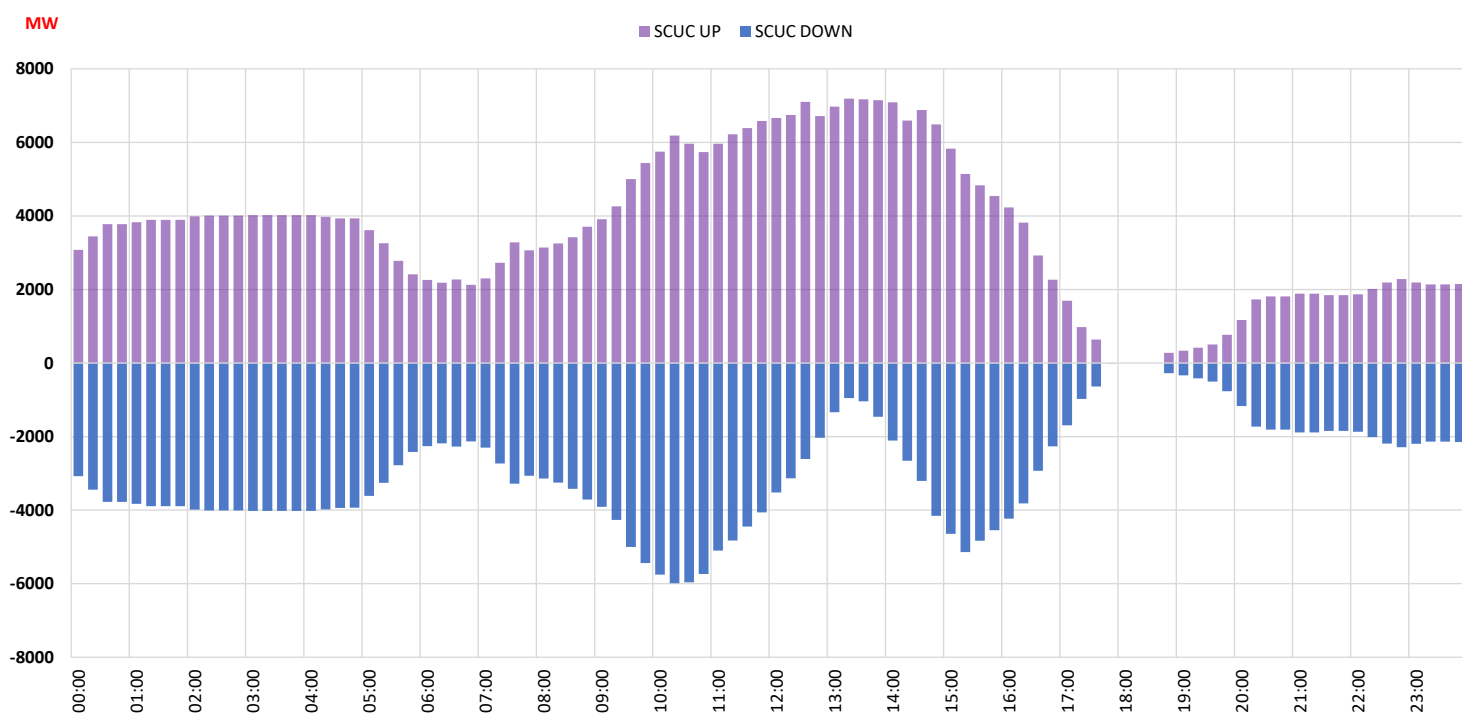


SCUC-Up Scheduled (MWh)	85921
SCUC-Down Scheduled (MWh)	-70255

Tertiary Reserve Ancillary Services (TRAS) Despatched for 30-10-2025

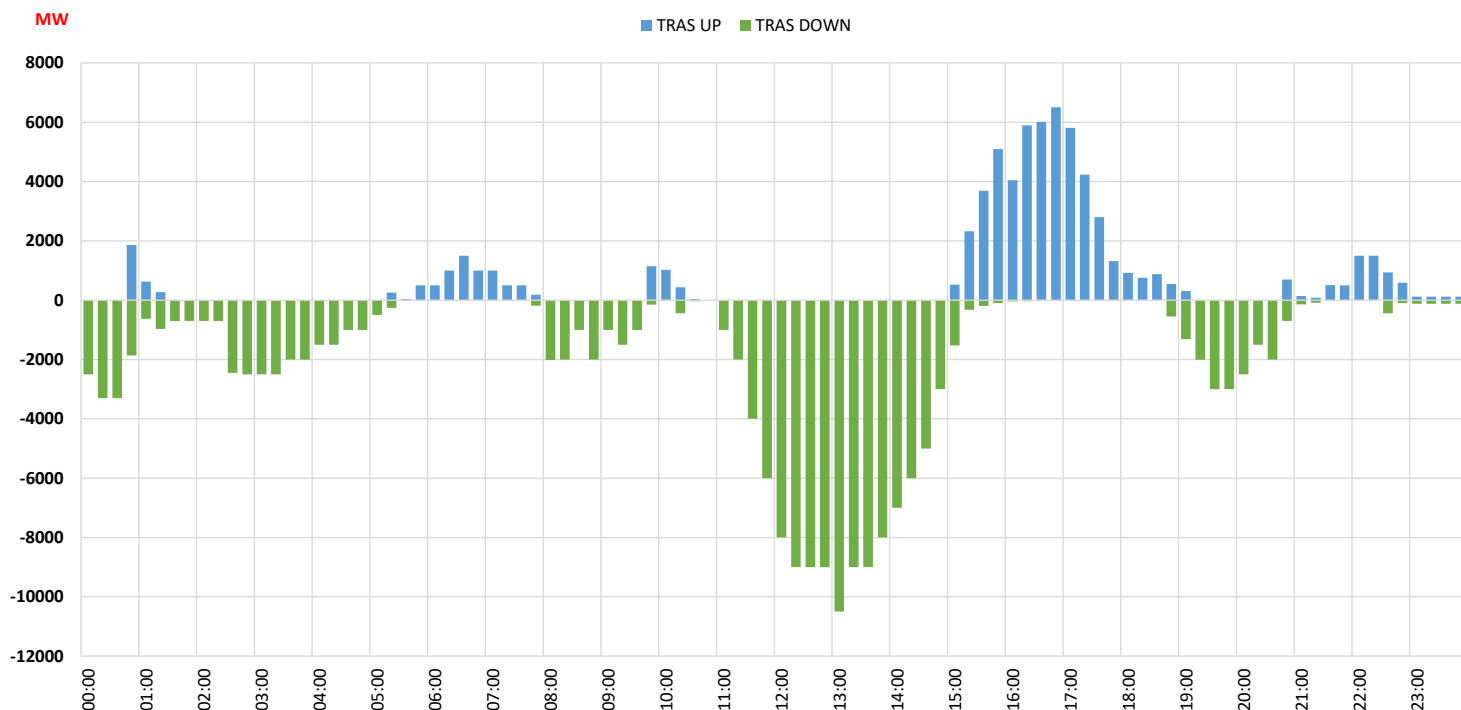

Secondary Reserve Ancillary Services (SRAS) Profile for 30-10-2025

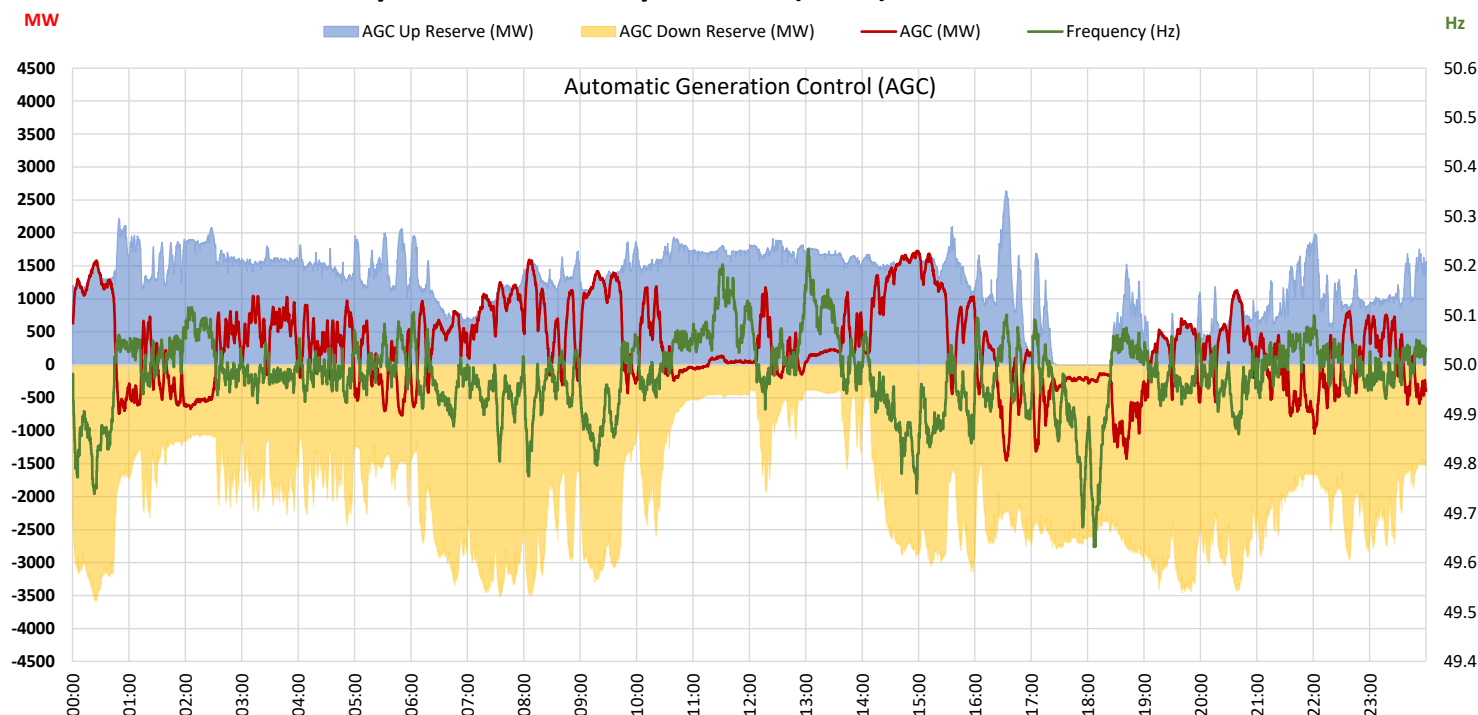

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	9671	-3206	1728	-1451	269
TRAS:	15767	-41010	6500	-10499	-1052
SRAS+TRAS:	25439	-44216	6725	-10461	-782