


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 05/11/2025

Reserve Profile for 05-11-2025

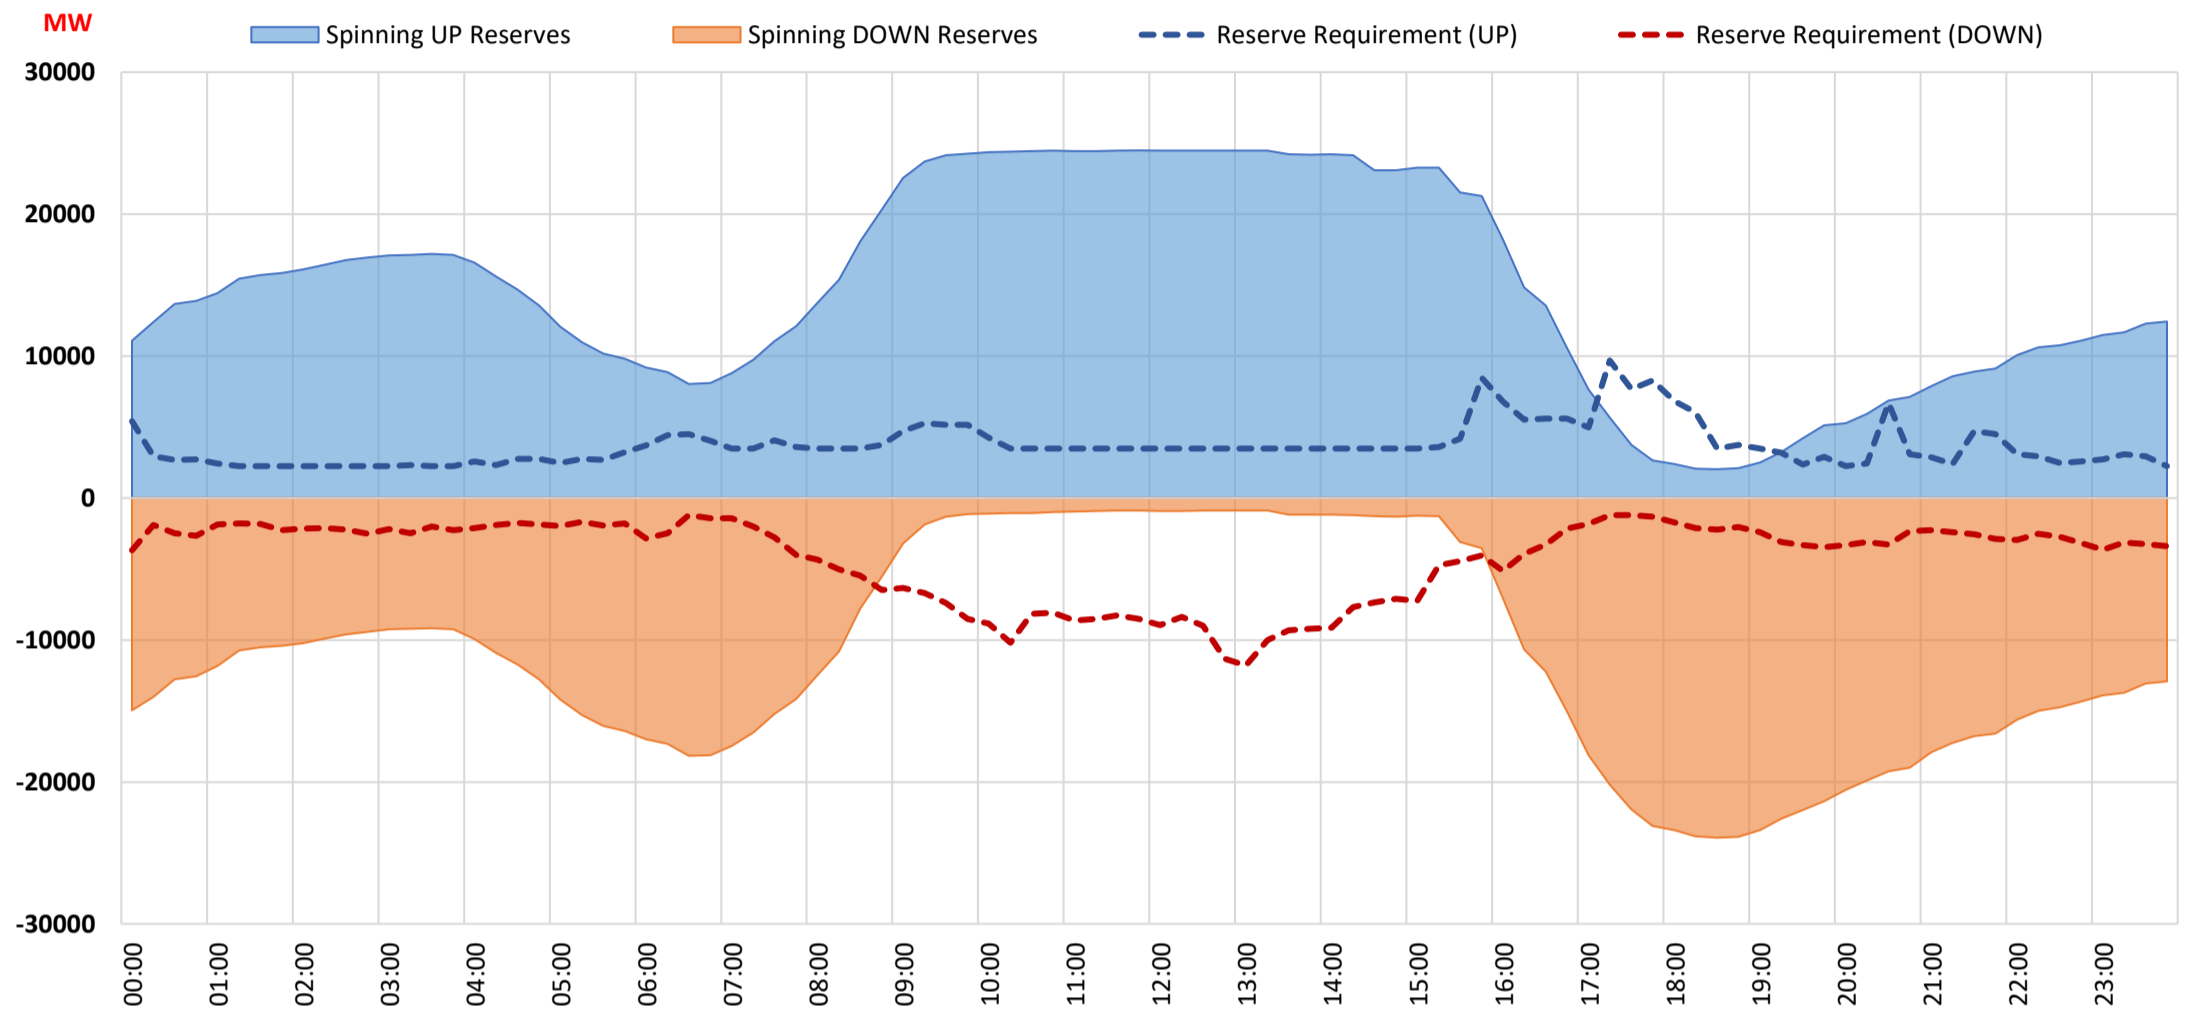


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 05-11-2025

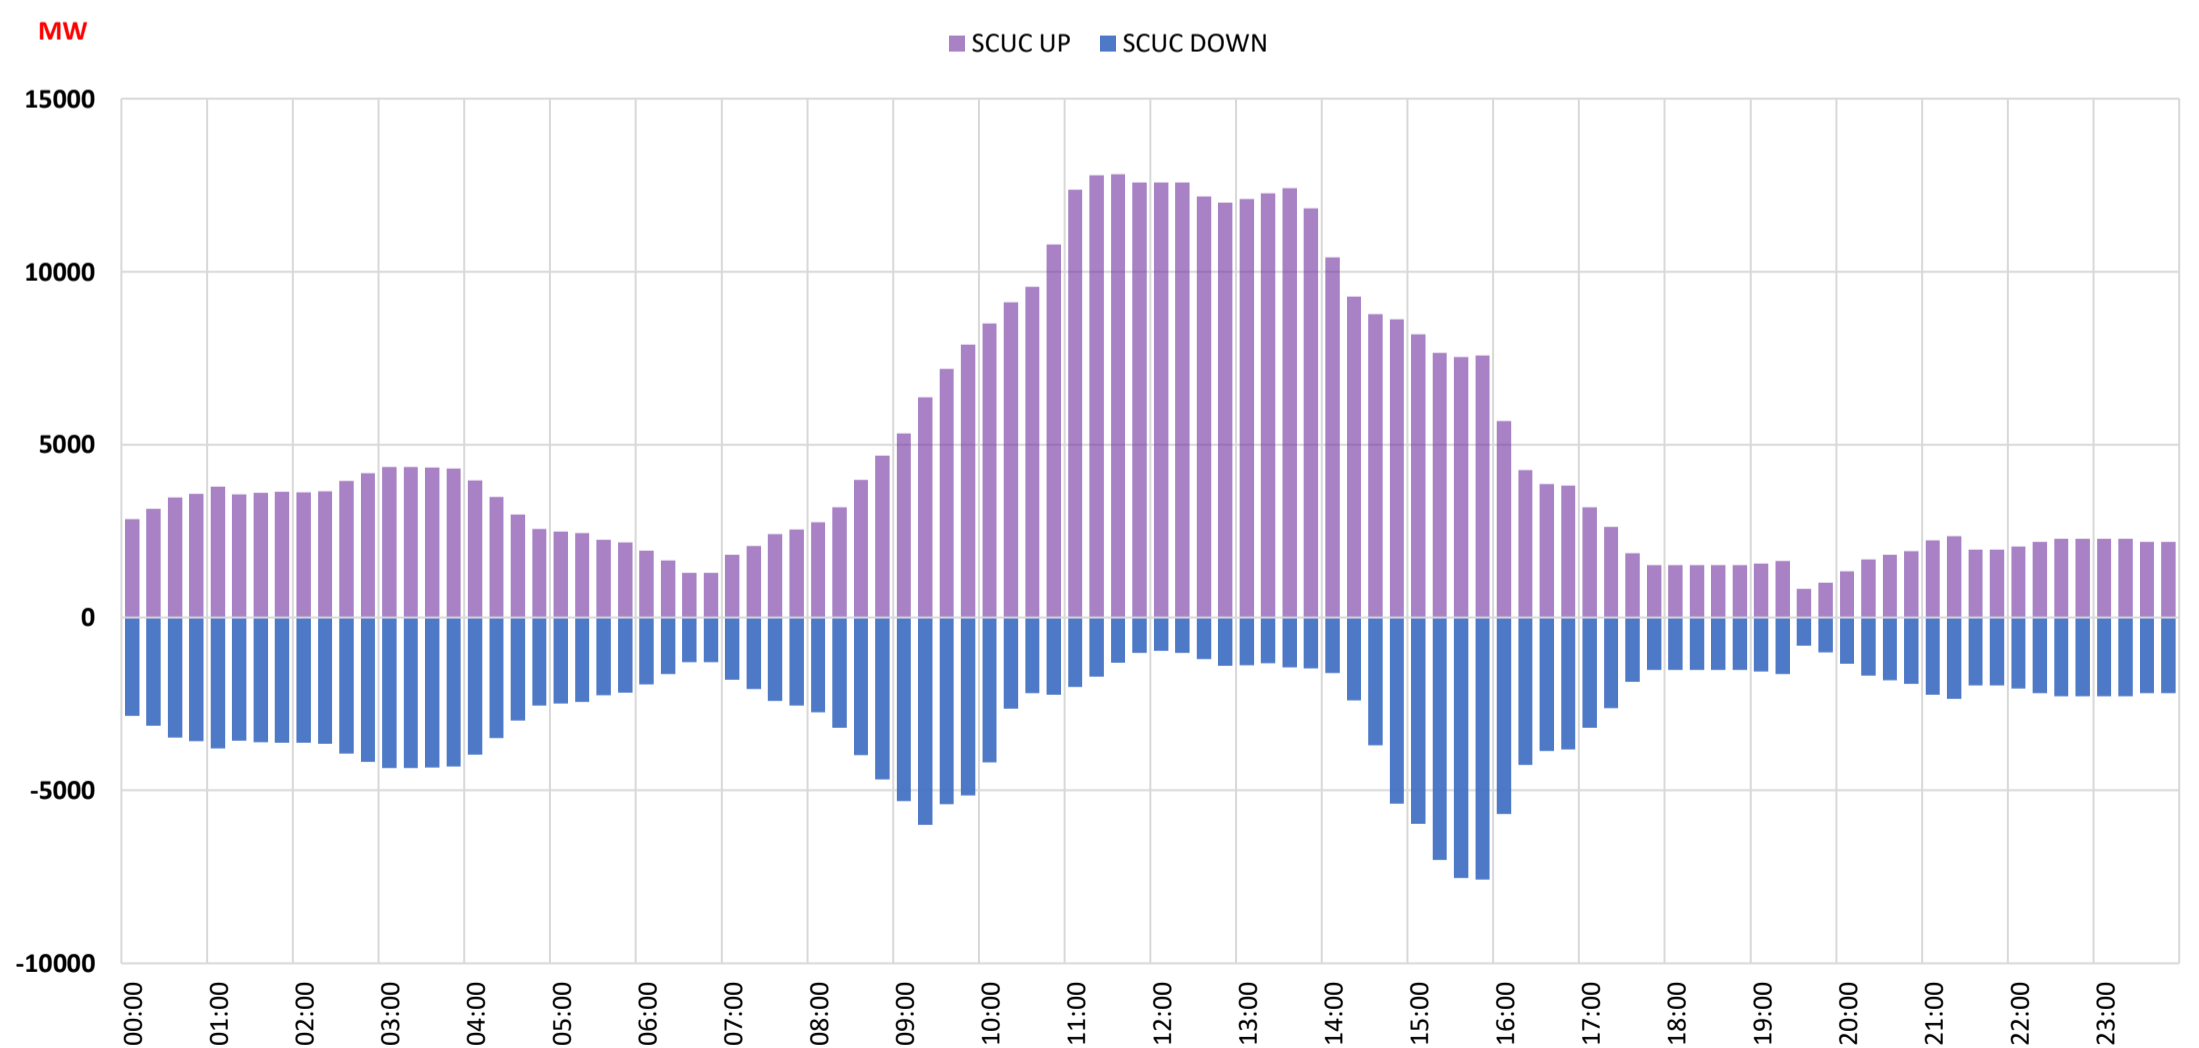


SCUC-Up Scheduled (MWh)	116099
SCUC-Down Scheduled (MWh)	-68418

Tertiary Reserve Ancillary Services (TRAS) Despatched for 05-11-2025

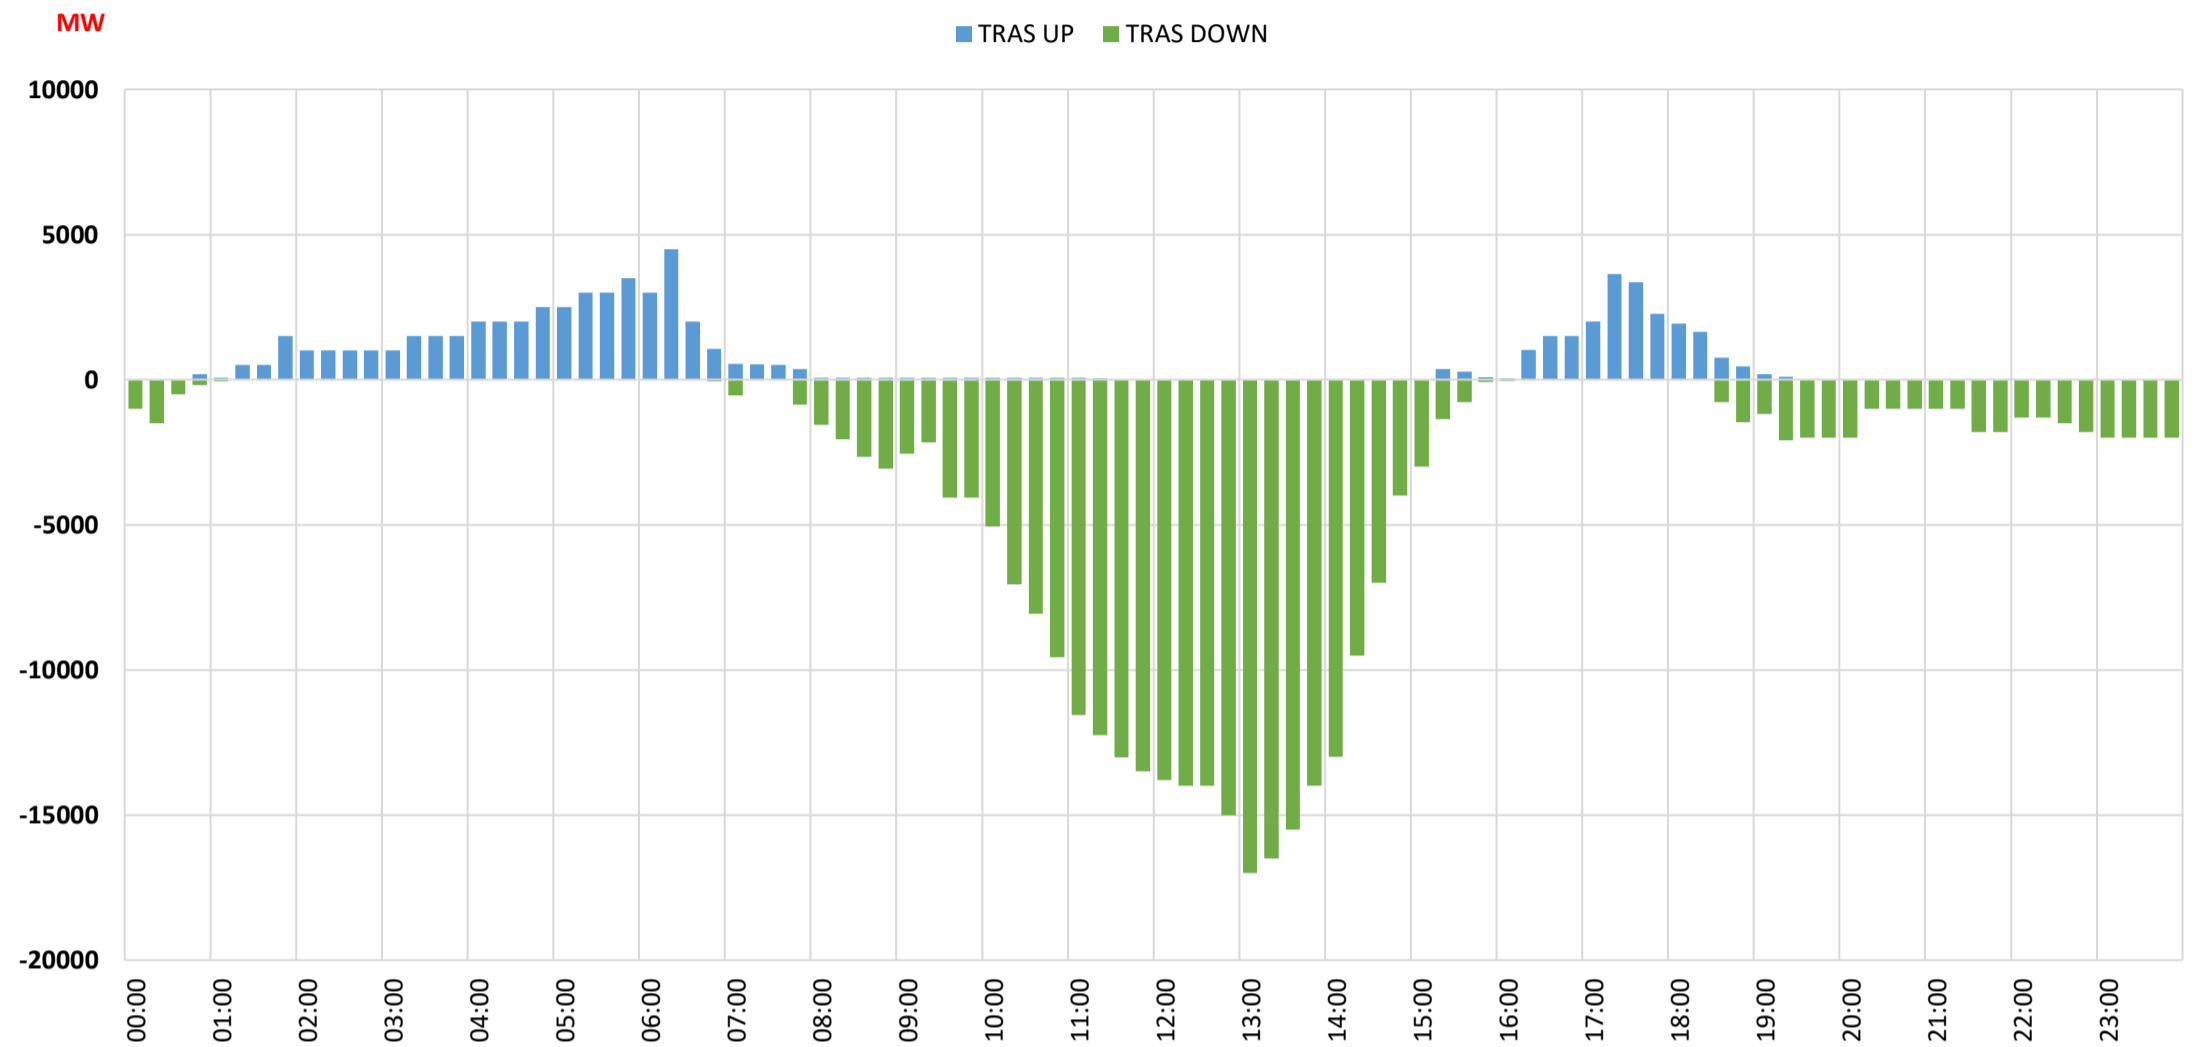

Secondary Reserve Ancillary Services (SRAS) Profile for 05-11-2025

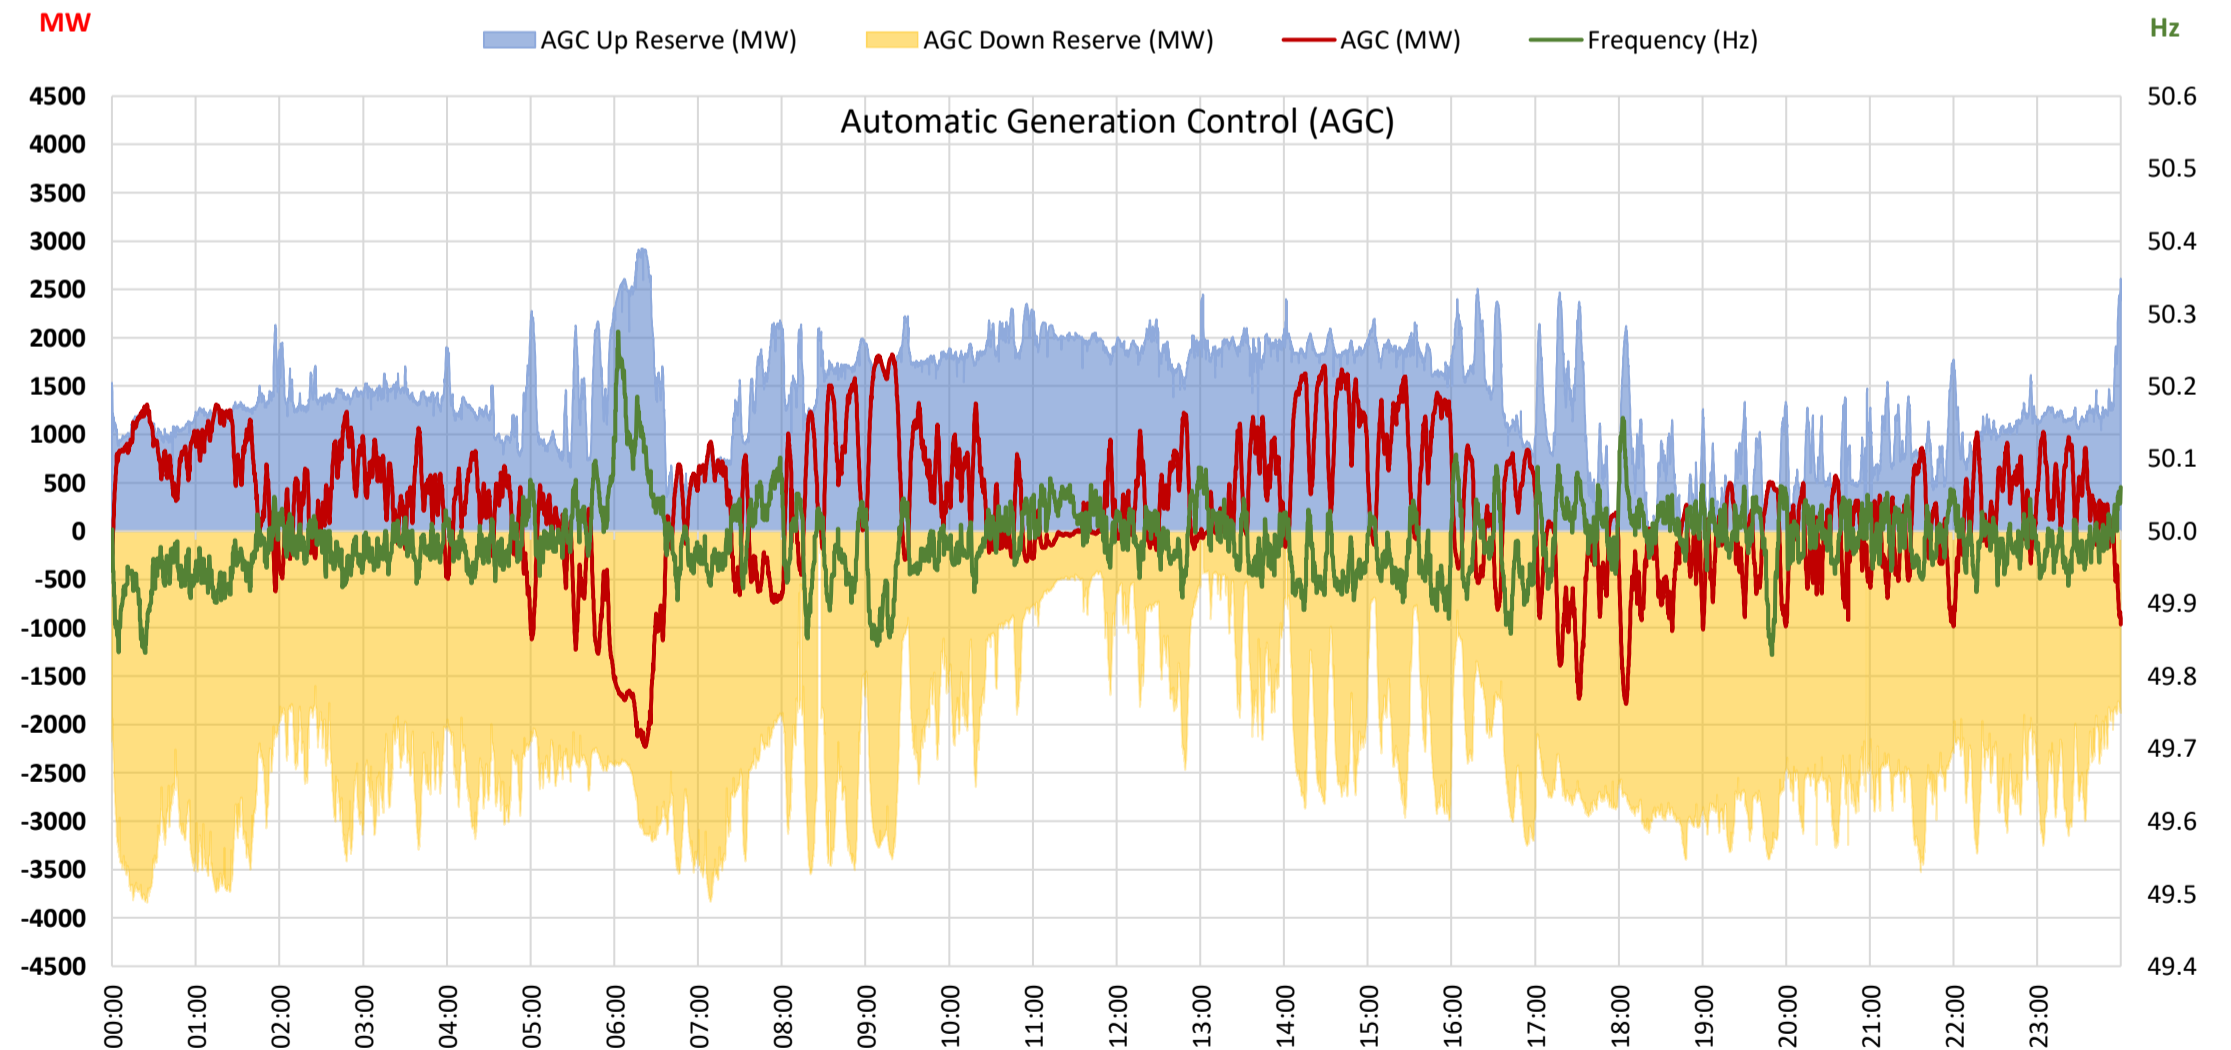

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	9589	-3973	1825	-2232	234
TRAS:	15710	-73794	4500	-16999	-2420
SRAS+TRAS:	25299	-77767	3640	-17071	-2186