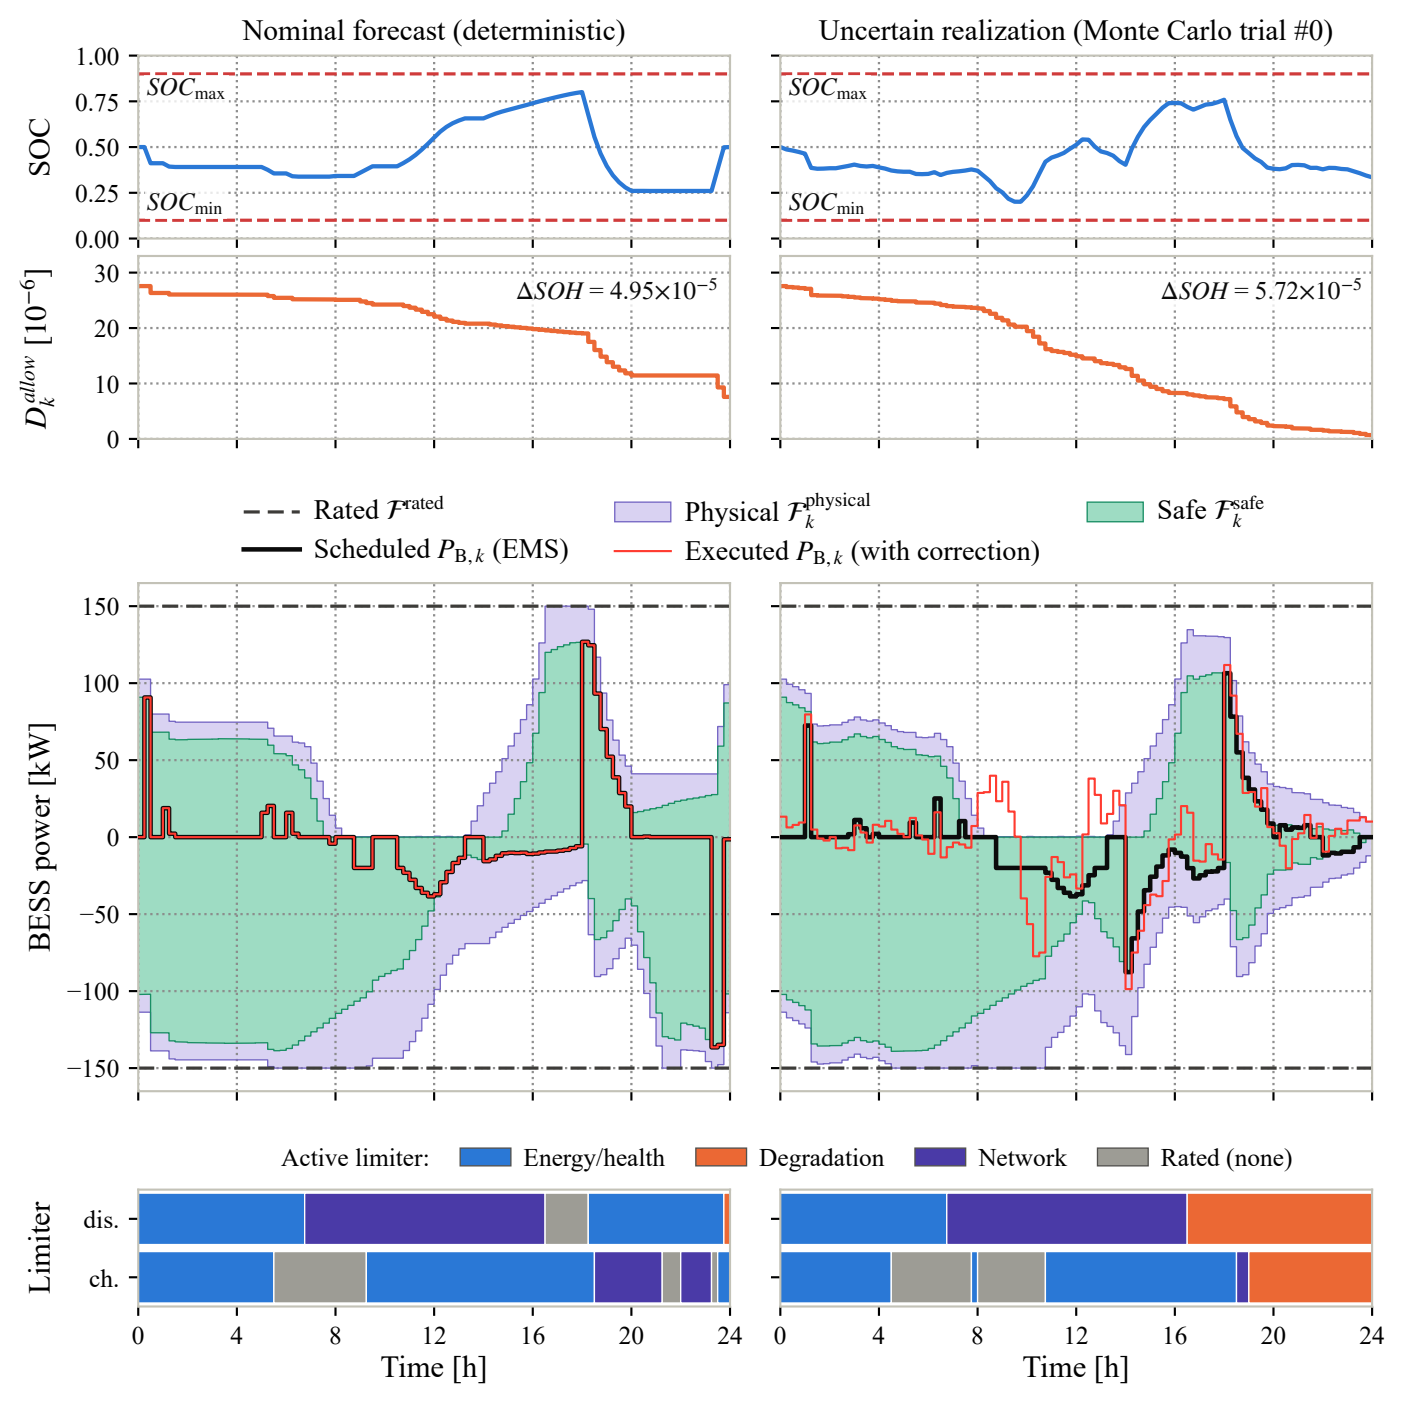

Nominal forecast (deterministic)
Uncertain realization (Monte Carlo trial #0)
SOC
SOC_{max}
SOC_{min}
1.00
0.75
0.50
0.25
0.00
D_k^{allow} [10^{-6}]
30
20
10
0
$\Delta SOH = 4.95\times10^{-5}$
$\Delta SOH = 5.72\times10^{-5}$
Rated $\mathcal{F}^{rated}$
Scheduled $P_{B,k}$ (EMS)
Physical $\mathcal{F}_k^{physical}$
Executed $P_{B,k}$ (with correction)
Safe $\mathcal{F}_k^{safe}$
BESS power [kW]
150
100
50
0
−50
−100
−150
Active limiter:
Energy/health
Degradation
Network
Rated (none)
Limiter
dis.
ch.
0
4
8
12
16
20
24
Time [h]
Time [h]