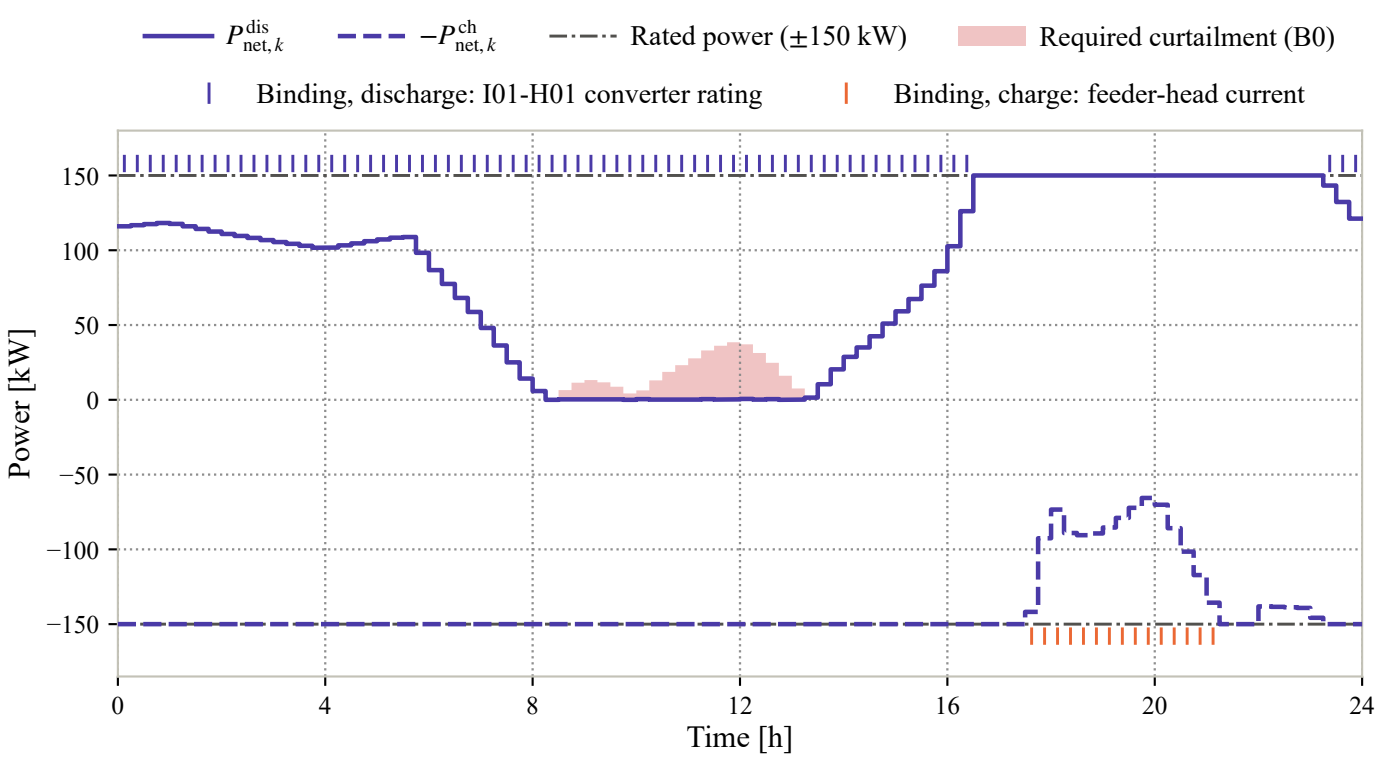
$P^{\mathrm{dis}}_{\mathrm{net},k}$
$-P^{\mathrm{ch}}_{\mathrm{net},k}$
Rated power (±150 kW)
Required curtailment (B0)
Binding, discharge: I01-H01 converter rating
Binding, charge: feeder-head current
150
100
50
0
−50
−100
−150
Power [kW]
0
4
8
12
16
20
24
Time [h]