

F. WATERTIGHT CONSTRUCTION:

1. THE FOLLOWING STRUCTURAL ELEMENTS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS
- A. INSITU PLANTERS
B. LANDSCAPE AREAS
2. WATER TANK SLAB AND WALLS SHALL BE COATED WITH A CEMENTITIOUS FLEXIBLE COATING. THE MATERIAL SHALL BE NON-TOXIC AND NON-HAZARDOUS.
3. WATER BARS AND SEALANTS SHALL BE FROM SERVICISED LTD OR EQUAL APPROVED

G. MANHOLES, SUMPS AND WATER TANKS.

1. THE LATEST DM STANDARD SPECIFICATIONS FOR GRP LINING SHALL BE APPLIED TO THE FOLLOWING:
- A. ALL INTERNAL SURFACES OF SEWERAGE MANHOLES AND HOUSE CONNECTION CHAMBERS.
B. FOULWATER / STORMWATER SUMPS BENCHING.
C. WATER TANKS (EXCEPT DRINKING WATER TANKS, CEMENTITIOUS FLEXIBLE COATING SHALL BE USED).
2. FOR MATERIAL REQUIREMENTS REFER TO ARCHITECTURAL SPECIFICATIONS.

H. BLOCKWORK

1. BLOCKWORK (ALL LIGHT WEIGHT, DRY WALL PARTITIONS AND HOLLOW BLOCKS SHALL COMPLY WITH THE REQUIREMENTS OF THE LOCAL MUNICIPALITY.)
- A. ALL SUPERSTRUCTURE PARTITIONS SHALL BE LIGHT WEIGHT PARTITIONS WITH UNIT WEIGHT NOT MORE THAN 6.00 KN/M³ AS PER ARCHITECTURAL DRAWINGS.
B. ALL LIGHT WEIGHT BLOCK WORKS SHALL BE NON LOAD BEARING. BLOCK WORKS FOR LOAD BEARING WALLS SHALL BE IN SOLID BLOCKS.
C. JOINTS BETWEEN NON LOAD BEARING BLOCK WORK AND SUSPENDED SLABS OR BEAMS TO HAVE 25mm COMPRESSIBLE JOINT FILLER.
E. QUALITY OF CONCRETE BLOCKS SHALL BE AS FOLLOWS:
MINIMUM CRUSHING STRENGTH AT 28 DAYS WORKING TEST:
i. LOAD BEARING BLOCKS > 12.5 N/mm² FOR AVERAGE OF 10 BLOCKS
> 10.0 N/mm² FOR ANY BLOCKS
ii. NON LOAD BEARING BLOCKS > 7.5 N/mm² FOR AVERAGE OF 10 BLOCKS
> 7.5 N/mm² FOR ANY BLOCKS
F. ALL THE BLOCK WORK ALONG WITH SECONDARY FRAMING ELEMENTS SHALL BE DESIGNED BY CONTRACTOR AND SUBMITTED TO ENGINEERS FOR APPROVAL.
G. ALL BLOCK WORK BELOW GROUND SHALL BE CONSTRUCTED FROM SULPHATE RESISTING CEMENT.
H. DENSITY FOR NORMAL CONCRTE FOR BLOCKS SHOULD NOT BE LESS THAN 1320 Kg/m³
2. MORTAR DESIGNATION (iii) TO BS 5628 : PT. 1 : 1992
3. PROTECTIVE COATING (BELOW GROUND) UNO TWO COATS APPROVED BITUMINOUS PAINT. REFER TO SPECIFICATION REQUIREMENTS.

I. DEFERRED SUBMITTAL

1. THE FOLLOWING ITEMS SHALL BE CONSIDERED AS DEFERRED SUBMITTAL AND SHALL BE DESIGNED BY THE CONTRACTOR. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ENGINEERED SHOP DRAWINGS FROM THE SPECIALTY SUBCONTRACTOR PREPARED UNDER THE DIRECT SUPERVISION OF A CALIFORNIA LICENSED ENGINEER. THESE SHOP DRAWINGS SHALL BE PROVIDED TO THE ARCHITECT, ENGINEER, AND BUILDING DEPARTMENT OF AUTHORITY OF JURISDICTION FOR REVIEW AND APPROVAL PRIOR TO FABRICATION. THESE ITEMS SHALL INCLUDE:
- A. SHORING SYSTEMS
B. STEEL STRUCTURE CONNECTIONS
C. STEEL STRUCTURE MISC. SUCH AS CANOPIES, TRELLIS, SECONDARY STEEL FOR FACED SUPPORTS, STEEL STAIRS, MASTS AND ROOF TOPS
D. CURTAIN WALL SYSTEMS
E. ALL TEMPORARY WORKS AND ERECTION SEQUENCES REQUIRED TO COMPLETE THE WORKS
F. FRAMING AND SUPPORTING STRUCTURE TO ALL ACCESS DOORS AND OPENINGS INCLUDING ROLLER SHUTTERS AND LOADING BAYS, ETC.
G. BLOCK WORK DETAILS

J. CODE

1. BUILDING SHALL COMPLY WITH THE 2022 INTERNATIONAL BUILDING CODE & 2021 DUBAI CODE. SYMBOLS AND DEFINITIONS ARE PER LATEST EDITION OF ASCE7
2. RISK CATEGORY: II
3. VERTICAL LIVE LOADS FOR EACH USE PER ASCE7 AND DUBAI BUILDING CODE
- A. ROOF L_r = 2.0 kN/m² (REDUCIBLE)
B. FLOORS L = RESIDENTIAL & LIVING SPACES = 2.0 kN/m²
C. EGRESS L = 4.8 kN/m² (NON-REDUCIBLE)
D. PARKING = 2.0 kN/m²
4. WIND:
- B. V (MR10): 30 m/sec
C. V (MR100): 47 m/sec
D. WIND IMPORTANCE, I_w: 1.00
E. EXPOSURE TYPE: C
F. OCCUPANCY CATEGORY: II
G. DIRECTIONAL FACTOR, K_d: 1.0
H. ENCLOSURE CLASSIFICATION: CLOSED

INTERSTORY DRIFT: EXPECTED INTERSTORY DRIFT FOR EACH STORY IS AS OUTLINED BELOW. ALL NON-STRUCTURAL ELEMENTS OF THE BUILDING INCLUDING BUT NOT LIMITED TO FINISHES, GLAZING, MEP, ETC. SHALL TAKE INTO ACCOUNT THIS PARAMETER.
INELASTIC INTERSTORY DRIFT LIMIT = H/400 TO H/600
OVER DISPLACEMENT LIMIT = H/500

5. SEISMIC:
- A. SITE CLASS: D
B. SEISMIC DESIGN CATEGORY: II
C. SEISMIC IMPORTANCE FACTOR, I_e: 1.0
D. S_s = 0.51
E. S₁ = 0.18
F. F_a = 1.392
G. F_v = 2.24
H. S_{DS} = 0.4733
I. S_{DI} = 0.2688
J. R = 4.0 - BUILDING FRAME SYSTEM ORDINARY REINFORCEMENT SHEAR WALLS
K. ρ = 1.0

INTERSTORY DRIFT: EXPECTED INTERSTORY DRIFT FOR EACH STORY IS AS OUTLINED BELOW. ALL NON-STRUCTURAL ELEMENTS OF THE BUILDING INCLUDING BUT NOT LIMITED TO FINISHES, GLAZING, MEP, ETC. SHALL TAKE INTO ACCOUNT THIS PARAMETER.
- INELASTIC INTERSTORY DRIFT RATIO = 0.02
- ELASTIC INTERSTORY DRIFT RATIO = CONTACT CONSULTANT

K. FIRE RESISTANCE REQUIREMENTS

1. THE GENERAL REQUIREMENT FOR THE STRUCTURE ARE AS PER THE FOLLOWING UNLESS NOTED OTHERWISE IN THE FIRE & SAFTEY REPORT BY THE SPECIALIST.
- A. LOAD BEARING WALLS, COLUMNS, AND TRANSFER BEAMS 2hrs
B. FLOOR CONSTRUCTION INCLUDING BEAMS 2hrs
C. SHAFTS AND STAIR WALLS 2hrs
D. ROOF CEILING ASSEMBLIES > 6.10M FROM FLOOR 0hr
E. ROOF CEILING ASSEMBLIES =< 6.10M FROM FLOOR) 2hrs

L. LIGHTNING PROTECTION

1. THE CONCRETE FRAME FORMS PART OF THE LIGHTING PROTECTION SYSTEM. FOR DESIGNATED LIGHTNING PROTECTION COLUMNS, THE CONTRACTOR MUST ENSURE THAT THE FOLLOWING MEASURES ARE CARRIED OUT:
- F. GOOD CONTACT BETWEEN REINFORCING BARS SHOULD BE ENSURED, i.e. BY FIXING THE BARS WITH TYING WIRE. REFER TO ELECTRICAL DRAWINGS FOR ELECTRICAL TYING WIRE SIZE.
G. TIES SHOULD BE PROVIDED FOR BOTH VERTICAL LAPS IN MAIN REINFORCEMENT AND BETWEEN LINKS AND MAIN REINFORCEMENT.
H. REFER TO ELECTRICAL DRAWINGS FOR LOCATION OF DESIGNATION OF LIGHTING PROTECTION ELEMENTS AND SPECIFIC REQUIREMENTS.
2. FOR DETAILS AND LOCATION OF EARTHING PITS REFER TO RELEVANT SERVICE DRAWINGS.

M. ABBREVIATIONS


ACRONYMS OF ABBREVIATION MAY INTERCHANGEABLY USED WITH OR WITHOUT SEPARATION DOTS (E.G. BOTH AB OR A.B, MEAN "ANCHOR BOLTS")

AB	ANCHOR BOLTS	MAX	MAXIMUM
AESS	ARCHITECTURALLY EXPOSED	MB	MACHINE BOLTS
	STRUCTURAL STEEL	MD	METAL DECK
APE	ADJOINING PANEL EDGES	MDC	METAL DECK AND CONCRETE
AR	ANCHOR REINFORCEMENT	M&M	MEANS AND METHODS
ARCH	ARCHITECT OR ARCHITECTURAL	MIN	MINIMUM
ATR	ALL THREADED ROD	MOW	MINISTRY OF WORKS
AXO	AXONOMETRIC VIEW	MS	MILD STEEL
B	BOTTOM	N	NEW
BB	BASE BUILDING	NF	NEAR FACE
BF	BOTH FACES	NLB	NON LOAD BEARING
BM	BEAM	NSI	NON STRUCTURAL INFRASTRUCTURE
B.O.F.	BOTTOM OF FOOTING	NTS	NOT TO SCALE
BS	BOUNDARY SCREWS		
B/W OR BW	BOTH WAYS	OC	ON CENTER
		OBZ	ORDINARY BOUNDARY ZONE
CA	COLUMN ABOVE		
CIP	CAST IN PLACE	P.E	PROFESSIONAL ENGINEER'S
C&C	COMPONENT AND CLADDING	PT	PRESERVATIVE TREATED
CF	COLD FORMED	P.L.	PLATE/PROPERTY LINE
CFS	COLD FORMED STEEL		
CLN	COLUMN	RC	REINFORCED CONCRETE
CONC	CONCRETE	RD	RELATIVE DENSITY
CONN	CONNECTION	RBS	REDUCED BEAM SECTION
CONT	CONTINUOUS	REINF	REINFORCEMENT
CPE	CONTINUOUS PANEL EDGES	REQ'D	REQUIRED
		RR	ROOF RAFTERS
Da	ANCHOR DIAMETER		
Dagg	NOMINAL MAX SIZE OF COURSE	SAD	SEE ARCHITECTURAL DRAWINGS
		SBZ	SPECIAL BOUNDARY ZONE
Dt OR db	REBAR DIAMETER	SH	STANDARD HOOK
DO	DO OVER	SOG	SLAB ON GRADE
DWG'S	DRAWINGS	SCHED	SCHEDULE
		SIM	SIMILAR
E	EXISTING	SMD	STEEL METAL DECK
EA	EACH	SMS	SHEET METAL SCREWS
EF	EACH FACE	SS	SELECT STRUCTURAL
		SSL	STRUCTURAL SLAB LEVEL
FF	FAR FACE	STD	STANDARD
FF&E	FURNITURE FIXTURE AND EQUIPMENT	STG	STAGGERED
FL	FINISH FLOOR LEVEL	SOP	SETTING OUT POINT
FRM/G	FRAMING		
FR	FLEXURAL REINFORCEMENT	TB, T&B	TOP AND BOTTOM
FRT	FIRE RETARDANT TREATED	THK	THICKNESS
FTG	FOOTING	T&G	TONGUE AND GROOVE
		T&SR	TEMPERATURE & SHRINKAGE
			REINFORCEMENT
GALV	GALVANISED	T.O.B.	TOP OF BEAM
GC	GENERAL CONTRACTOR	T.O.F.	TOP OF FOOTING
GL	GRID LINE	T.O.W.	TOP OF WALL
		TYP	TYPICAL
HCS	HOLLOW CORE SLAB		
HOR	HORIZONTAL	UB	UNIVERSAL BEAM
		UNO	UNLESS NOTED OTHERWISE
Ld	TENSION DEVELOPMENT LENGTH	UIS	UPSTAND
Ldc	COMPRESSION DEVELOPMENT LENGTH	USP	UNDER SEPARATE PERMIT
Ldh	DEVELOPMENT LENGTH OF STD HOOK		
Ldt	DEVELOPMENT LENGTH OF HEADED	VER	VERTICAL
	BARs	VIF	VERIFY IN FIELD
Lsc	COMPRESSION LAP SPLICE		
Lsl	TENSION LAP SPLICE	WCR	WATER CEMENT RATIO
LB	LOAD BEARING		
LG	LIGHT GAUGE	@	FOLLOWED BY NUMBER IS
LS	LAP SPLICE		SPACING ON CENTER
LW	LIGHT WEIGHT		IF NO OTHER UNITS ARE
			SPECIFIED MILLIMETERS ARE
			IMPLIED

GENERAL NOTES

1. This Drawing Issue has been checked and approved in accordance with the LOCI Quality Management System.
2. All works shall be carried out in accordance with particular & general specifications, in conjunction with relevant conditions of contract.
3. This Drawing shall not be used directly for Construction, but for preparation of Shop Drawings in coordination with other disciplines and Suppliers prior to manufacture, delivery and execution on site.
4. All dimensions and levels are in millimeter, unless noted otherwise, only written dimensions to be followed and not scaled from the drawing.
5. All dimensions to be verified at site and coordinated with other disciplines/ manufacturers in the preparation of shop drawings. Any changes shall be validated by the consultant.
6. For elements with indicative design, the contractor / supplier shall submit complete construction details and technical specifications for approval prior to execution. Shop drawings to particularly incorporate details at structural expansion joints as well as expansion / construction joints needed for the respective materials/ finishes / related works.
7. Safety standards and statutory regulations shall be adhered to in the manufacture, supply, storage and installation of all works.
8. Any discrepancy or ambiguity whatsoever with dimensions / details / legends / specifications / etc, shall be brought to the attention of the Consultant and clarification obtained prior to finalization of tender / construction.

KEY PLAN

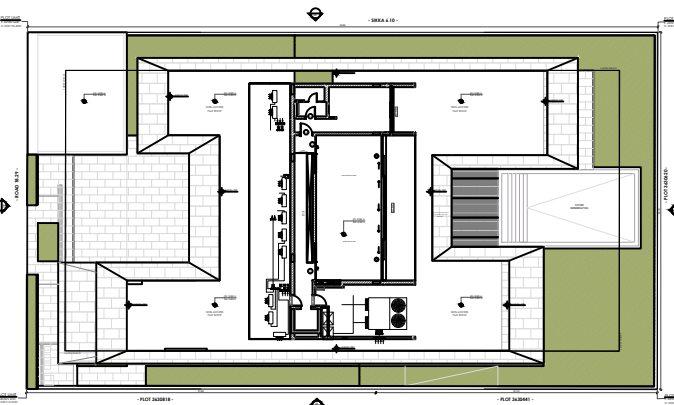

DRAWING REVISIONS

REV	DATE	DESCRIPTION	CHECKED	APPROVED
00	14.03.2025	ISSUED FOR APPROVAL	AN	BR

CLIENT

TARUN HARISH CHANDRA KHANNA

DRAWING DETAILS

GENERAL NOTES - (SHEET 2 OF 2)

SHEET #

269-S-002

REVISION	ISSUE DATE:	SCALE @ A1
R0	14-03-2025	AS SHOWN

PROJECT DETAILS

KHANNA VILLA



PROJECT LOCATION
PLOT NO. 3630160
Al Manara,
Dubai

269

PROJECT PHASE
DETAIL DESIGN

CONSULTANT

LOCI
لوکار

Office M31, KIA Flagship
Building
Sheikh Zayed Rd, Al Quoz 1
P. O. Box 72928, Dubai
T +971 4 357 6573
W www.loci.ae