



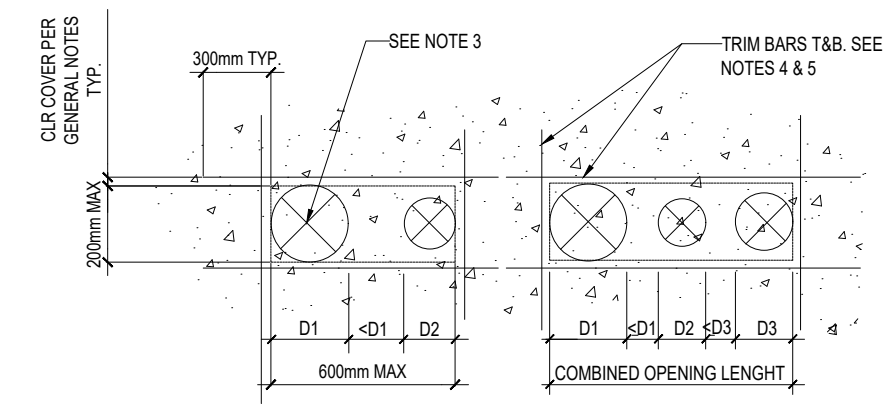

OPENINGS UP TO 600mm

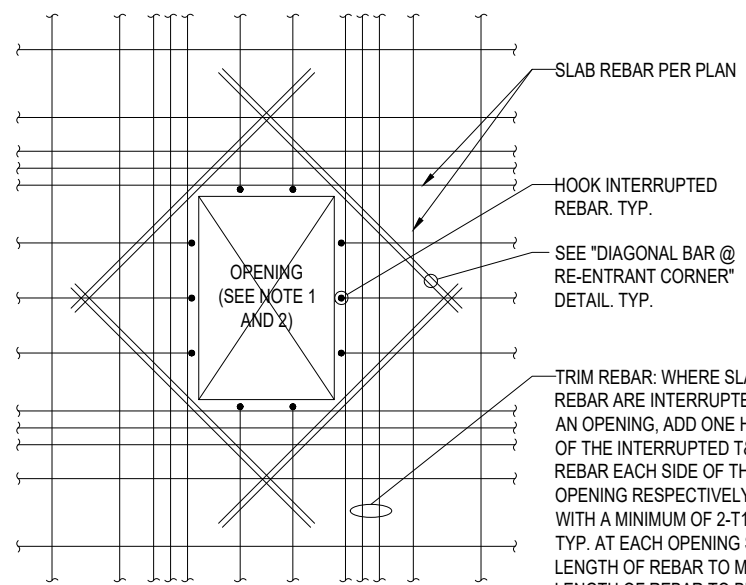


OPENINGS WITH AT LEAST ONE SIDE GREATER THAN 600mm

NOTES:

- SCOPE: THIS DETAIL ADDRESSES ARRANGEMENT OF SLAB REBAR, ADD OR "TRIM" REBAR, AND ADD DIAGONAL REBAR AT OPENINGS IN CONCRETE SLABS AWAY FROM COLUMNS. THE DETAIL APPLIES FOR OPENINGS WITH ANY SHAPE. FOR PENETRATIONS CLOSE TO COLUMNS SEE "SLAB PENETRATIONS CLOSE TO COLUMNS" DETAILS
- FOR LOCATION OF OPENINGS SEE STRUCTURAL PLANS
- INSERTS/PENETRATIONS WITH A CLEAR DISTANCE WHICH IS LESS THAN THE DIAMETER OF THE LARGER OF THE TWO ARE CONSIDERED TO FORM A COMBINED OPENING
- IF THE COMBINED OPENING LENGTH IS LESS THAN 300mm AND NO SLAB REINFORCING IS INTERRUPTED, NO TRIM BARS ARE REQUIRED
- IF THE COMBINED OPENING LENGTH IS MORE THAN 300mm, BUT LESS THAN 600mm, PROVIDE 1-T16 T&B TRIM REBAR EA SIDE OF THE OPENING. NO DIAGONAL BARS ARE NECESSARY
- IF COMBINED OPENING LENGTH IS LARGER THAN 600mm REFER TO INSET DETAIL "B"

SLAB OPENINGS AND PENETRATIONS

SCALE: N.T.S.

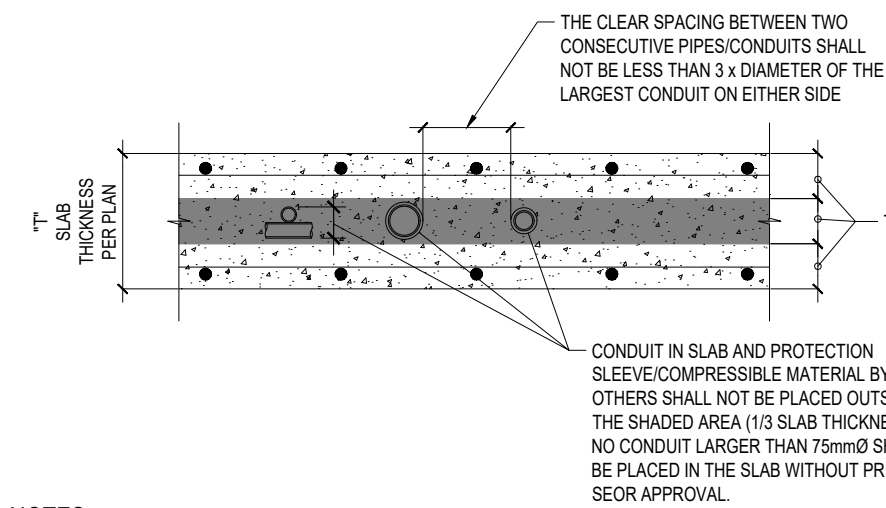


NOTES:

- THIS DETAIL ADDRESSES THE ARRANGEMENT OF CONDUITS WITHIN THE SLAB THICKNESS
- SLEEVES OR COMPRESSIBLE MATERIAL AROUND THE CONDUITS FOR MEP CODE COMPLIANCE SHALL BE SPECIFIED BY OTHERS. CONTRACTOR SHALL CONFIRM WITH MEP SUBCONTRACTORS OR MEP ENGINEER SUCH REQUIREMENT PRIOR TO PLACING THE CONDUITS WITHIN THE CONCRETE SLAB
- CONDUIT SHALL BE SUPPORTED BY ADDITIONAL REBAR AND CHAIRS IN THE SLAB
- CONDUIT SHALL STAY 2 FT CLEAR FROM COLUMN FACES, STUD RAILS, DROP PANELS, SHEAR WALLS.

CONDUIT IN SLAB

SCALE: N.T.S.

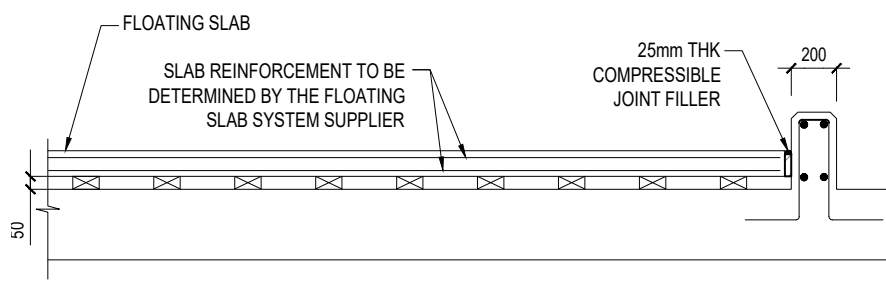

NOTES:


- ALL DETAILS RELATED TO THE FLOATING FLOOR SHALL BE PERFORMED STRICTLY AS PER MANUFACTURER'S DETAILS.
- SIZE AND LOCATION AS PER ARCHITECTURAL/ MEP DRAWINGS.

FLOATING SLAB

SCALE: N.T.S.


NOTES:

- THIS DETAIL ADDRESSES PENETRATIONS FOR PIPES, CONDUITS, ETC. CLOSE TO COLUMNS IN SLABS OR DROP PANELS WITHOUT STRUDRALS. SEE STUDRAILS DETAILS FOR "PENETRATIONS CLOSE TO STUDRAILS" DETAIL.
- PENETRATIONS OUTSIDE DROP PANELS OR (5 x T) PERIMETER PER DETAIL B SHALL BE PER "SLAB OPENINGS AND PENETRATIONS" DETAIL.
- LIMITATIONS SET FORTH IN THIS DETAIL MAY BE WAIVED IF APPROVED IN WRITING BY SEOR OR IF SPECIFICALLY CALLED OUT ON FLOOR PLANS.

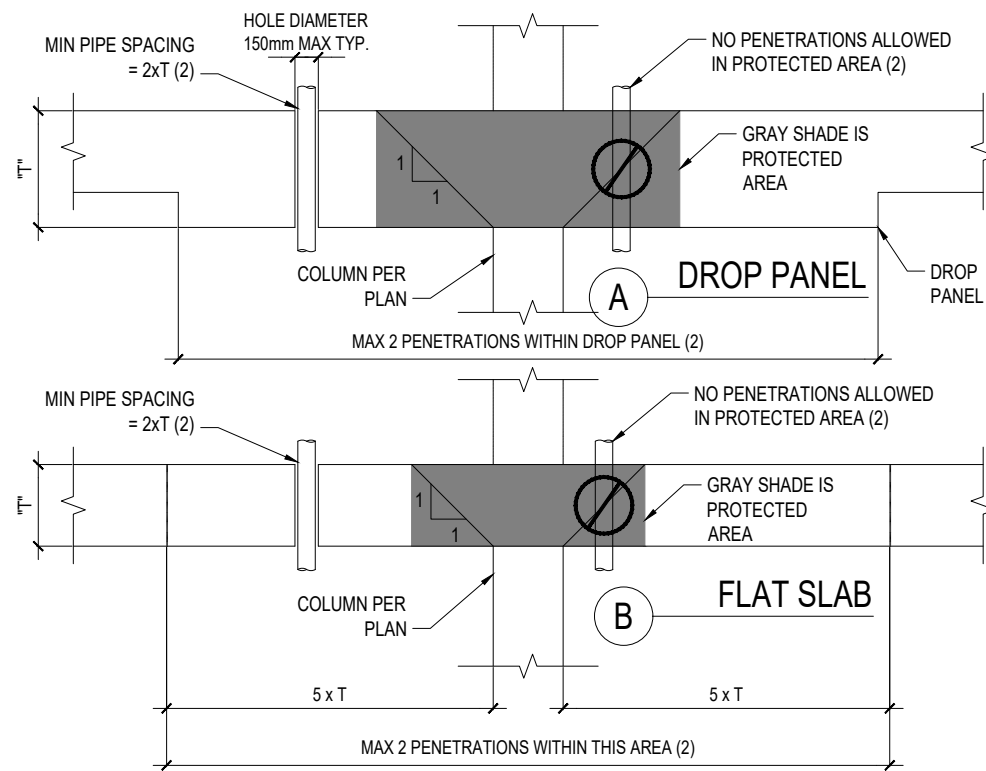

SLAB PENETRATIONS CLOSE TO COLUMNS

SCALE: N.T.S.

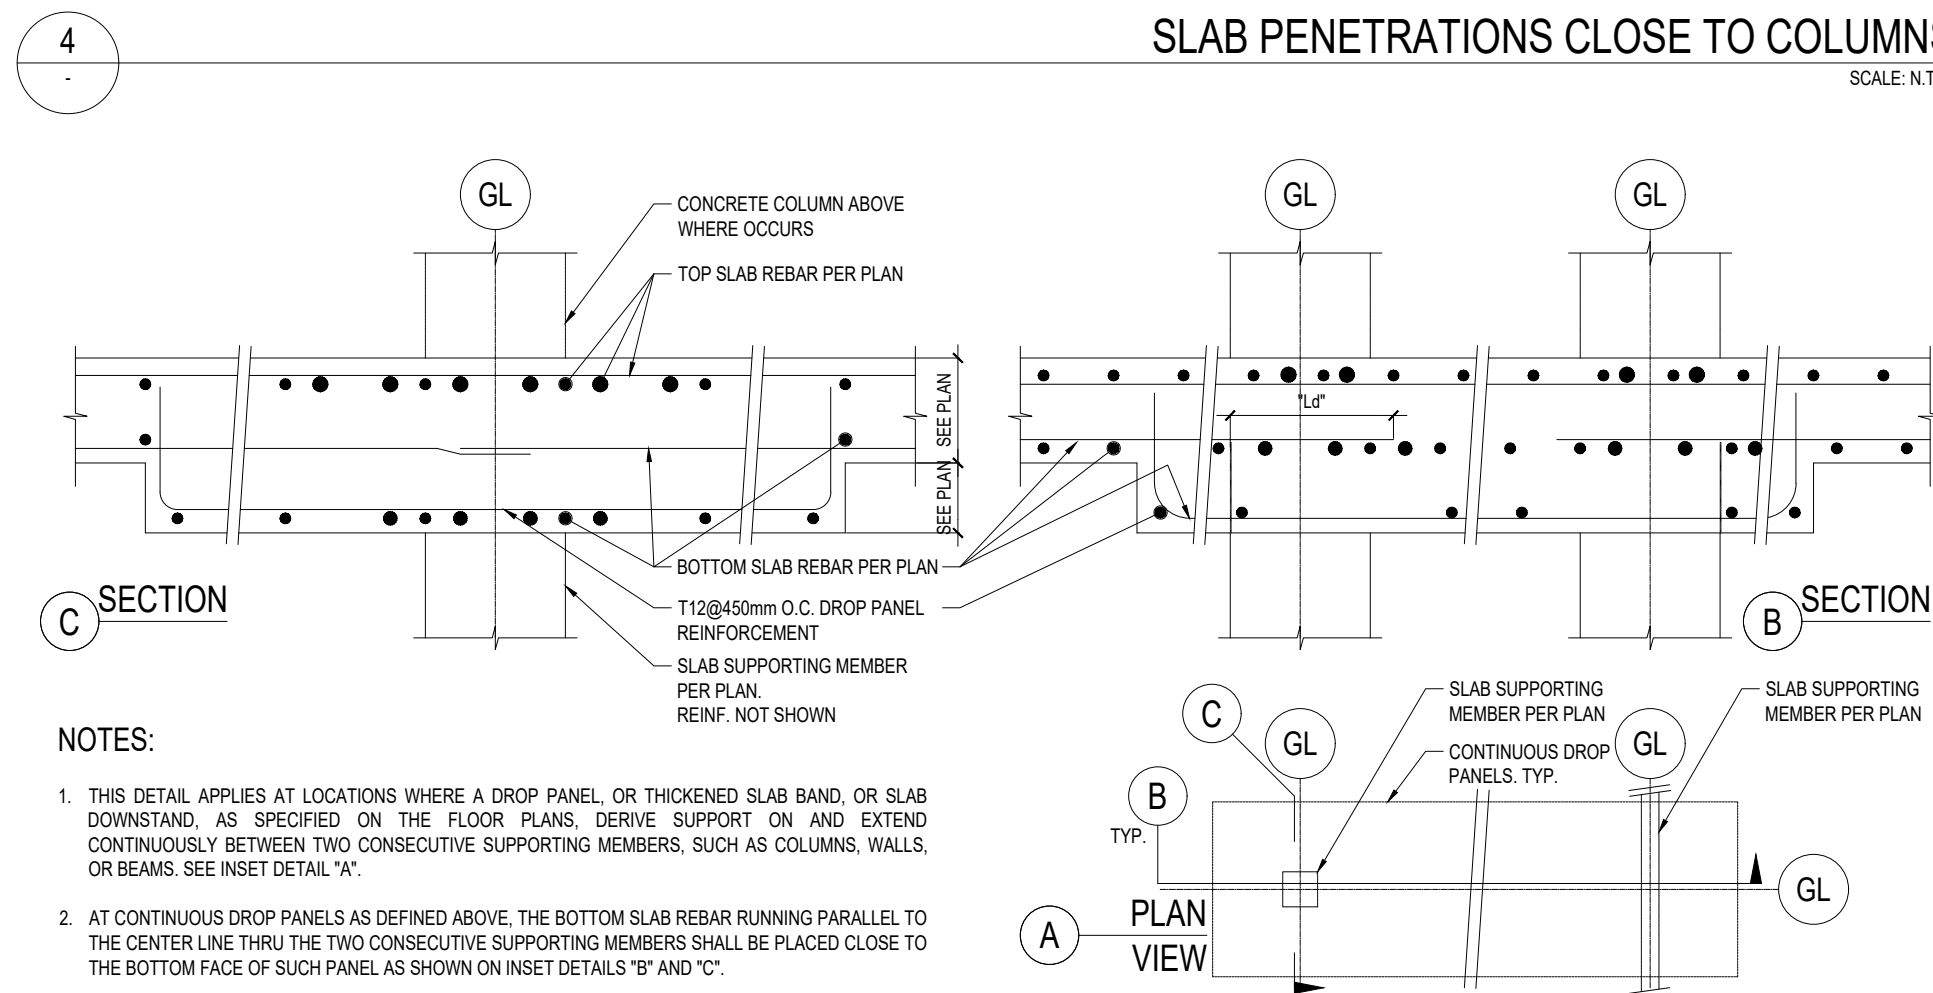


NOTES:

- THIS DETAIL APPLIES AT LOCATIONS WHERE A DROP PANEL, OR THICKENED SLAB BAND, OR SLAB DOWNSTAND, AS SPECIFIED ON THE FLOOR PLANS, DERIVE SUPPORT ON AND EXTEND CONTINUOUSLY BETWEEN TWO CONSECUTIVE SUPPORTING MEMBERS, SUCH AS COLUMNS, WALLS, OR BEAMS. SEE INSET DETAIL "A".
- AT CONTINUOUS DROP PANELS AS DEFINED ABOVE, THE BOTTOM SLAB REBAR RUNNING PARALLEL TO THE CENTER LINE THRU THE TWO CONSECUTIVE SUPPORTING MEMBERS SHALL BE PLACED CLOSE TO THE BOTTOM FACE OF SUCH PANEL AS SHOWN ON INSET DETAILS "B" AND "C".


CONTINUOUS DROP PANEL

SCALE: N.T.S.

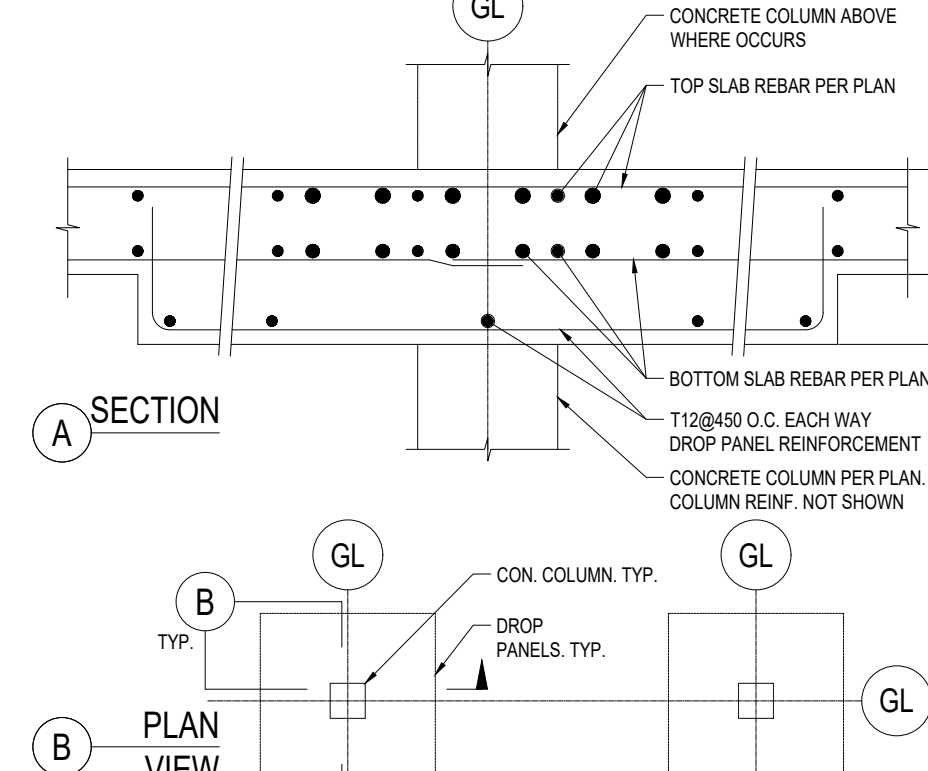

ISOLATED DROP PANEL

SCALE: N.T.S.

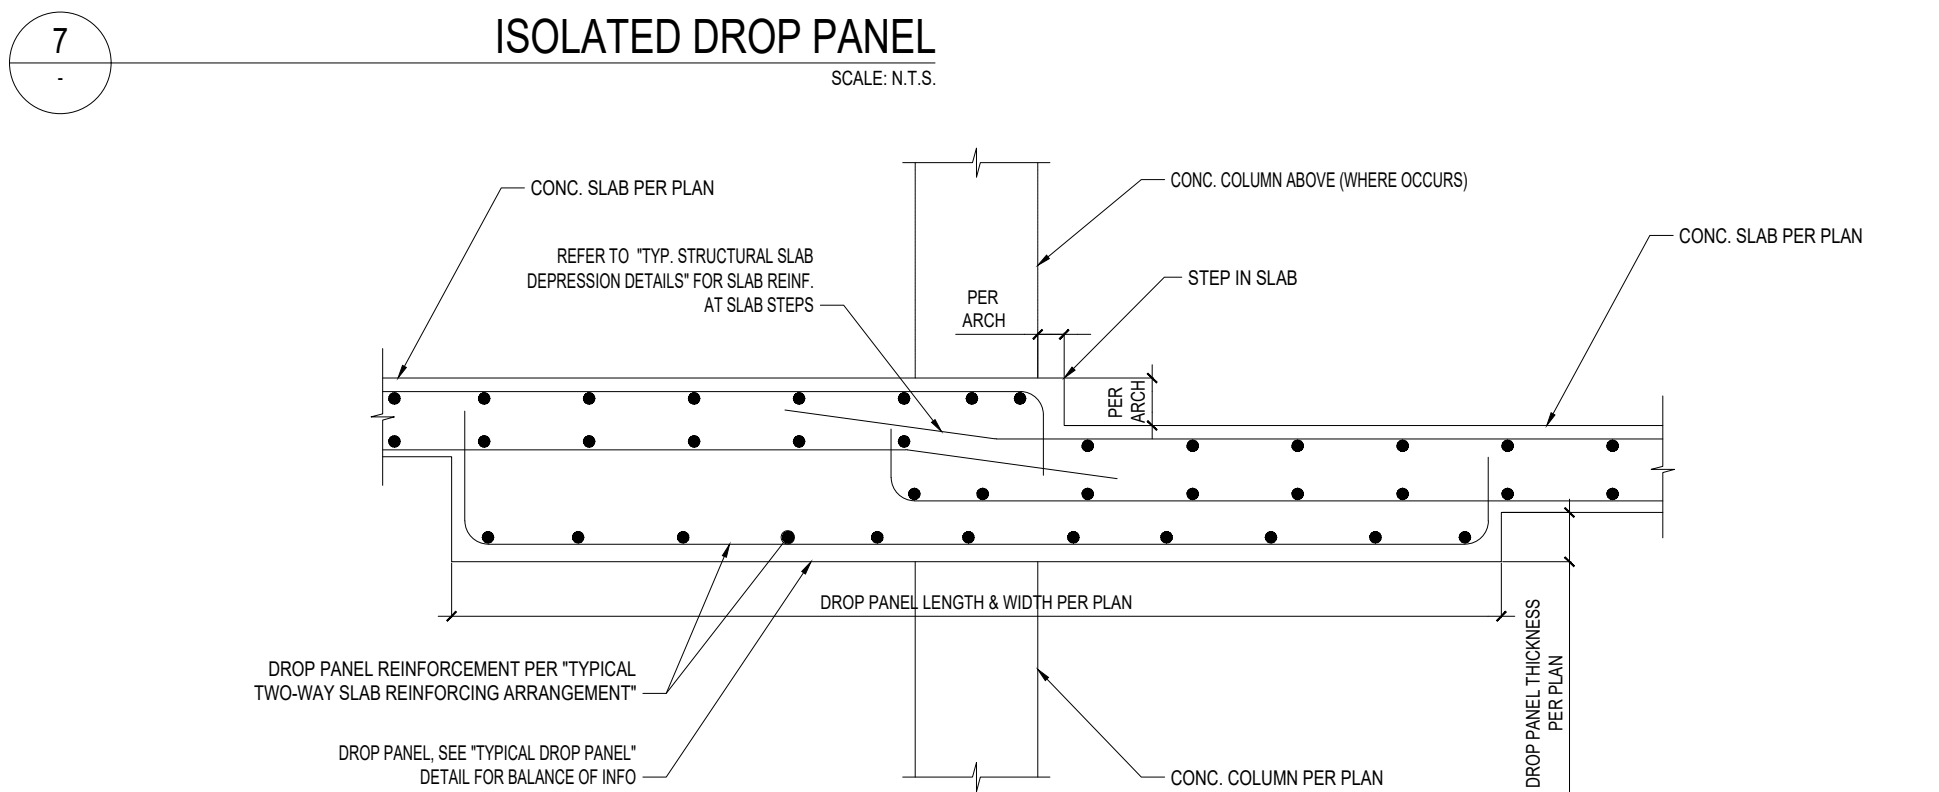


NOTES:


- THIS DETAIL ADDRESSES CONSTRUCTION AND SIZE OF DROP PANELS OCCURRING BELOW A SLAB STEP.
- AS SHOWN ON THE DETAIL, THE UNDERSIDE OF THE DROP PANEL SHALL HAVE UNIFORM ELEVATION FOR ENTIRE DROP PANEL EXTENT.
- THE UNDERSIDE OF THE DROP PANEL SHALL BE DETERMINED BASED ON THE LOWEST SLAB ELEVATION WITHIN DROP PANEL EXTENT.

SLAB DEPRESSION AT DROP PANEL


SCALE: N.T.S.

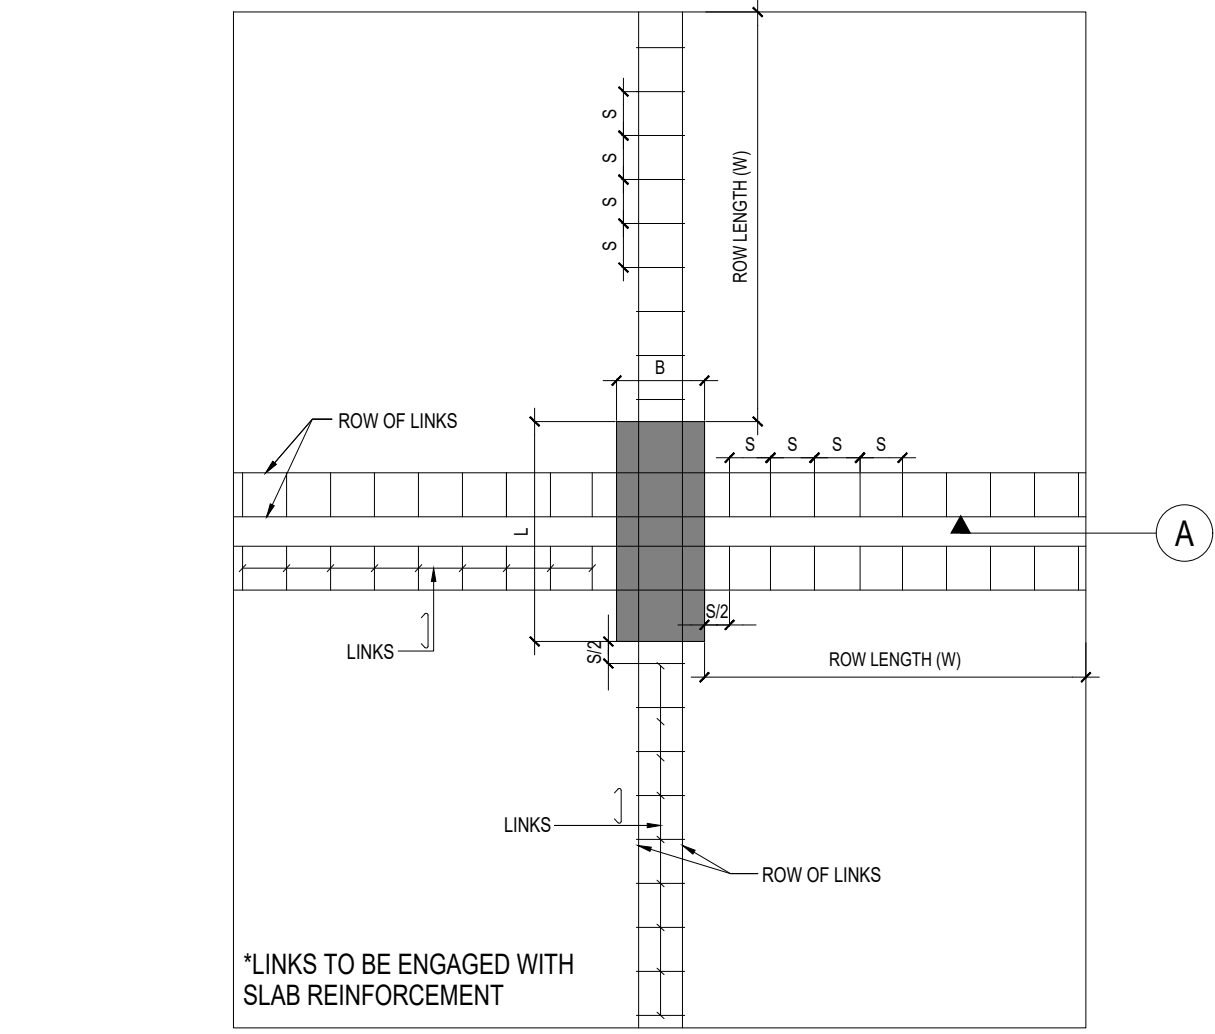

INTERNAL COLUMNS

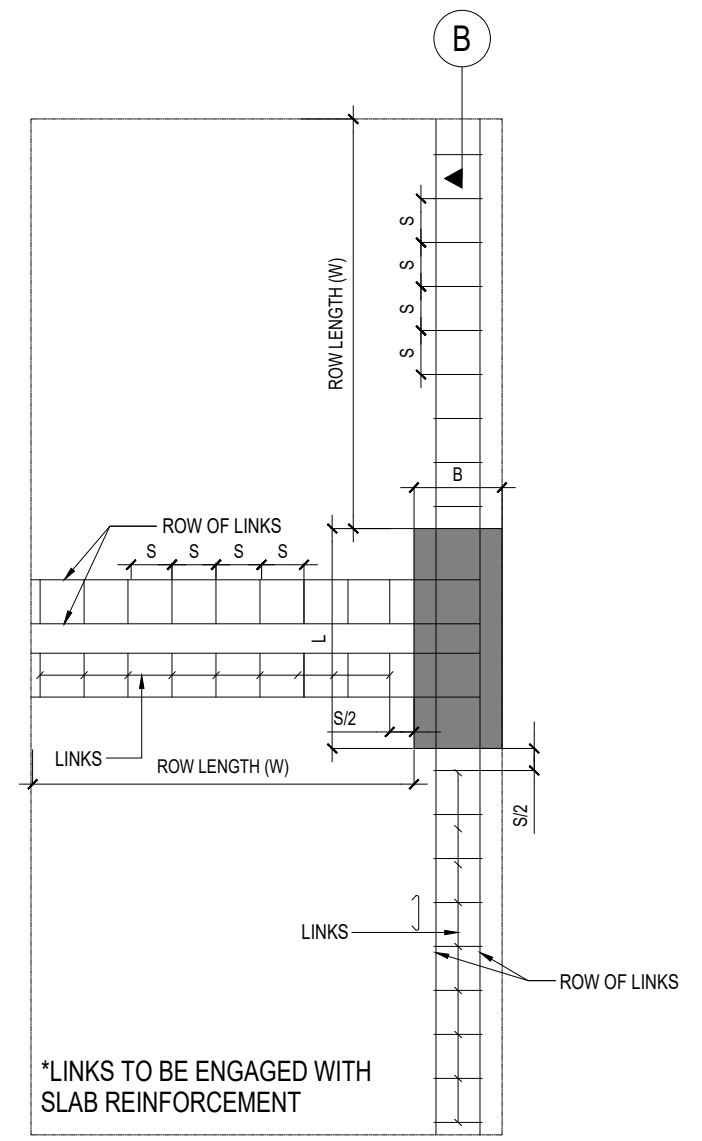

EDGE COLUMNS

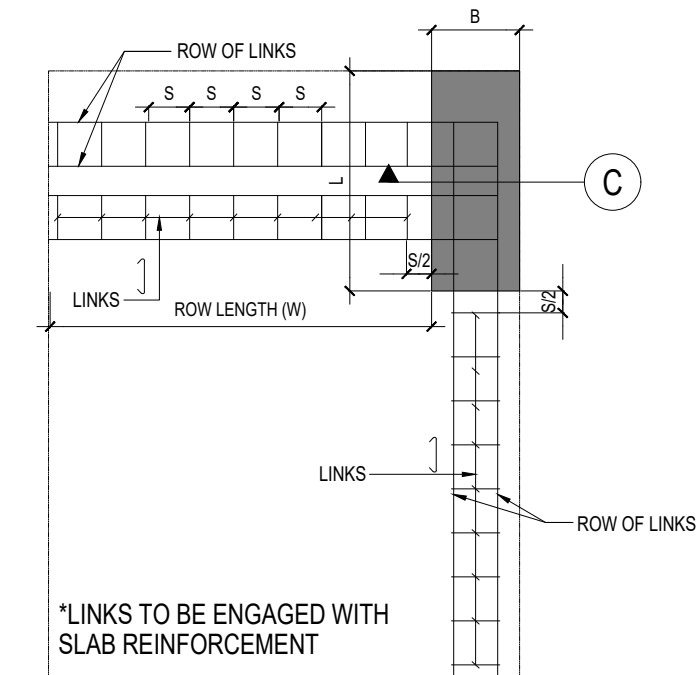

CORNER COLUMNS


TYPICAL PUNCHING SHEAR REINFORCEMENT DETAILS

SCALE: N.T.S.

GENERAL NOTES

- This Drawing Issue has been checked and approved in accordance with the LOCI Quality Management System.
- All works shall be carried out in accordance with particular & general specifications, in conjunction with relevant conditions of contract.
- This drawing shall not be used directly for construction, but for preparation of Shop Drawings in coordination with other disciplines and Suppliers prior to manufacture, delivery and execution on site.
- All dimensions and levels are in millimeter, unless noted otherwise. Only written dimensions to be followed and not scaled from the drawing.
- All dimensions to be verified at site and coordinated with other disciplines/ manufacturers in the preparation of shop drawings. Any changes shall be validated by the consultant.
- For elements with indicative design, the contractor / supplier shall submit complete construction details and technical specifications for approval prior to execution. Shop drawings to particularly incorporate details at: structural expansion joints as well as expansion / construction joints needed for the respective materials/ finishes / related works.
- Safety standards and statutory regulations shall be adhered to in the manufacture, supply, storage and installation of all works.
- Any discrepancy or ambiguity whatsoever with dimensions / details / legends / specifications / etc., shall be brought to the attention of the Consultant and clarification obtained prior to finalization of tender / construction.

KEY PLAN

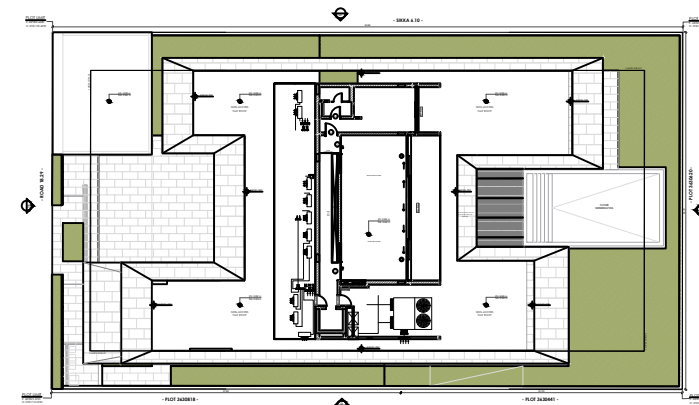

DRAWING REVISIONS

REV	DATE	DESCRIPTION	CHECKED	APPROVED
00	14.03.2025	ISSUED FOR APPROVAL	AN	BR

CLIENT

TARUN HARISH CHANDRA KHANNA

DRAWING DETAILS

TYPICAL DETAILS - (SHEET 6 OF 10)

SHEET #

269-S-015

REVISION

R0

ISSUE DATE:

14-03-2025

SCALE @ A1

AS SHOWN

PROJECT DETAILS

KHANNA VILLA



PROJECT LOCATION

PLOT NO. 3630160
Al Manara,
Dubai

PROJECT NUMBER

269

PROJECT PHASE

DETAIL DESIGN

CONSULTANT

LOCI
لوکار

Office M31, KIA Flagship
Building
Sheikh Zayed Rd, Al Quoz 1
P. O. Box 72928, Dubai
T +971 4 357 6573
W www.loci.ae