



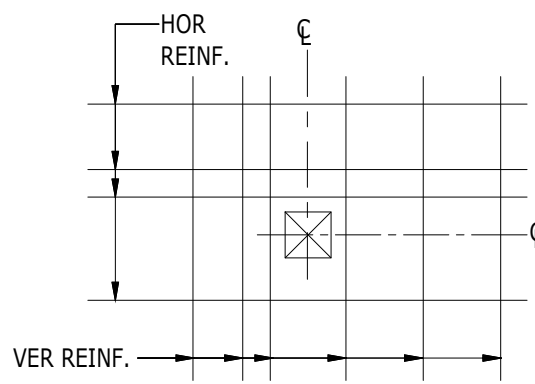

WALL OPENING
LESS THAN 150mm

NOTES:


1. BARS MAY BE DISPLACED
2. NO ADDITIONAL REFT. NECESSARY

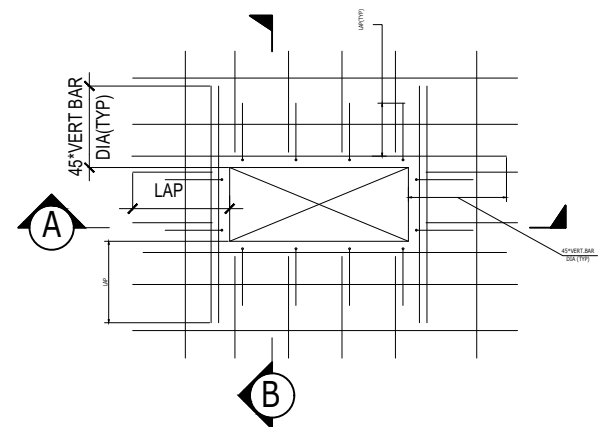


WALL OPENING GREATER THAN
150mm & LESS THAN 450mm

NOTES:


1. DIAMETER OF TRIMMER REFT. = DIAMETER OF WALL REFT CUT BY OPENING.
2. No. OF TRIMMER BARS = No. OF WALL REFT BARS CUT BY OPENING.

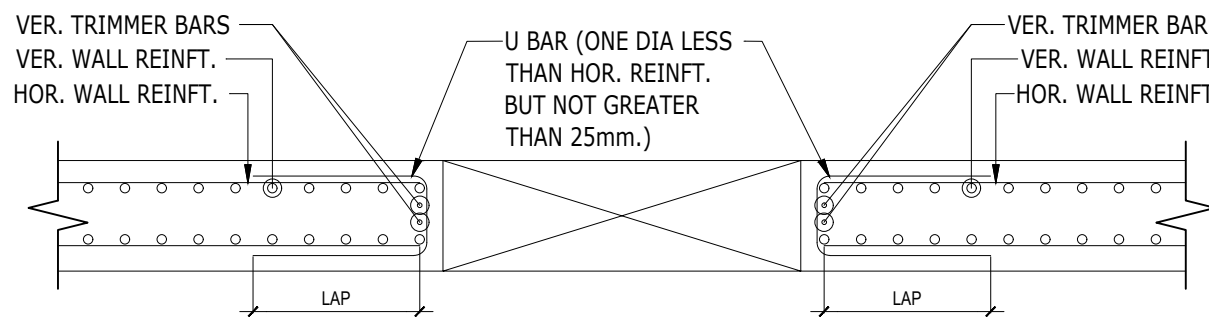

SECTION-A

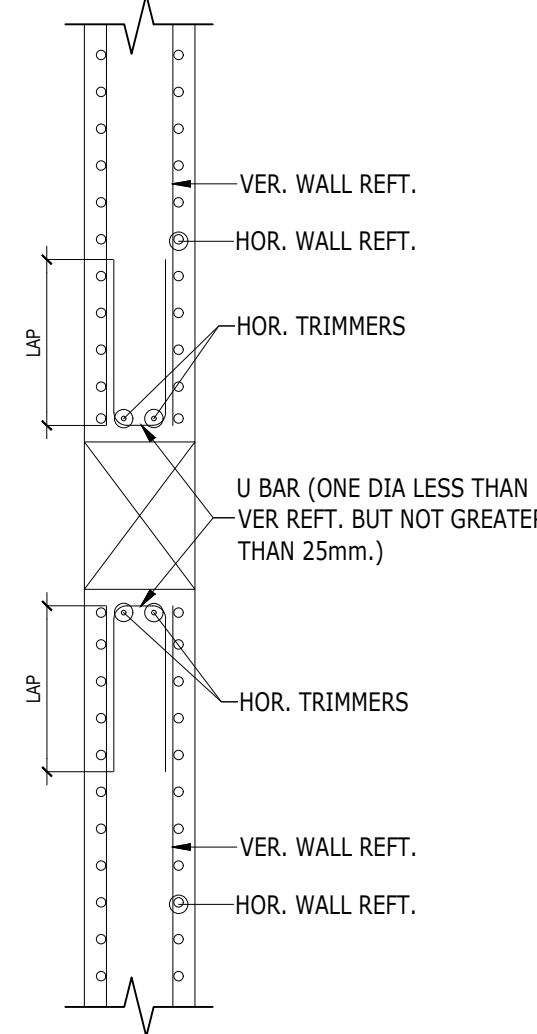


SECTION-B

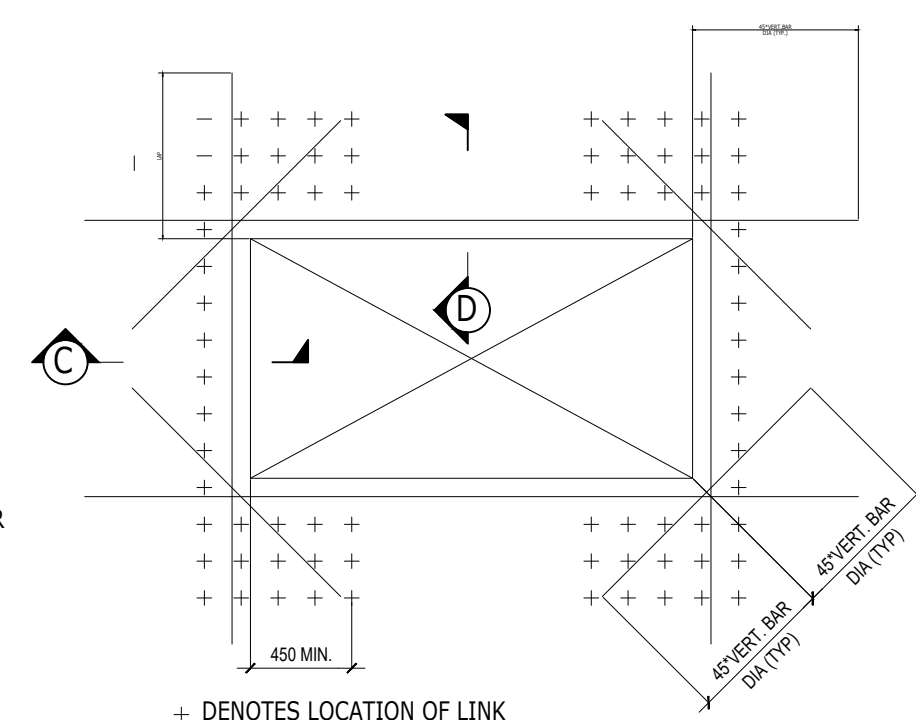


WALL OPENING GREATER THAN
450mm & LESS THAN 900mm

NOTES:

1. DIAMETER OF TRIMMER BARS:-
VERTICAL TRIMMERS = VERTICAL WALL REFT.
HORIZONTAL TRIMMERS = HORIZONTAL WALL REFT.
DIAGONAL TRIMMERS = VERTICAL WALL REFT.
BUT NOT GREATER THAN 25mm
AND NOT LESS THAN 16mm.
2. LINKS SHALL BE T8 BARS AND SHALL CONFIRM WITH THE SPACING
WALL REINFORCEMENT, BUT SPACING NOT TO EXCEED 200mm.

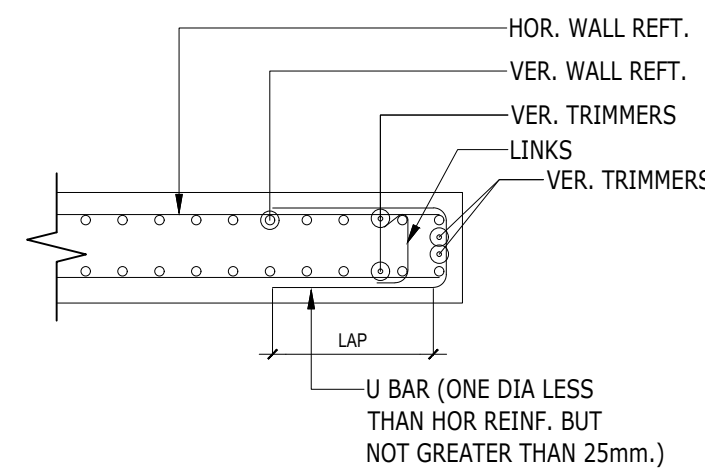

SECTION-C

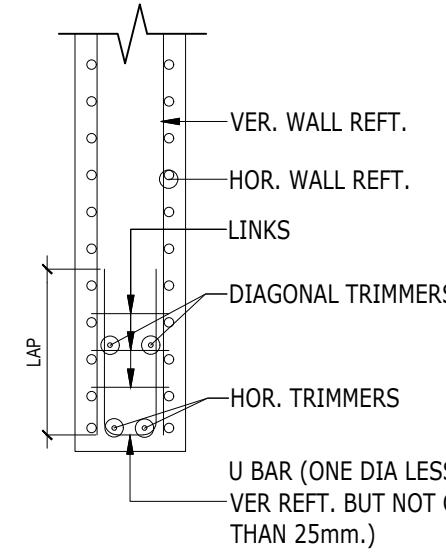


SECTION-D

GENERAL NOTES

1. This Drawing Issue has been checked and approved in accordance with the LOCI Quality Management System.
2. All works shall be carried out in accordance with particular & general specifications, in conjunction with relevant conditions of contract.
3. This drawing shall not be used directly for Construction, but for preparation of Shop Drawings in coordination with other disciplines and Suppliers prior to manufacture, delivery and execution on site.
4. All dimensions and levels are in millimeter, unless noted otherwise, only written dimensions to be followed and not scaled from the drawing.
5. All dimensions to be verified at site and coordinated with other disciplines/ manufacturers in the preparation of shop drawings. Any changes shall be validated by the consultant.
6. For elements with indicative design, the contractor / supplier shall submit complete construction details and technical specifications for approval prior to execution. Shop drawings to particularly incorporate details at structural expansion joints as well as expansion / construction joints needed for the respective materials/ finishes / related works.
7. Safety standards and statutory regulations shall be adhered to in the manufacture, supply, storage and installation of all works.
8. Any discrepancy or ambiguity whatsoever with dimensions / details / legends / specifications / etc, shall be brought to the attention of the Consultant and clarification obtained prior to finalization of tender / construction.

KEY PLAN

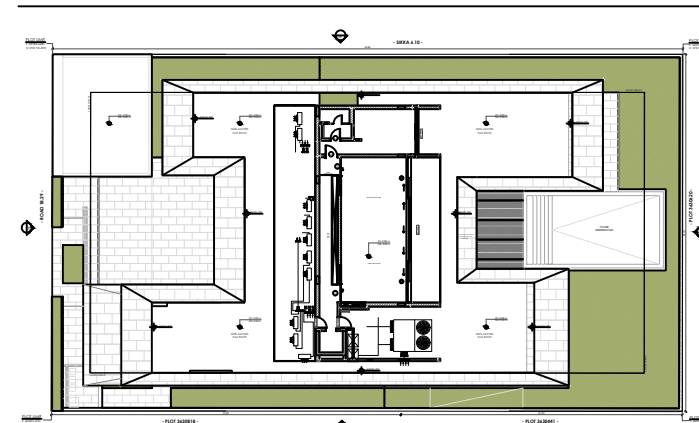


DRAWING REVISIONS

REV	DATE	DESCRIPTION	CHECKED	APPROVED
00	14.03.2025	ISSUED FOR APPROVAL	AN	BR

TRIMMING REINFORCEMENT FOR OPENINGS IN WALLS


SCALE: N.T.S.

1

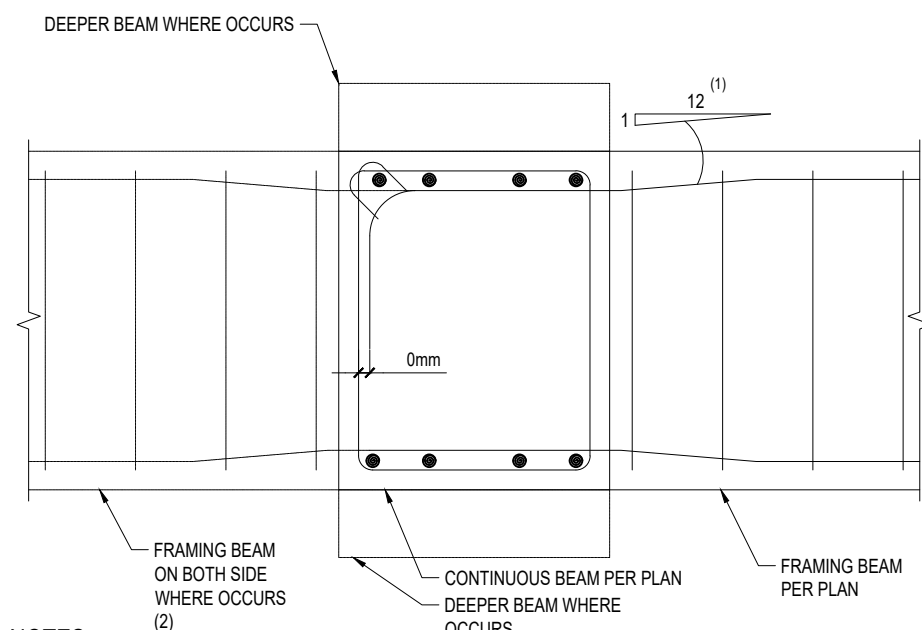


NOTES:

1. PROVIDE 1:12 BEND OF LONGITUDINAL REBAR OF FRAMING BEAM AS NEEDED TO CLEAR LONGITUDINAL REBAR OF CONTINUOUS BEAM. DO NOT BEND REBAR OF CONTINUOUS BEAM.
2. IN CASE FRAMING BEAM OCCUR ON BOTH SIDES OF CONTINUOUS BEAM, CONTACT ENGINEER TO CLARIFY CONTINUOUS BEAM VS FRAMING BEAM IF NEEDED.

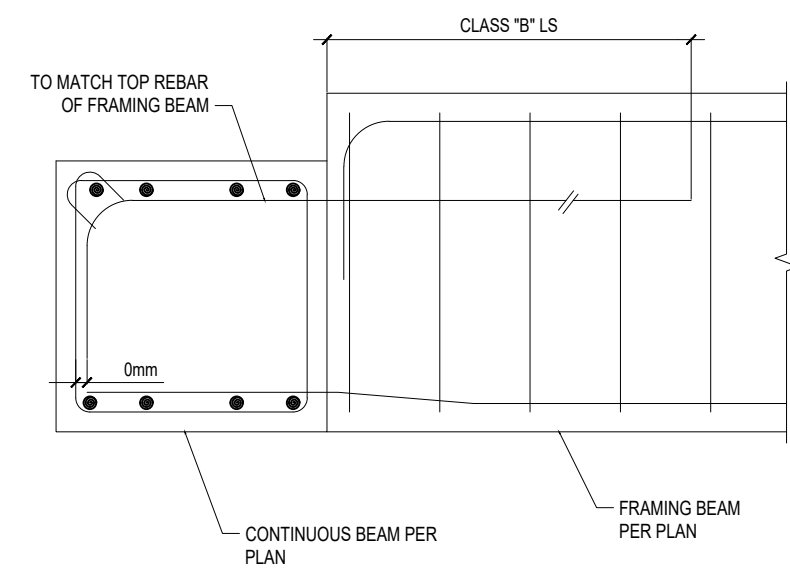


CONCRETE BEAM TO BEAM CONNECTION

SCALE: N.T.S.

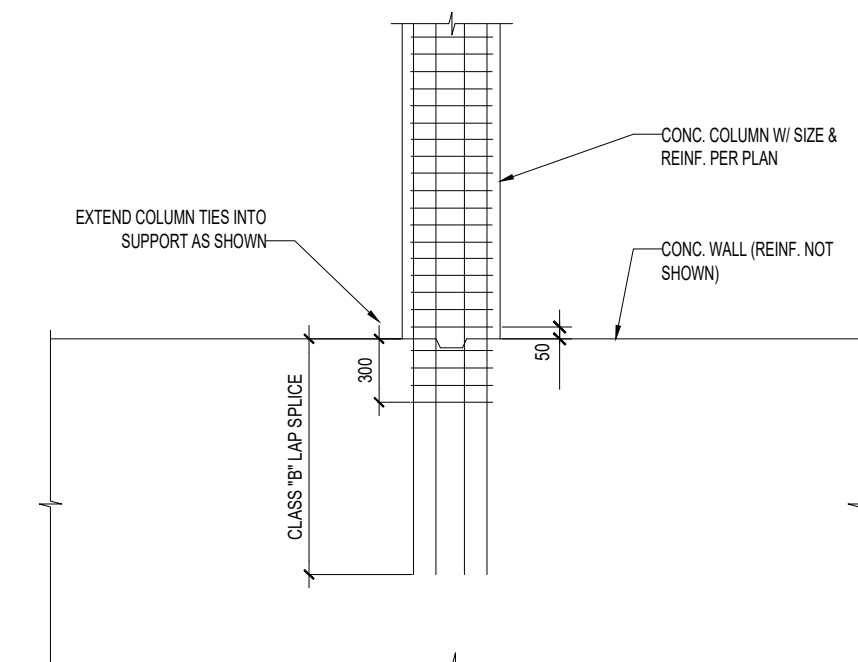



TYP. CONC. COLUMN ON WALL

SCALE: N.T.S.

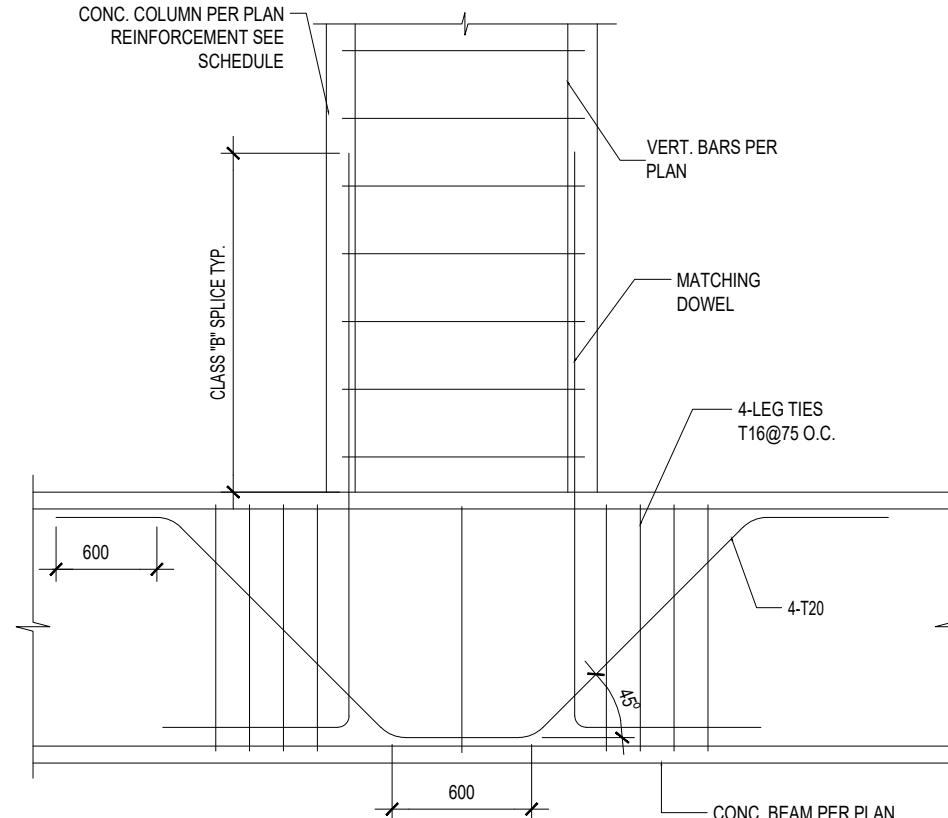


BEAM SUPPORTING COLUMN

SCALE: N.T.S.

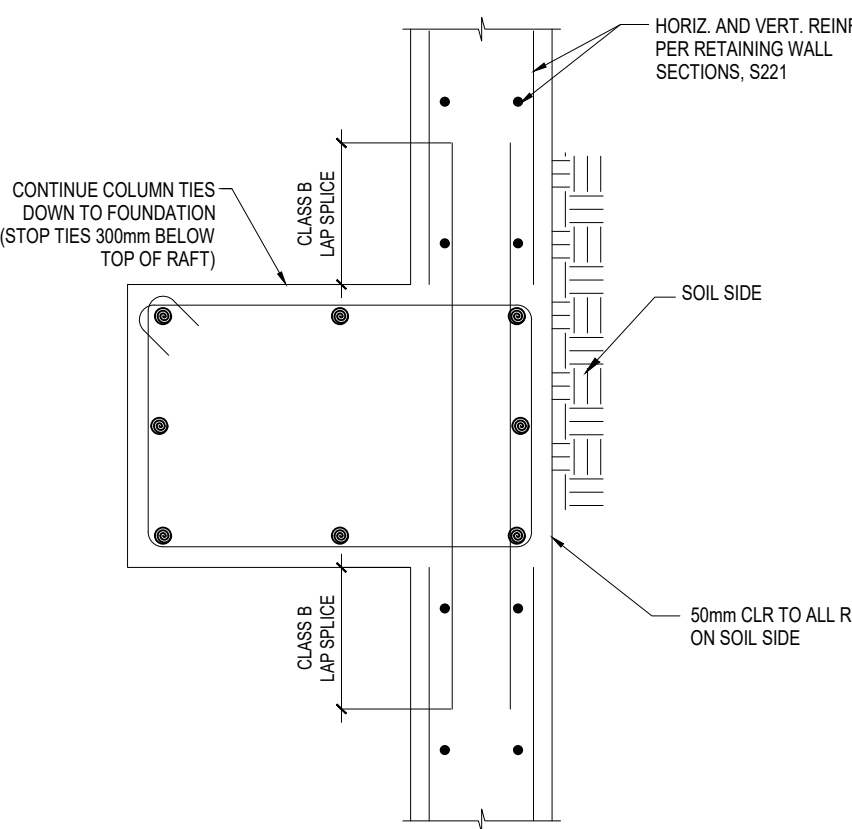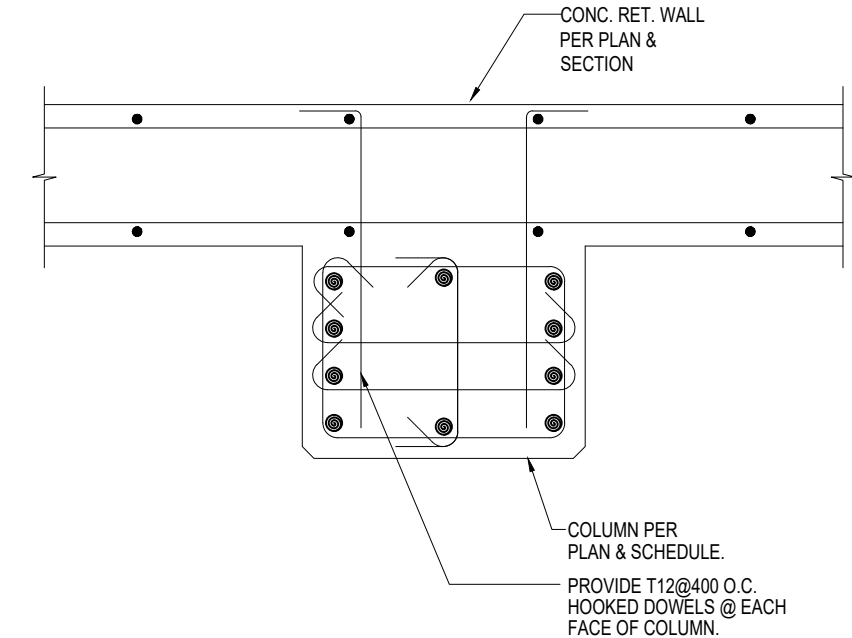


PLAN VIEW

2

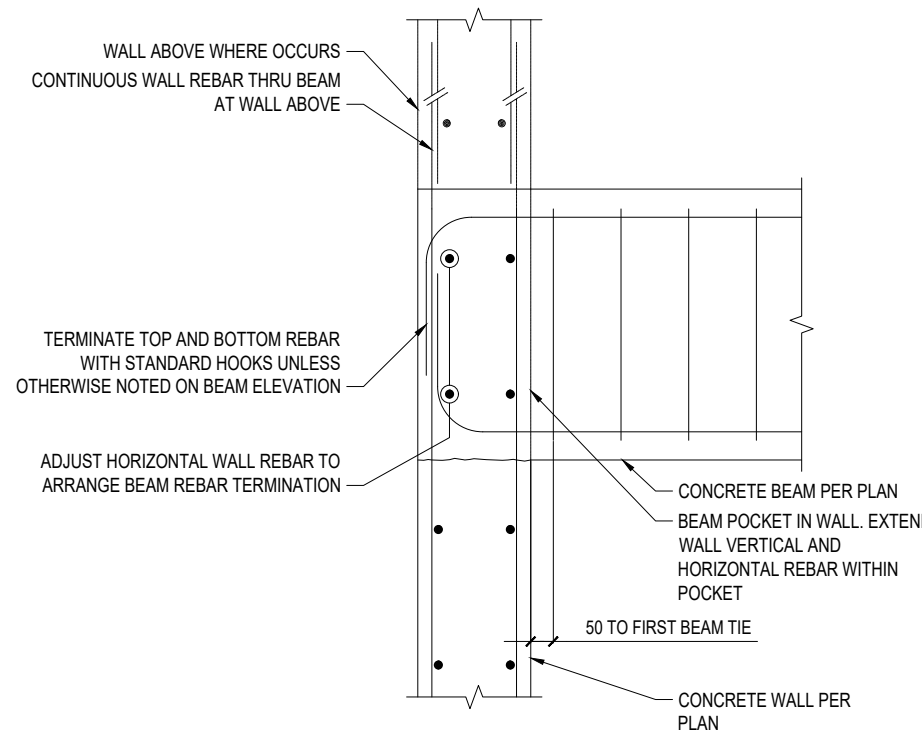


END SUPPORT

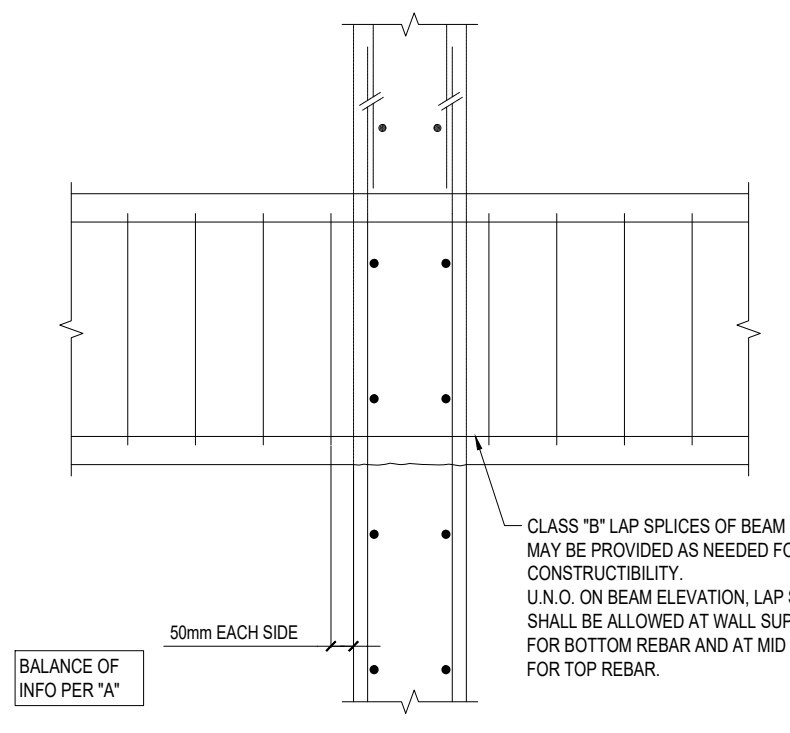


INTERMEDIATE SUPPORT

4

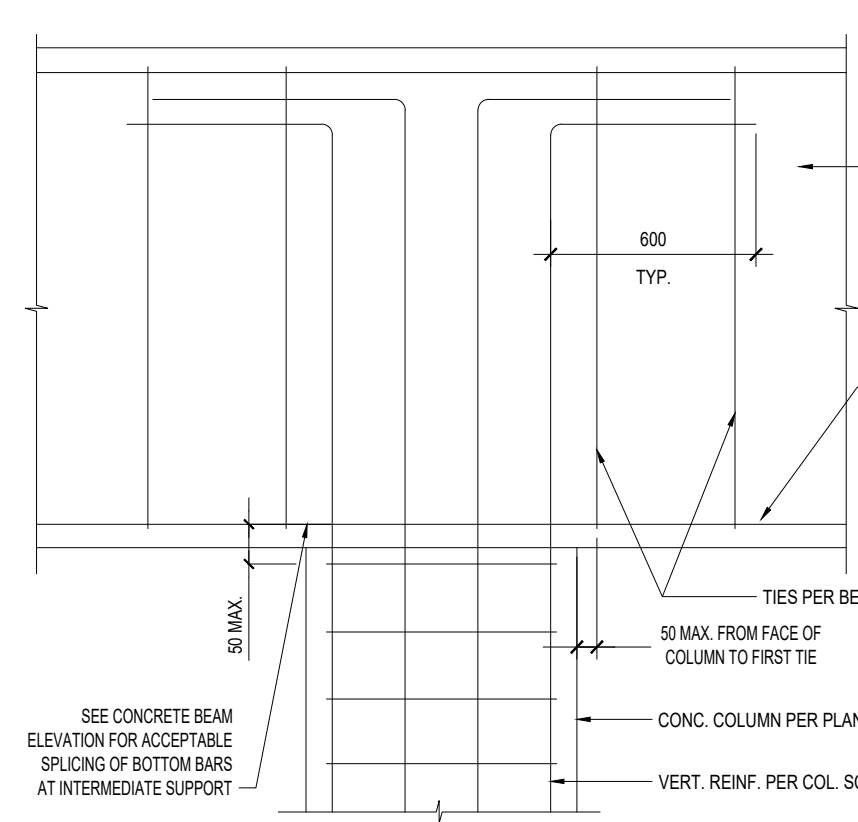


6

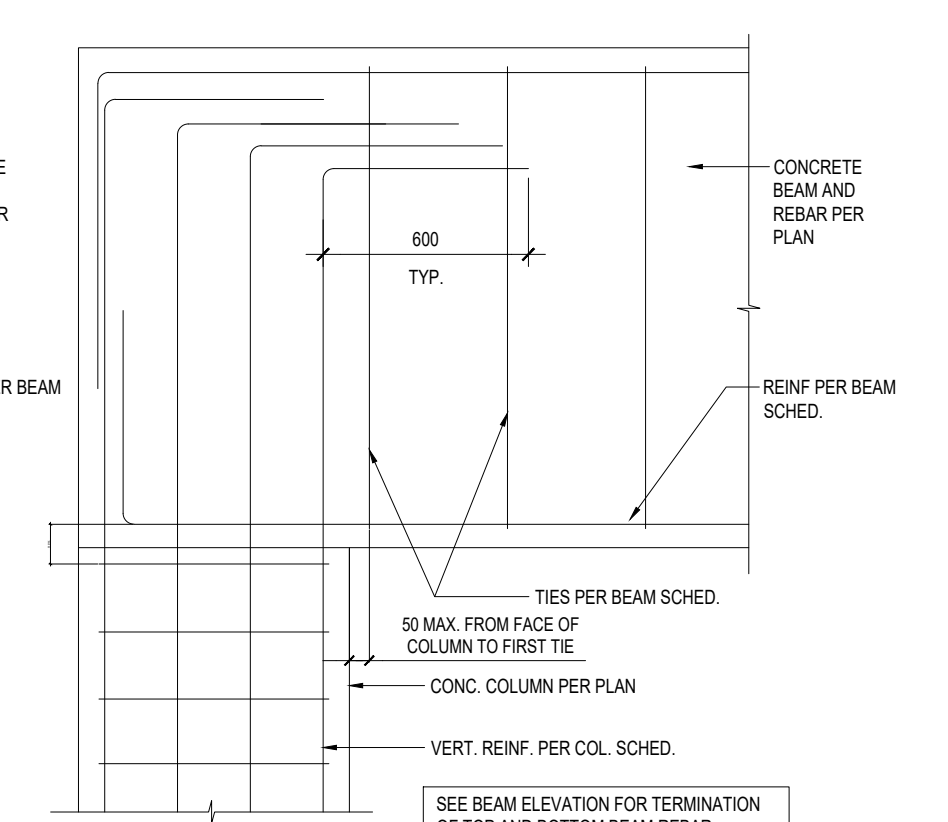

CONCRETE COLUMN TO BEAM CONNECTION

SCALE: N.T.S.

7

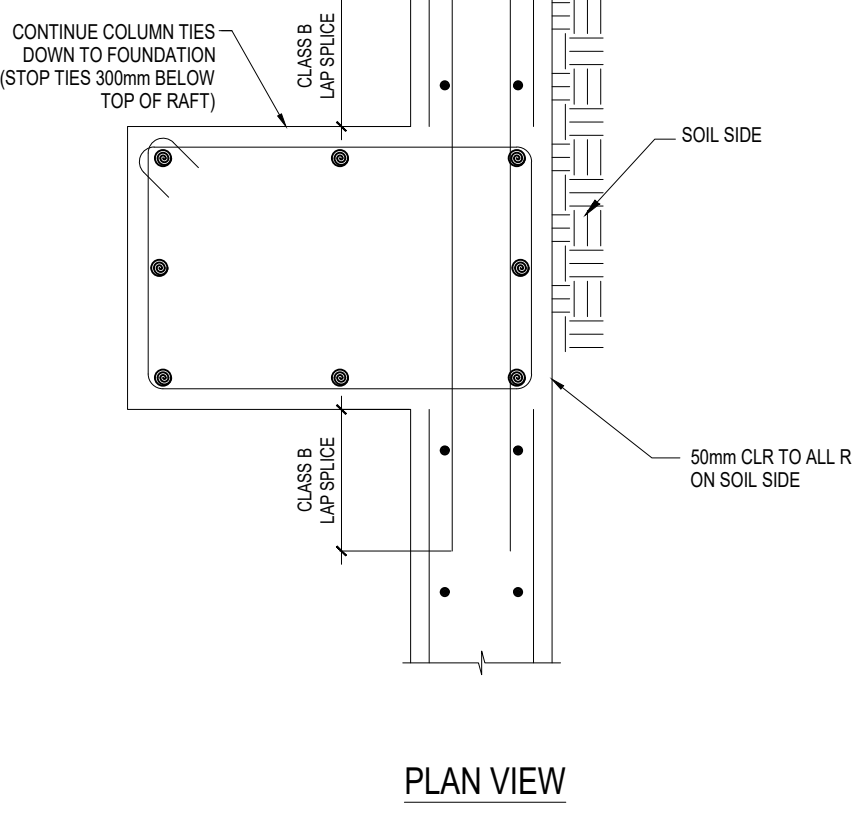

PERIMETER COLUMN AT BASEMENT WALL

SCALE: N.T.S.

CLIENT

TARUN HARISH CHANDRA KHANNA

DRAWING DETAILS

TYPICAL DETAILS - (SHEET 9 OF 10)

SHEET #

269-S-018

REVISION

R0

ISSUE DATE:

14-03-2025

SCALE @ A1

AS SHOWN

PROJECT DETAILS

KHANNA VILLA



PROJECT LOCATION
PLOT NO. 3630160
Al Manara,
Dubai

PROJECT NUMBER

269

PROJECT PHASE

DETAIL DESIGN

CONSULTANT

LOCI
لوکار

Office M31, KIA Flagship
Building
Sheikh Zayed Rd, Al Quoz 1
P. O. Box 72928, Dubai
T +971 4 357 6573
W www.loci.ae