


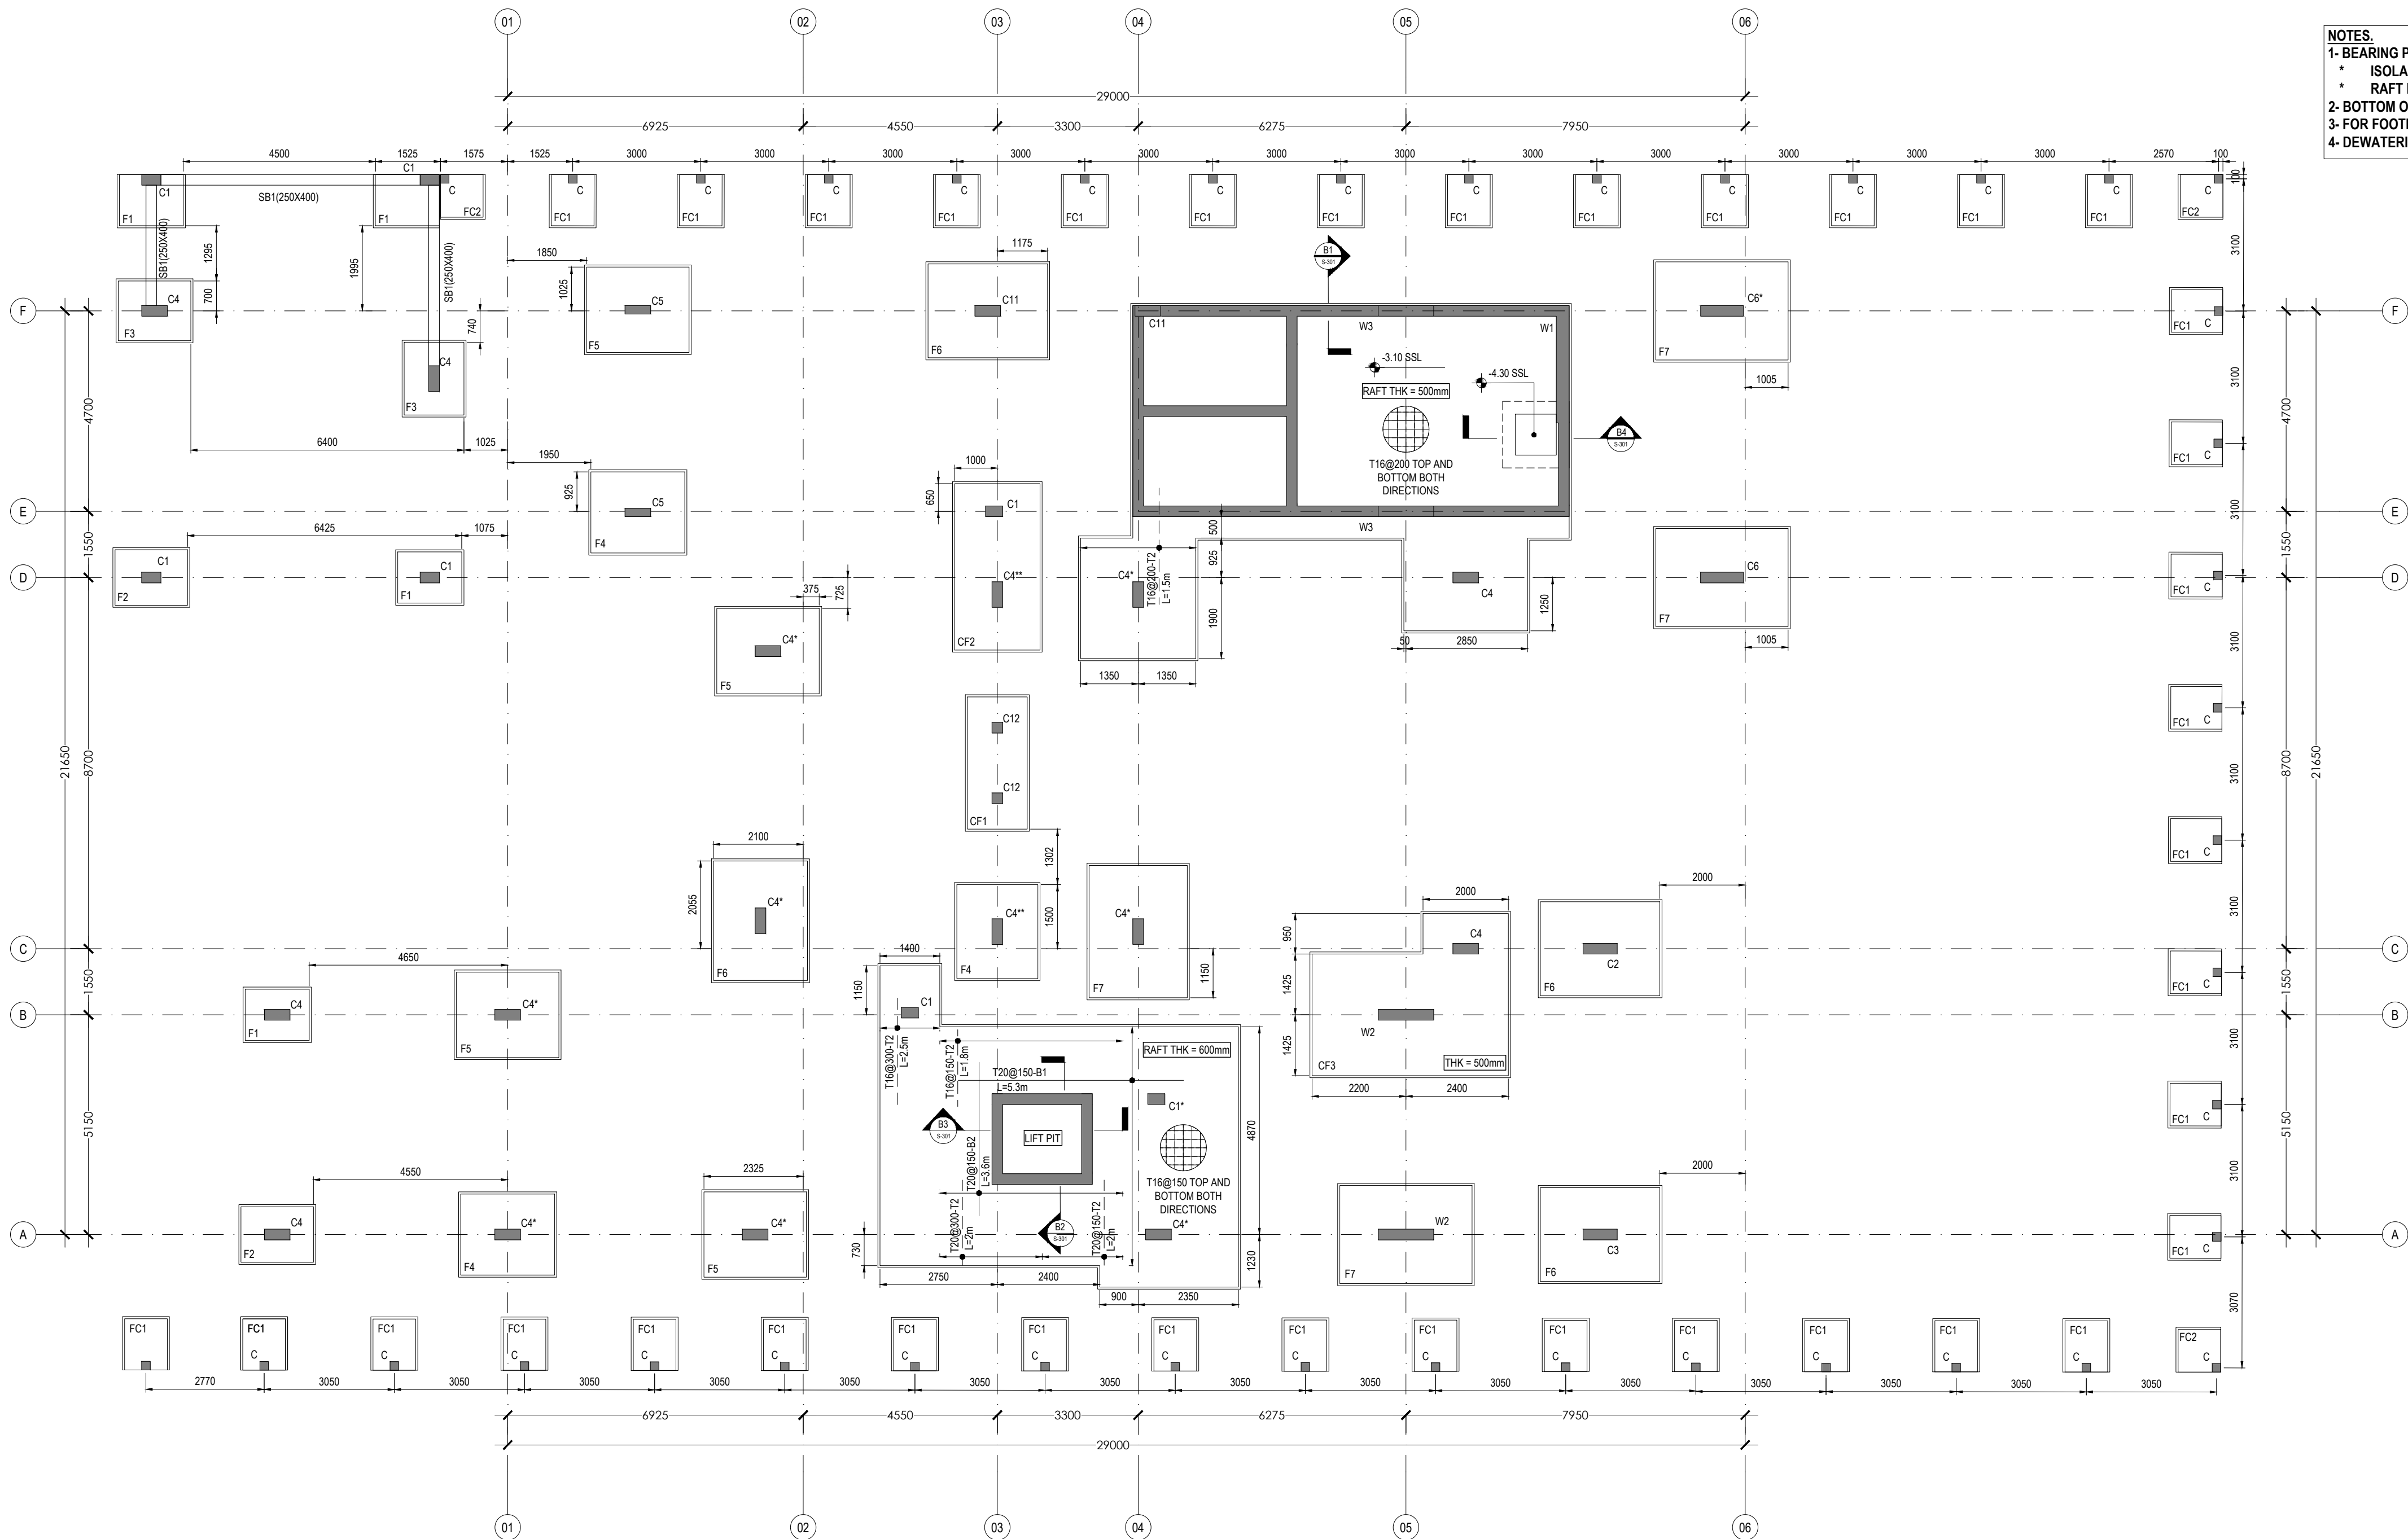


NOTE.
ACCORDING TO THE SOIL INVESTIGATION REPORT WITH REF. PDS/27401, CLAUSE 8.1.4, THE FOLLOWING APPROACH SHOULD BE CONSIDERED TO REACH A MINIMUM SOIL BEARING CAPACITY.
PLACE ONE LAYER OF 250mm THICK EACH OF ROAD BASE MATERIAL AND COMPACT THAT LAYER WITH A HEAVY ROLLER COMPACTOR (25 TONS OR MORE) TO A MINIMUM OF 98% PROCTOR MAXIMUM DRY DENSITY UNTIL REACHING THE PROPOSED FOUNDATION LEVEL.

- NOTES.**
- 1- BEARING PRESSURE OF ISOLATED/COMBINED FOOTING SHOULD BE AS FOLLOWS:
 - * ISOLATED/ COMBINED FOOTING SHALL NOT BE LESS THAN 180 KN/m².
 - * RAFT FOUNDATION SHALL NOT BE LESS THAN 180 KN/m².
 - 2- BOTTOM OF FOOTING (B.O.F) IS AT (+2.35 DMD) m U.N.O.
 - 3- FOR FOOTINGS SECTIONS, REFER TO DWG No. (S-300).
 - 4- DEWATERING IS REQUIRED FOR WATERTANK FOUNDATION

- GENERAL NOTES**
1. This Drawing Issue has been checked and approved in accordance with the LOCI Quality Management System.
 2. All works shall be carried out in accordance with particular & general specifications, in conjunction with relevant conditions of contract.
 3. This drawing shall not be used directly for Construction, but for preparation of Shop Drawings in coordination with other disciplines and Suppliers prior to manufacture, delivery and execution on site.
 4. All dimensions and levels are in millimeter, unless noted otherwise. Only written dimensions to be followed and not scaled from the drawing.
 5. All dimensions to be verified at site and coordinated with other disciplines/ manufacturers in the preparation of shop drawings. Any changes shall be validated by the consultant.
 6. For elements with indicative design, the contractor / supplier shall submit complete construction details and technical specifications for approval prior to execution. Shop drawings to particularly incorporate details at structural expansion joints as well as expansion / construction joints needed for the respective materials/ finishes / related works.
 7. Safety standards and statutory regulations shall be adhered to in the manufacture, supply, storage and installation of all works.
 8. Any discrepancy or ambiguity whatsoever with dimensions / details / legends / specifications / etc, shall be brought to the attention of the Consultant and clarification obtained prior to finalization of tender / construction.

KEY PLAN

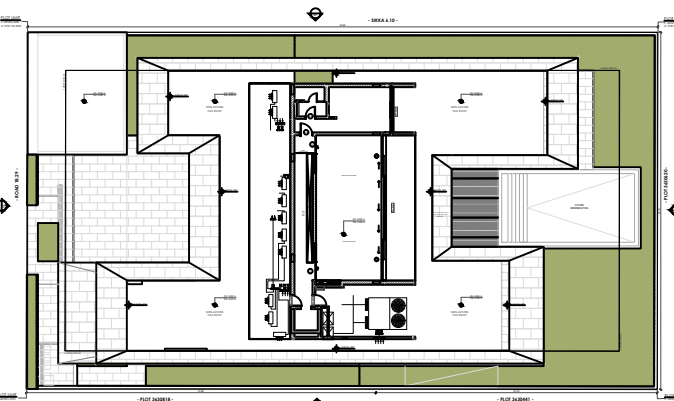

DRAWING REVISIONS

REV	DATE	DESCRIPTION	CHECKED	APPROVED
00	14.03.2025	ISSUED FOR APPROVAL	AN	BR

CLIENT

TARUN HARISH CHANDRA KHANNA

DRAWING DETAILS

FOUNDATIONS

SHEET #

269-S-100

REVISION

R0

ISSUE DATE:

14-03-2025

SCALE @ A1

AS SHOWN

PROJECT DETAILS

KHANNA VILLA



PROJECT LOCATION

PLOT NO. 3630160
Al Manara,
Dubai

PROJECT NUMBER

269

PROJECT PHASE

DETAIL DESIGN

CONSULTANT

LOCI
لوکار

Office M31, KIA Flagship
Building
Sheikh Zayed Rd, Al Quoz 1
P. O. Box 72928, Dubai
T +971 4 357 6573
W www.loci.ae

1

FOUNDATIONS
SCALE: 1:100

BEAM REINFORCEMENT SCHEDULE FOR FOUNDATION STRAP BEAMS

BEAM (MARK)	BOTTOM REINFORCEMENT	TOP REINFORCEMENT	LINKS	SIDE BARS EACH FACE	LINK ARRANGEMENT	REMARKS
SB-1	3T16+2T16	3T16+2T16	2L-T10@150	--		WITH FOUNDATION

SCHEDULE OF FOOTINGS

FOOTING	P.C FOOTING DIMENSIONS (mm)	R.C FOOTING DIMENSIONS (mm)	BOTTOM REINF. (LONG DIR.)	BOTTOM REINF. (SHORT DIR.)	TOP REINF. (X-DIRECTION)	TOP REINF. (Y-DIRECTION)	REMARKS
F1	1300 x 1600 x 50	1200 x1500 x 300	T12-200	T12-200	T12-250	T12-250	
F2	1400 x 1800 x 50	1300 x 1700 x 300	T12-200	T12-200	T12-250	T12-250	
F3	1500 x 1800 x 50	1400 x 1700x 300	T12-200	T12-200	T12-250	T12-250	
F4	2000 x 2300 x 50	1900 x 2200 x 400	T12-150	T12-150	T12-250	T12-250	REFER TO SHEET S-010 - DETAIL 4
F5	2100 x 2500 x 50	2000 x 2400 x 400	T12-150	T12-150	T12-250	T12-250	
F6	2300 x 2900 x 50	2200 x 2800 x 400	T16-200	T16-200	T12-250	T12-250	
F7	2400 x 3200 x 50	2300 x 3100 x 500	T16-200	T16-200	T12-250	T12-250	REFER TO SHEET S-010 - DETAIL 4
CF1	1500 x 3200 x 50	1400 x 3100 x 400	T12-150	T12-150	T12-250	T12-250	
CF2	2100 x 4000 x 50	2000 x 3900 x 400	T12-150	T12-150	T12-250	T12-250	
CF3	REFER TO PLAN	REFER TO PLAN	T20-150	T16-200	T12-250	T12-250	
FC1	1100 x 1250 x 50	1000 x 1200 x 300	T12-150	T12-150	T12-200	T12-200	
FC2	1050 x 1050 x 50	1000 x 1000 x 300	T12-150	T12-150	T12-200	T12-200	