



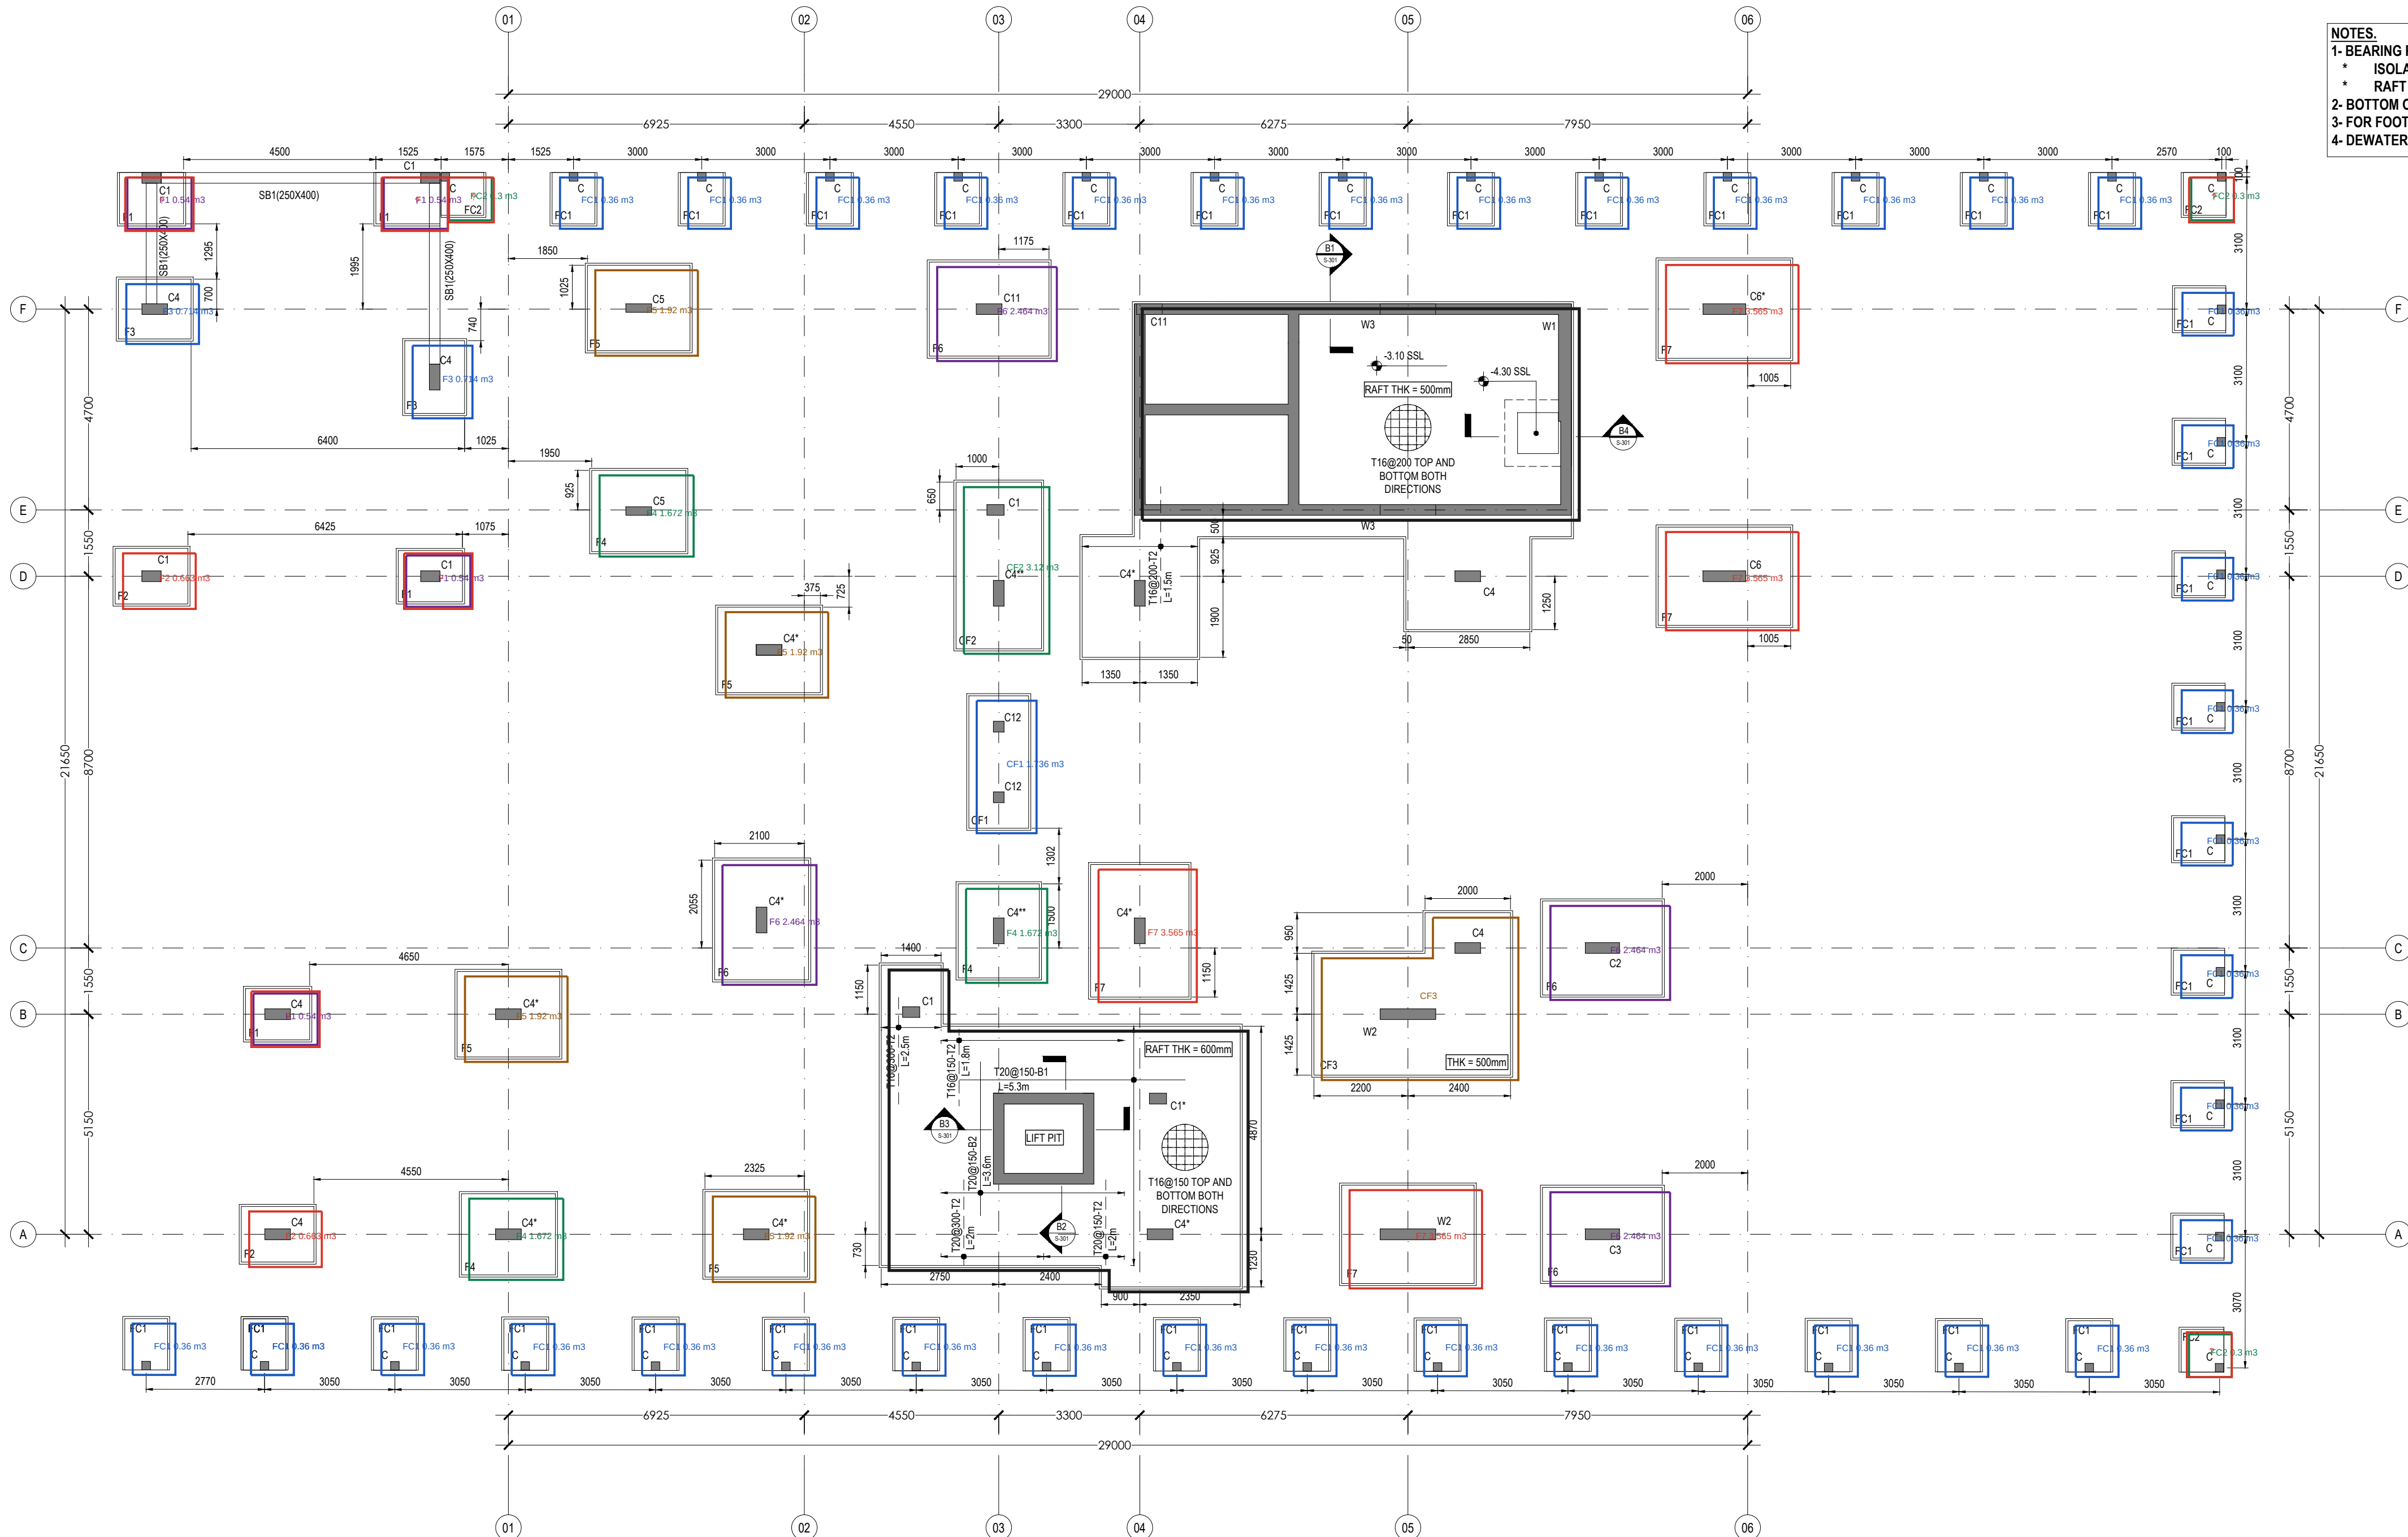

**NOTE.**  
**ACCORDING TO THE SOIL INVESTIGATION REPORT WITH REF. PDS/27401, CLAUSE 8.1.4, THE FOLLOWING APPROACH SHOULD BE CONSIDERED TO REACH A MINIMUM SOIL BEARING CAPACITY.**  
**PLACE ONE LAYER OF 250mm THICK EACH OF ROAD BASE MATERIAL AND COMPACT THAT LAYER WITH A HEAVY ROLLER COMPACTOR (25 TONS OR MORE) TO A MINIMUM OF 98% PROCTOR MAXIMUM DRY DENSITY UNTIL REACHING THE PROPOSED FOUNDATION LEVEL.**

- NOTES.**
- 1- BEARING PRESSURE OF ISOLATED/COMBINED FOOTING SHOULD BE AS FOLLOWS:
    - \* ISOLATED/ COMBINED FOOTING SHALL NOT BE LESS THAN 180 KN/m<sup>2</sup>.
    - \* RAFT FOUNDATION SHALL NOT BE LESS THAN 180 KN/m<sup>2</sup>.
  - 2- BOTTOM OF FOOTING (B.O.F) IS AT (+2.35 DMD) m U.N.O.
  - 3- FOR FOOTINGS SECTIONS, REFER TO DWG No. (S-300).
  - 4- DEWATERING IS REQUIRED FOR WATERTANK FOUNDATION

- GENERAL NOTES**
1. This Drawing Issue has been checked and approved in accordance with the LOCI Quality Management System.
  2. All works shall be carried out in accordance with particular B general specifications, in conjunction with relevant conditions of contract.
  3. This drawing shall not be used directly for Construction, but for preparation of Shop Drawings in coordination with other disciplines and Suppliers prior to manufacture, delivery and execution on site.
  4. All dimensions and levels are in millimeter, unless noted otherwise. Only written dimensions to be followed and not scaled from the drawing.
  5. All dimensions to be verified at site and coordinated with other disciplines/ manufacturers in the preparation of shop drawings. Any changes shall be validated by the consultant.
  6. For elements with indicative design, the contractor / supplier shall submit complete construction details and technical specifications for approval prior to execution. Shop drawings to particularly incorporate details at structural expansion joints as well as expansion / construction joints needed for the respective materials/ finishes / related works.
  7. Safety standards and statutory regulations shall be adhered to in the manufacture, supply, storage and installation of all works.
  8. Any discrepancy or ambiguity whatsoever with dimensions / details / legends / specifications / etc, shall be brought to the attention of the Consultant and clarification obtained prior to finalization of tender / construction.

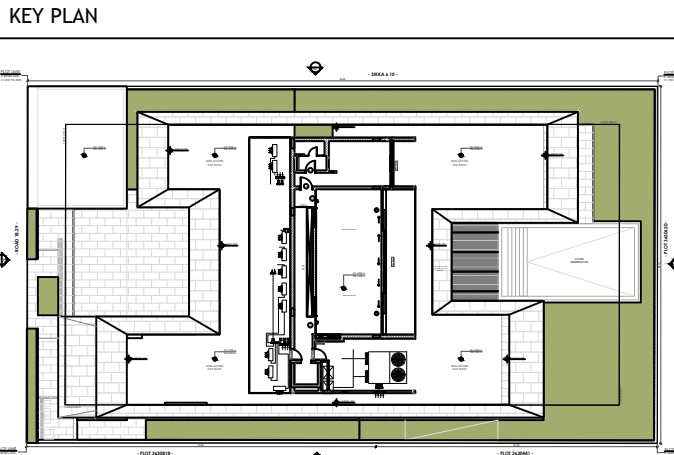

| DRAWING REVISIONS |            |                     |         |          |
|-------------------|------------|---------------------|---------|----------|
| REV               | DATE       | DESCRIPTION         | CHECKED | APPROVED |
| 00                | 14.03.2025 | ISSUED FOR APPROVAL | AN      | BR       |

CLIENT  
**TARUN HARISH CHANDRA KHANNA**

DRAWING DETAILS  
**FOUNDATIONS**

SHEET #  
**269-S-100**

|          |             |            |
|----------|-------------|------------|
| REVISION | ISSUE DATE: | SCALE @ A1 |
| R0       | 14-03-2025  | AS SHOWN   |

PROJECT DETAILS  
**KHANNA VILLA**



|                                         |                |
|-----------------------------------------|----------------|
| PROJECT LOCATION                        | PROJECT NUMBER |
| PLOT NO. 3630160<br>Al Manara,<br>Dubai | <b>269</b>     |

PROJECT PHASE  
**DETAIL DESIGN**

CONSULTANT

**LOCI**  
لوکار

Office M31, KIA Flagship Building  
Sheikh Zayed Rd, Al Quoz 1  
P.O. Box 72928, Dubai  
T +971 4 357 6573  
W www.loci.ae

| SCHEDULE OF FOOTINGS |                             |                             |                           |                            |                          |                          |                                 |
|----------------------|-----------------------------|-----------------------------|---------------------------|----------------------------|--------------------------|--------------------------|---------------------------------|
| FOOTING              | P.C FOOTING DIMENSIONS (mm) | R.C FOOTING DIMENSIONS (mm) | BOTTOM REINF. (LONG DIR.) | BOTTOM REINF. (SHORT DIR.) | TOP REINF. (X-DIRECTION) | TOP REINF. (Y-DIRECTION) | REMARKS                         |
| F1                   | 1300 x 1600 x 50            | 1200 x1500 x 300            | T12-200                   | T12-200                    | T12-250                  | T12-250                  |                                 |
| F2                   | 1400 x 1800 x 50            | 1300 x 1700 x 300           | T12-200                   | T12-200                    | T12-250                  | T12-250                  |                                 |
| F3                   | 1500 x 1800 x 50            | 1400 x 1700x 300            | T12-200                   | T12-200                    | T12-250                  | T12-250                  |                                 |
| F4                   | 2000 x 2300 x 50            | 1900 x 2200 x 400           | T12-150                   | T12-150                    | T12-250                  | T12-250                  | REFER TO SHEET S-010 - DETAIL 4 |
| F5                   | 2100 x 2500 x 50            | 2000 x 2400 x 400           | T12-150                   | T12-150                    | T12-250                  | T12-250                  |                                 |
| F6                   | 2300 x 2900 x 50            | 2200 x 2800 x 400           | T16-200                   | T16-200                    | T12-250                  | T12-250                  |                                 |
| F7                   | 2400 x 3200 x 50            | 2300 x 3100 x 500           | T16-200                   | T16-200                    | T12-250                  | T12-250                  | REFER TO SHEET S-010 - DETAIL 4 |
| CF1                  | 1500 x 3200 x 50            | 1400 x 3100 x 400           | T12-150                   | T12-150                    | T12-250                  | T12-250                  |                                 |
| CF2                  | 2100 x 4000 x 50            | 2000 x 3900 x 400           | T12-150                   | T12-150                    | T12-250                  | T12-250                  |                                 |
| CF3                  | REFER TO PLAN               | REFER TO PLAN               | T20-150                   | T16-200                    | T12-250                  | T12-250                  |                                 |
| FC1                  | 1100 x 1250 x 50            | 1000 x 1200 x 300           | T12-150                   | T12-150                    | T12-200                  | T12-200                  |                                 |
| FC2                  | 1050 x 1050 x 50            | 1000 x 1000 x 300           | T12-150                   | T12-150                    | T12-200                  | T12-200                  |                                 |

**FOUNDATIONS**  
SCALE: 1:100

| BEAM REINFORCEMENT SCHEDULE FOR FOUNDATION STRAP BEAMS |                      |                   |            |                     |                  |                 |
|--------------------------------------------------------|----------------------|-------------------|------------|---------------------|------------------|-----------------|
| BEAM (MARK)                                            | BOTTOM REINFORCEMENT | TOP REINFORCEMENT | LINKS      | SIDE BARS EACH FACE | LINK ARRANGEMENT | REMARKS         |
| SB-1                                                   | 3T16+2T16            | 3T16+2T16         | 2L-T10@150 | --                  |                  | WITH FOUNDATION |