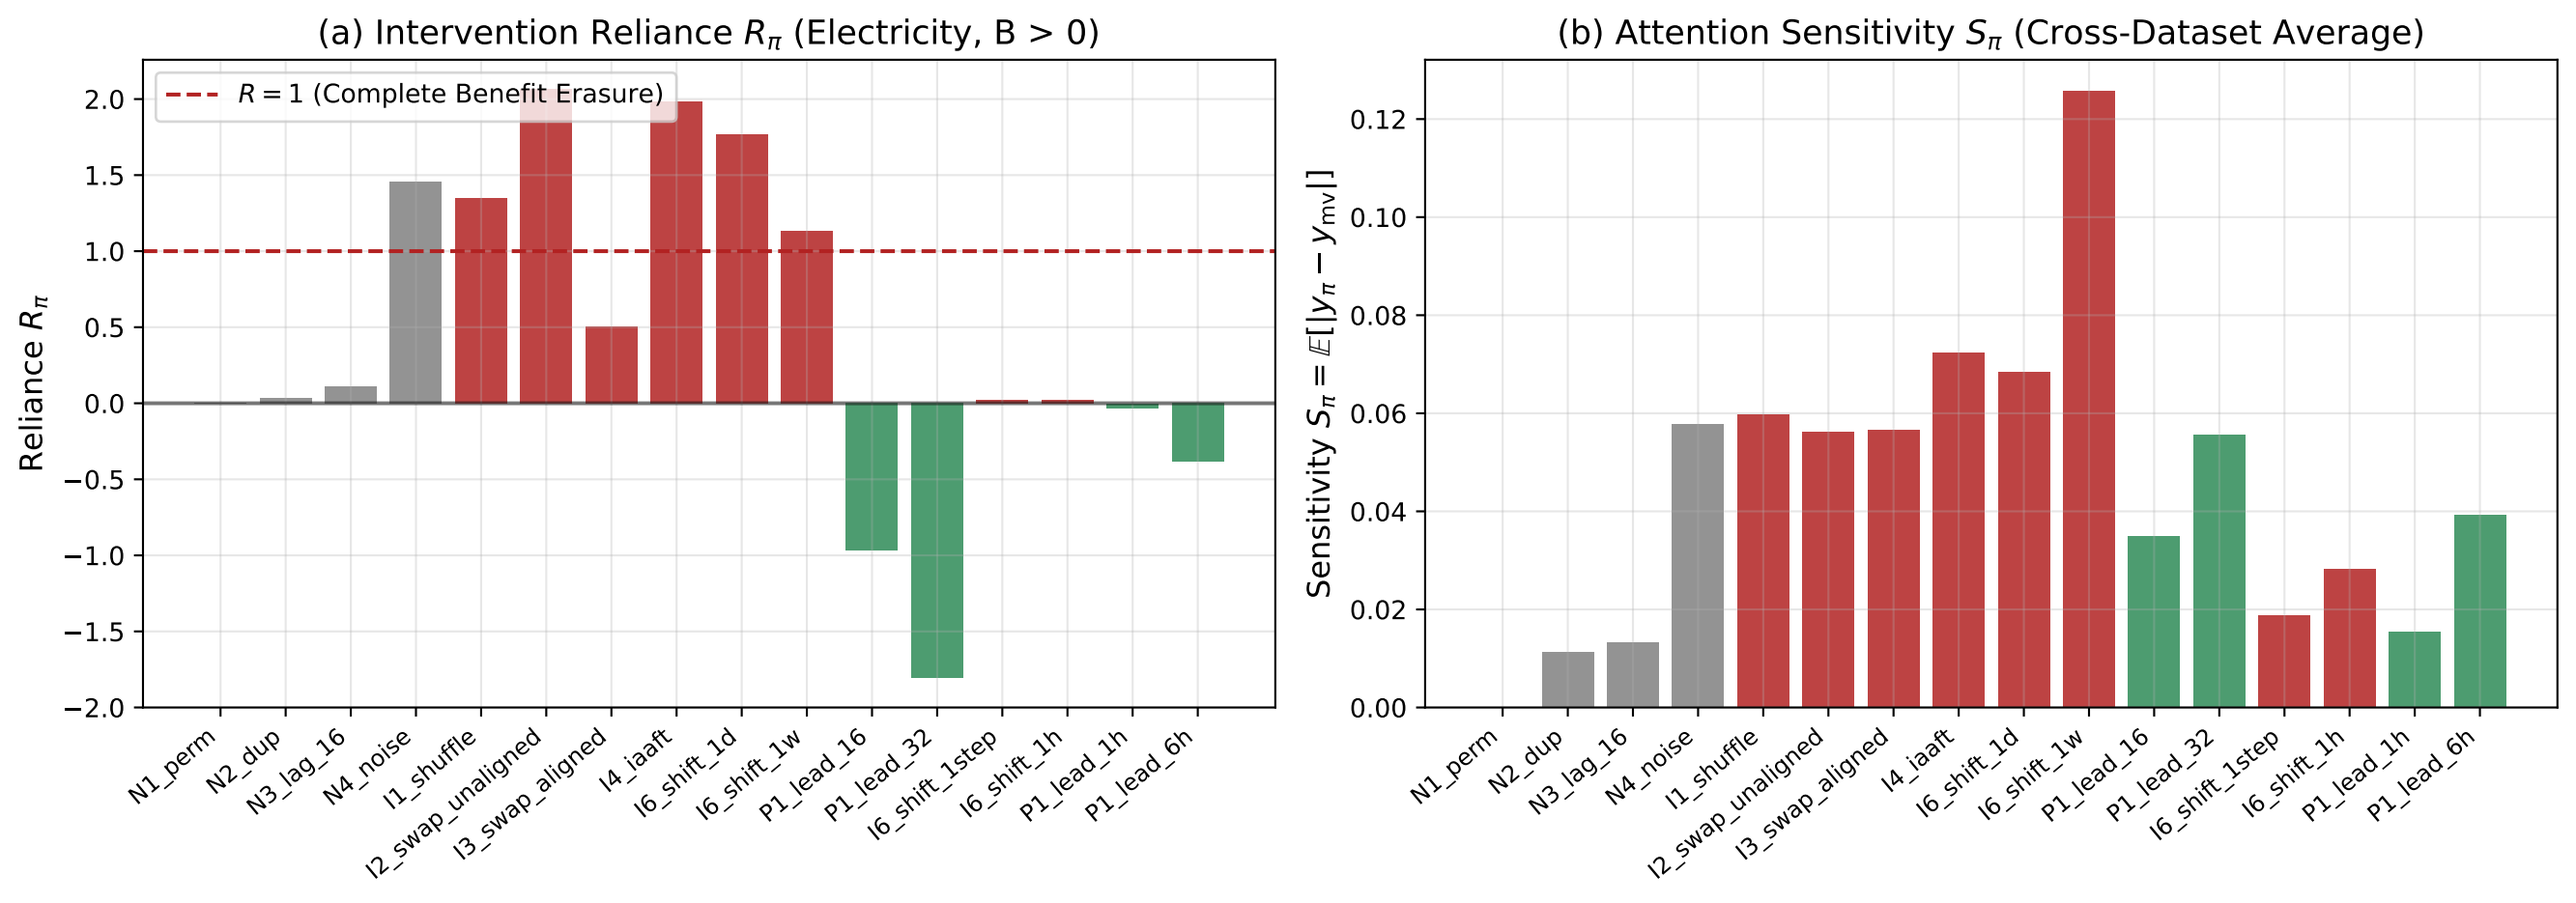
(a) Intervention Reliance R_π (Electricity, B > 0)
$R = 1$ (Complete Benefit Erasure)
Reliance R_π
2.0
1.5
1.0
0.5
0.0
−0.5
−1.0
−1.5
−2.0
N1_perm
N2_dup
N3_lag_16
N4_noise
I1_shuffle
I2_swap_unaligned
I3_swap_aligned
I4_iaaft
I6_shift_1d
I6_shift_1w
P1_lead_16
P1_lead_32
I6_shift_1step
I6_shift_1h
P1_lead_1h
P1_lead_6h
(b) Attention Sensitivity S_π (Cross-Dataset Average)
Sensitivity $S_\pi = \mathbb{E}[|y_\pi - y_{\text{mv}}|]$
0.12
0.10
0.08
0.06
0.04
0.02
0.00
N1_perm
N2_dup
N3_lag_16
N4_noise
I1_shuffle
I2_swap_unaligned
I3_swap_aligned
I4_iaaft
I6_shift_1d
I6_shift_1w
P1_lead_16
P1_lead_32
I6_shift_1step
I6_shift_1h
P1_lead_1h
P1_lead_6h