

INSTALLATION OF CONDENSATE OVERFLOW SWITCH

**WARNING TURN OFF POWER AT
DISCONNECT BEFORE INSTALLATION**



RECTOR SEAL
SS3

INSTALLED
NEARLY TOUCHES
BOTTOM OF PAN
WHEN SET AT
DEEPEST
LOCATION


DONUT RISING AN
INCH WILL TRIP

NO FURTHER
UPPER LEVEL CAN
BE SET WITHOUT
ADDING METAL TO
PAN LIP






EASILY REMOVED
WIREWAY COVER
PANELS 5/16 NUT
DRIVER

FISH WIRE
THROUH AND INTO
CONTROL SECTION

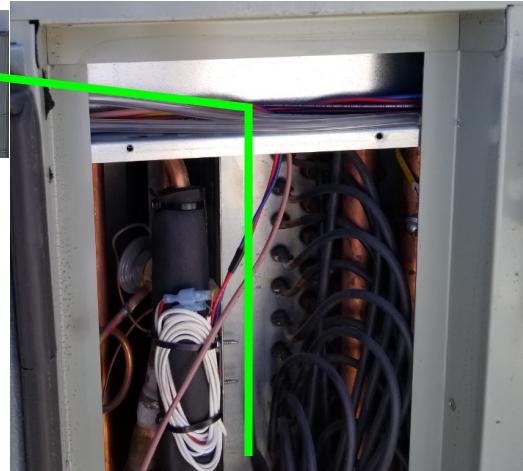

SIDE OF UNIT WITH
ACCESS DOORS

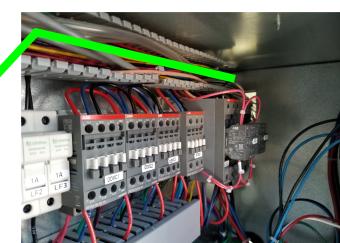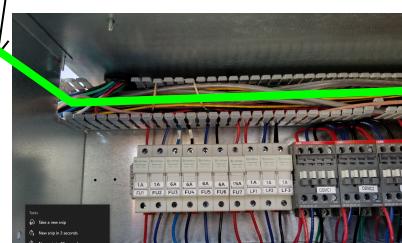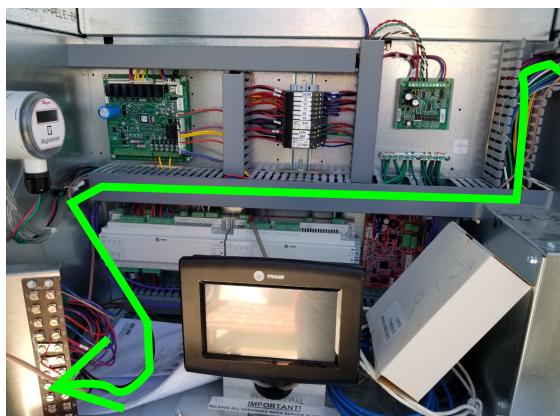

CONTROLS SECTION