Analog input 1 is maintained at a temperature of analog input 2 plus variable 1 value.

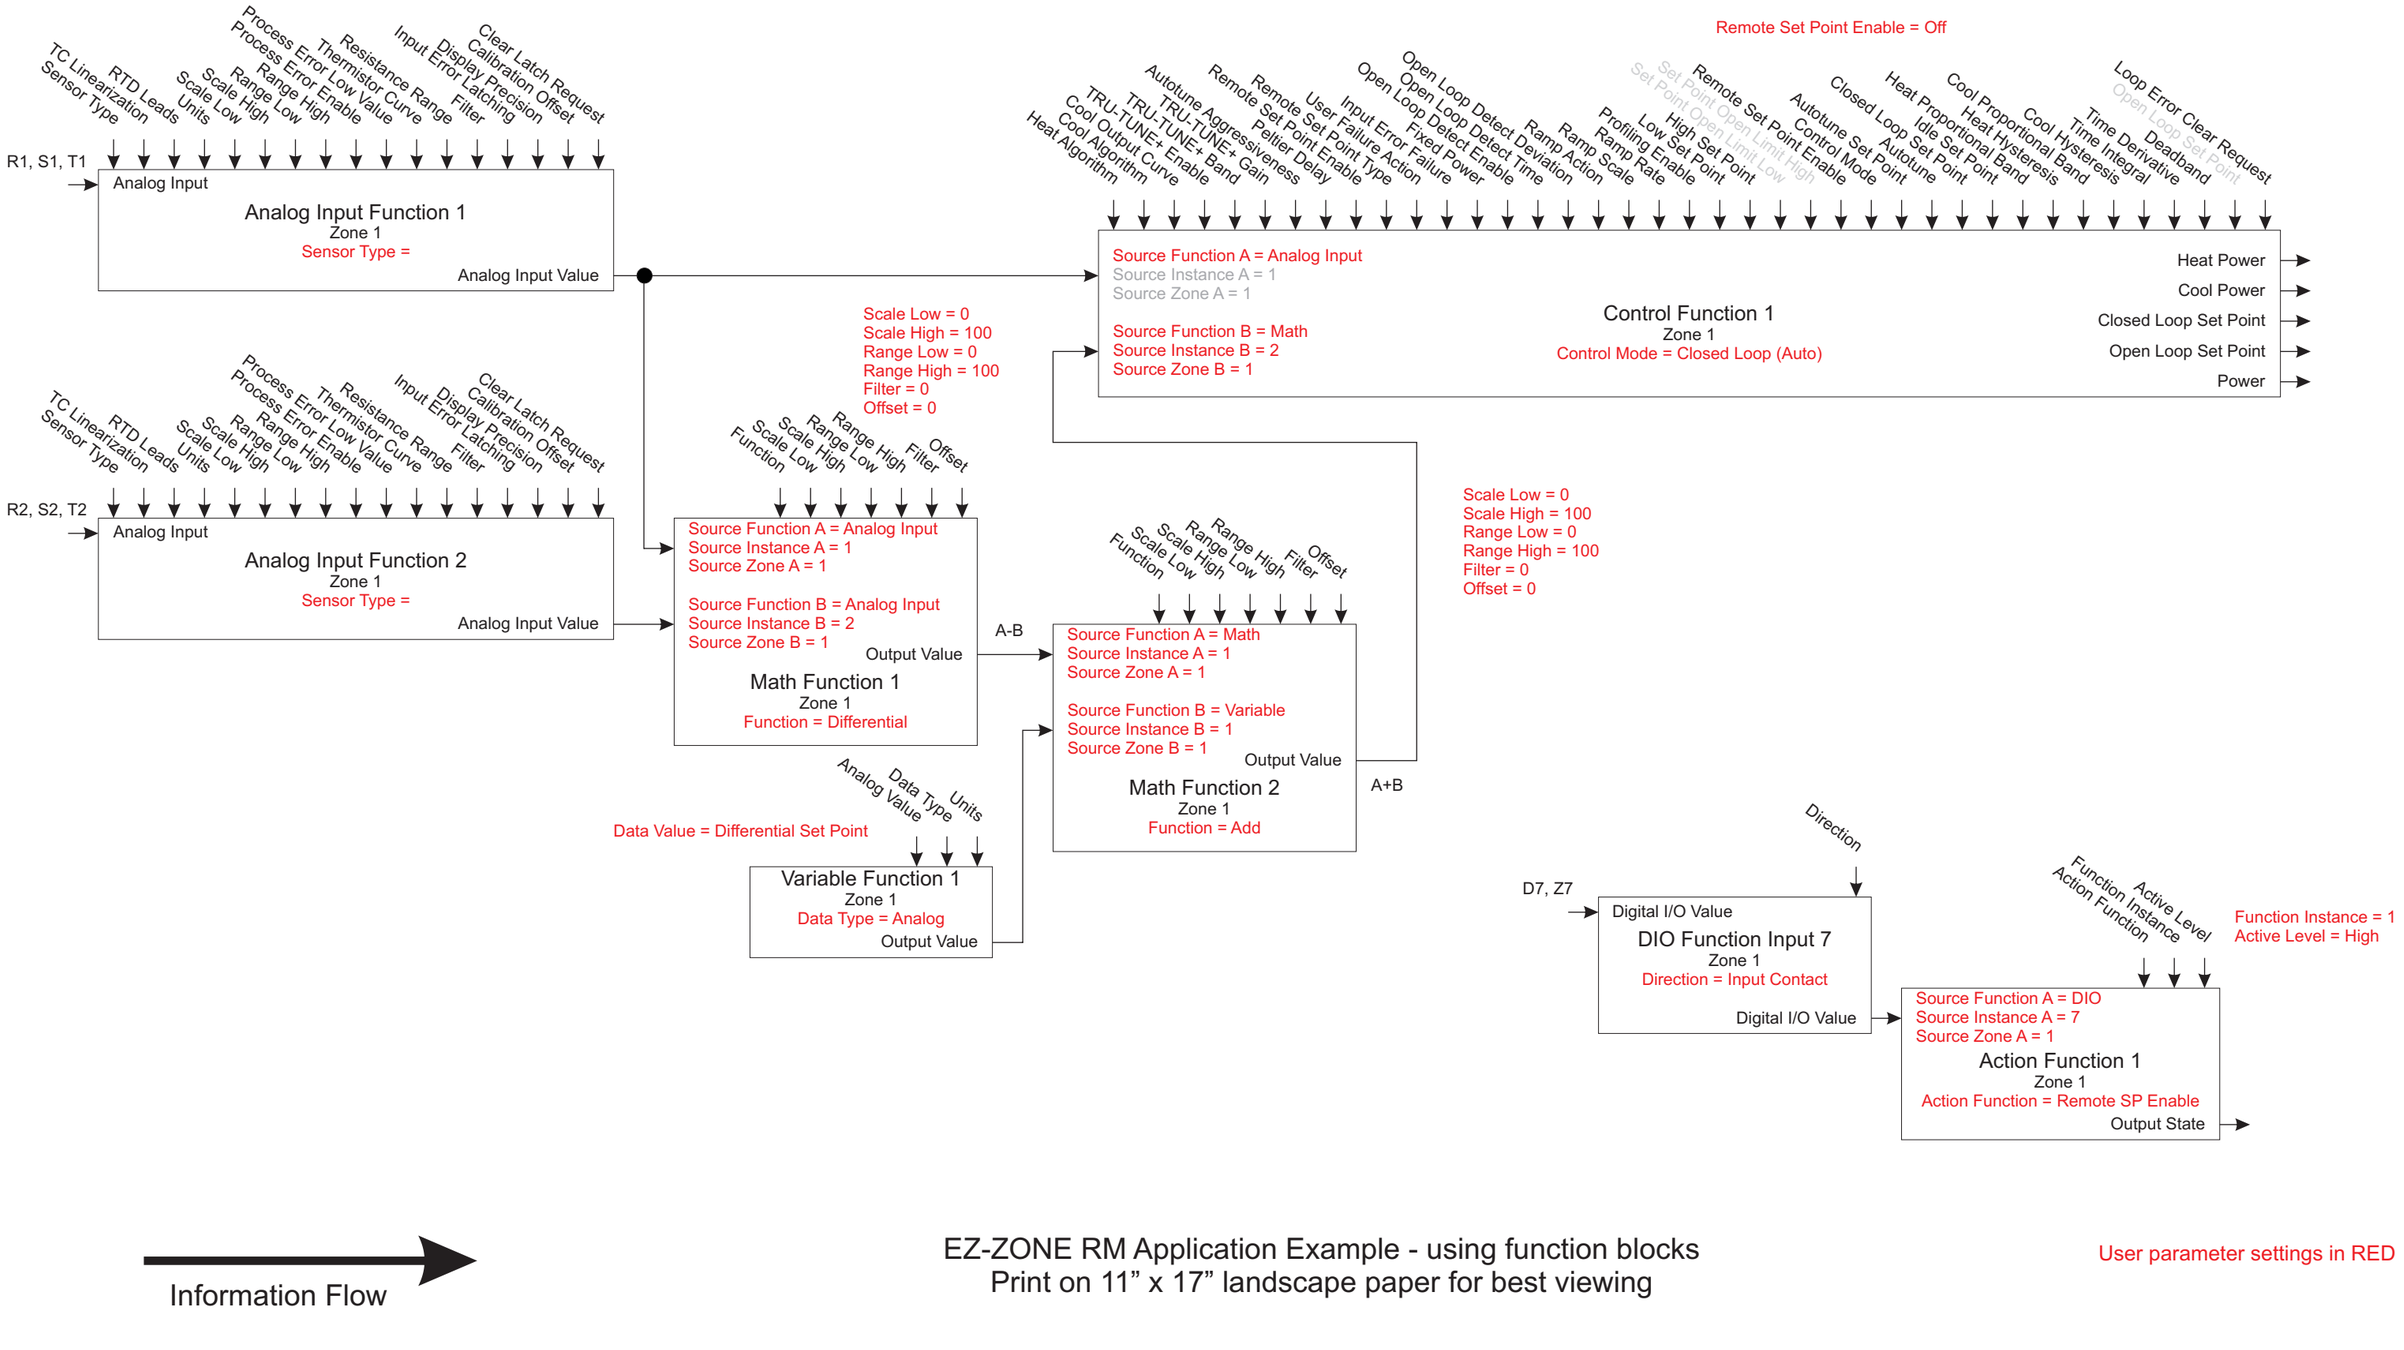

Information Flow

EZ-ZONE RM Application Example - using function blocks
Print on 11” x 17” landscape paper for best viewing

User parameter settings in RED