


HVAC CONTROLS (GM6) Interface
In CPI Electrical Control Cabinet


LED #5 In CPI Cabinet is on when
ALI/ alarm input is correct

LED #4 In CPI Cabinet is on when
system is armed

	Relay #1	Lights
System Armed	Open - ALA	Off
System Disarmed	Closed - ALA	On
	Relay #2	Lights
Secure	Closed - ALI	NA
In Alarm	Open - ALI	On

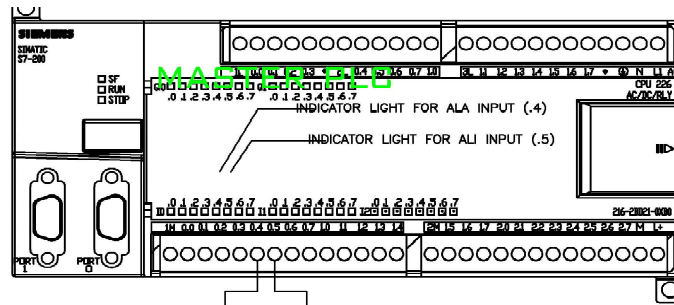

Terminals in CPI
Panel

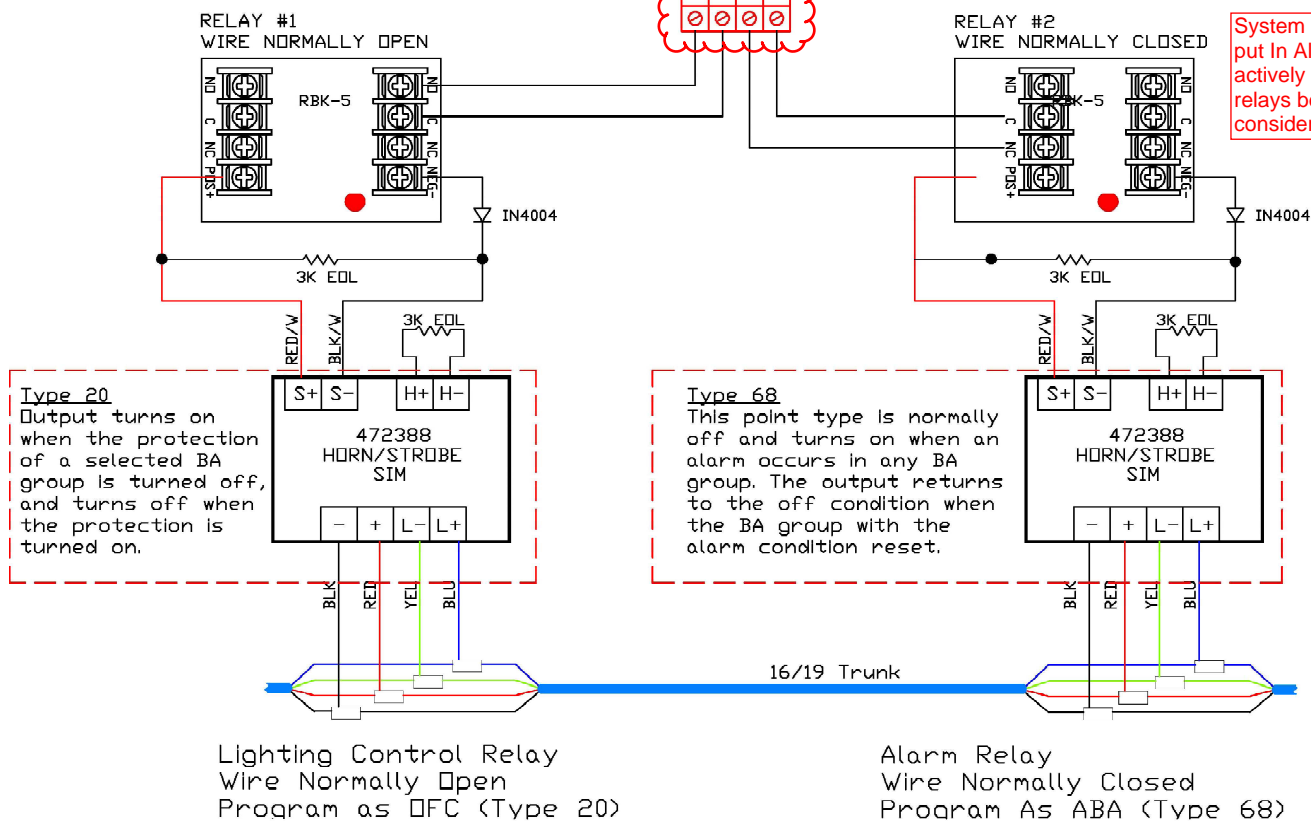

System must be Armed and
put In Alarm while Nomad is
actively watching to verify
relays before this can be
considered verified

Type 20
Option 1 - Yes
Option 2 - Not
Option 3 - Not

Type 68
Option 1 - Not
Option 2 - Not
Option 3 - Not