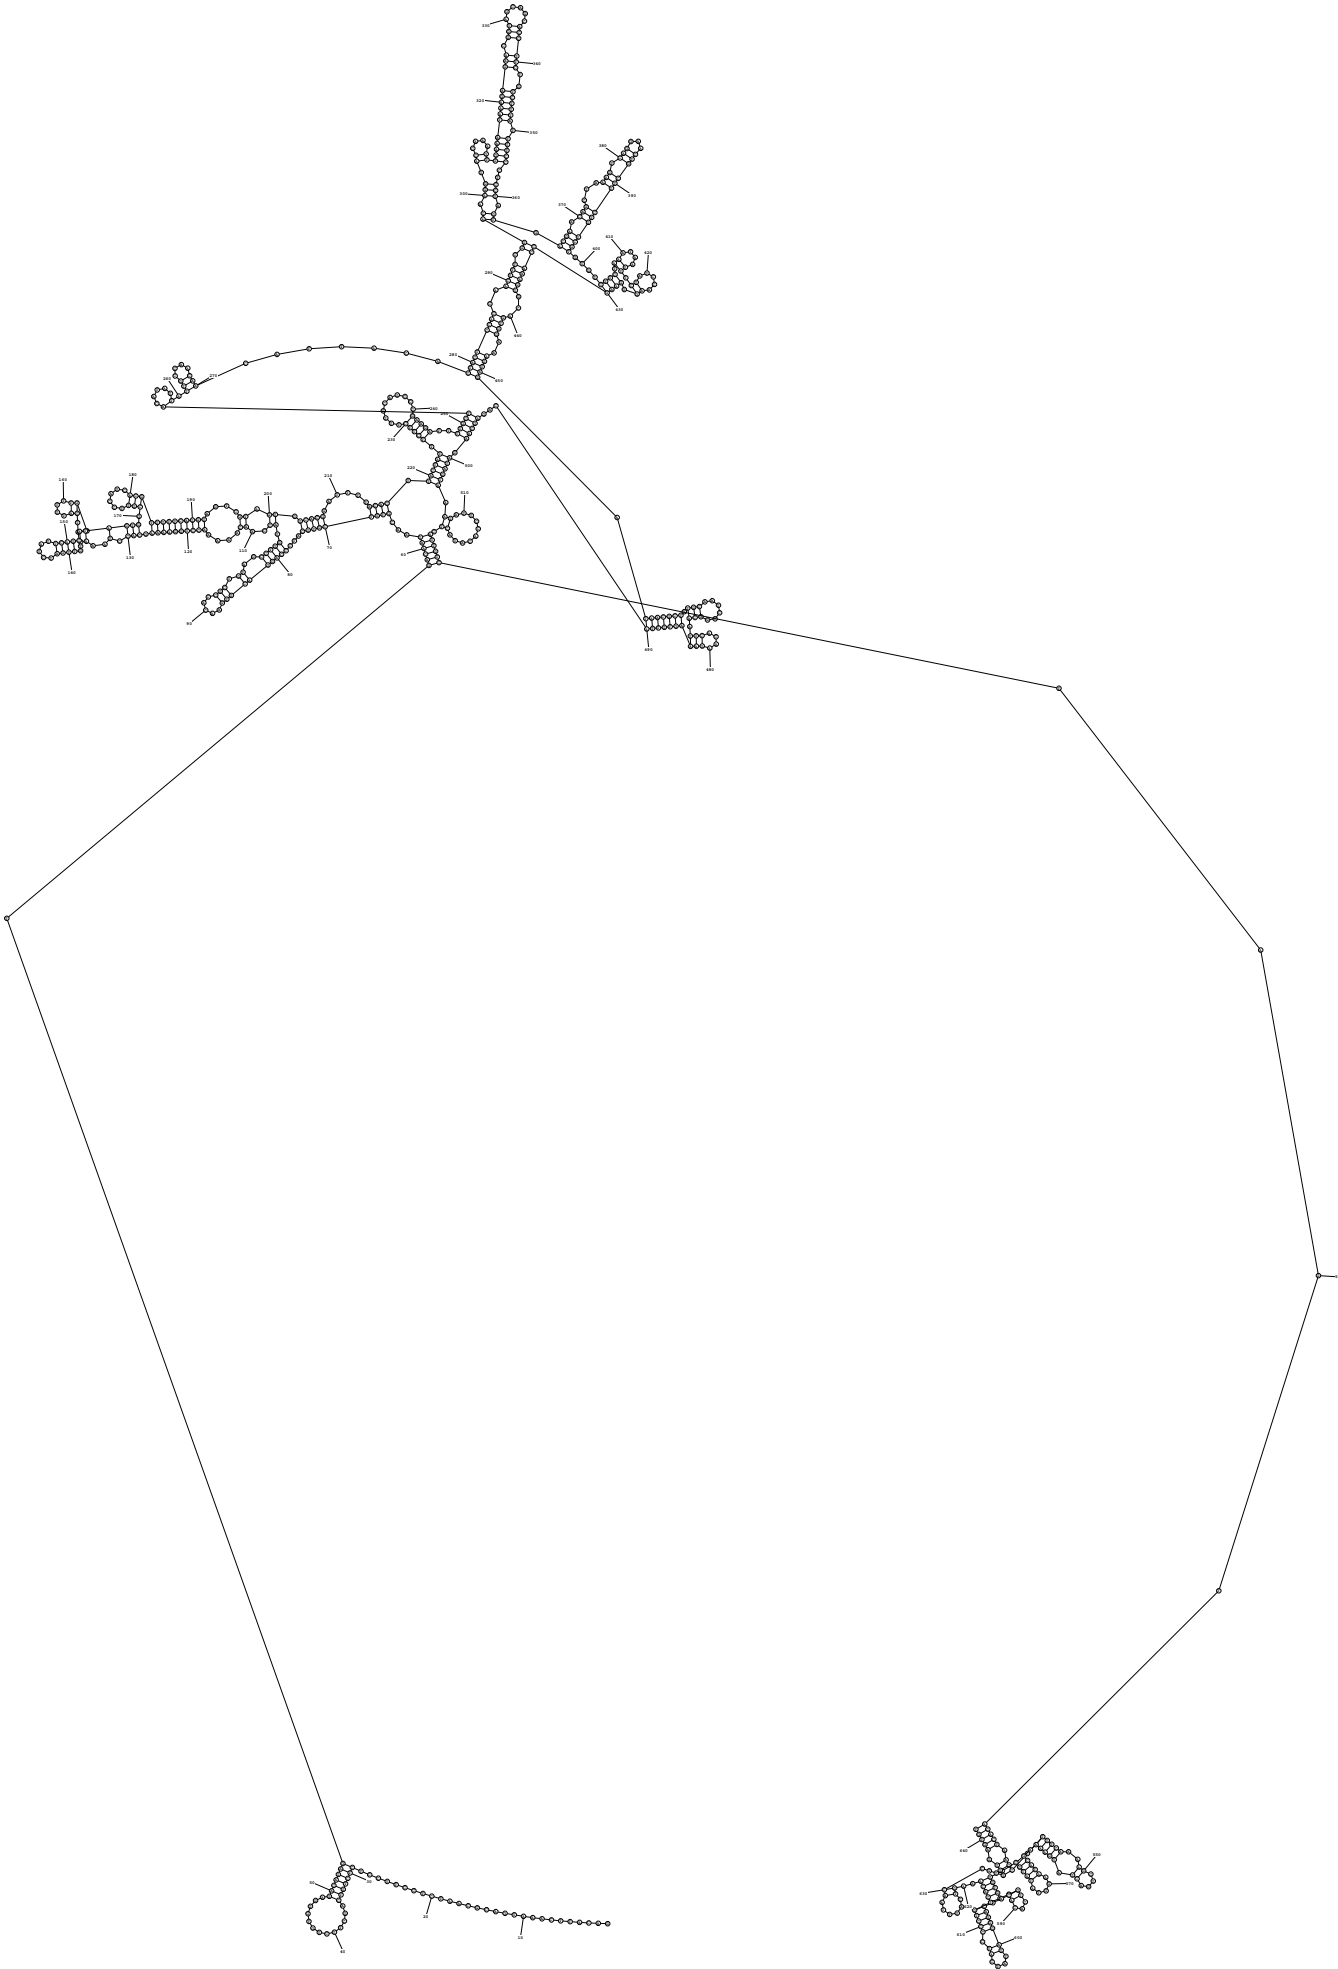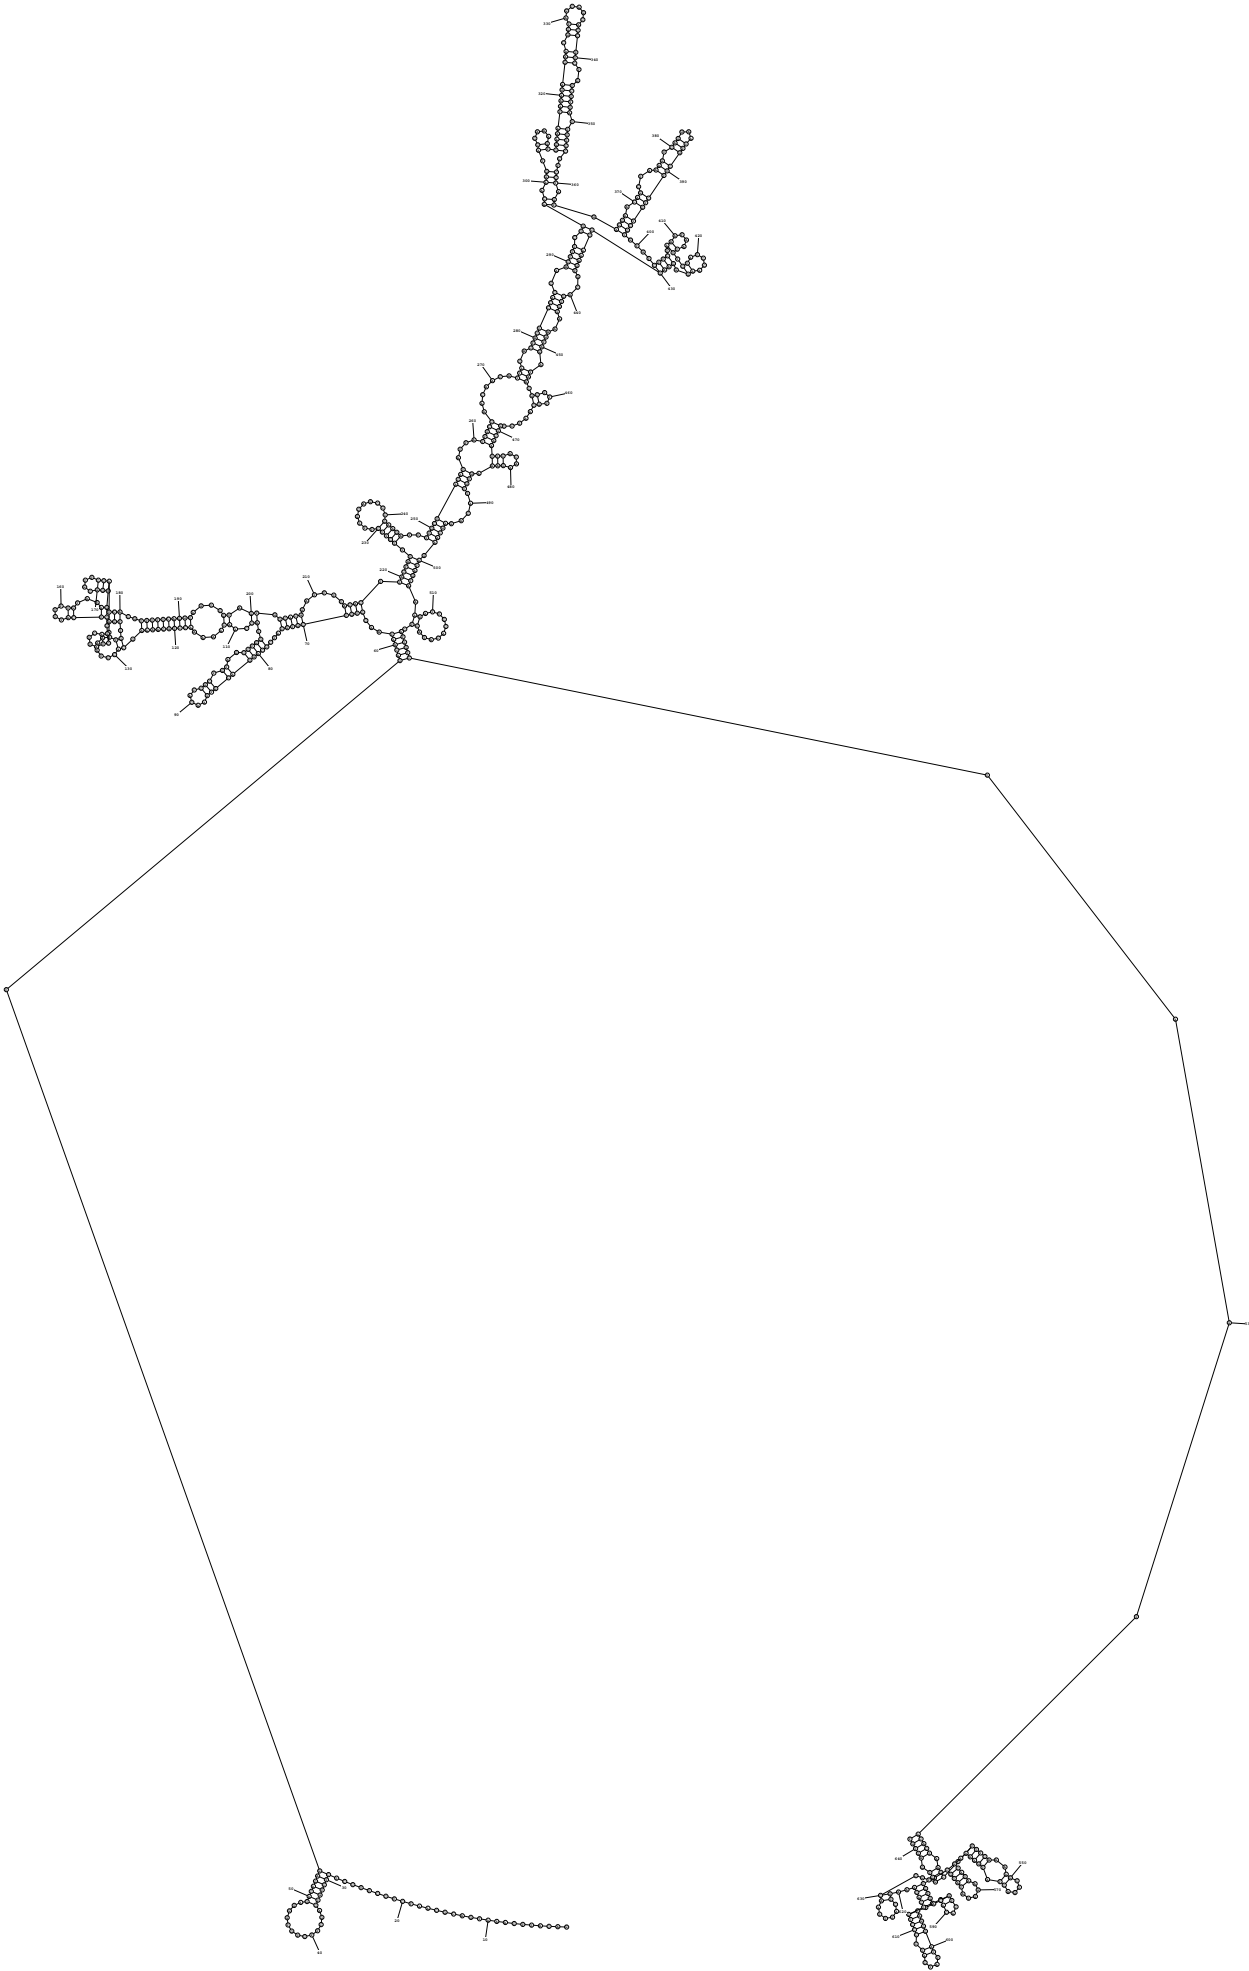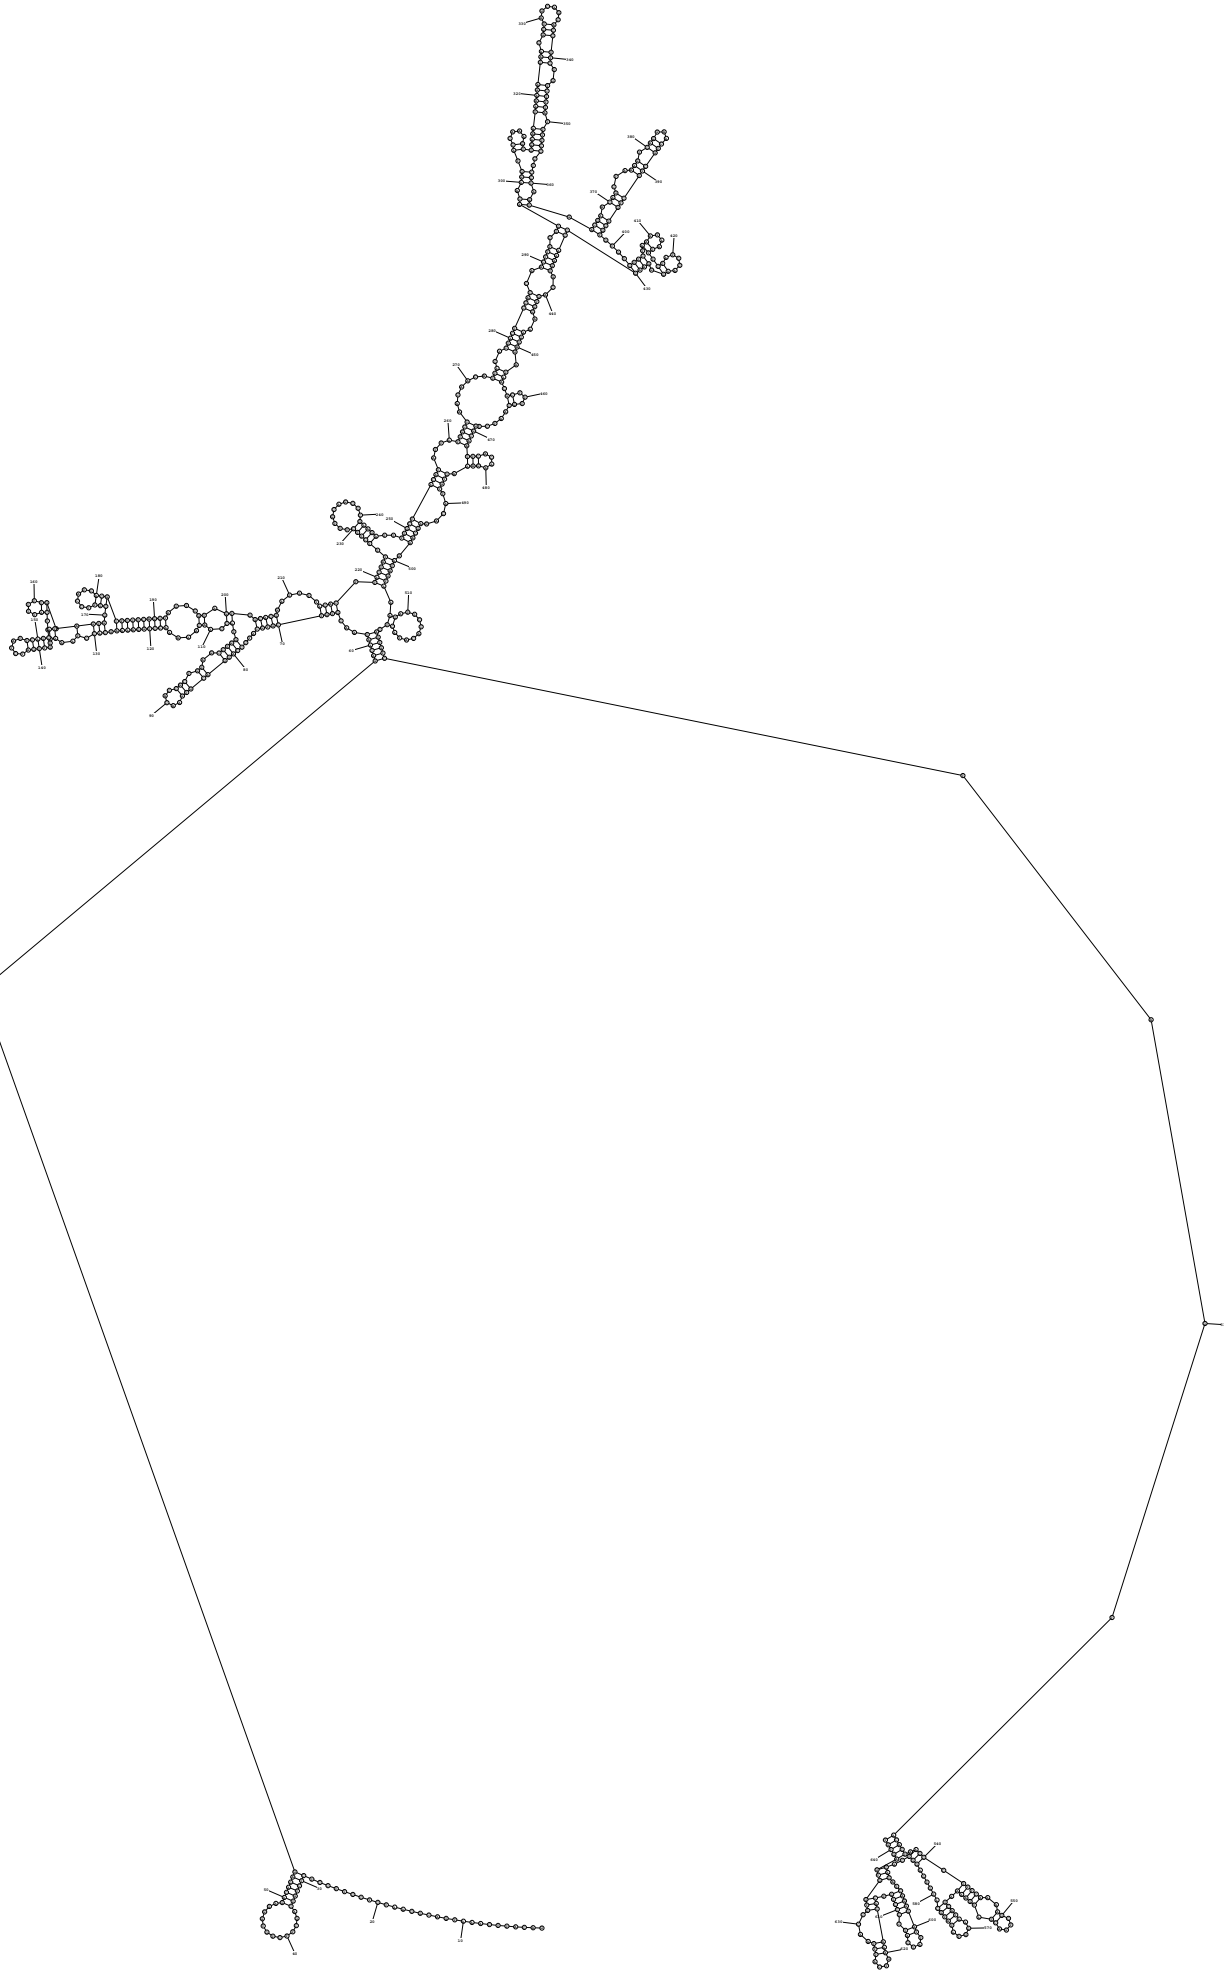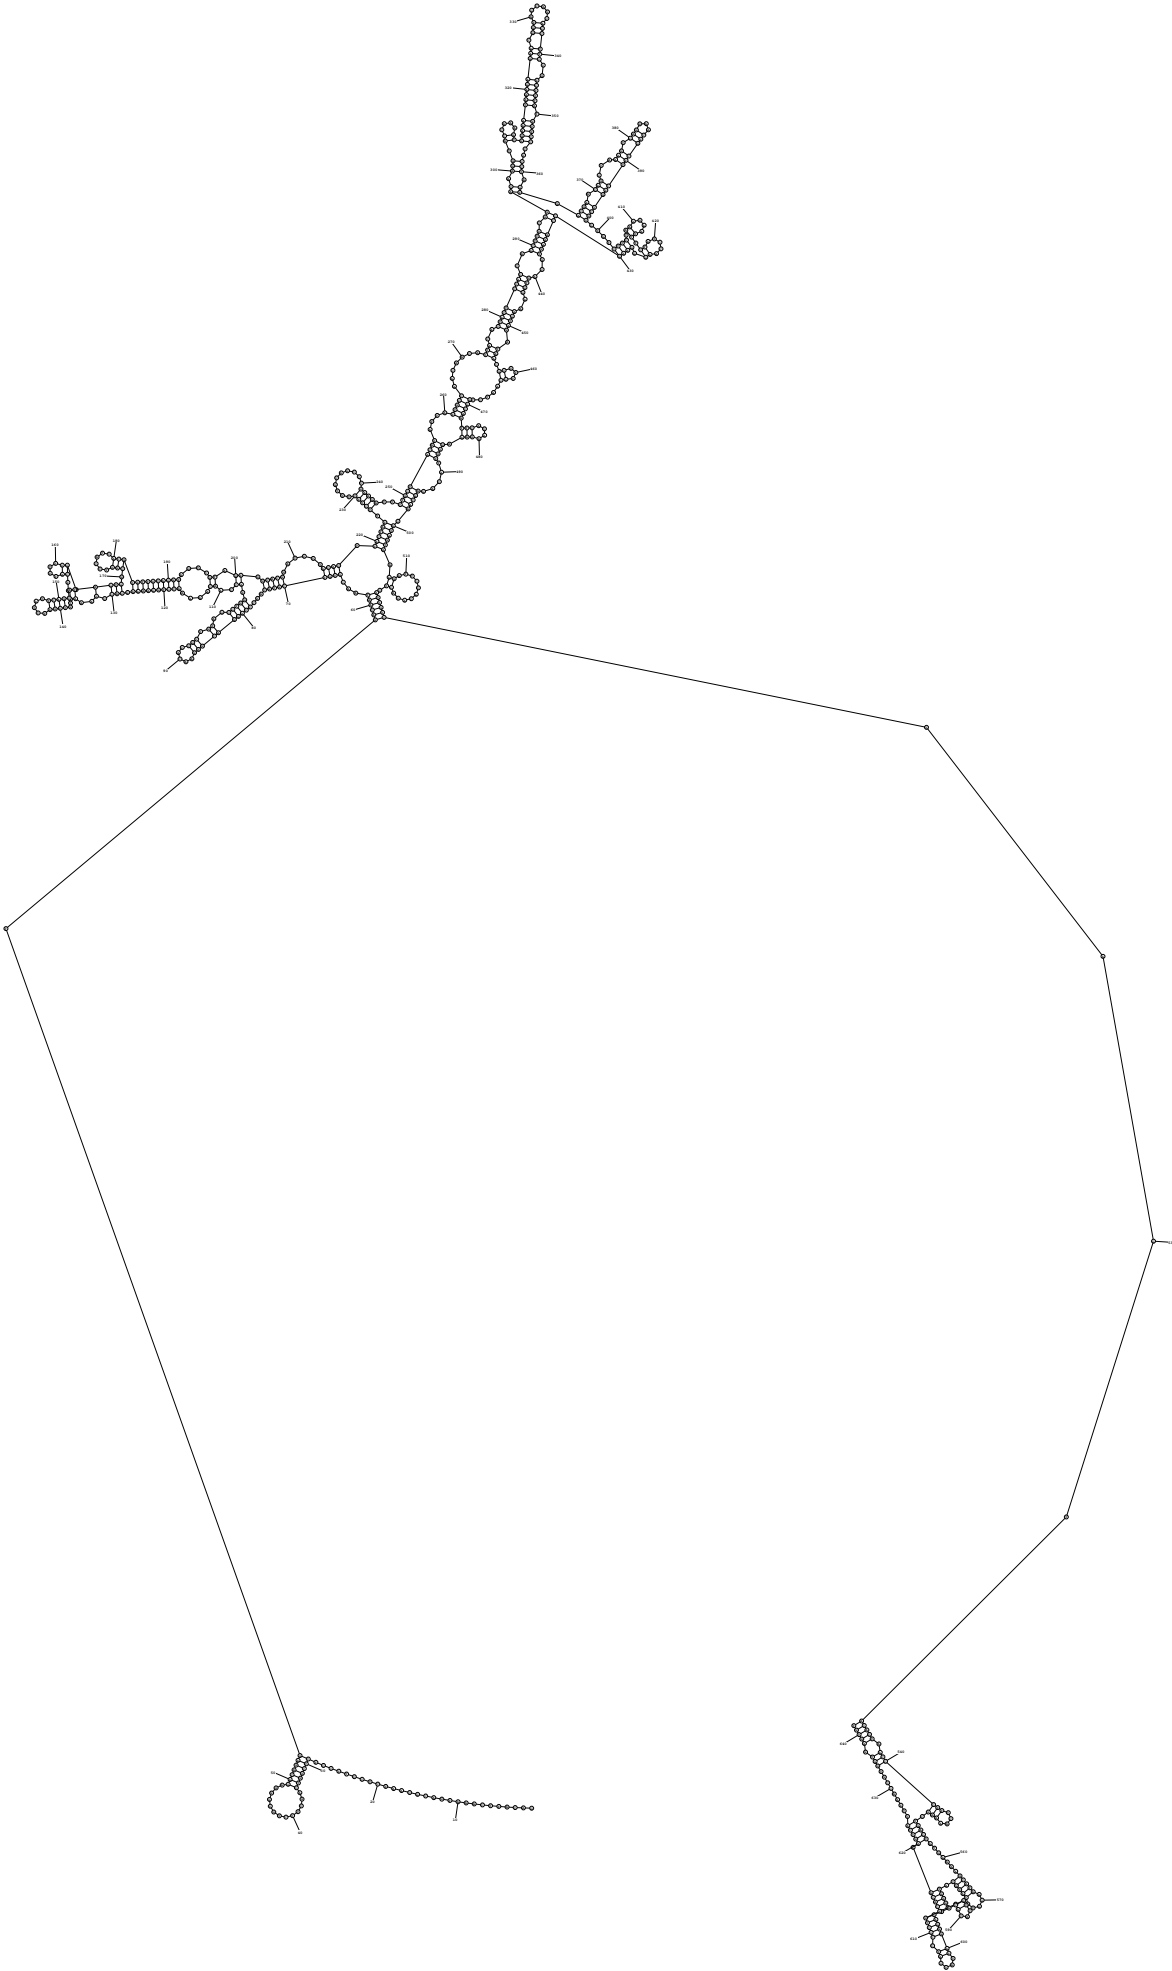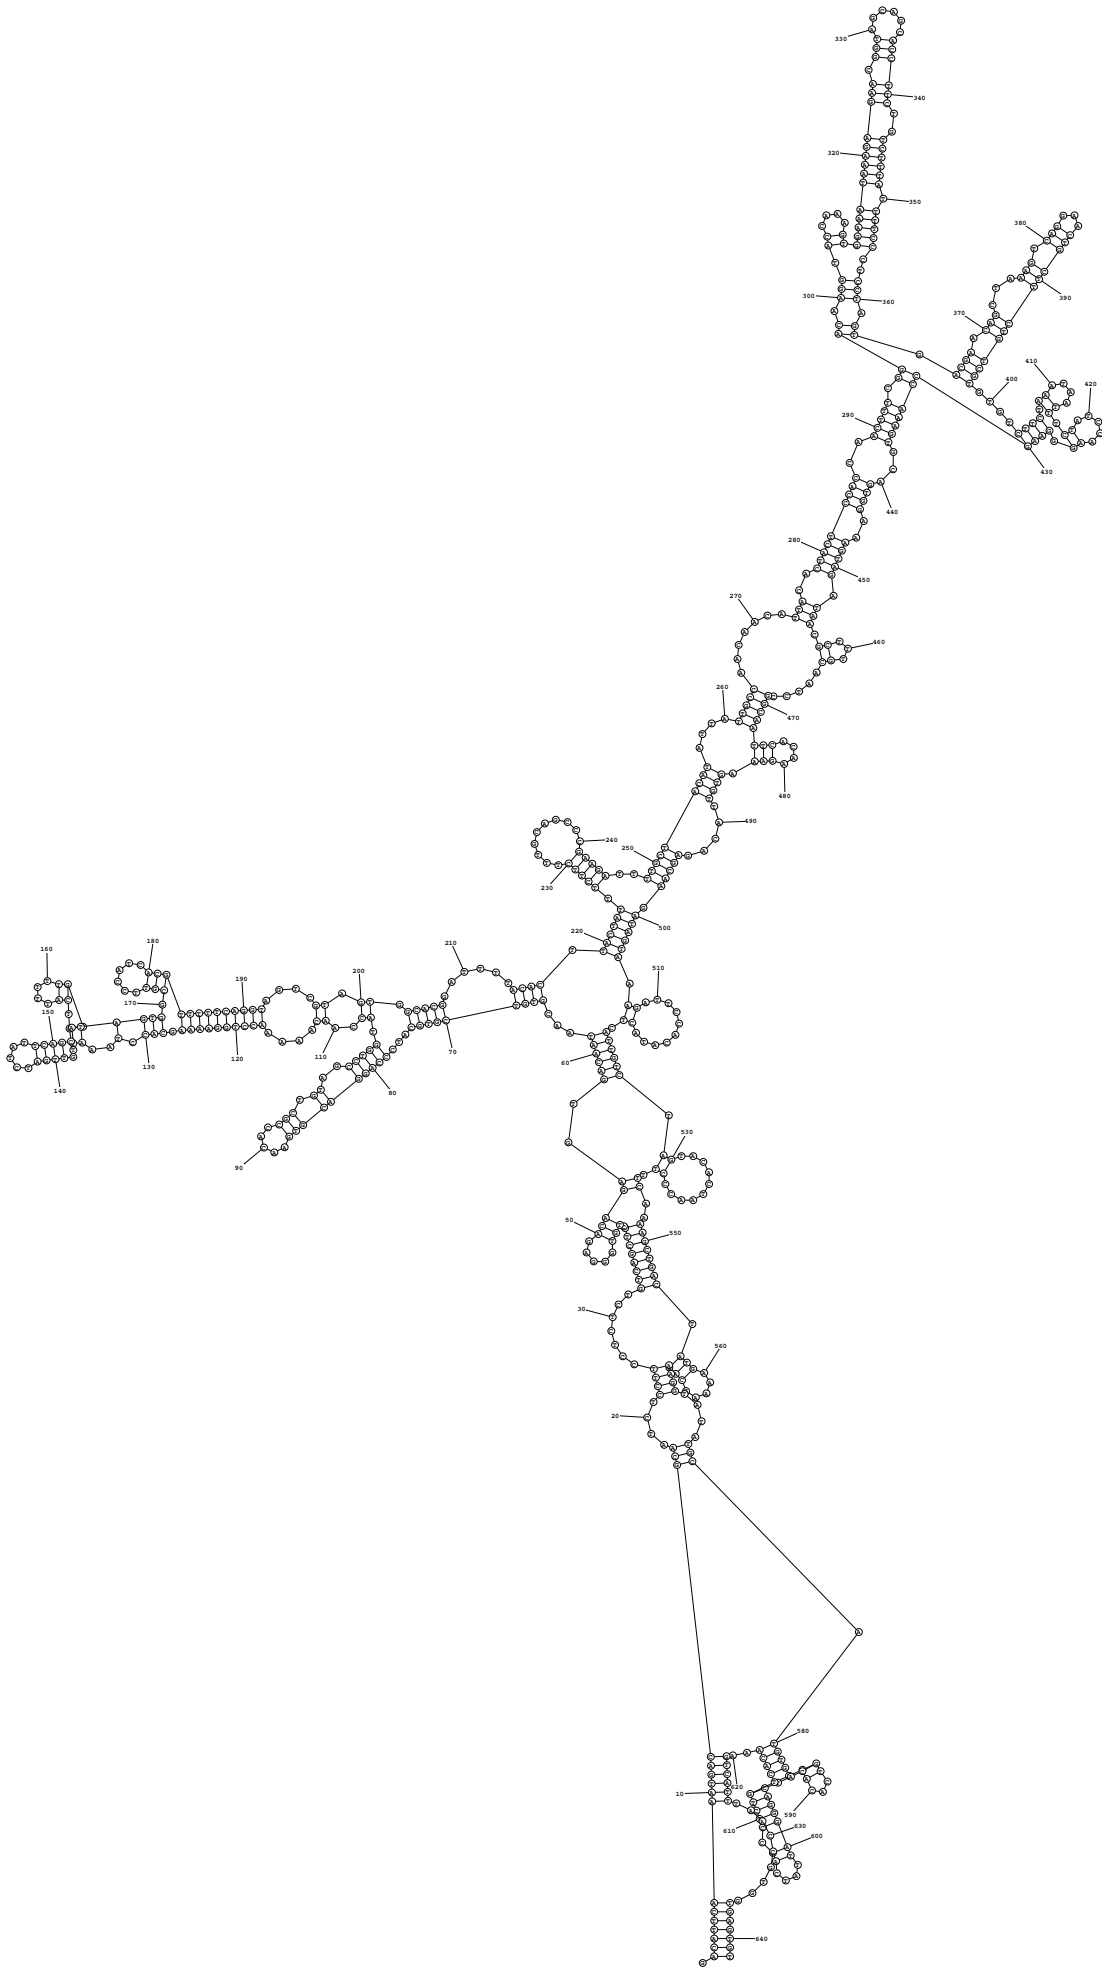ENERGY = -82.4 HerLC_IDT

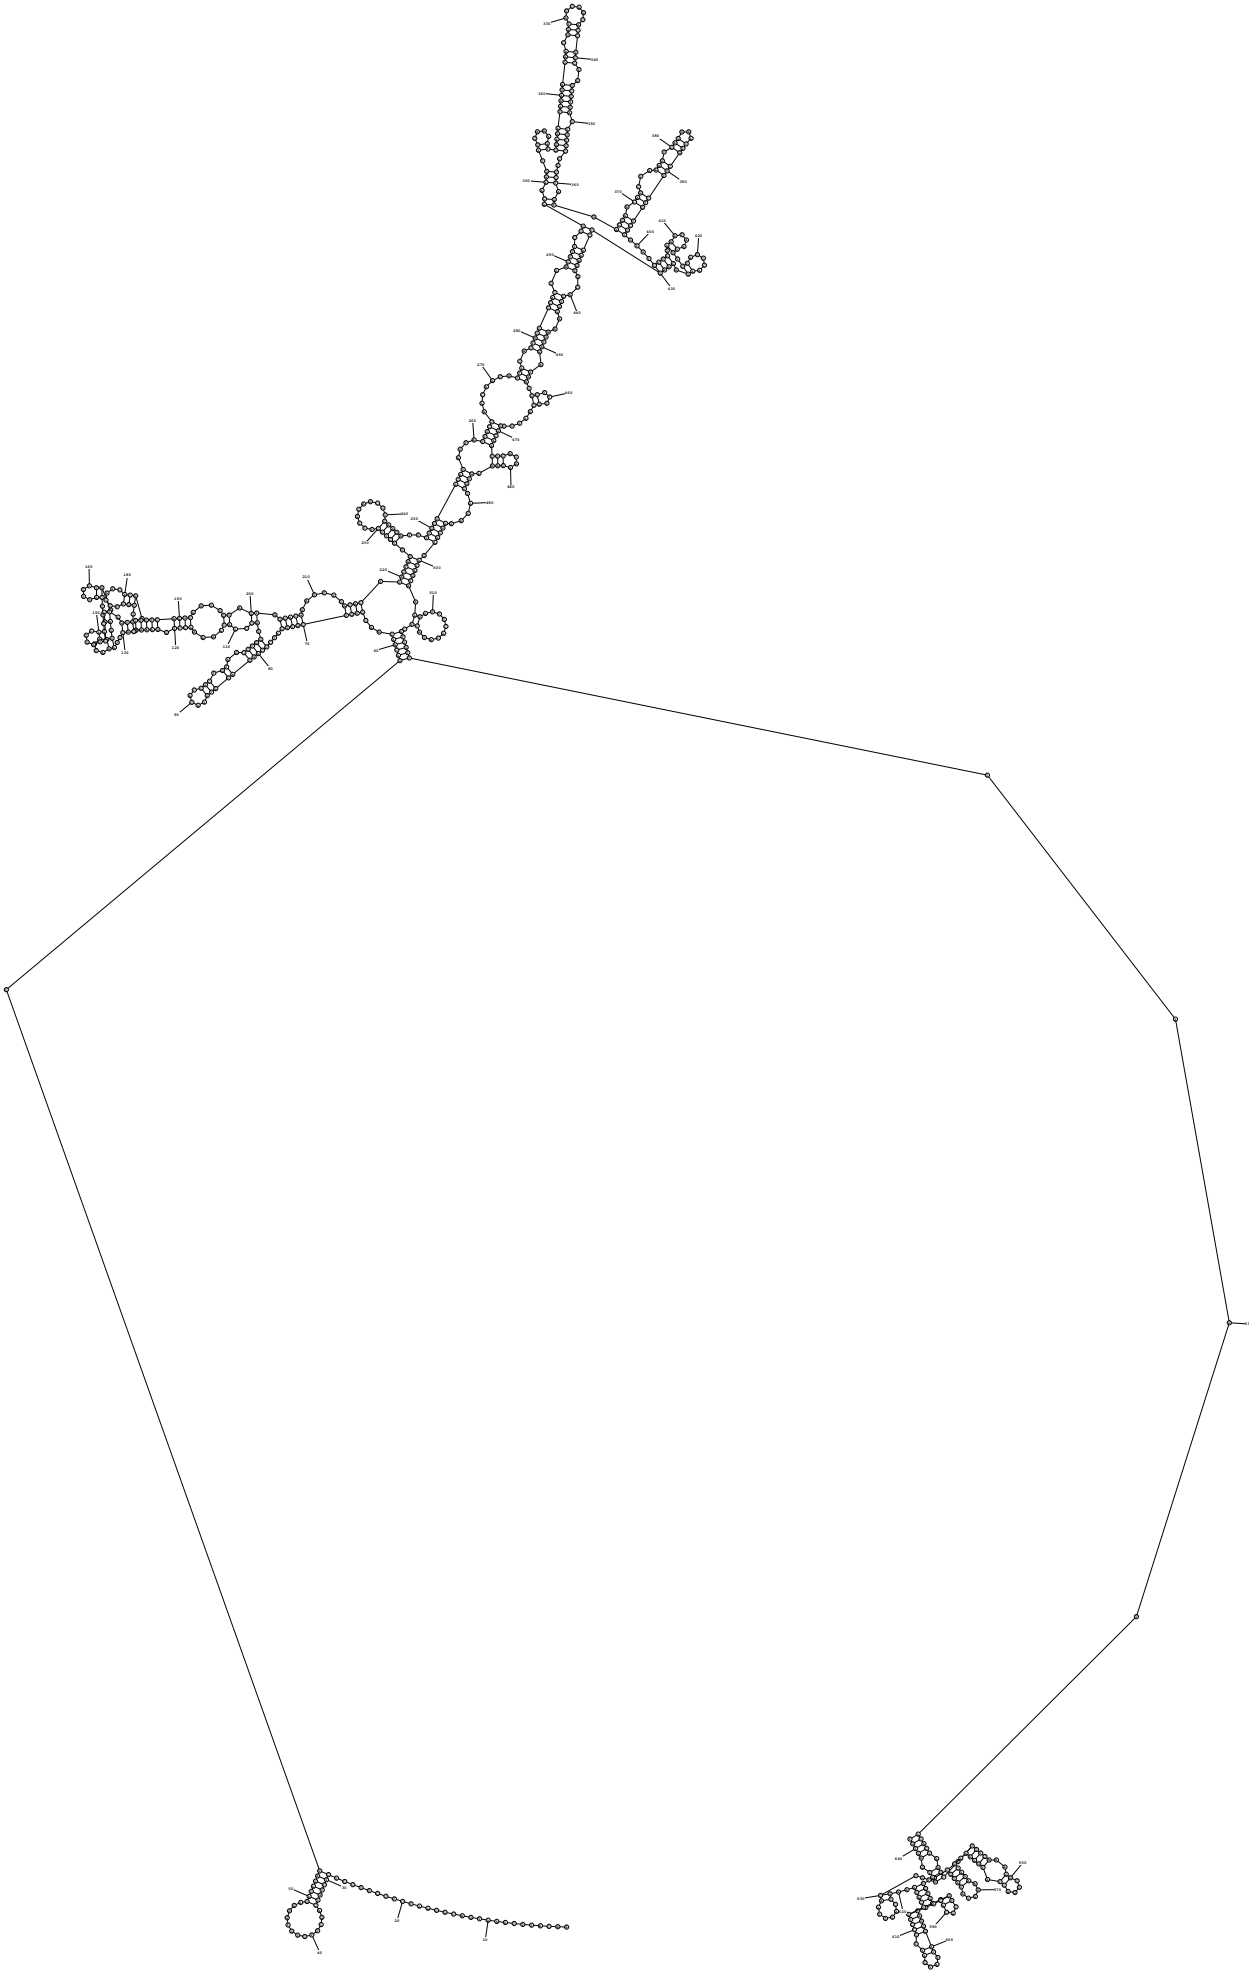ENERGY = -82.1 HerLC_IDT

ENERGY = -82.0   HerLC_IDT
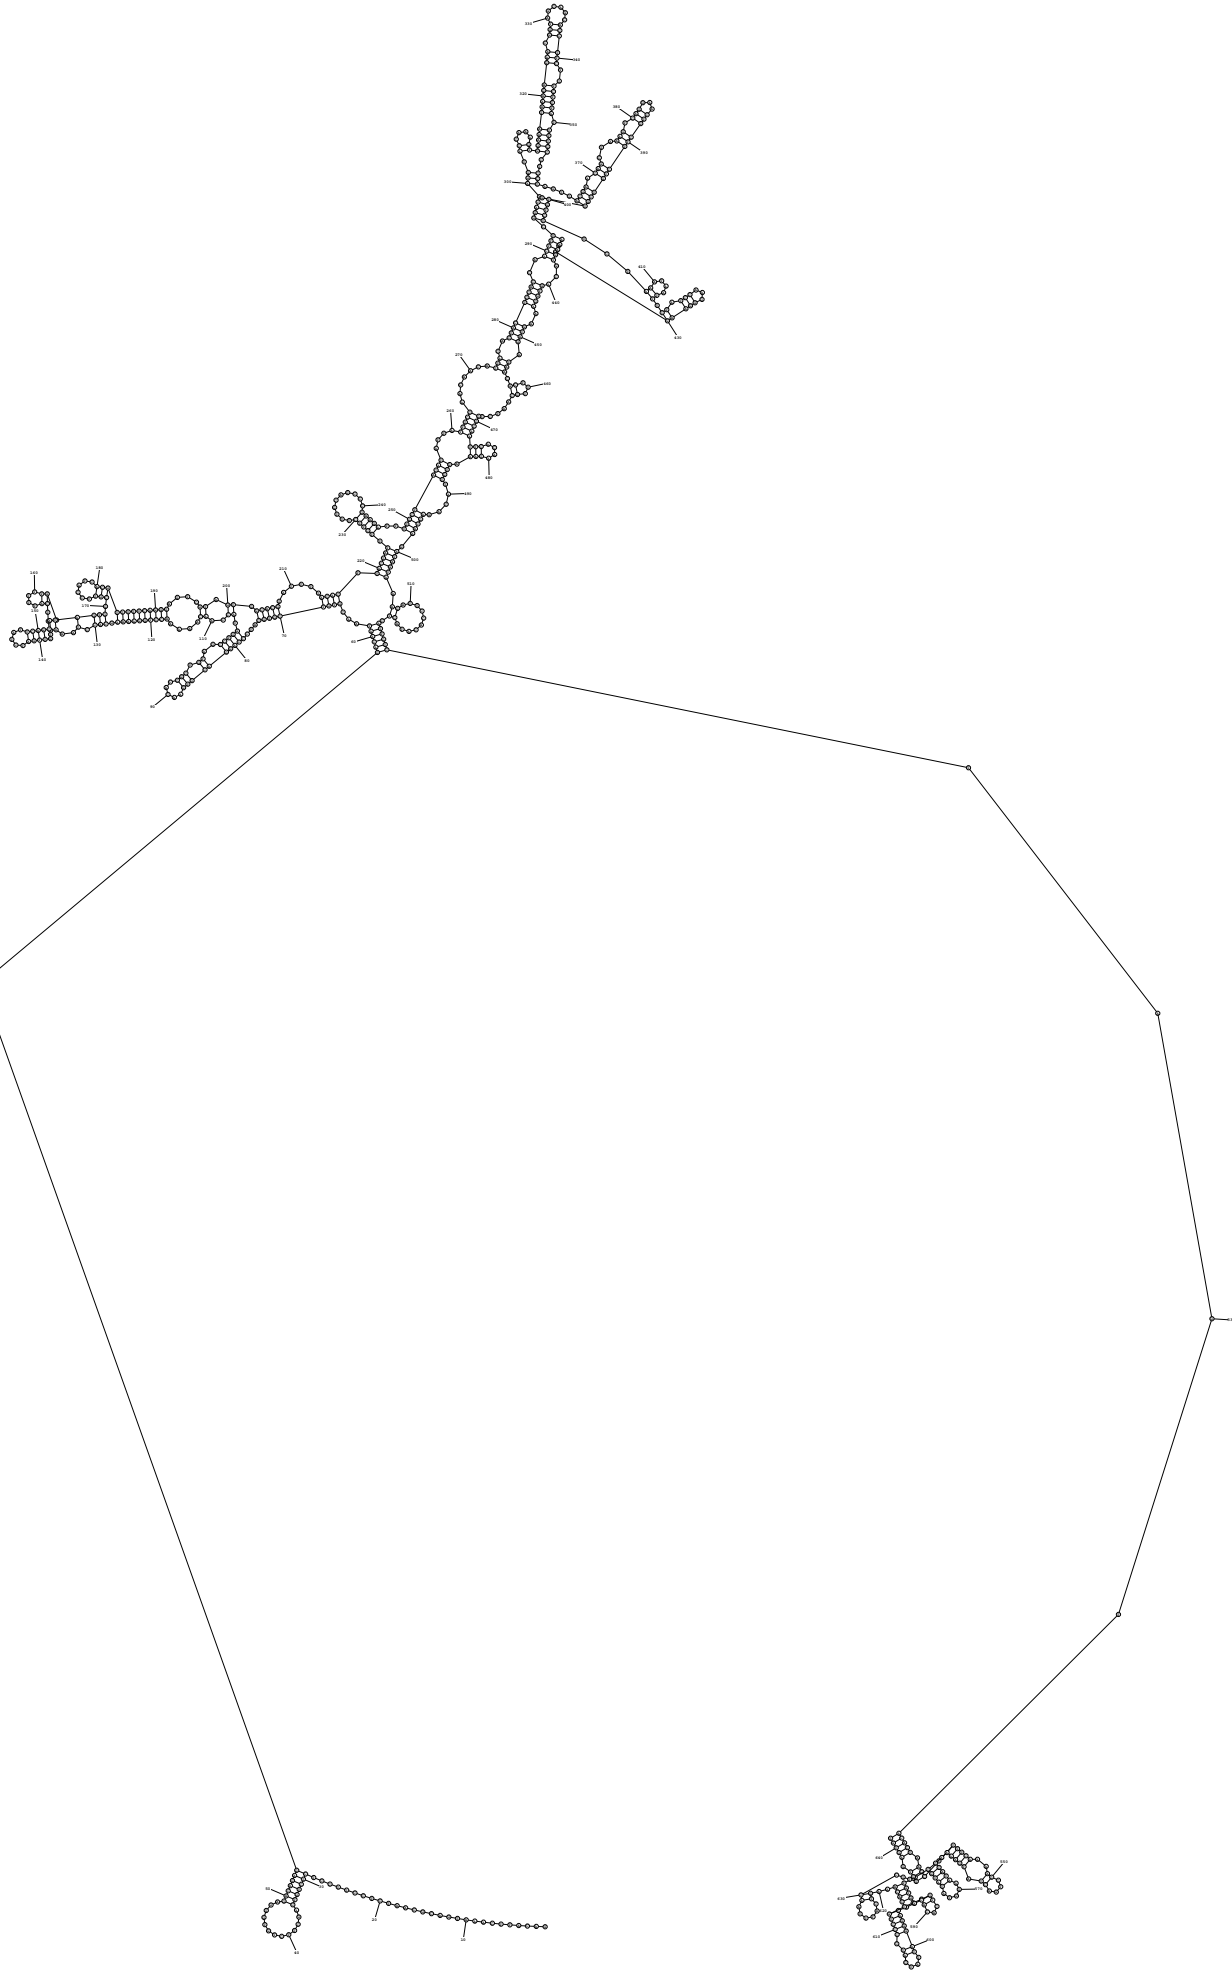
ENERGY = -82.0   HerLC_IDT

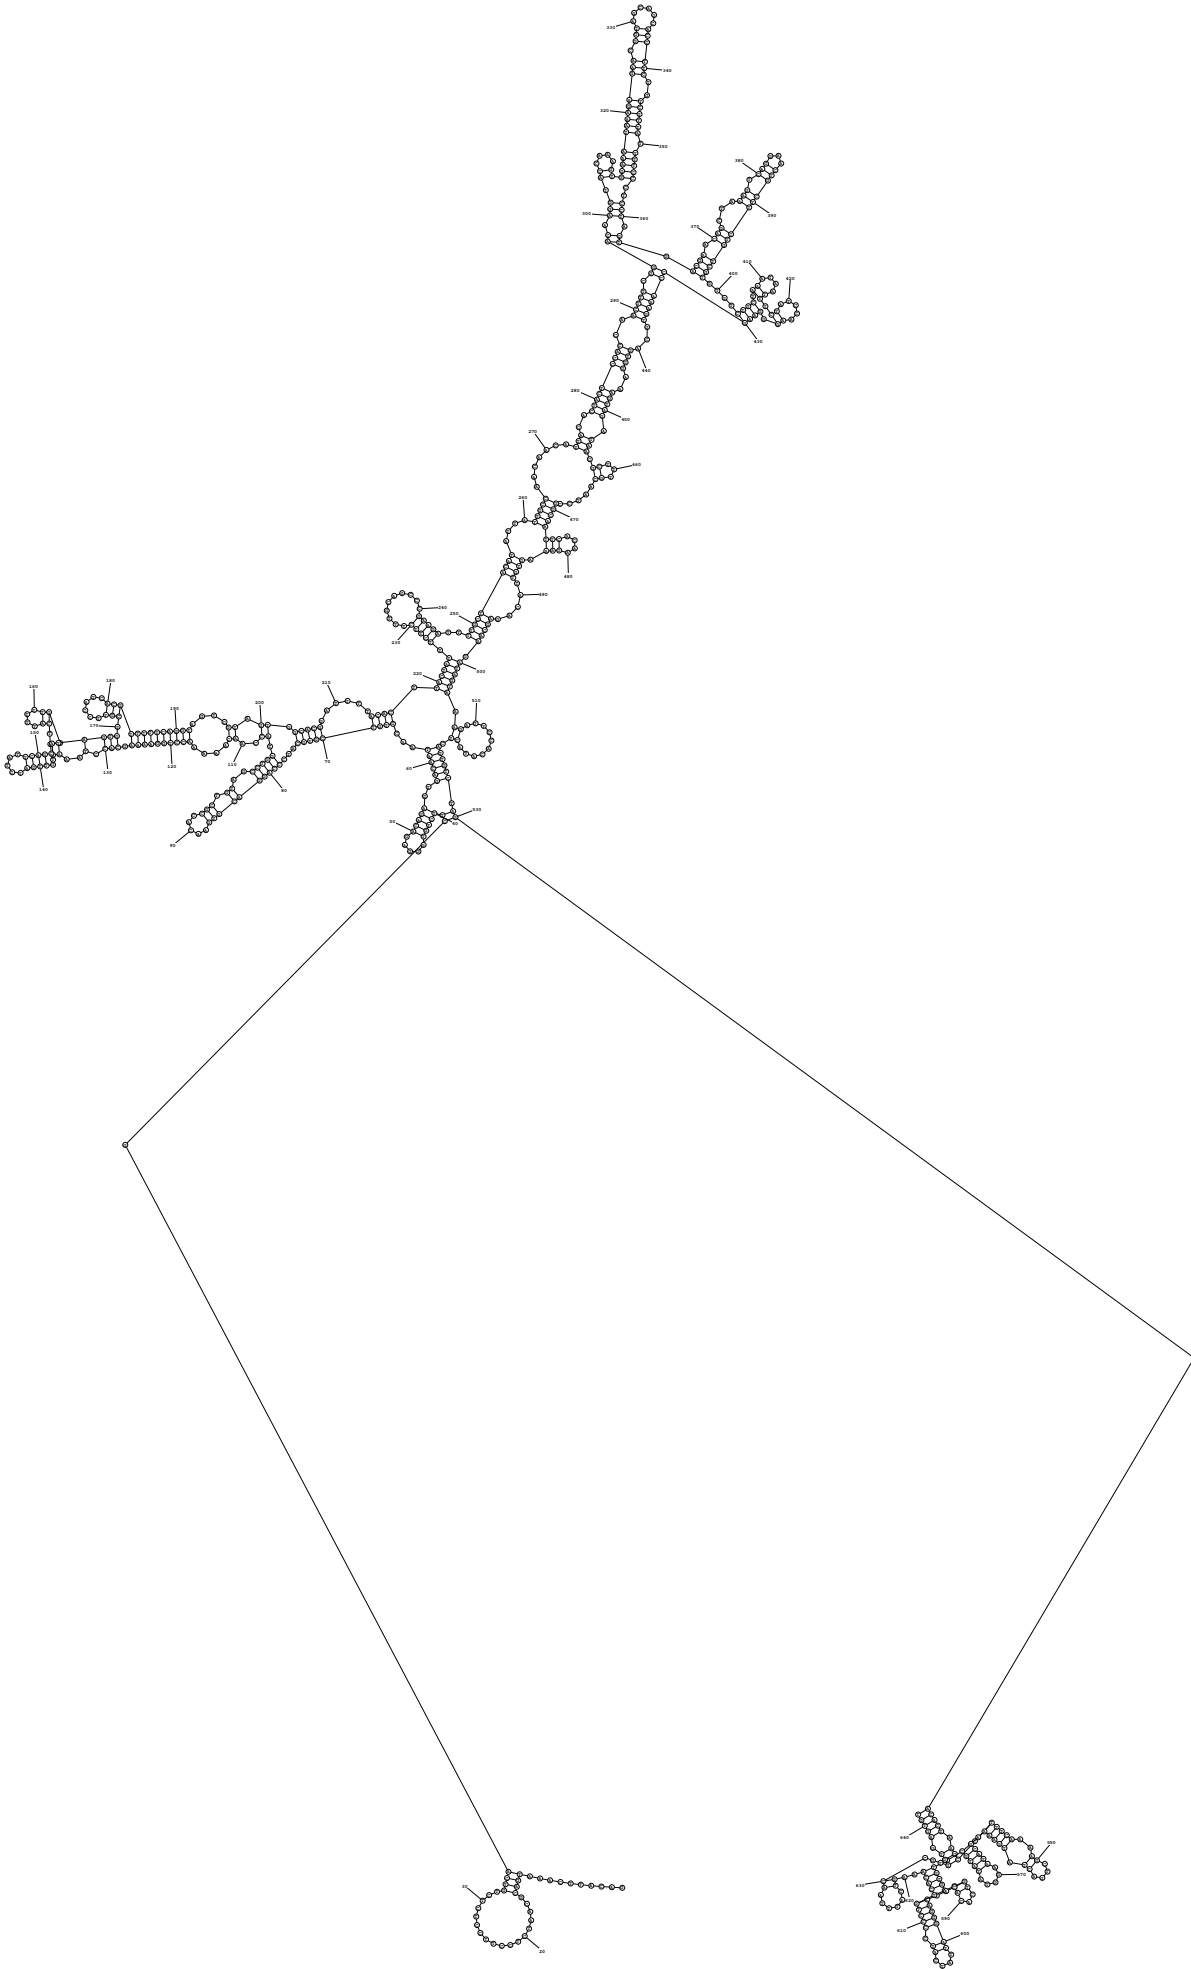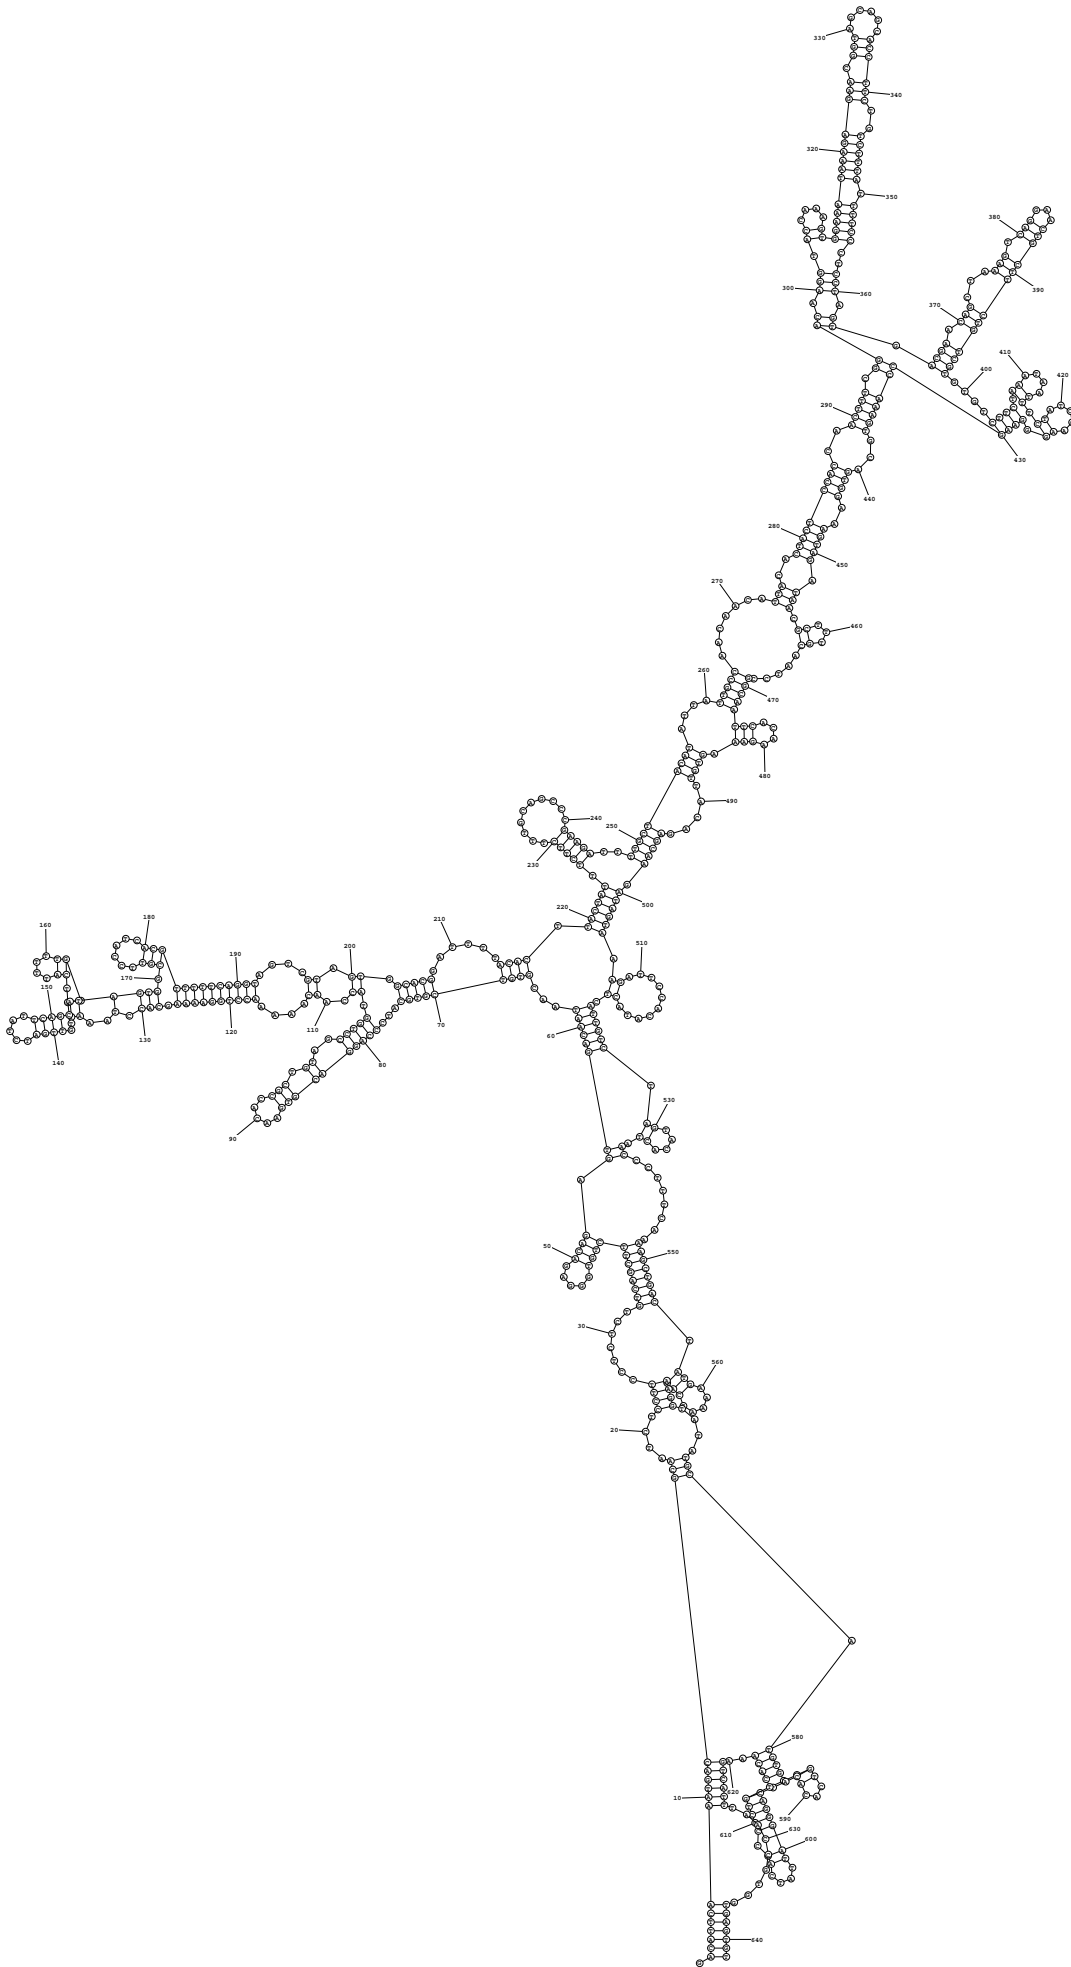ENERGY = -82.0   HerLC_IDT

ENERGY = -81.7 HerLC_IDT
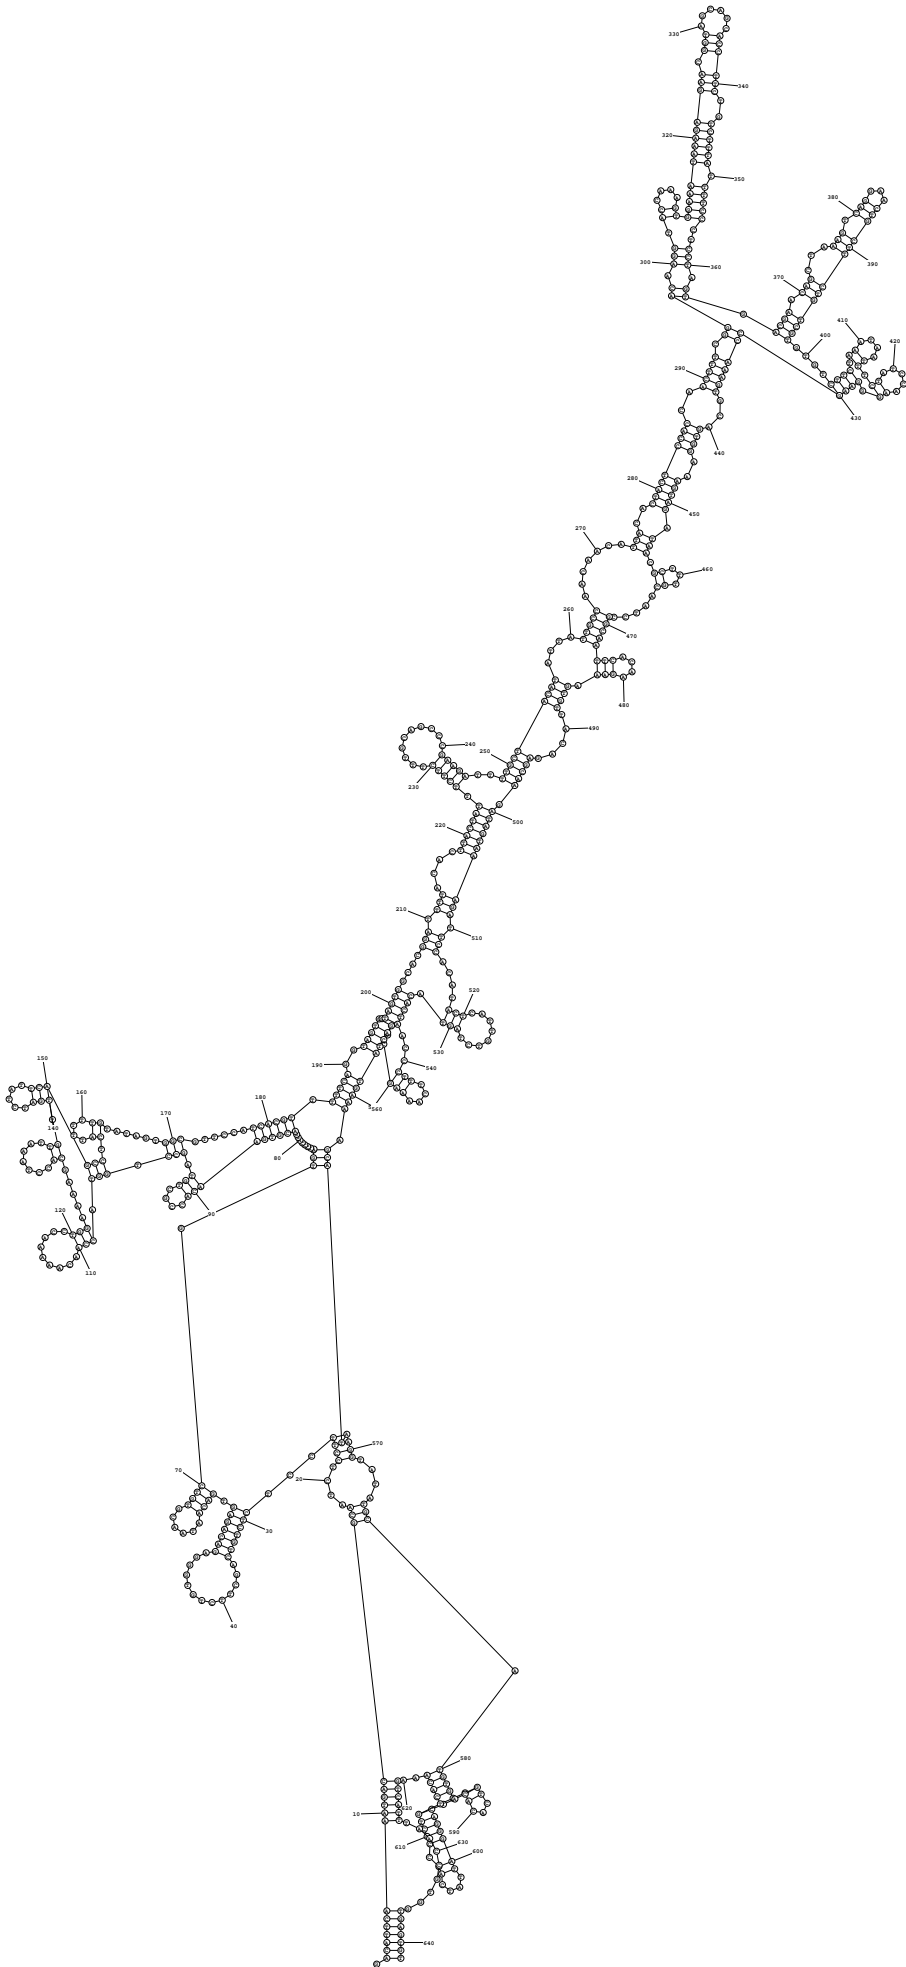
ENERGY = -81.6   HerLC_IDT
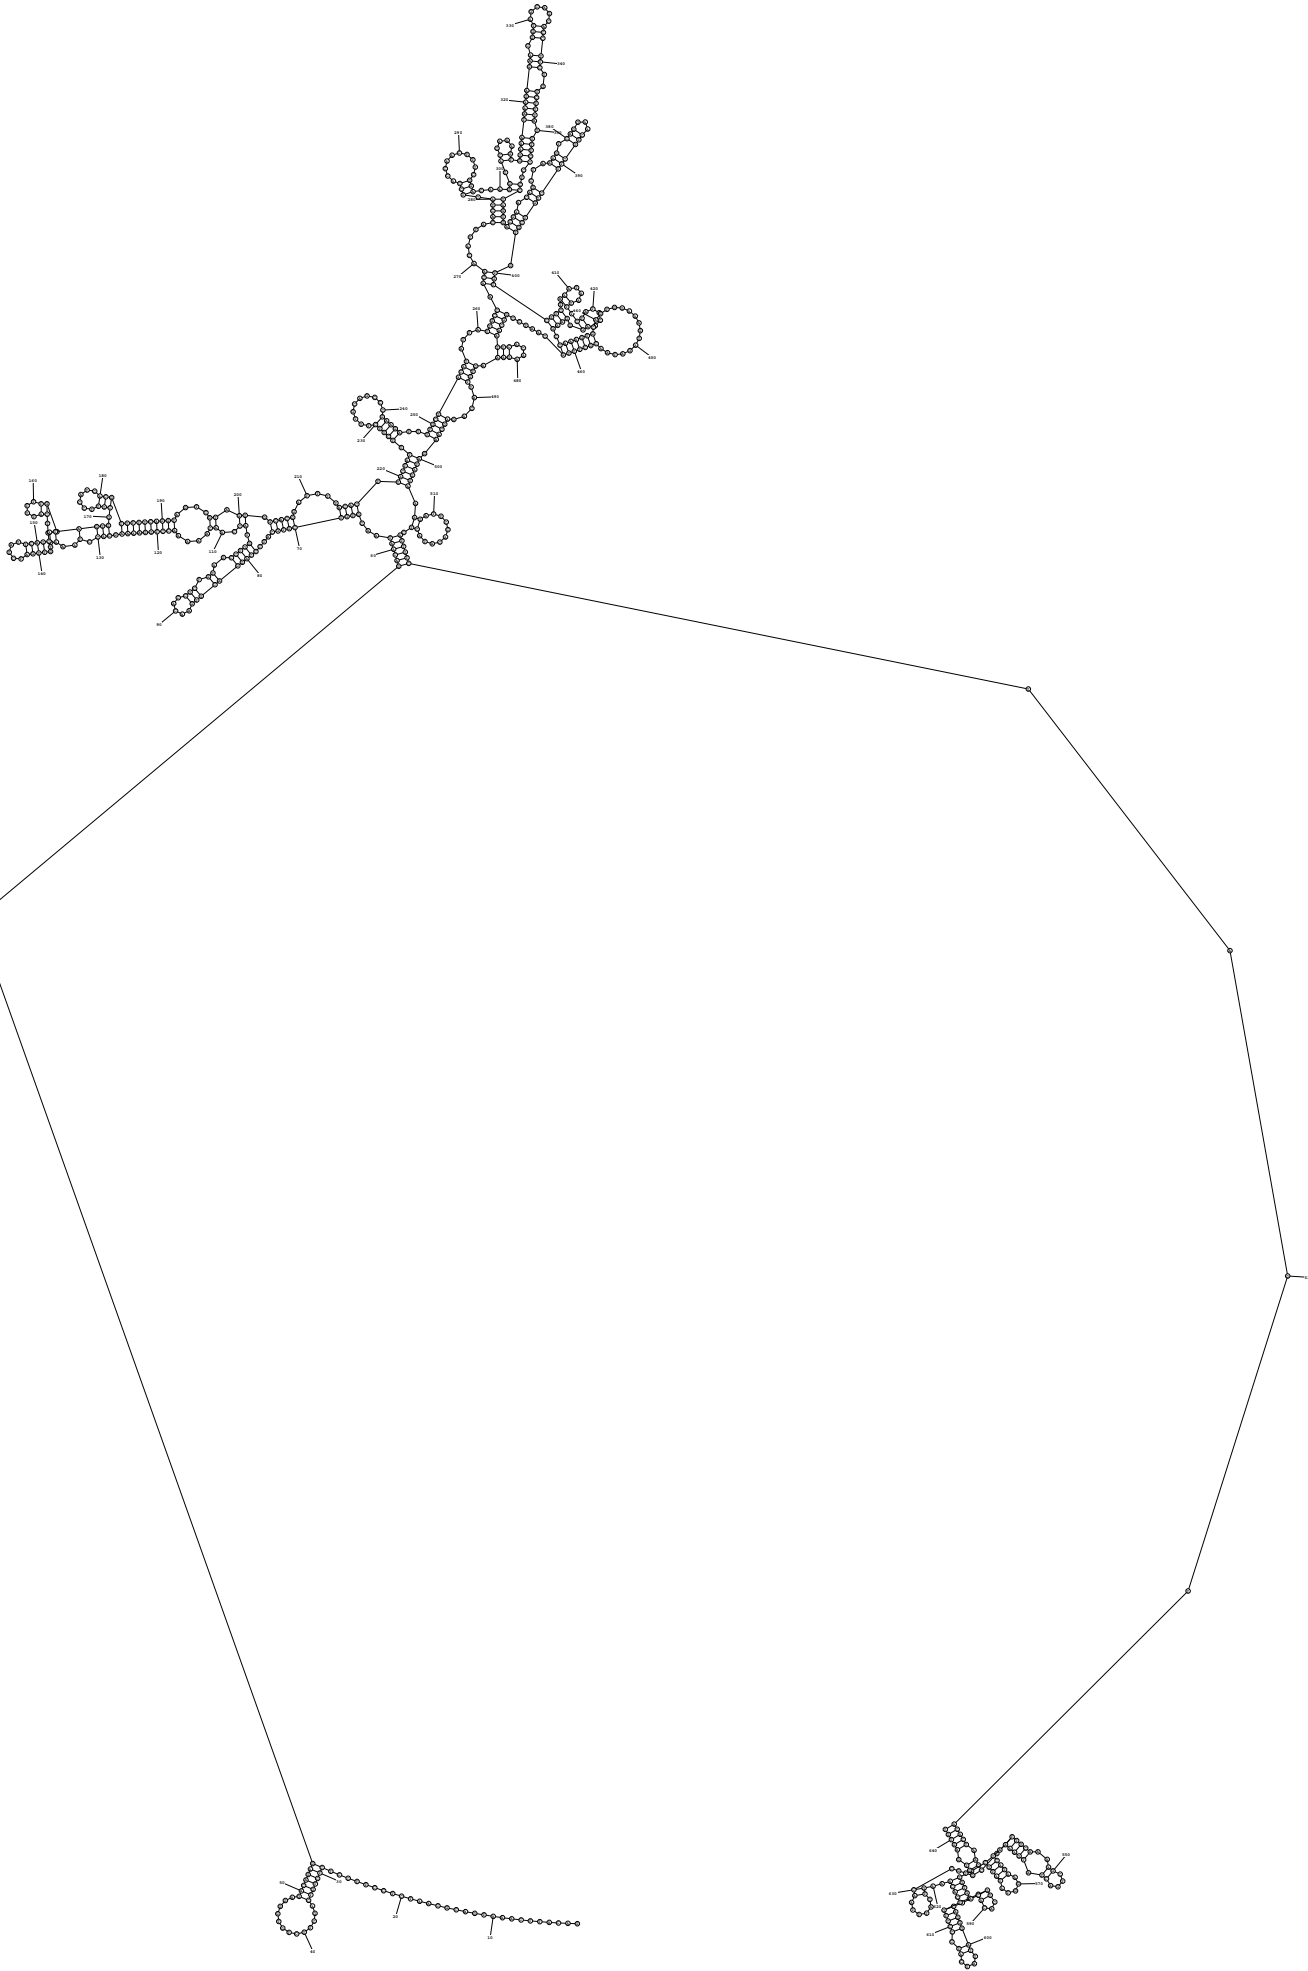
ENERGY = -81.6   HerLC_IDT
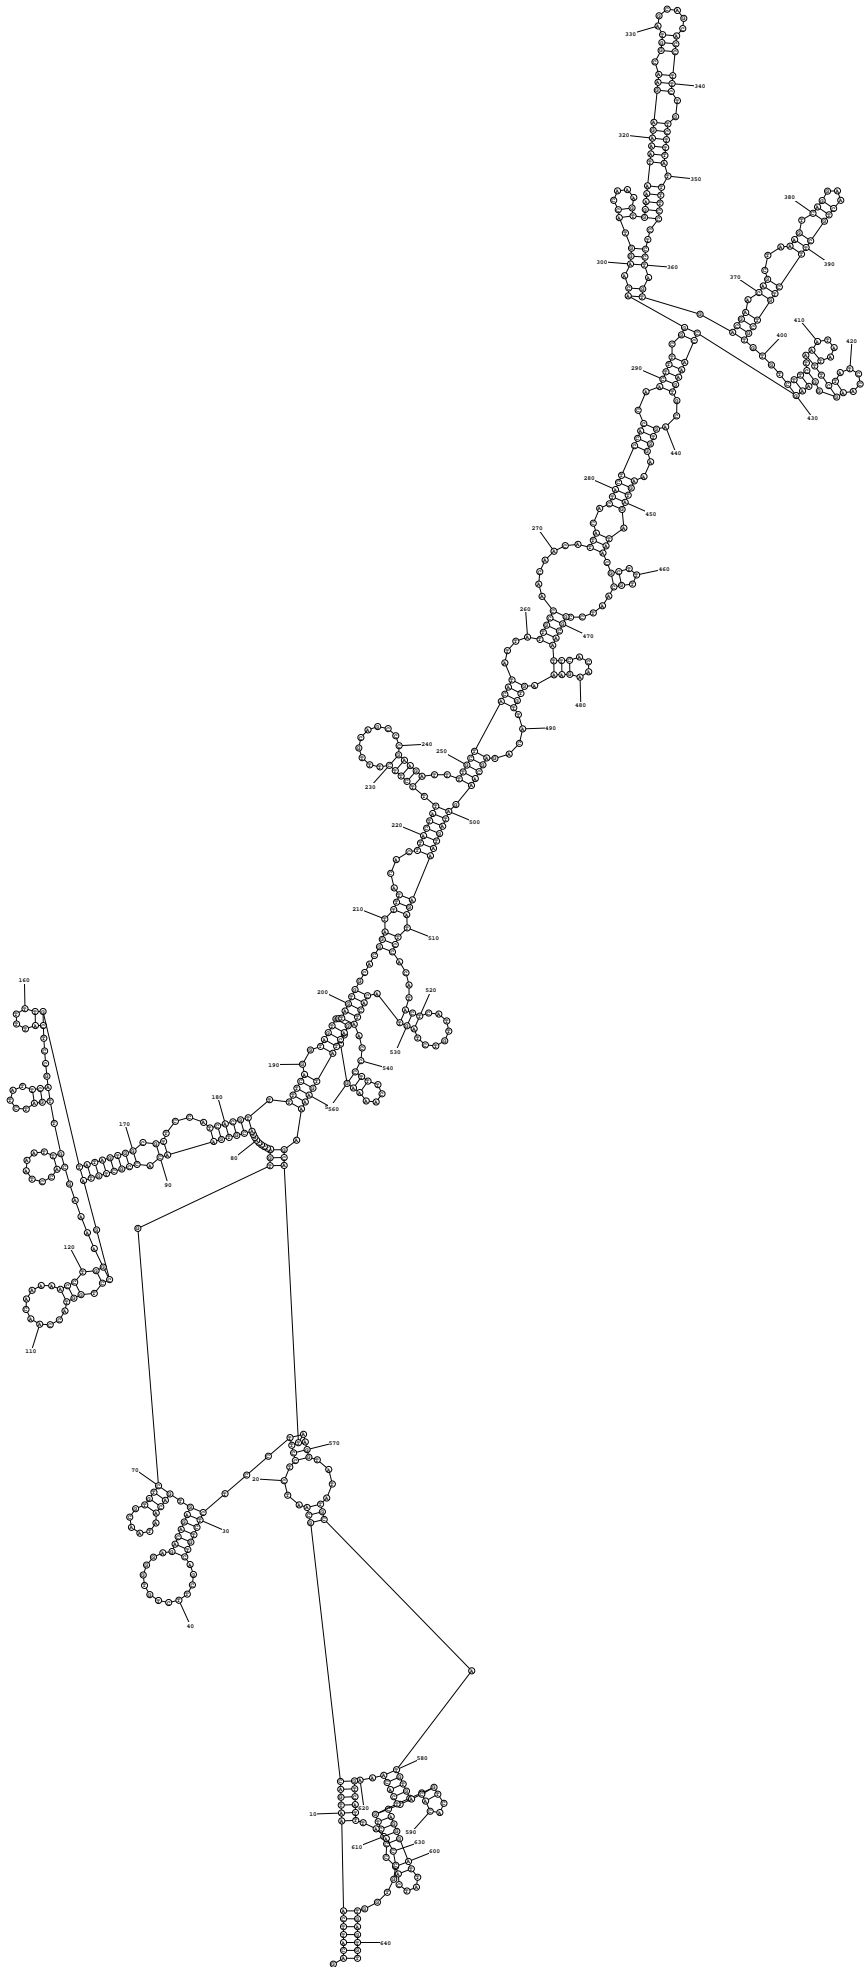
ENERGY = -81.2   HerLC_IDT
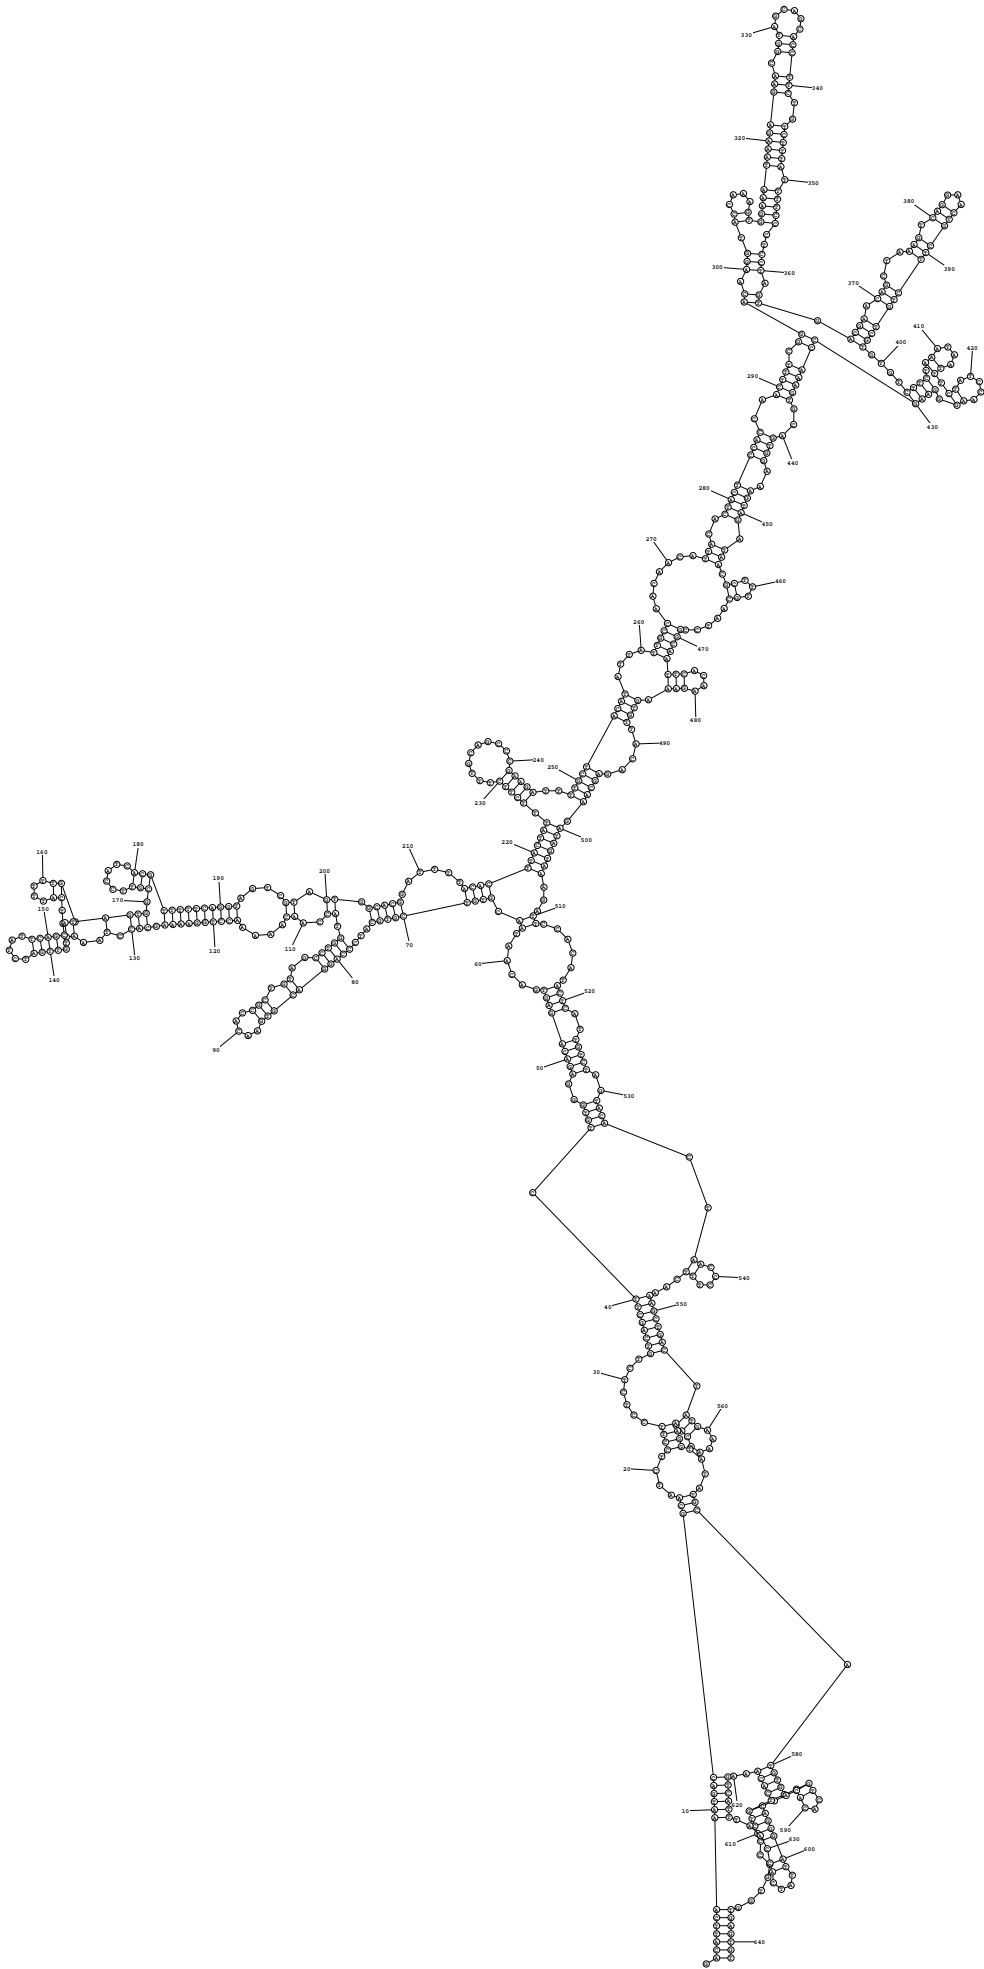
ENERGY = -81.2   HerLC_IDT
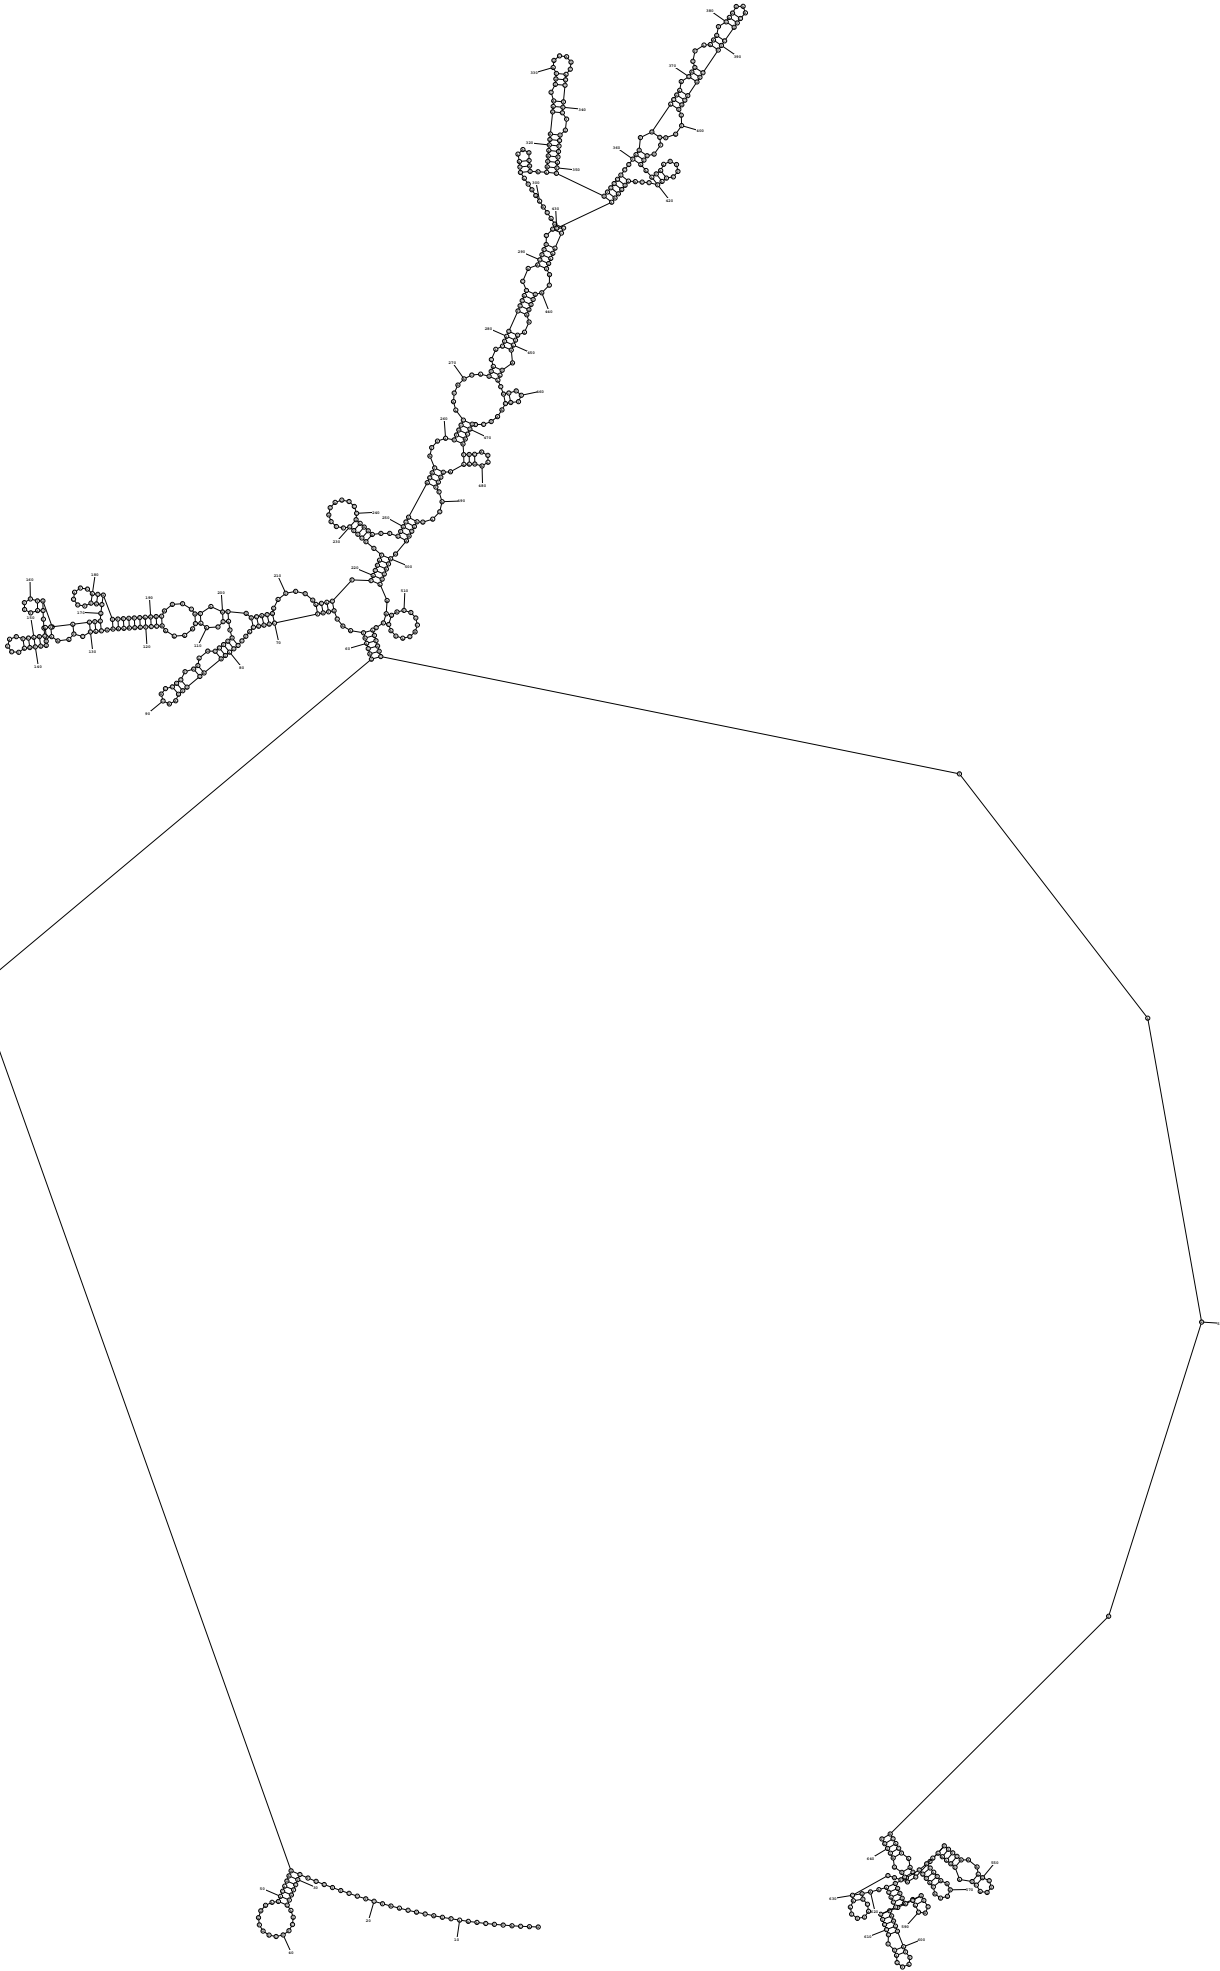
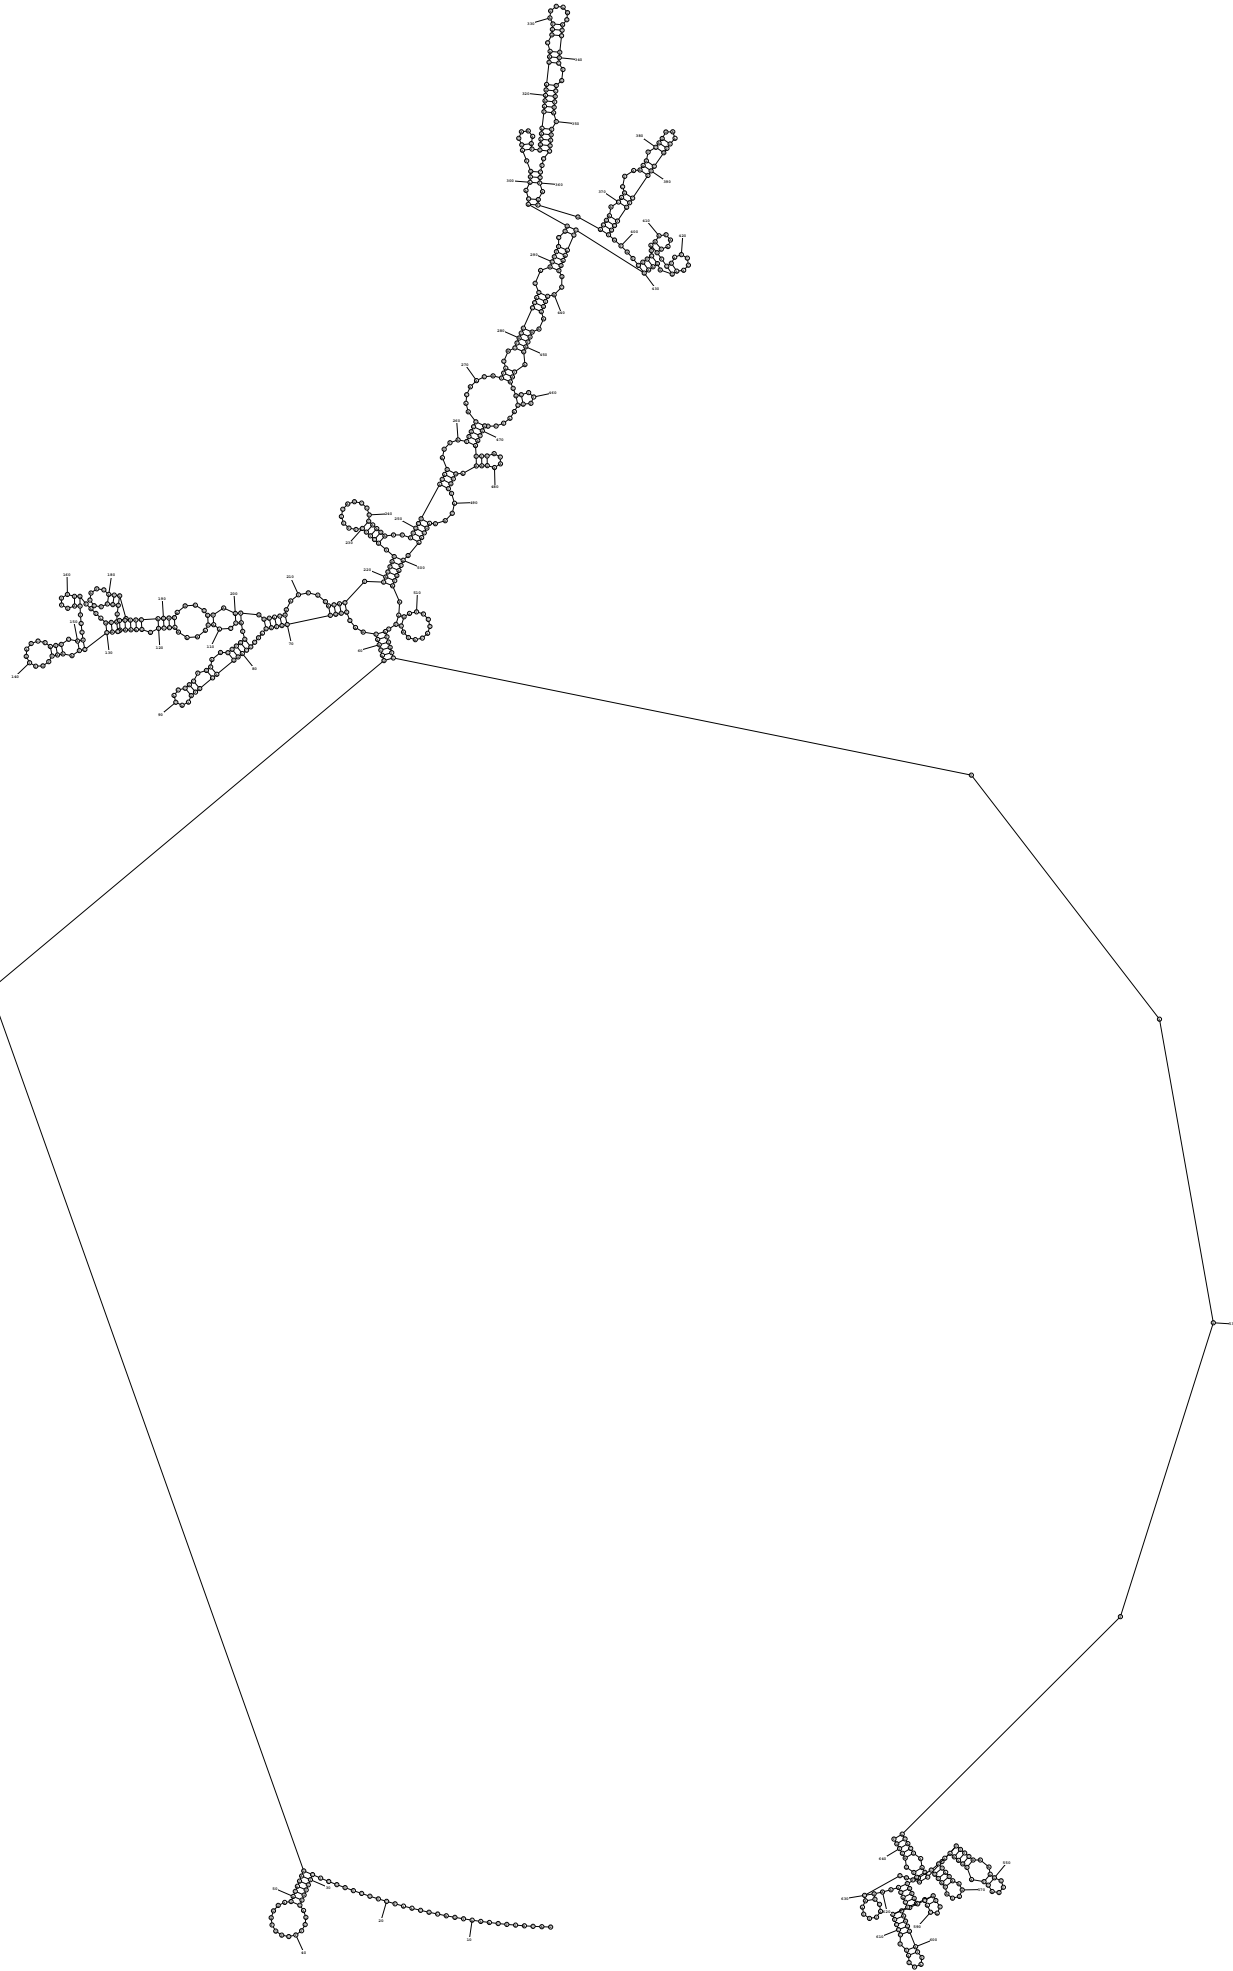ENERGY = -80.9 HerLC_IDT
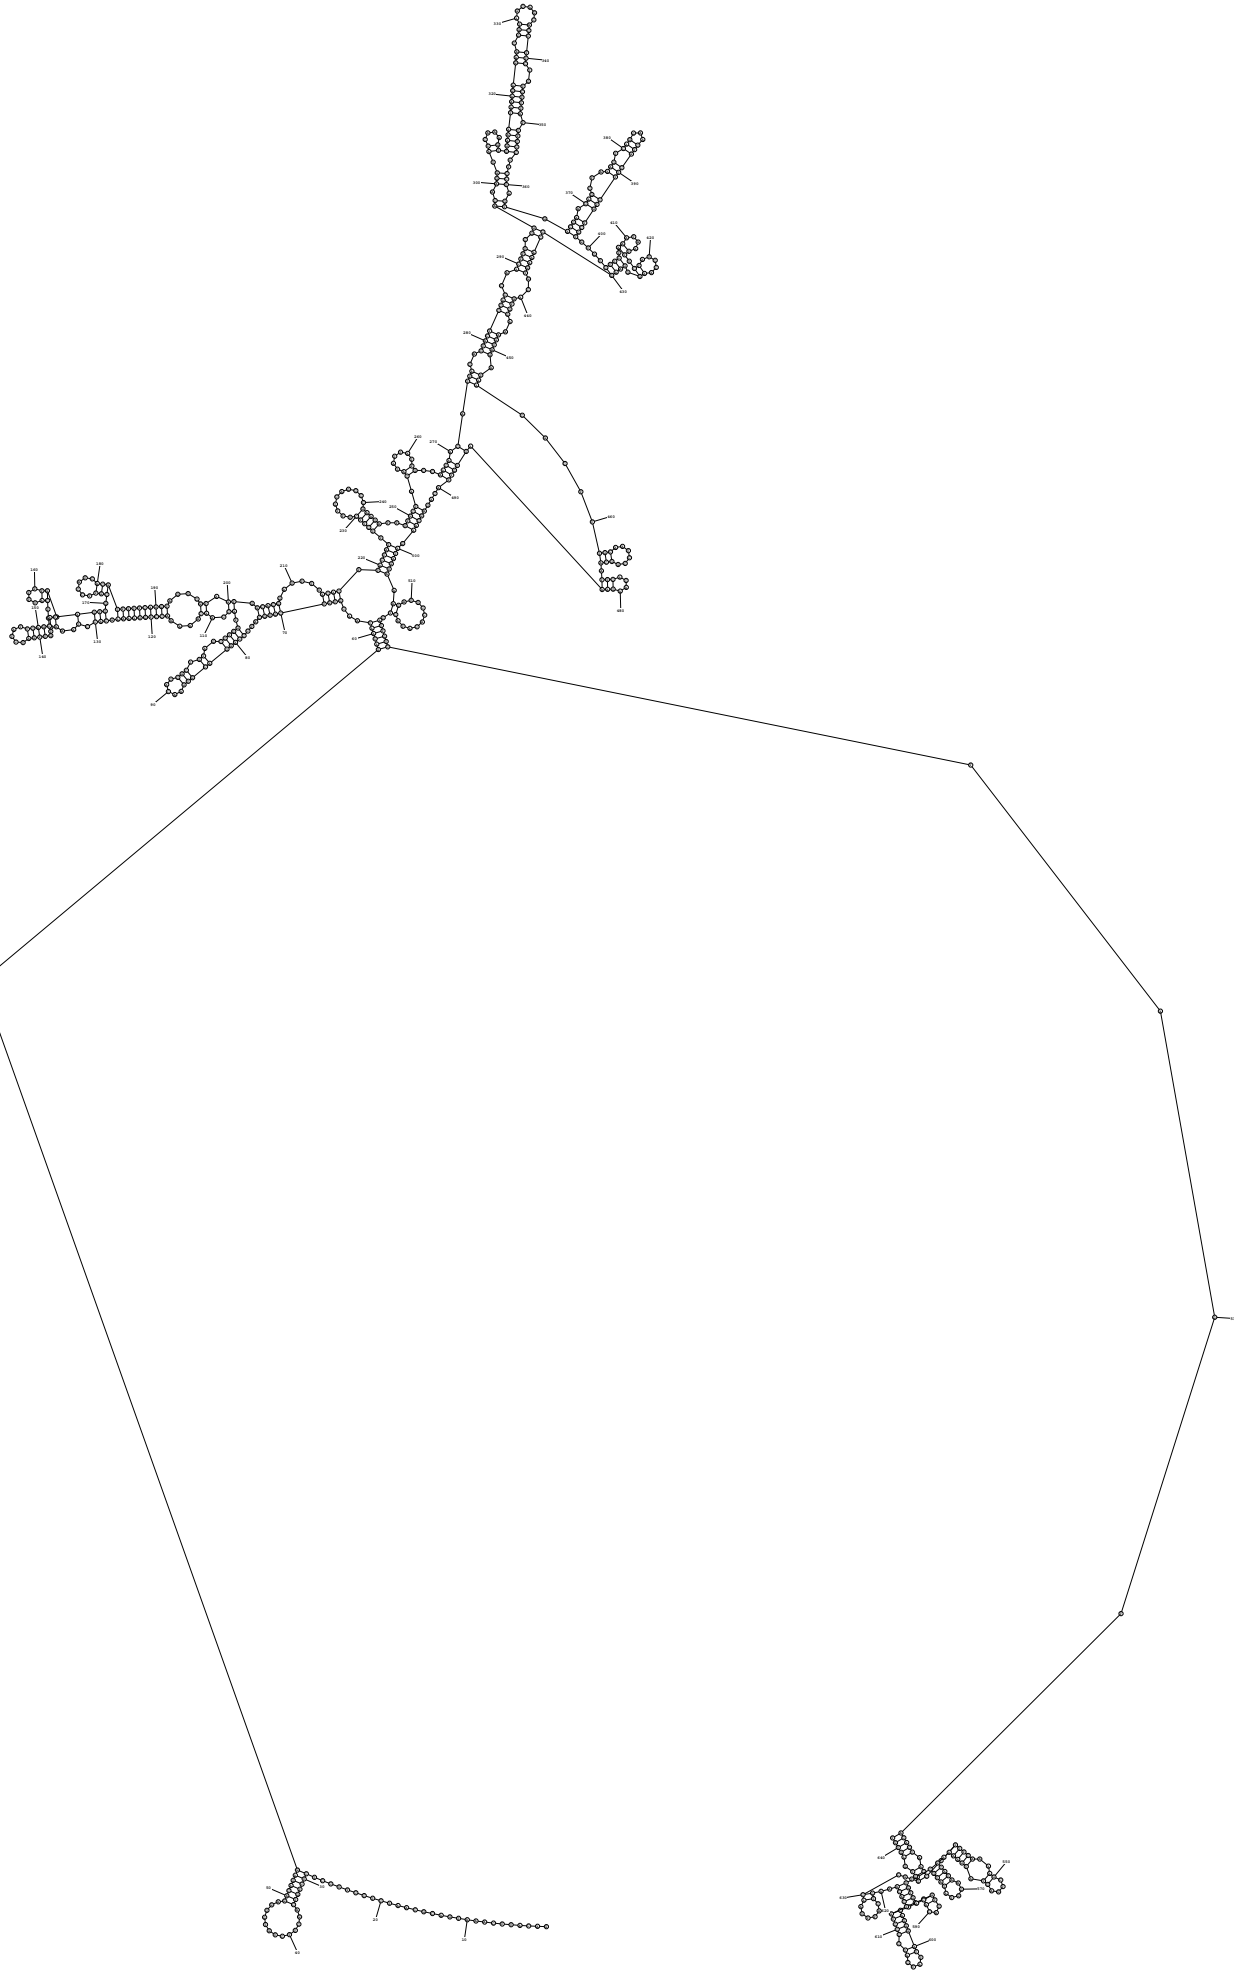
ENERGY = -80.9 HerLC_IDT

ENERGY = -80.8   HerLC_IDT
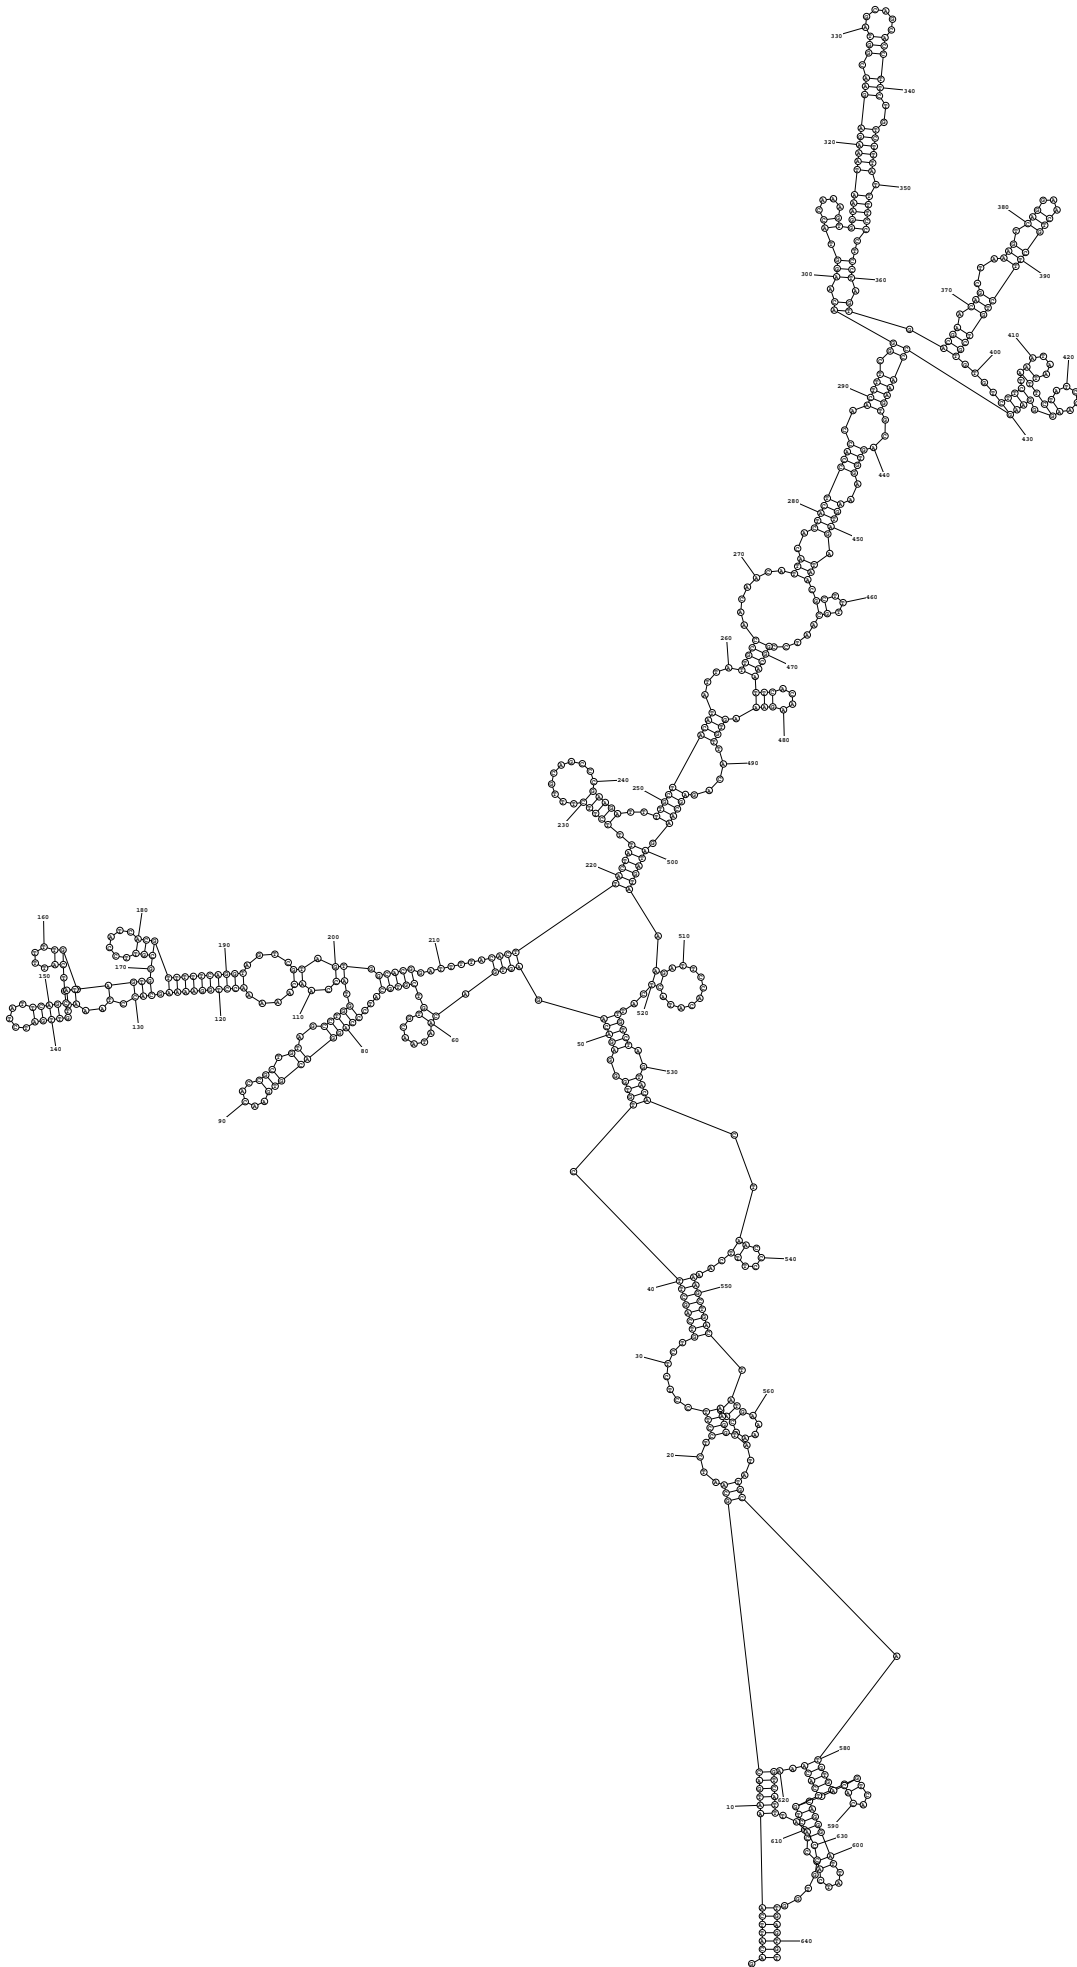
ENERGY = -80.8   HerLC_IDT

ENERGY = -80.8 HerLC_IDT

ENERGY = -80.7   HerLC_IDT

ENERGY = -80.6   HerLC_IDT

ENERGY = -80.6   HerLC_IDT

ENERGY = -80.6 HerLC_IDT

ENERGY = -80.5 HerLC_IDT