

KU Leuven/EnergyVille

Energy Systems Modeling

The potential for active demand response with heat pumps


Erik Delarue

With Dieter Patteeuw, Kenneth Bruninx, Alessia Arteconi,
William D'haeseleer and Lieve Helsen

iiESI Workshop – Imperial College, May 16, 2017




Electricity generation system operation and planning

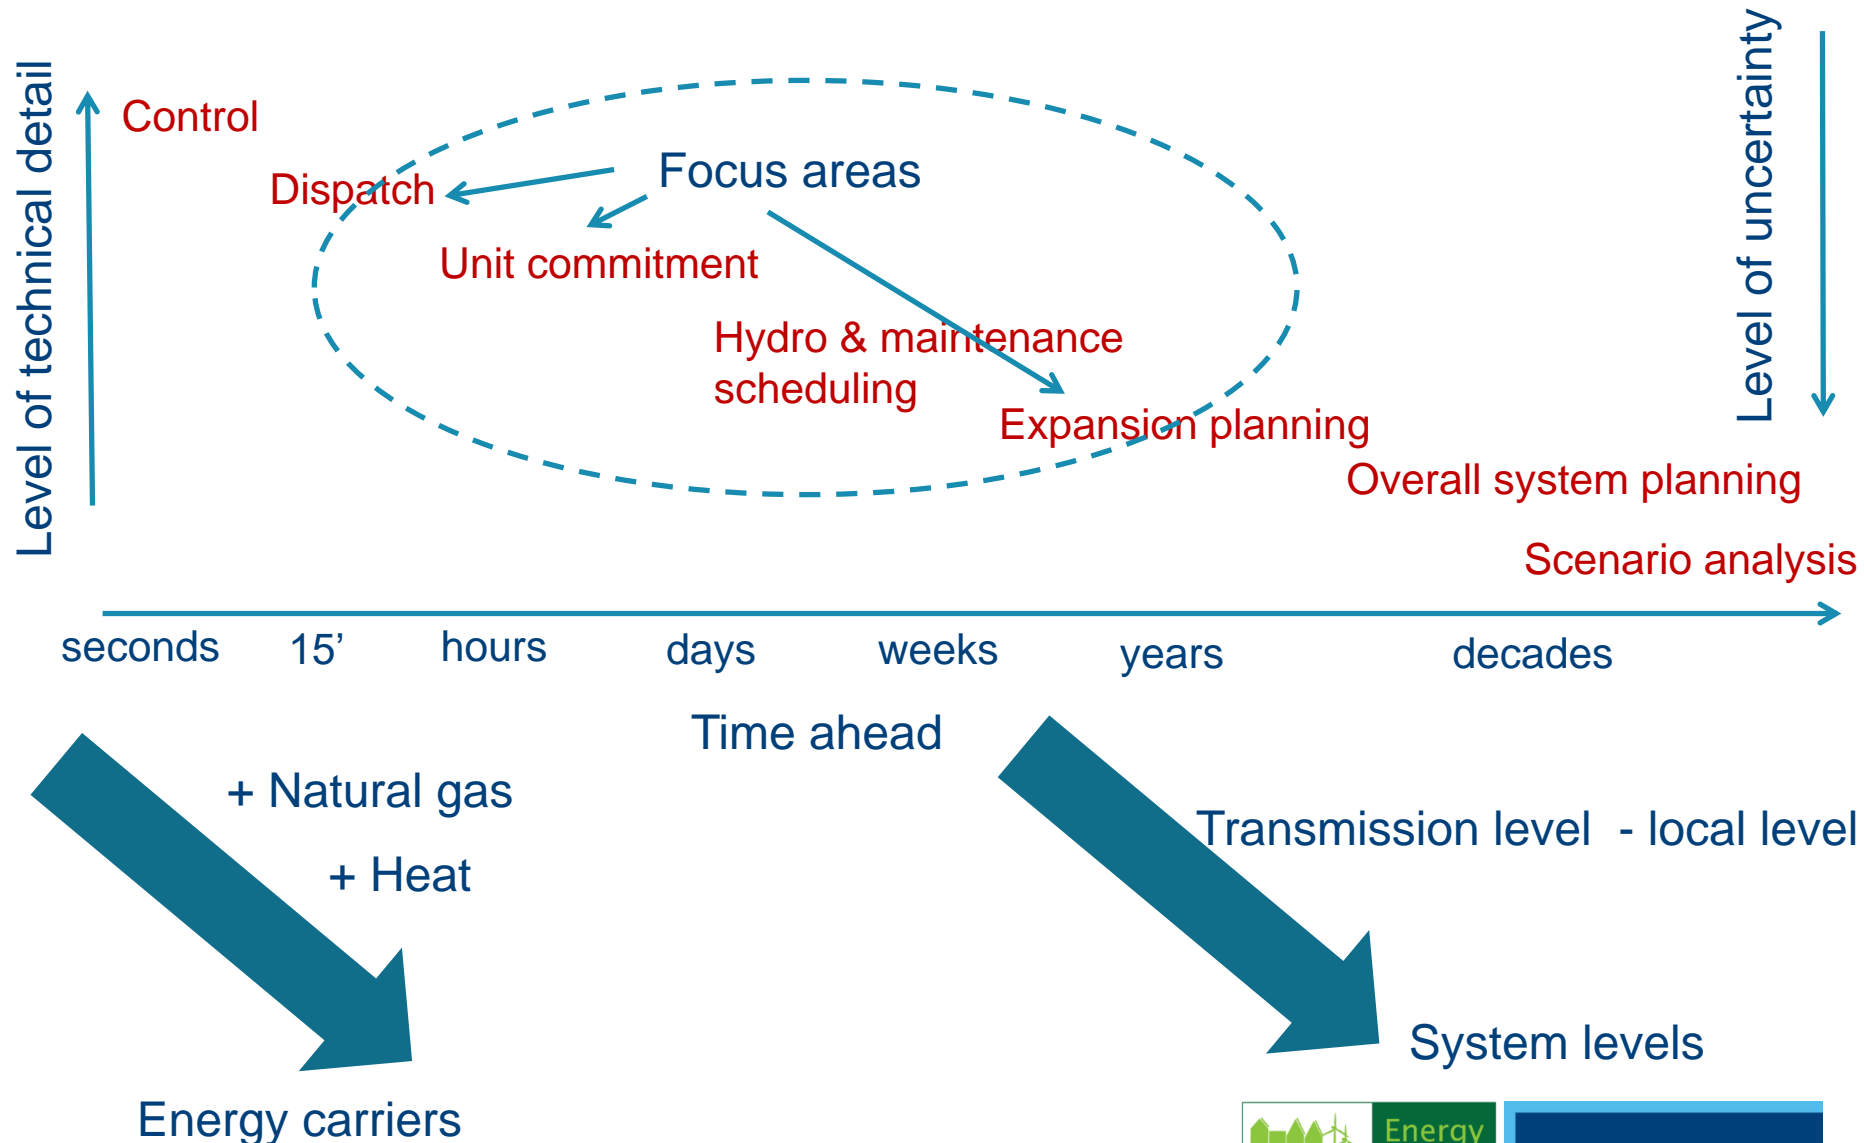

Energy
Ville

KU LEUVEN


Scope & motivation

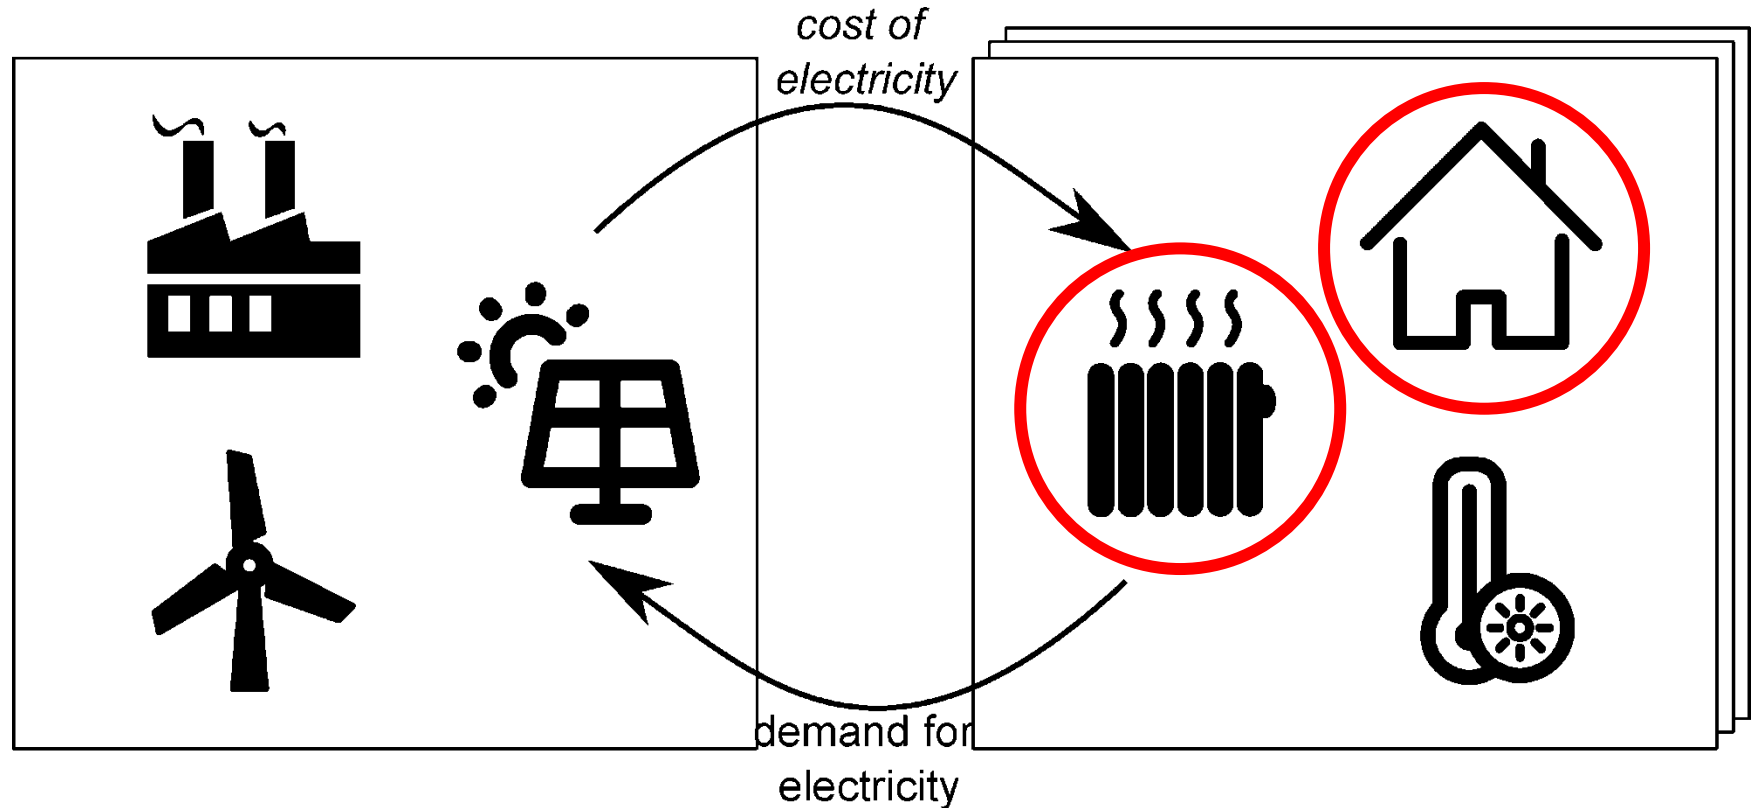

Conventional & stochastic
RES-based electricity
generation

Thermal inertia allows decoupling
the electrical demand and the
thermal demand without loss of
comfort

Modeling challenges & issues

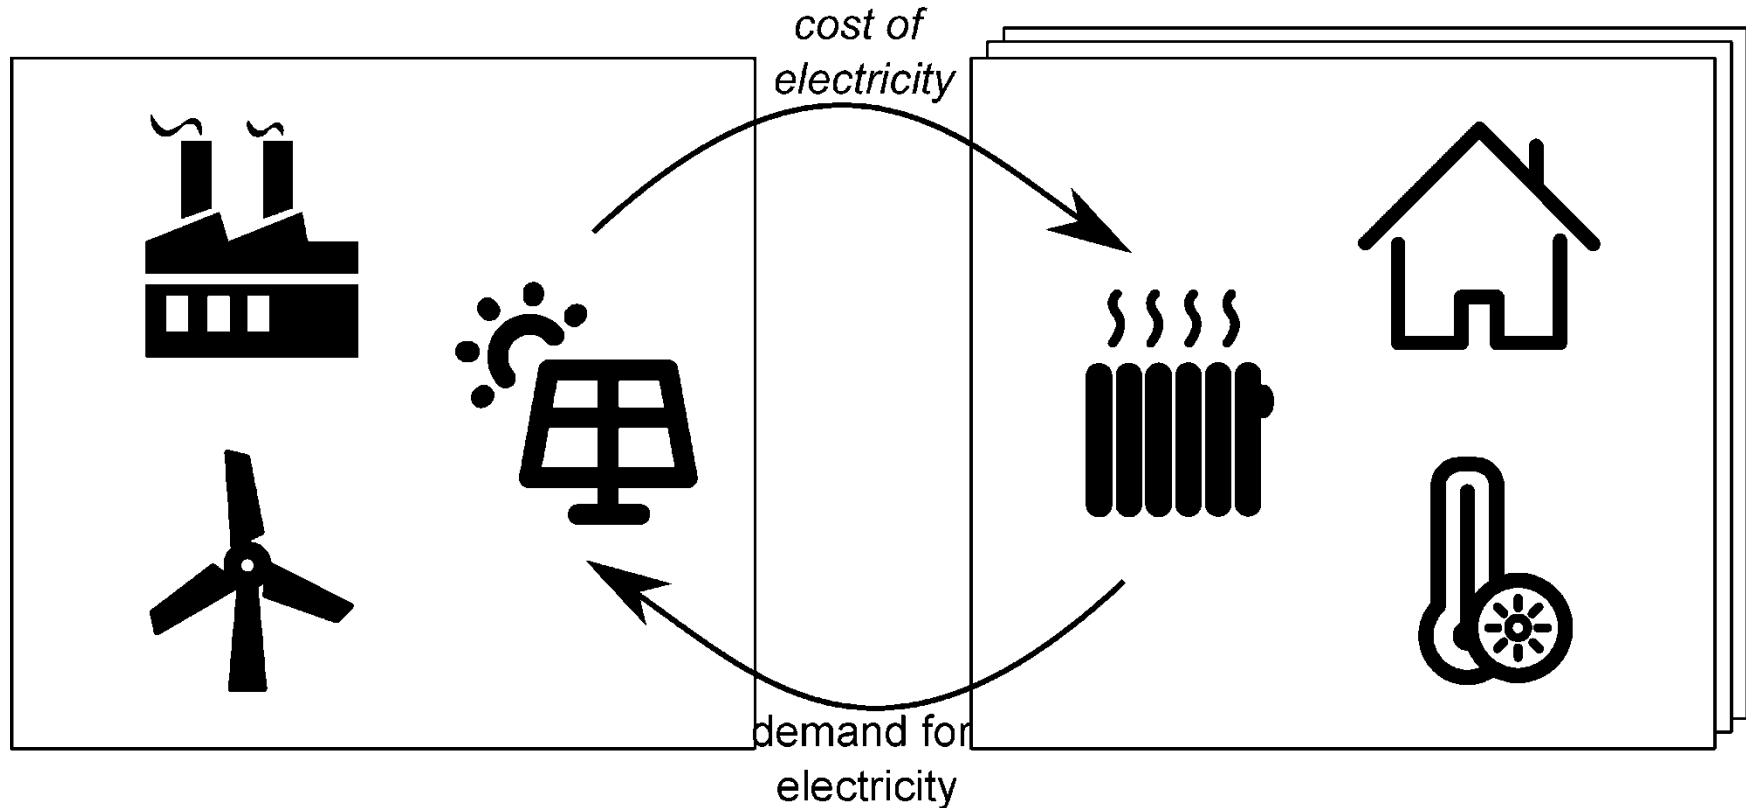

Complex interactions between demand and supply: how do you capture this in an operational model?




Energy
Ville

KU LEUVEN


Modeling challenges & issues

Focus on supply side:

Simplified representations of the demand side flexibility in a unit commitment and economic dispatch model

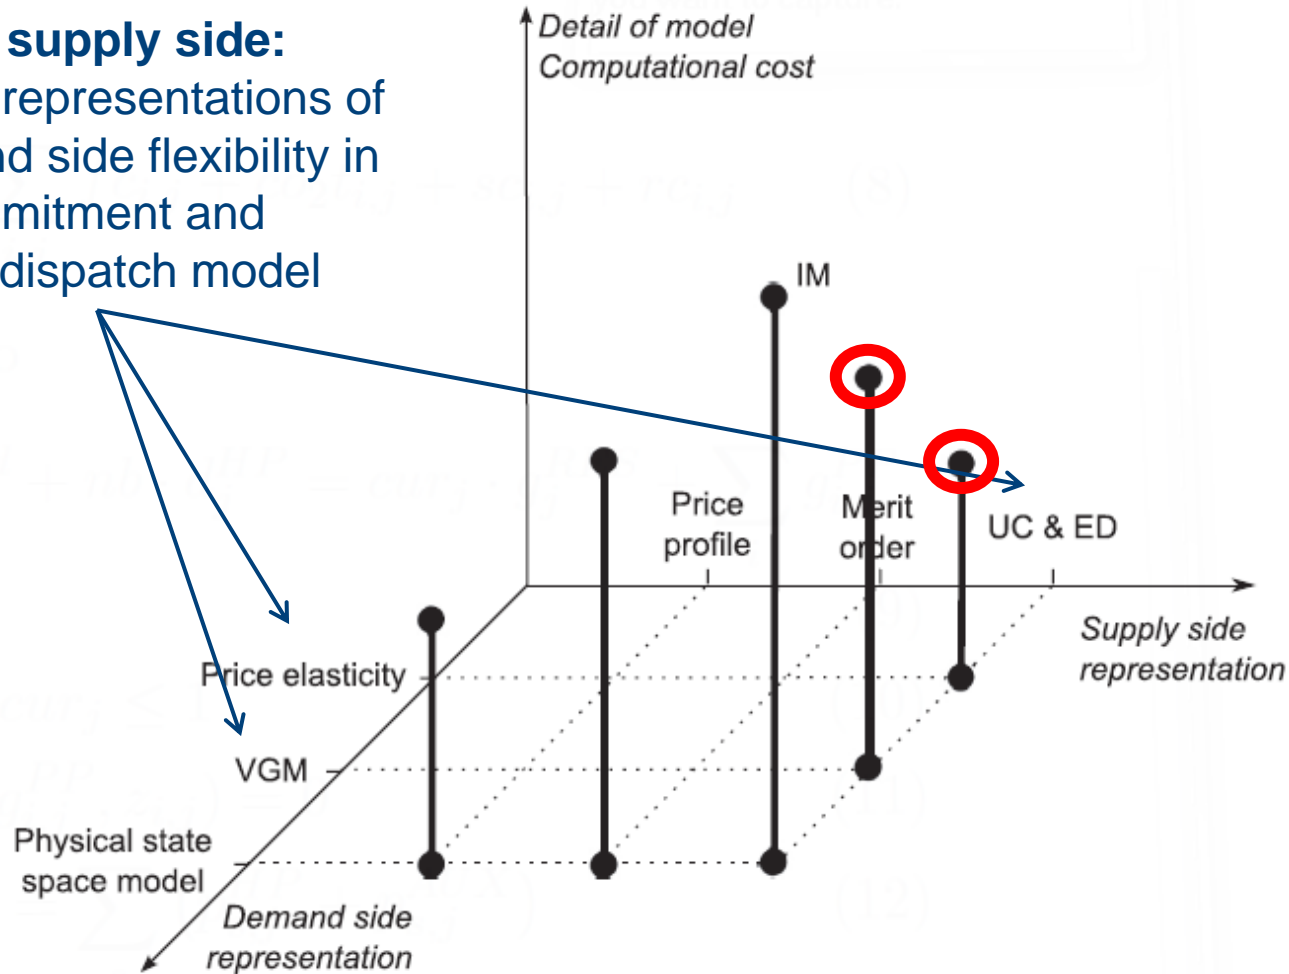


Modeling challenges & issues

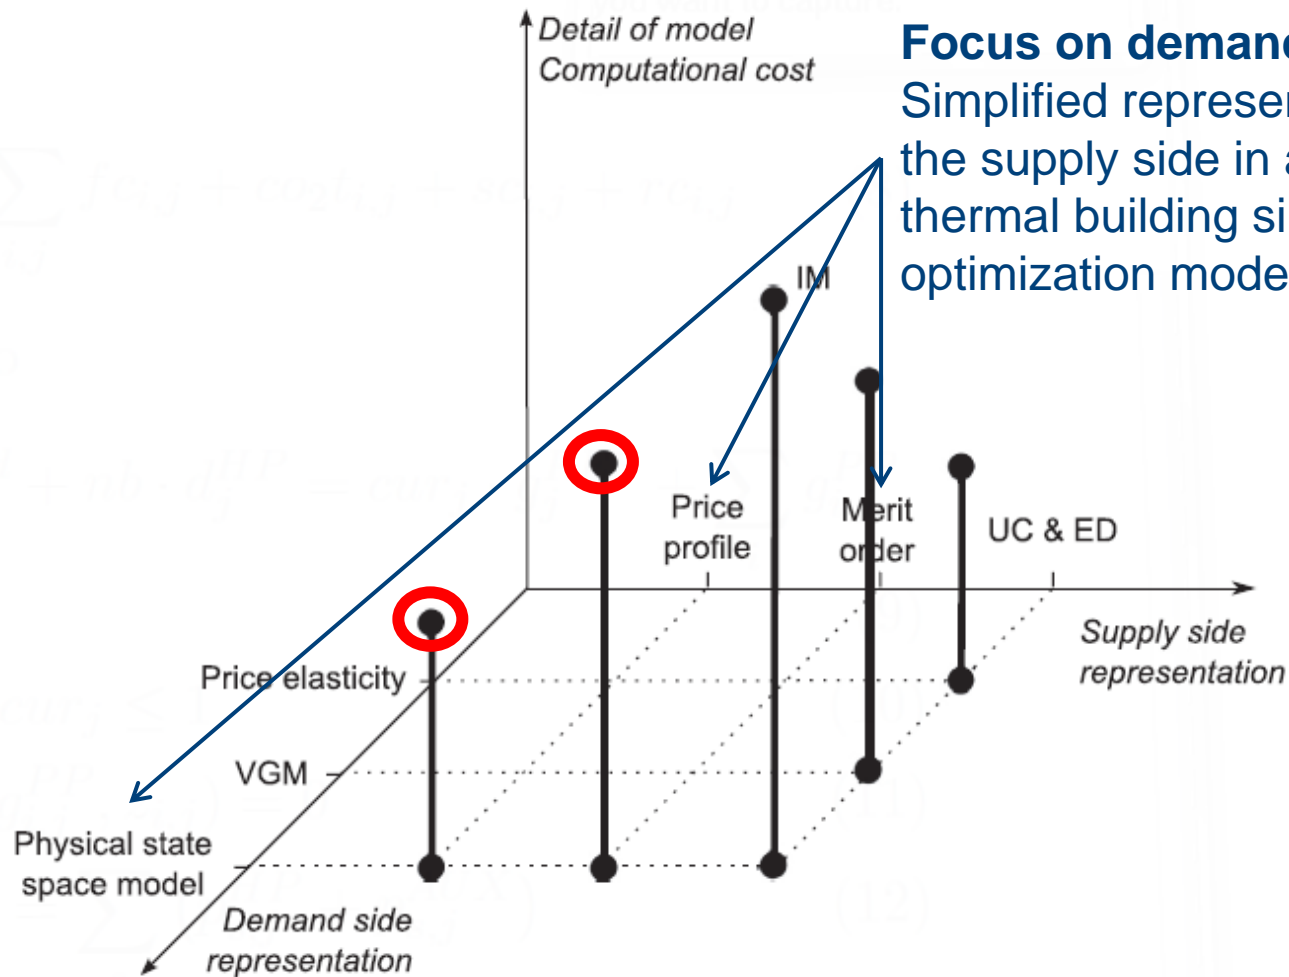

Modeling challenges & issues

Integrated model (IM)

Combination of a UC&ED model and a detailed thermal building model

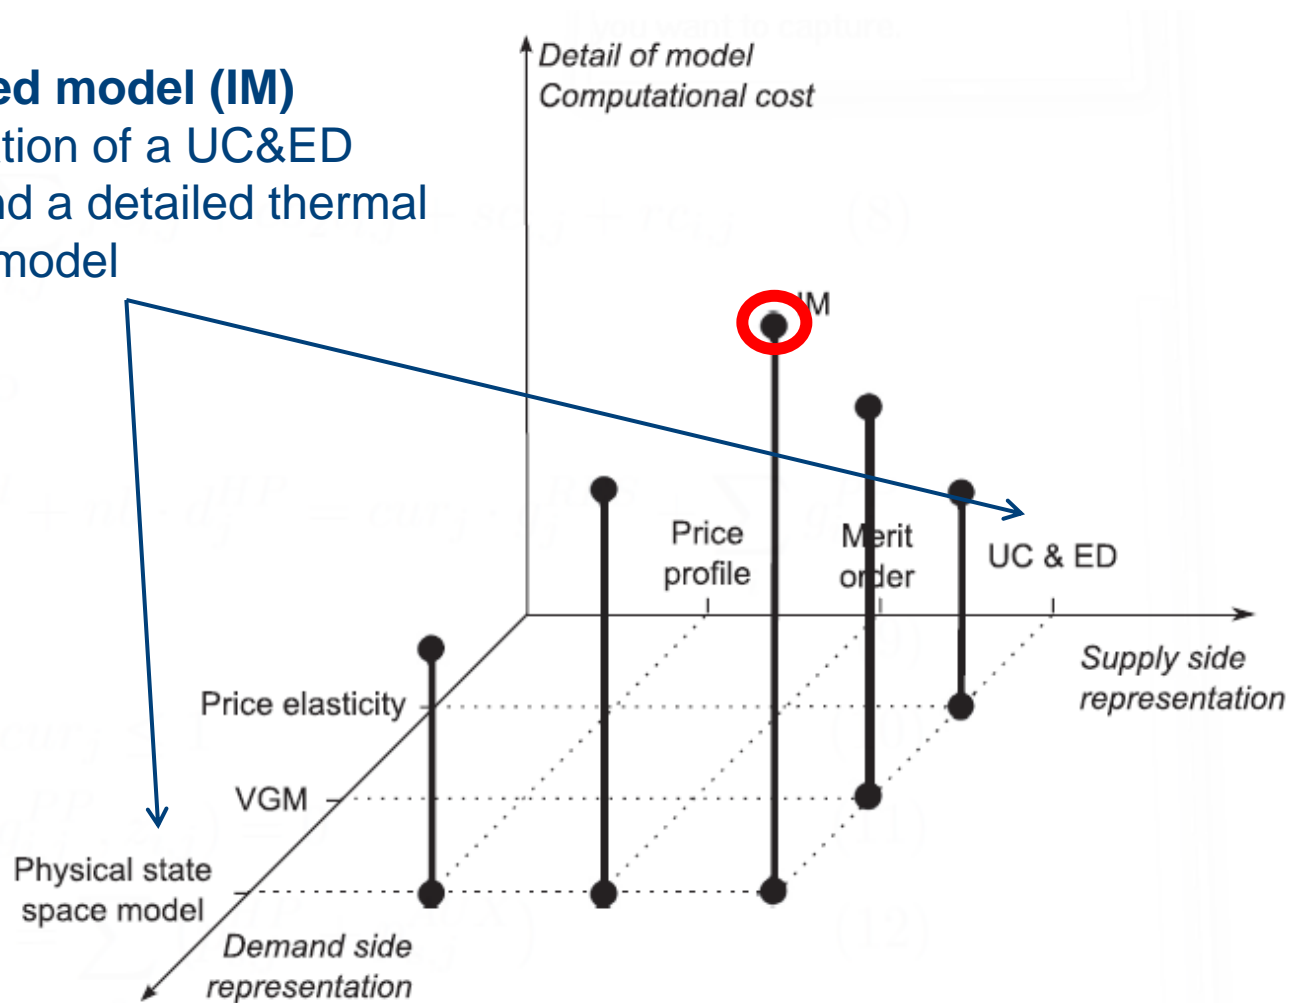


Energy
Ville

KU LEUVEN

An integrated model

Joint optimization: minimize total operational cost

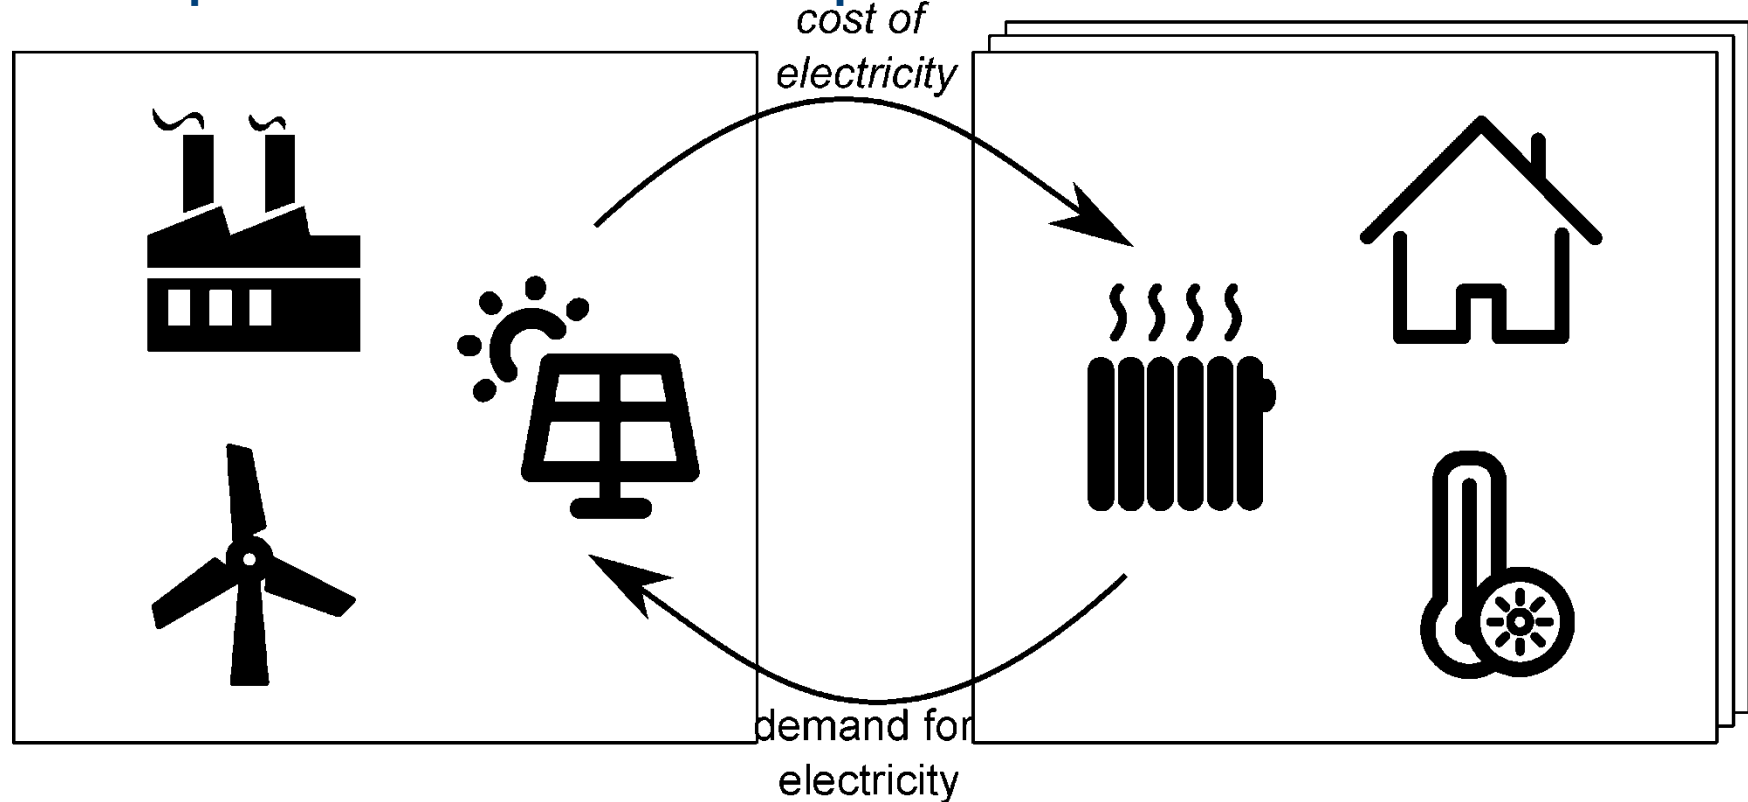

UC & ED model, considering set of power plants, RES-based generation and a fixed demand profile (MILP)


DR-adherent demand model: RC network (thermal dynamics building), linear heat pump model, user behavior & external gains (LP)





KU LEUVEN

An integrated model

Joint optimization: minimize total operational cost

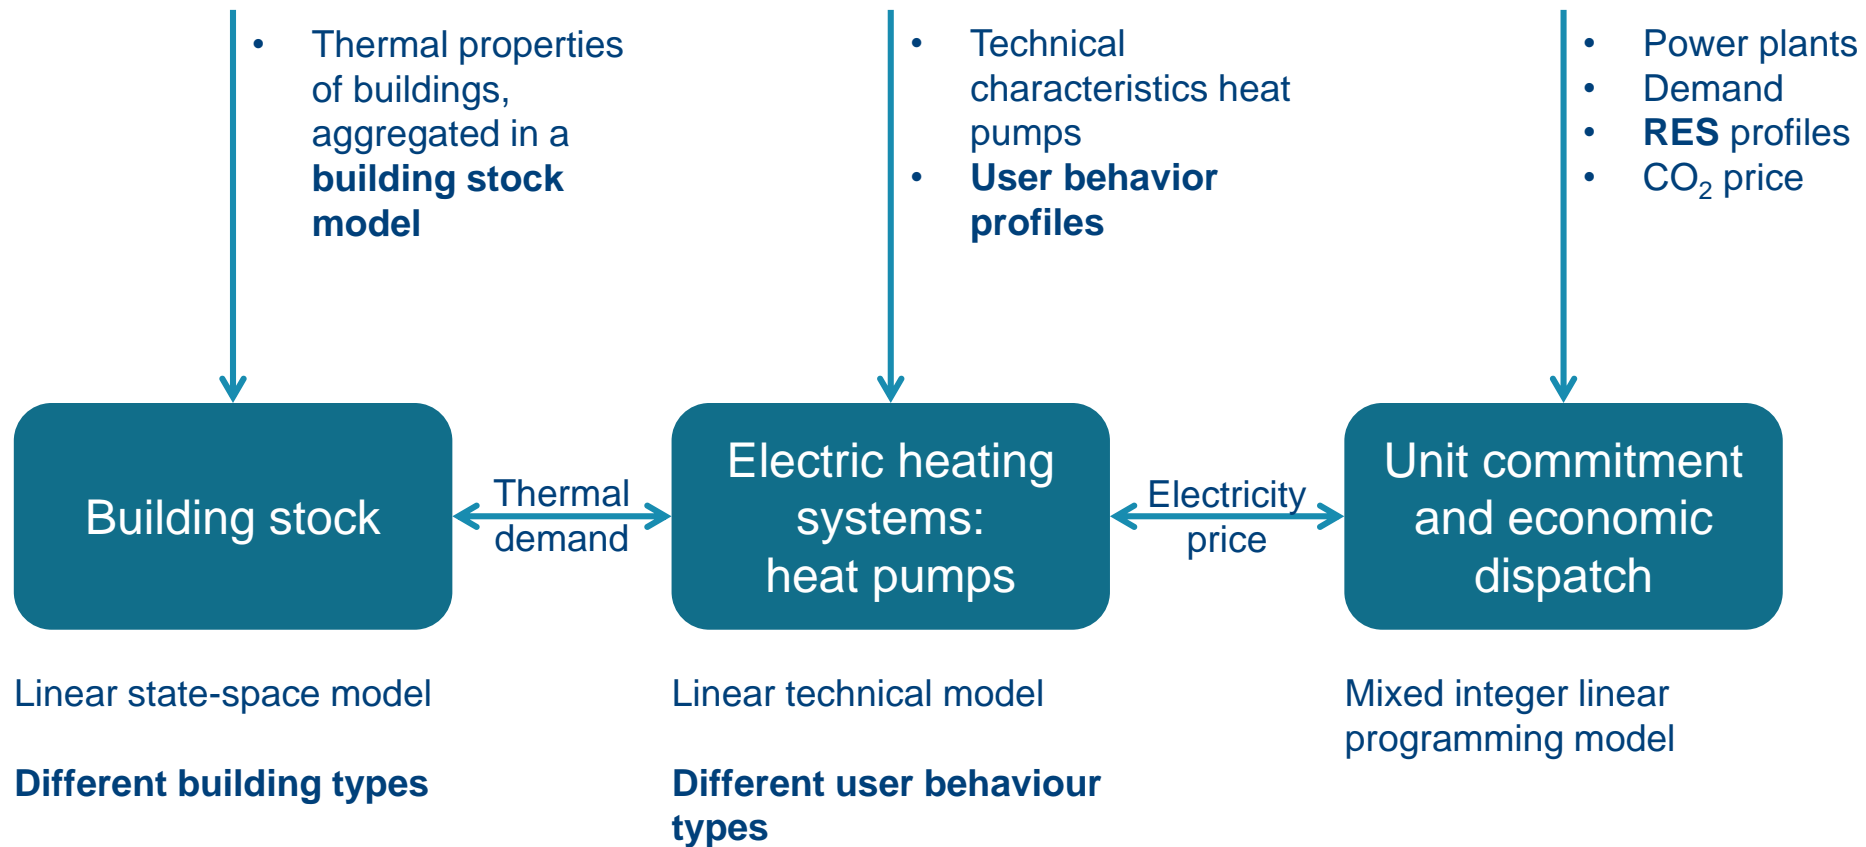

An integrated model: a first example

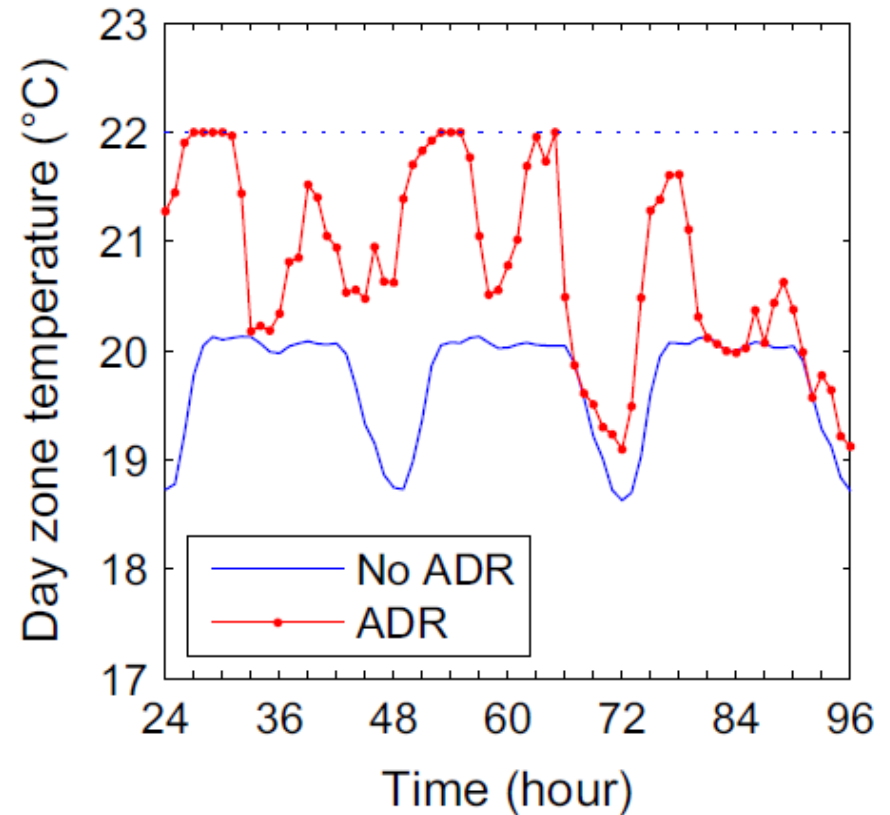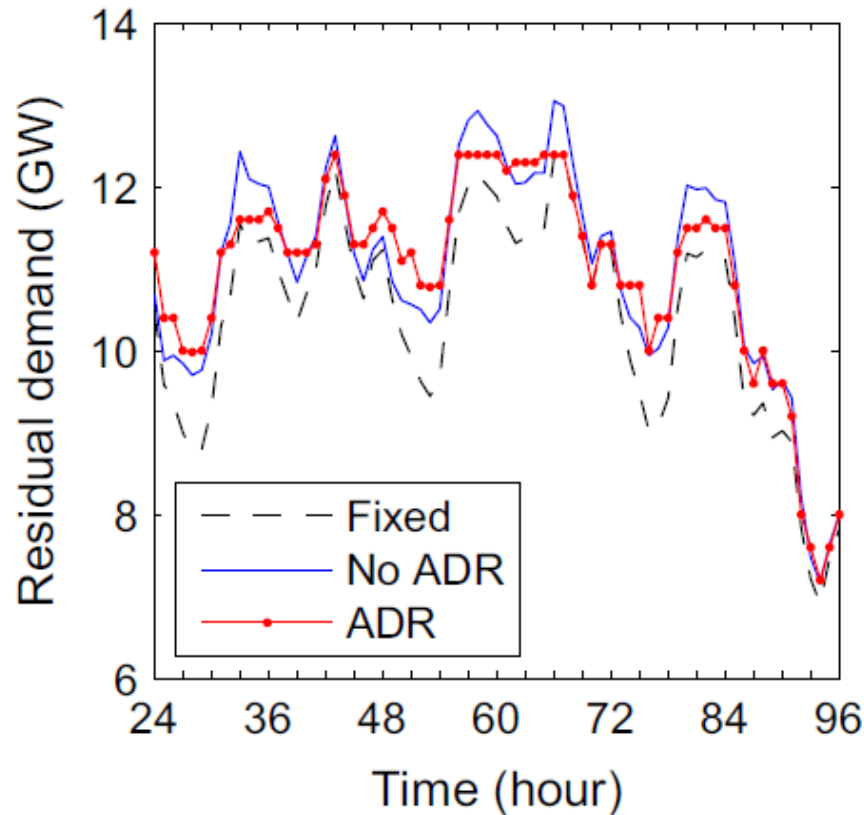


- Power system inspired on possible future setting of BE power system;
- 250,000 heat pumps;
- 52 user behavior profiles.




Energy
Ville

KU LEUVEN



An integrated model: a second example

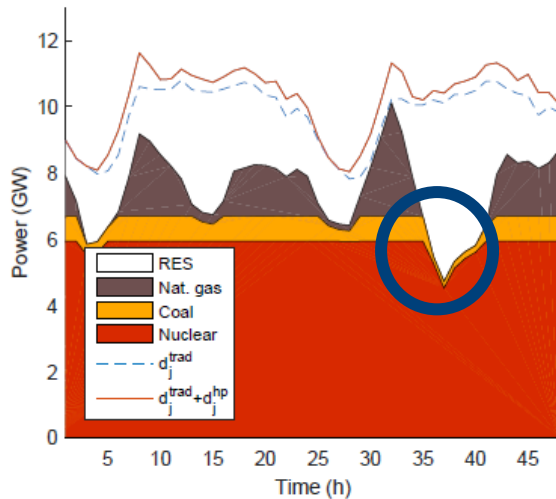


(a) Electricity generation, no DR

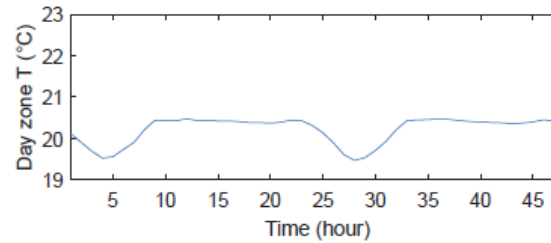


(b) Mean temperatures, no DR

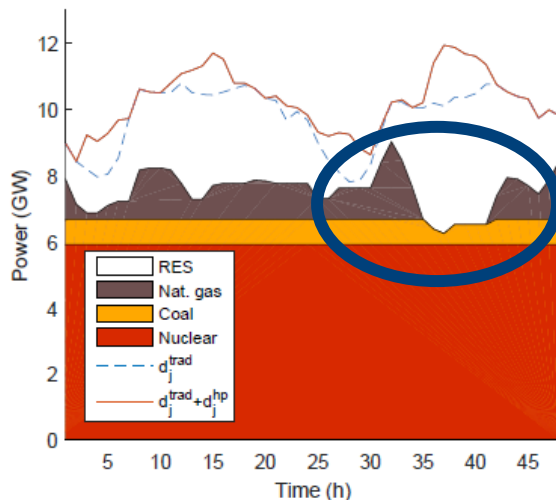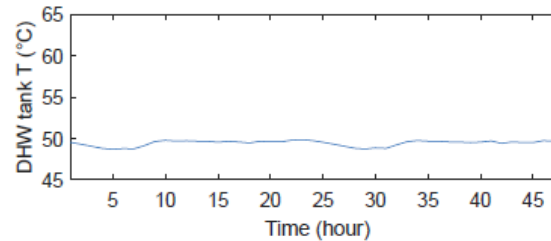

(c) Electricity generation, with DR

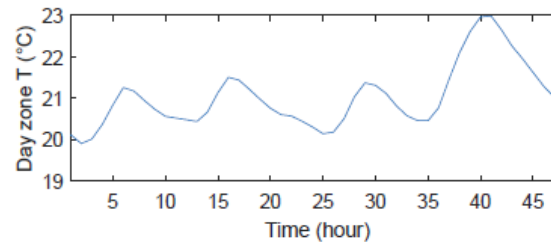

(d) Mean temperatures, with DR

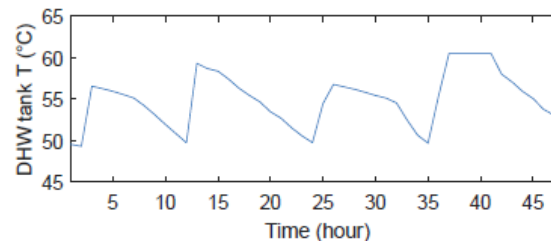

Case study:


- Power system inspired on possible future setting of BE power system;
- 250,000 heat pumps;
- Building properties represented via an 'average' building (detached dwelling);
- 52 user behavior profiles.



Energy
Ville

KU LEUVEN


Value of DR-based arbitrage and regulation services

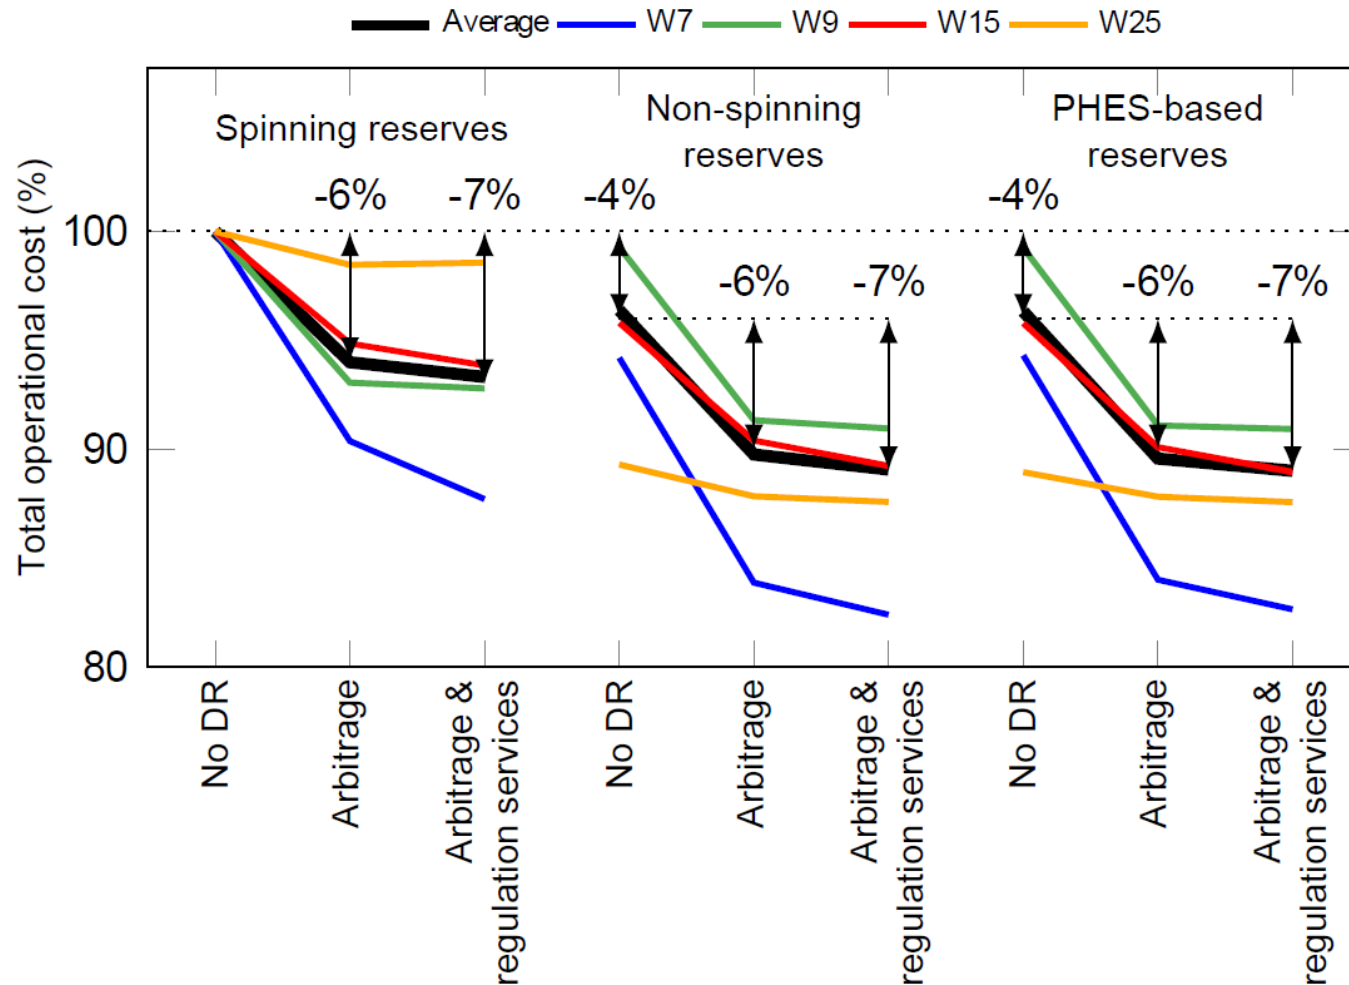

Energy
Ville

KU LEUVEN

Impact of limited DR-controllability

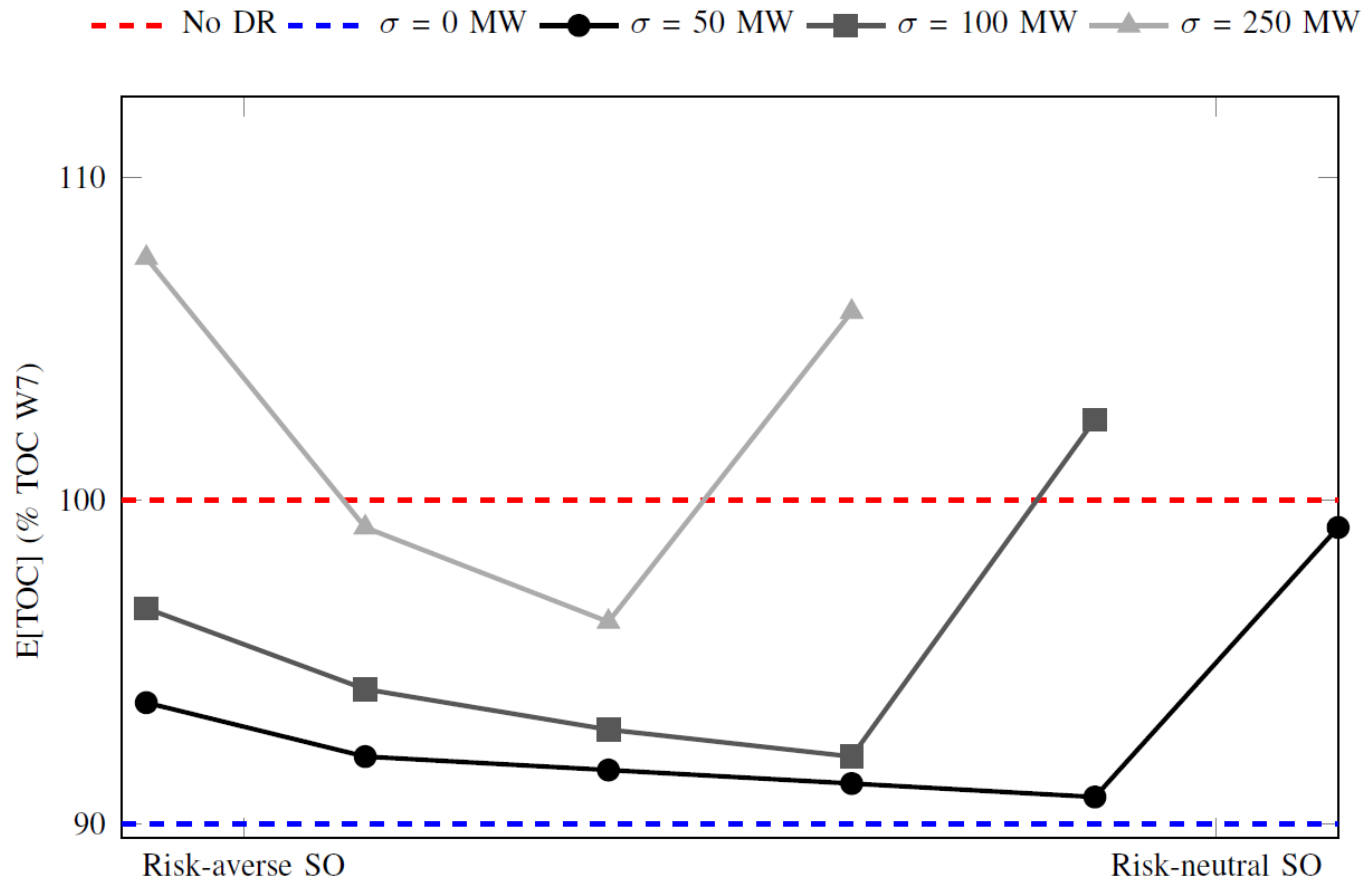

From: Bruninx, K., Dvorkin, Y., Delarue, E., D'haeseleer, W., Kirschen, D. Valuing Demand Response Controllability via Chance Constrained Programming. Under Review at IEEE Transactions on Sustainable Energy, 2017.



Energy
Ville

KU LEUVEN

Conclusion

1 Integrated modelling framework

- Operational demand and supply side model formulated using MILP
- More accurate representation w.r.t. other methods
 - Merit order model provides valuable results at much lower computational cost
- Myriad of applications possible

2 Demand response with heat pumps

- Could hold significant environmental and economical advantages: operational cost savings, (additional) peak demand reduction, cost-effective regulation services
- Current modeling provides upper bound

3 Future work

- Impact on heating system design and life time
- Heterogeneity of DR-loads, user behavior, building types
- Conflicting objectives building owner – system operator
- Long term system adequacy



Further reading

- [1] D. Patteeuw et al., *Integrated modeling of active demand response with electric heating systems coupled to thermal energy storage systems*, Applied Energy 151, pp. 306-319, 2015.
- [2] D. Patteeuw et al., *CO2-abatement cost of residential heat pumps with Active Demand Response: demand-and supply-side effects*, Applied Energy 156, pp. 490-501, 2015.
- [3] A. Arteconi et al., *Active demand response with electric heating systems: impact of market penetration*, Applied Energy 177, 636-648, 2016.
- [4] K. Bruninx, E. Delarue (co-supervisor) and W. D'haeseleer (supervisor), *Improved modeling of unit commitment decisions under uncertainty*, PhD thesis, KU Leuven, May 2016.
- [5] D. Patteeuw and L. Helsen (supervisor), *Demand response for residential heat pumps in interaction with the electricity generation system*, PhD thesis, KU Leuven, September 2016.
- [6] K. Bruninx, et al., *Valuing Demand Response Controllability via Chance Constrained Programming*. Under Review at IEEE Transactions on Sustainable Energy, 2017.

