Zwick Roell

Print date: 21.01.21

Test report

Customer	:	-redacted-
Job no.	:	OPP.226686
Test standard	:	Textile strip tensile with Customer's individual testing parameter
Specimen type	:	Strips with 12mm/10mm/9mm width
Tester	:	ct-Sam Liu
Notes	:	Clamping pressure 6 bar = 10.8 kN
Machine data	:	Grips: Pneumatic Capstan grips type 8314 Fmax=10 kN (316888) Jaws: Steel corrugated 50*60mm (313912) Pneumatic foot control (057427) Extensometer: VideoXtens 3-300 (1043970) FOV 300*90 mm Resolution 0.5µm

Pre-load	:	200 N
Test speed	:	100 mm/min

This is the way how reports look today.
Static and per test only.

Test results:

Legend	12mm No.	L_0 mm	F_{max} N	$Strain_{Fmax}$ %	dL at break %	b_0 mm
	1.1	100	5738	17,6	17,7	12
	1.2	100	5779	17,6	17,7	12
	1.3	100	5710	17,4	17,4	12
	1.4	100	5752	17,7	17,7	12
	1.5	100	5761	17,7	17,7	12

Series graph:

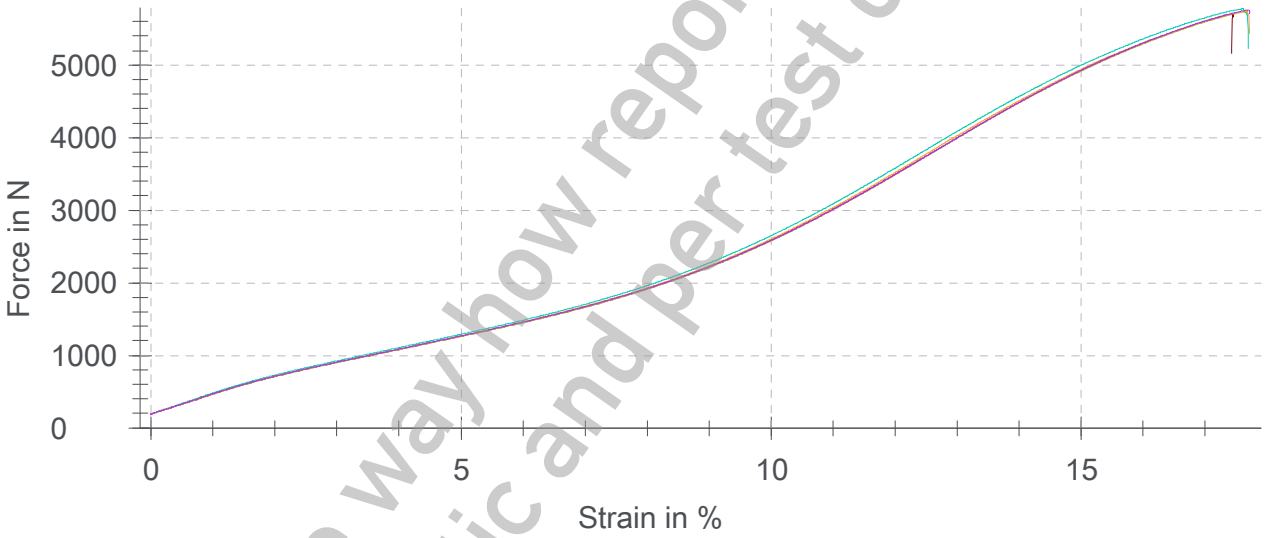

Statistics:

12mm n = 5	L_0 mm	F_{max} N	$Strain_{Fmax}$ %	dL at break %	b_0 mm
$\bar{x}$	100	5748	17,6	17,6	12
s	0	25,85	0,1	0,1	0,000
□[%]	0,00	0,45	0,60	0,71	0,00

This is the way how reports look today. Static and per test only.

Zwick Roell

Print date: 21.01.21

Test results:

Legend	10mm No.	L_0 mm	F_{max} N	$Strain_{Fmax}$ %	dL at break %	b_0 mm
	2.1	100	3944	15,4	15,6	10
	2.2	100	3767	14,9	14,9	10
	2.3	100	3869	15,1	15,6	10
	2.4	100	3842	15,1	15,5	10
	2.5	100	3897	15,5	16,2	10

Series graph:

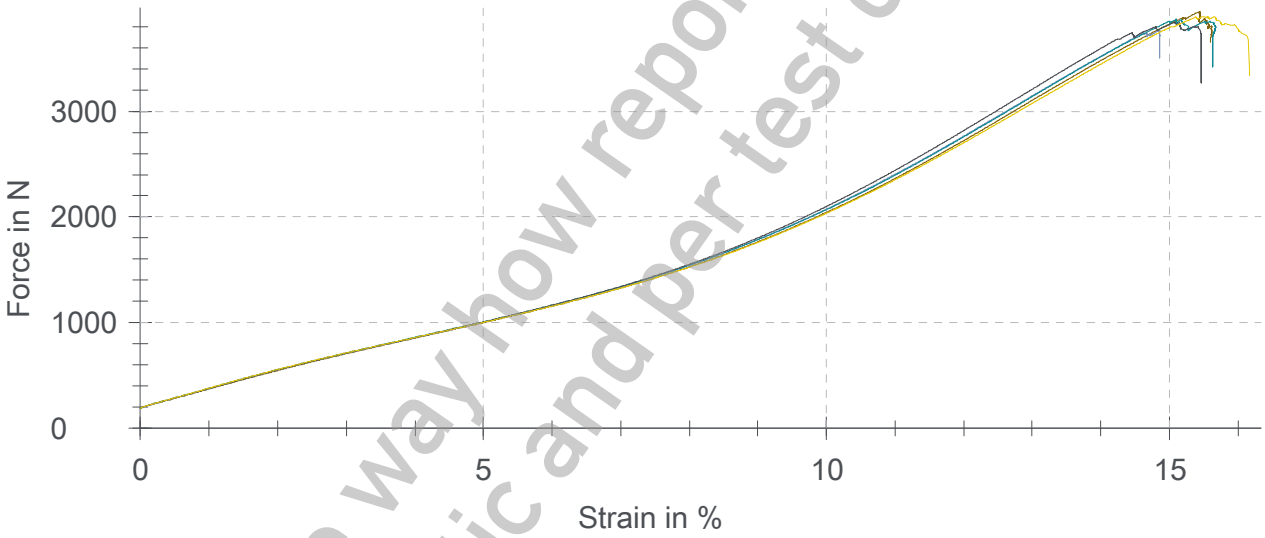

Statistics:

10mm n = 5	L_0 mm	F_{max} N	$Strain_{Fmax}$ %	dL at break %	b_0 mm
$\bar{x}$	100	3864	15,2	15,5	10
s	0	66,07	0,3	0,5	0,000
□[%]	0,00	1,71	1,75	3,00	0,00

This is the way how reports look today. Static and per test only.

Zwick Roell

Print date: 21.01.21

Test results:

Legend	9mm No.	L_0 mm	F_{max} N	$Strain_{Fmax}$ %	dL at break %	b_0 mm
	3.1	100	2522	20,7	20,8	9
	3.2	100	2481	19,6	19,6	9
	3.3	100	2520	20,6	20,6	9
	3.4	100	2495	19,5	19,5	9

Series graph:

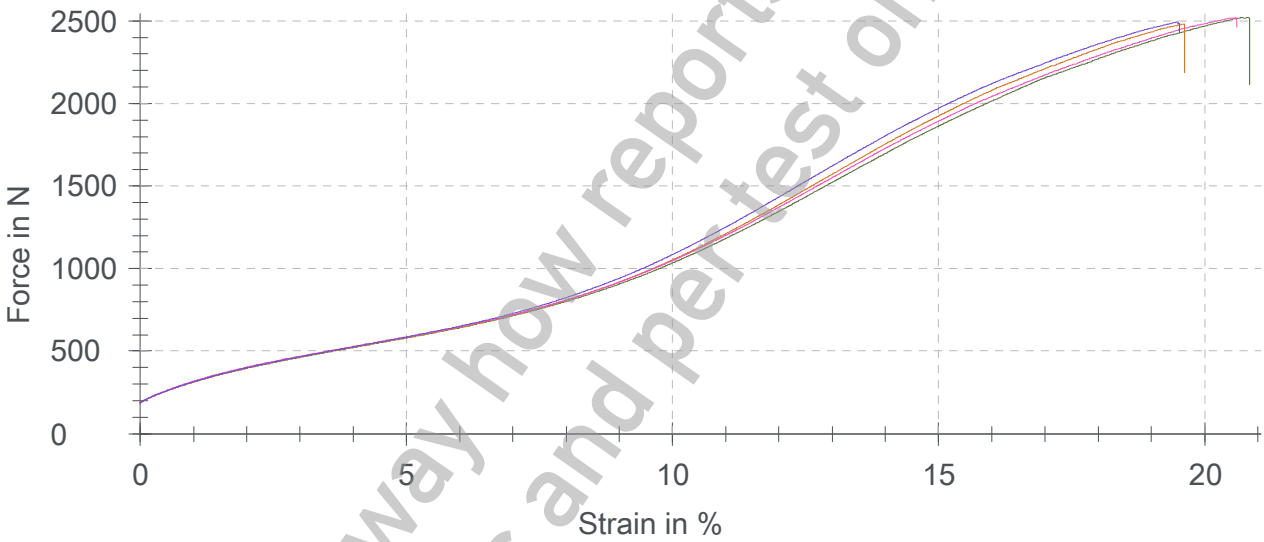

Statistics:

9mm n = 4	L_0 mm	F_{max} N	$Strain_{Fmax}$ %	dL at break %	b_0 mm
$\bar{x}$	100	2504	20,1	20,1	9
s	0	19,64	0,6	0,7	0,000
□ [%]	0,00	0,78	3,16	3,33	0,00

This is the way how reports look today. Static and per test only.