

SCOPE OF WORK:

TO INSTALL A TESLA BATTERY PACK SYSTEM AT THE OWNER RESIDENCE LOCATED AT 1659 BEE CANYON RD, ARROYO GRANDE, CA 93420, USA. THE POWER GENERATED BY THE PV SYSTEM WILL BE INTERCONNECTED WITH THE UTILITY GRID THROUGH THE EXISTING ELECTRICAL SERVICE EQUIPMENT. THE SYSTEM INCLUDE STORAGE BATTERIES WITH BACKUP SWITCH.

GOVERNING CODES

- 2025 CALIFORNIA BUILDING CODE (CBC)
- 2025 CALIFORNIA RESIDENTIAL CODE (CRC)
- 2025 CALIFORNIA ELECTRICAL CODE (CEC)
- 2025 CALIFORNIA FIRE CODE (CFC)
- 2025 CALIFORNIA ENERGY CODE

AHJ NAME: SAN LUIS OBISPO COUNTY

(N) SYSTEM RATING

11.50 KWAC

BATTERIES MUST BE
INSTALLED 3 FT FROM ANY
WINDOW OR DOOR.

SHEET INDEX

PV-0	COVER PAGE
PV-0A	ELECTRICAL NOTES
PV-1	SITE PLAN
PV-2	ROOF PLAN & BOM
PV-2A	EQUIPMENT ELEVATION
PV-3	ELECTRICAL LINE DIAGRAM
PV-3A	ELECTRICAL CALCS.
PV-3B	SPECIFICATIONS
PV-4+	SIGNAGE
PV-5	PLACARD
PV-6+	EQUIPMENT SPECIFICATIONS
PV-11+	BATTERY MOUNT DETAILS
PV-17	PV HAZARD REPORT

BATTERY STORAGE SYSTEM NOTES

BACKFEED BREAKERS MUST BE LOCATED@OPPOSITE END OF BUS BAR FROM MAIN BREAKER OR MAIN LUG ON GRID SIDE. WHEN A BACKFED BREAKER IS THE METHOD OF UTILITY INTERCONNECTION, BREAKER SHALL NOT READ 'LINE OR LOAD'. PER CEC 250.64(C): CONDUCTOR SPLICES ONLY ALLOWED WITH COMPRESSION CONNECTORS OR EXOTHERMIC WELDING VERIFY (E) UFER GROUND NEAR MSP. IF (E) UFER IS NOT ACCESSIBLE OR VERIFIABLE, INSTALL A NEW 5/8"0 X 8' LONG GROUNDING ROD AND BOND SOLAR SYSTEM EQUIPMENT GROUNDING ACCORDINGLY.

WHEN ESS IS INSTALLED INSIDE GARAGE - ANY PLANNED OR EXISTING ATTACHED GARAGE SHALL COMPLY WITH ALL APPLICABLE CODES AND STANDARDS, AND WITH THE MANUFACTURERS INSTALLATION MANUALS TO WHICH EQUIPMENT HAS BEEN LISTED. INCLUDING REQUIREMENTS PERTAINING TO FIRE PROTECTIVE FEATURES (E.G. GYPSUM BOARD, DOORS, AND DUCTS) AND TO ALARM/DETECTOR DEVICES.

NEW EQUIPMENT SUMMARY

(01) TESLA INC./AC COUPLED HYBRID SYSTEM POWERWALL 3 1707000-21-L, 11.5KW, 13.5KWH [120V/240V]

(01) TESLA BACKUP SWITCH 200A, 120/240V,NEMA 3R, 1624171-XX-Y

(01) TESLA POWERWALL 3 EXPANSION UNIT 1807000-20-Y,13.5KWH

VICINITY

GPS LOCATION : 35.160345, -120.565399

PROJECT SITE



1

PV-0

HOUSE PHOTO

SCALE: NTS

PROJECT SITE



2

PV-0

VICINITY MAP

SCALE: NTS

SYSTEM INFO

(01) TESLA POWERWALL 3 EXPANSION UNIT 1807000-20-Y,13.5KWH

(01) TESLA INC./AC COUPLED HYBRID SYSTEM POWERWALL 3 1707000-21-L, 11.5KW, 13.5KWH [120V/240V]

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

DATE: 04/03/2026


SHEET NAME
COVER PAGE

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER

PV-0

(E) BACK OF RESIDENCE

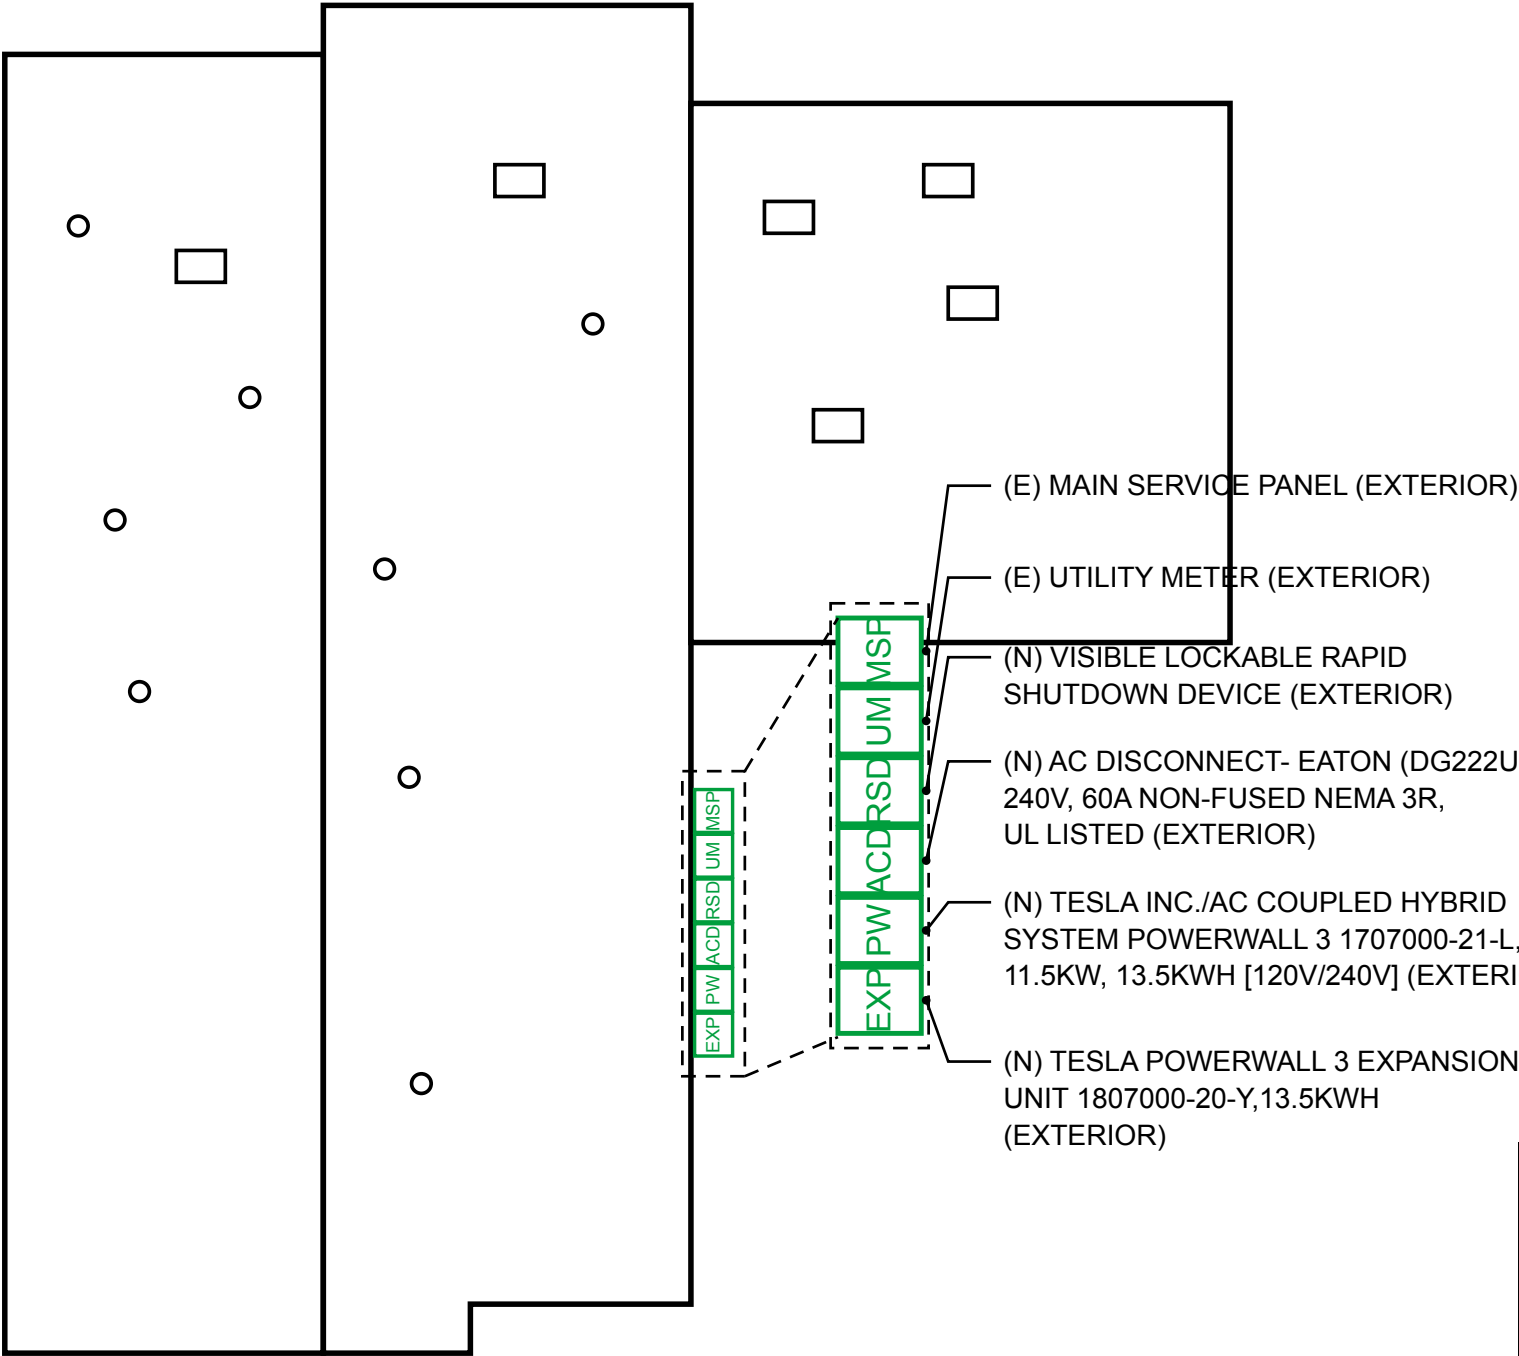

- MSP - MAIN SERVICE PANEL
- UM - UTILITY METER
- PW - TESLA POWERWALL 3
- ACD - AC DISCONNECT
- RSD - VISIBLE LOCKABLE RAPID SHUTDOWN DEVICE
- EXP - TESLA EXPANSION UNIT
- VENT, ATTIC FAN (ROOF OBSTRUCTION)

NEW EQUIPMENT SUMMARY
(01) TESLA INC./AC COUPLED HYBRID SYSTEM POWERWALL 3 1707000-21-L, 11.5KW, 13.5KWH [120V/240V]
(01) TESLA BACKUP SWITCH 200A, 120/240V,NEMA 3R, 1624171-XX-Y
(01) TESLA POWERWALL 3 EXPANSION UNIT 1807000-20-Y,13.5KWH

UTILITY METER NUMBER:- 1011687980

BILL OF MATERIALS			
EQUIPMENT	QTY	PRODUCT CODE	DESCRIPTION
INVERTER + BATTERY	1	1707000-21-L	TESLA INC./AC COUPLED HYBRID SYSTEM POWERWALL 3 1707000-21-L, 11.5KW, 13.5KWH [120V/240V]
BACKUP SWITCH	1	1841000-X1-Y	TESLA BACKUP SWITCH 200A, 120/240V,NEMA 3R, 1624171-XX-Y
TESLA EXPANSION UNIT	1	1807000-20-Y	TESLA POWERWALL 3 EXPANSION UNIT 1807000-20-Y, 13.5KWH
EXPANSION HARNESS	1	1807000-20-Y	HARNESS 2.0M - PW3 EXPANSION 1875157-20-Y
EXPANSION WALL MOUNT KIT	1	1978069-XX-Y	PW3 EXPANSION WALL MOUNT KIT 1978069-XX-Y
RSD	1	-	IMO VISIBLE LOCKABLE RAPID SHUTDOWN DEVICE

SYSTEM INFO

(01) TESLA POWERWALL 3 EXPANSION UNIT 1807000-20-Y,13.5KWH
(01) TESLA INC./AC COUPLED HYBRID SYSTEM POWERWALL 3 1707000-21-L, 11.5KW, 13.5KWH [120V/240V]

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS


DATE: 04/03/2026

SHEET NAME
ROOF PLAN & BOM

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER

PV-2



1

PV-2

ROOF PLAN & BOM

SCALE: 3/32" = 1'-0"

(E) FRONT OF RESIDENCE
BEE CANYON RD


NOTE: BATTERIES MUST BE INSTALLED 3 FT AWAY FROM DOORS AND WINDOWS ONLY WHEN INSTALLED OUTDOORS.

NOTE: EQUIPMENT LAYOUT IS ILLUSTRATIVE AND FOR REFERENCE ONLY. FINAL PLACEMENT SHALL COMPLY WITH LOCAL CODE REQUIREMENTS, MANUFACTURER SPECIFICATIONS, FIELD CONDITIONS, AND AUTHORITY HAVING JURISDICTION (AHJ) APPROVAL

NOTE:
* PROVIDE AND MAINTAIN 36" DEPTH, 30" WIDTH, AND 6'6" HEADROOM IN FRONT OF ELECTRICAL EQUIPMENT PER CEC 110.26

* METER CENTERLINE ELEVATION TO COMPLY WITH UTILITY-SPECIFIC REQUIREMENTS. TYPICAL ALLOWABLE RANGE: 48"-75" ABOVE FINISHED GRADE WITH 60" PREFERRED. CONFIRM FINAL PLACEMENT WITH SERVING UTILITY.

EXTERIOR HOUSE WALL, SOUTH-EAST SIDE (UNDER DECK)

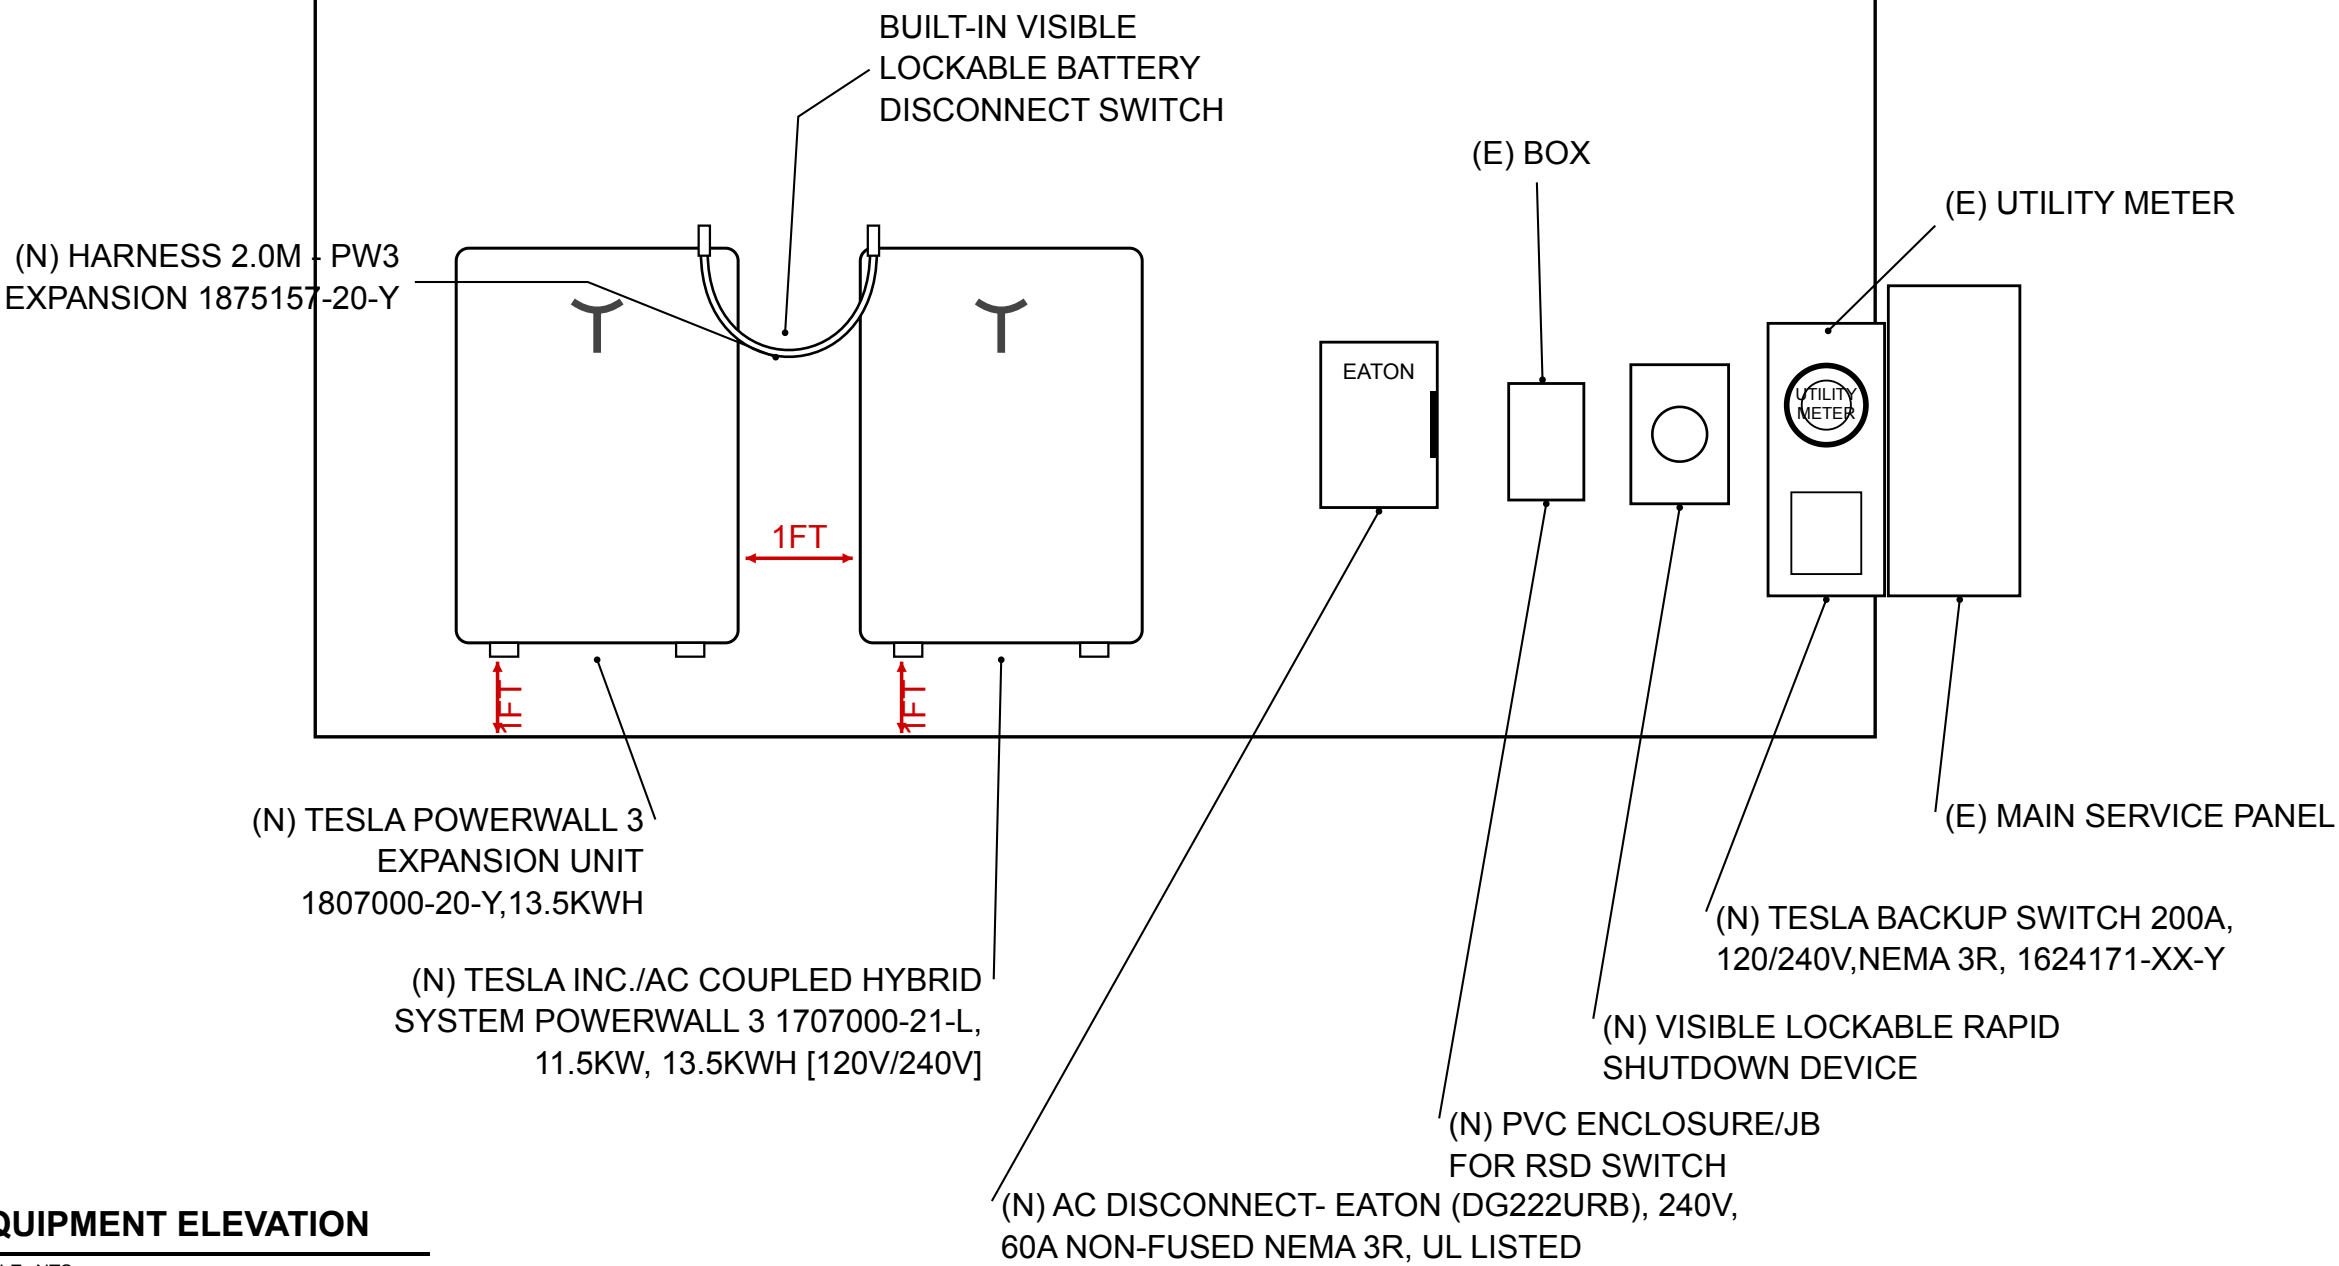

SYSTEM INFO		
(01) TESLA POWERWALL 3 EXPANSION UNIT 1807000-20-Y, 13.5KWH		
(01) TESLA INC./AC COUPLED HYBRID SYSTEM POWERWALL 3 1707000-21-L, 11.5KW, 13.5KWH [120V/240V]		
REVISIONS		
DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

DATE: 04/03/2026
SHEET NAME EQUIPMENT ELEVATION
SHEET SIZE ANSI B 11" X 17"
SHEET NUMBER PV-2A