


One cabinet, interchangeable filter modules

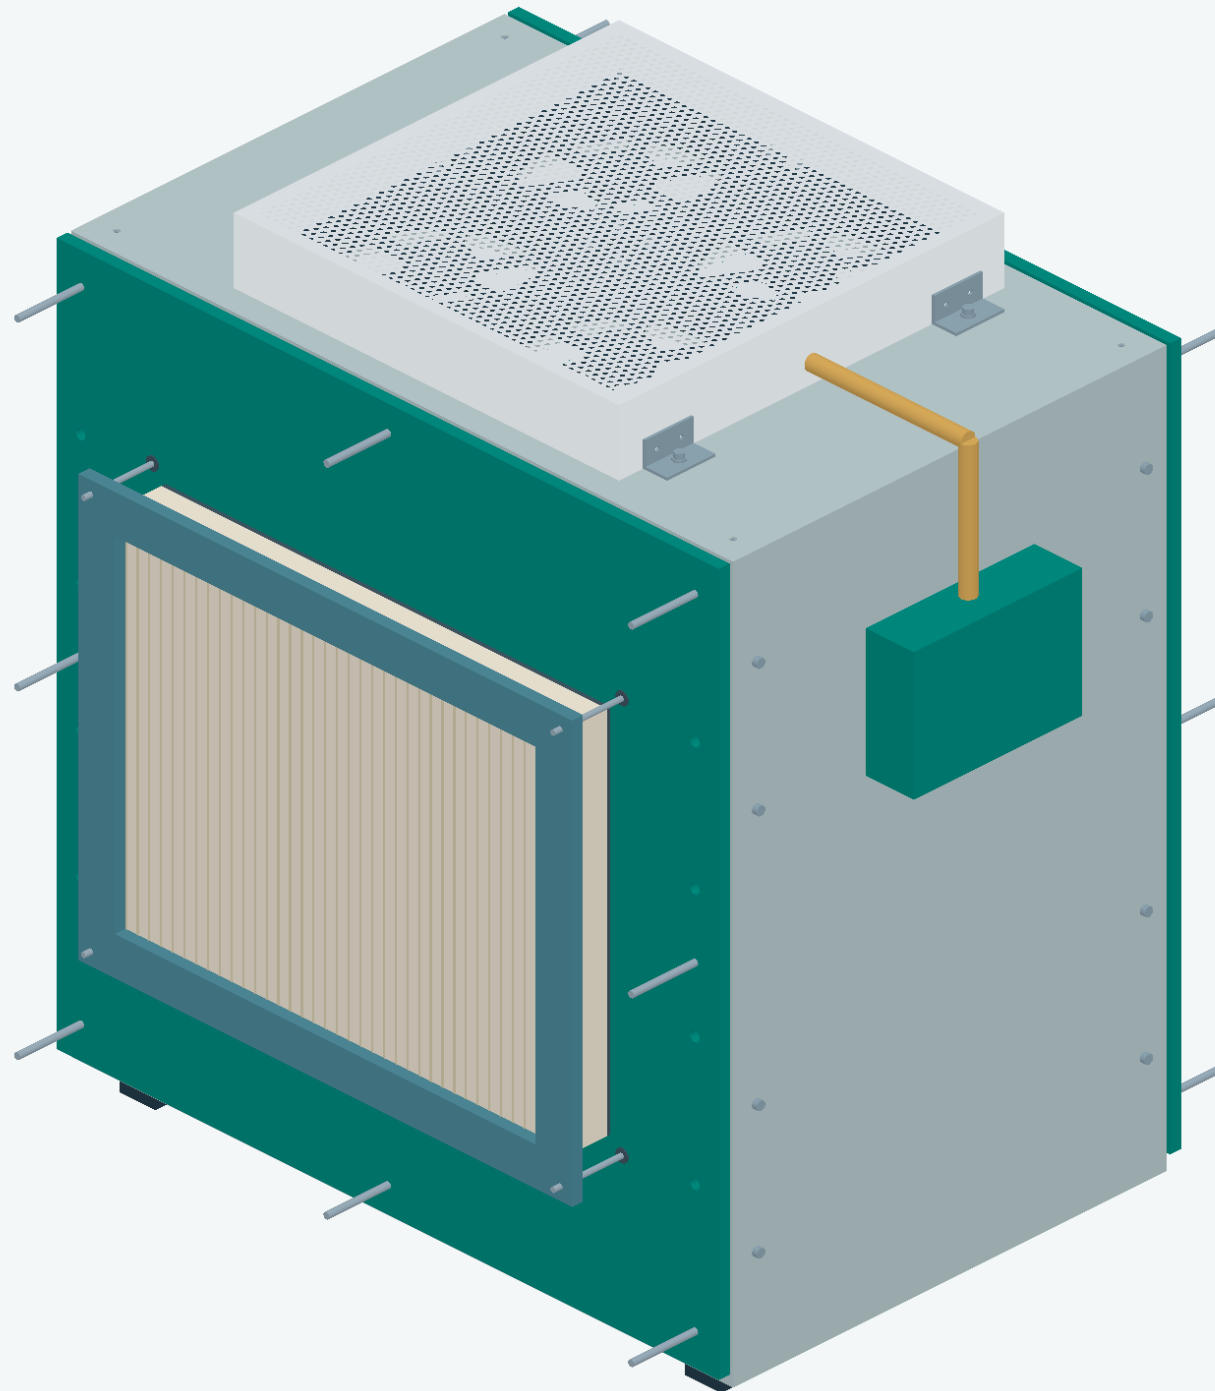

What changed

Two reducing plates adapt the same R01 cabinet to the published 370 x 290 x 40 mm STARKVIND envelope. Existing cabinet, fans, guards and outer seals are retained.

Sealing route

Cabinet -> original 495.3/475.3 mm gasket -> reducing plate -> assumed 370/350 by 290/270 mm gasket -> filter. Seal all new mounting feedthroughs; no unsealed screw holes into the plenum.

Positive support

Two proposed bent ledges per filter carry weight separately from clamping friction. Four M4 studs retain each removable frame. Final heads/nuts, bracket bends and strength remain unselected.

Digital checks

169 valid objects; 5310 new-part pair checks without positive-volume clashes. Native reopen and STEP volume checks pass. Original R01 hash unchanged.


Do not transfer old airflow

Smaller openings and a different filter invalidate earlier flow estimates. Pressure curve, bypass, installed flow and particle removal remain unmeasured. OEM permits intended use only in STARKVIND appliances; this custom use is experimental.

Reducer and retainer / proposed panel geometry

A01_REDUCER / quantity2 / thickness9 mm

Outside 550 x550 mm; opening350 x270 mm

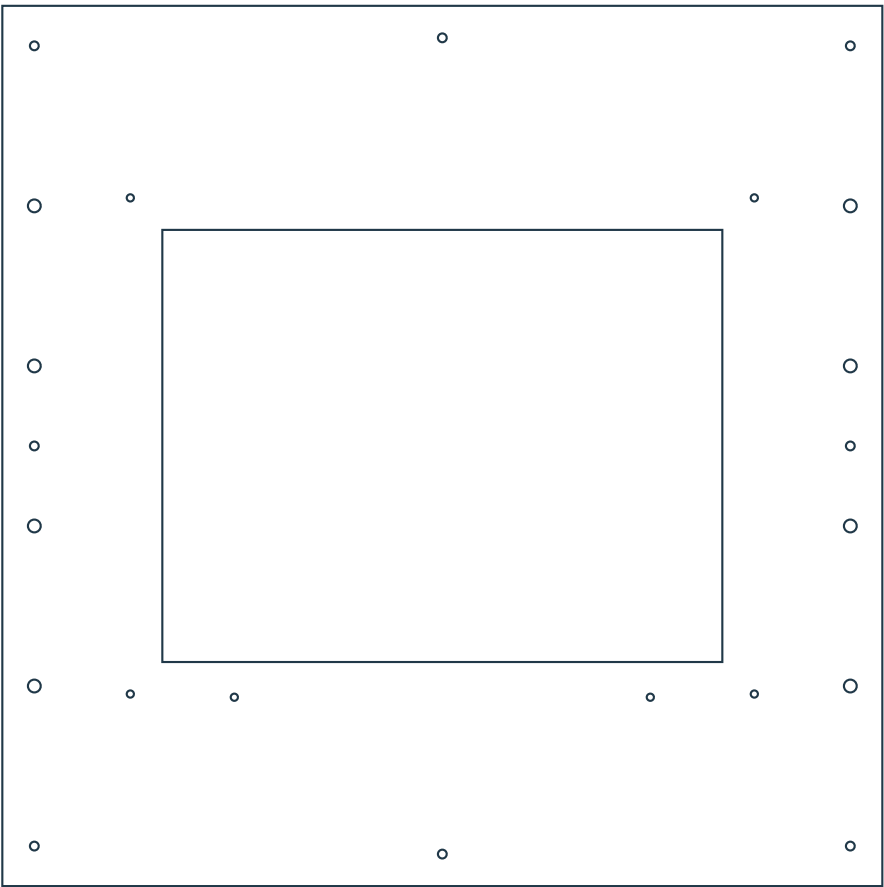

Datum: lower-left outside face. All coordinates in mm.

Opening lower-left: [100, 140]

Dia5.5: (20,25), (20,275), (20,525), (530,25), (530,275), (530,525), (275,20), (275,530)

Dia4.5: (80,120), (80,430), (470,120), (470,430), (145,118), (405,118)

Dia8: (20,125), (20,225), (20,325), (20,425), (530,125), (530,225), (530,325), (530,425)

Rear module mirrored physically. DXFs supplied for geometry review only. Hole sizes are proposals, not selected fastener tolerances.

A04_RETAINER / quantity2 / thickness9 mm

Outside 410 x330 mm; opening350 x270 mm



Datum: lower-left outside face. All coordinates in mm.

Opening lower-left: [30, 30]

Dia4.5: (10,10), (10,320), (400,10), (400,320)

Rear module mirrored physically. DXFs supplied for geometry review only. Hole sizes are proposals, not selected fastener tolerances.

Front section (global y, mm): cabinet0; old gasket -3..0; reducer -12..-3; new gasket -15..-12; filter -55..-15; retainer -64..-55. Rear is mirrored about y180. New gasket border and frame contact remain assumptions.