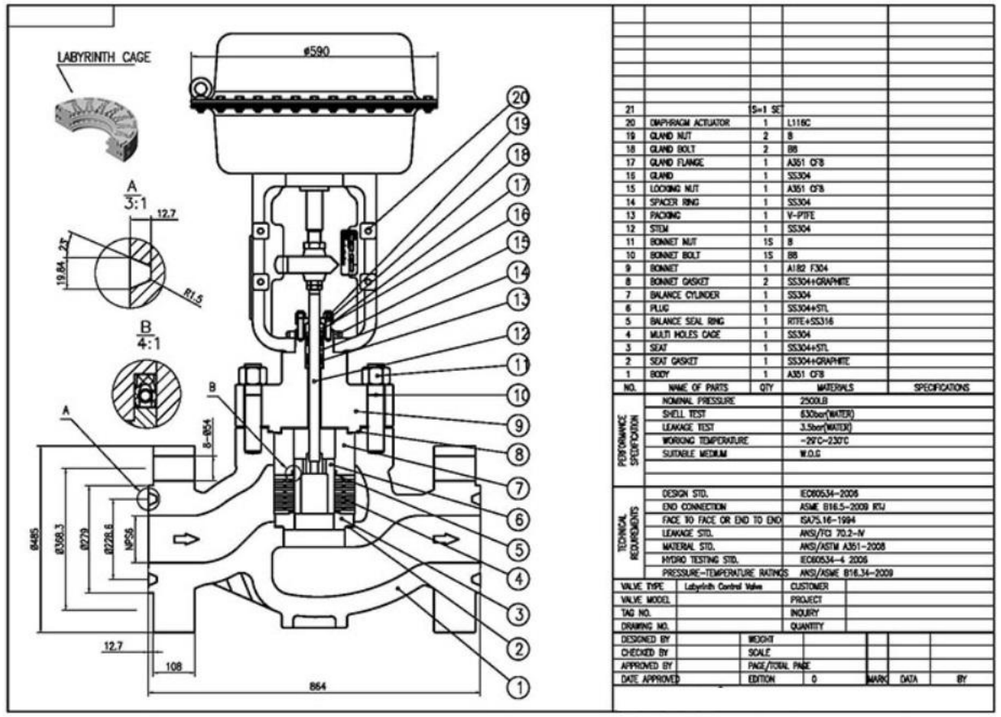


NO.	NAME OF PARTS	QTY	MATERIALS	SPECIFICATIONS
21		5+1 SET		
20	DIAPHRAGM ACTUATOR	1	L116C	
19	GLAND NUT	2	B	
18	GLAND BOLT	2	B8	
17	GLAND FLANGE	1	A351 CF8	
16	GLAND	1	SS304	
15	LOCKING NUT	1	A351 CF8	
14	SPACER RING	1	SS304	
13	PACKING	1	V-PTFE	
12	STEM	1	SS304	
11	BONNET NUT	16	B	
10	BONNET BOLT	16	B8	
9	BONNET	1	A182 F304	
8	BONNET GASKET	2	SS304+GRAPHITE	
7	BALANCE CYLINDER	1	SS304	
6	PLUG	1	SS304+STL	
5	BALANCE SEAL RING	1	RTFE+SS316	
4	MULTI HOLES CAGE	1	SS304	
3	SEAT	1	SS304+STL	
2	SEAT GASKET	1	SS304+GRAPHITE	
1	BODY	1	A351 CF8	

PERFORMANCE SPECIFICATION	NOMINAL PRESSURE	2500LB
	SHELL TEST	630bar(WATER)
	LEAKAGE TEST	3.5bar(WATER)
	WORKING TEMPERATURE	-29°C~230°C
	SUITABLE MEDIUM	W.O.G
TECHNICAL REQUIREMENTS	DESIGN STD.	IEC60534-2006
	END CONNECTION	ASME B16.5~2009 RTJ
	FACE TO FACE OR END TO END	ISA75.16-1994
	LEAKAGE STD.	ANSI/FCI 70.2-IV
	MATERIAL STD.	ANSI/ASTM A351-2008
	HYDRO TESTING STD.	IEC60534-4 2006
	PRESSURE-TEMPERATURE RATINGS	ANSI/ASME B16.34-2009

VALVE TYPE	Labyrinth Control Valve	CUSTOMER	
VALVE MODEL		PROJECT	
TAG NO.		INQUIRY	
DRAWING NO.		QUANTITY	
DESIGNED BY		WEIGHT	
CHECKED BY		SCALE	
APPROVED BY		PAGE/TOTAL PAGE	
DATE APPROVED		EDITION 0	MARK DATA BY

JOINT VALVE ROUTINE & SHUTDOWN MAINTENANCE FRAGNET

OPENING


- **Preparation**
  - **LOTO**
    - Depressurize
    - Isolate
  - **Inspect as found**
    - TAG
    - Inspect Body
    - Ispect Bonnet
  - **Functional Check**
    - Manual Operation
    - Check for Open/Close
- **Removal & Dissassemble**
  - **Drop the Valve**
    - Scaffold
    - Drop
    - Move to shop

REFURBISHMENT


- **Shop Activities**
  - **Dismantle Valve**
  - **Clean**
    - Remove Dirt
    - Remove Scale
    - Remove product
  - **Lubricate as recommended**
    - Lubricate stem
    - Lubricate gearboxes
    - Lubticator actuator links
  - **Seal & packing**
    - Replace valve gaskets
    - Replace valve packing
    - Replace O-rings
    - Replace seals
  - **Machining if needed**
    - Machine worn out parts
    - Machine gasket seats
    - Machine stem to free
  - **Reassemble**
    - Boxup Valve
    - Connect Body to Bonnet
    - Boltup end connections
  - **Valve testing**
    - Leak Test
    - Pressure test in shop
  - **Painting**
  - **Final Visual Inspection**

REFIXING

- **Valve return & refix**
  - **Rig Back**
    - Fix in location
    - Check direction and angle
  - **Bolting**
    - Clean mating flange surfaces
    - Replace gaskets
    - Boxup in location
    - Torque to appropriate value
  - **Reinsulate for HOT & Cold Services**
  - **Deblind**
  - **Descaffold**

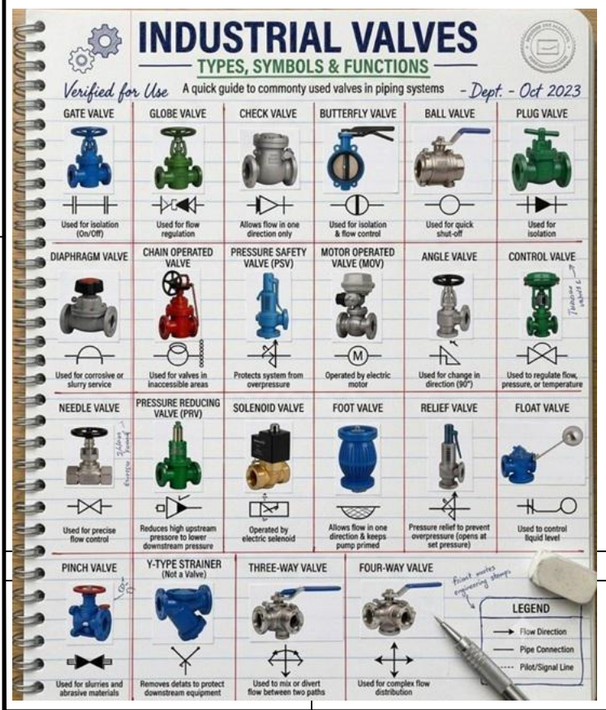

T17QECV0689: Overhaul XV 4"X150 CAT-A(43-30793)		999	13-Jan-17 14:00	24-Feb-17 05:00
Pre Shutdown		2	13-Jan-17 14:00	13-Jan-17 16:00
EQCT-1010	Erect Scaffolding	2	13-Jan-17 14:00	13-Jan-17 16:00
Shutdown		269	06-Feb-17 14:00	17-Feb-17 19:00
EQCT-1020	Verify LT&T and Obtain PTW	2	06-Feb-17 14:00	06-Feb-17 16:00
EQCT-1030	Disconnect Air & 24V Connections	2	06-Feb-17 16:00	06-Feb-17 18:00
EQCT-1035	Remove CV & Install End Blinds/Covers	6	06-Feb-17 18:00	07-Feb-17 00:00
EQCT-1040	Shift CV From Site to Workshop	1	07-Feb-17 00:00	07-Feb-17 01:00
EQCT-1045	Overhaul/Service Valve & Actuator	18	07-Feb-17 01:00	07-Feb-17 19:00
EQCT-1050	Test CV as per Datasheet	2	07-Feb-17 19:00	07-Feb-17 21:00
EQCT-1055	Shift CV From Workshop to Site	1	07-Feb-17 21:00	07-Feb-17 22:00
EQCT-1060	Remove End Blinds/Covers & install CV	6	17-Feb-17 09:00	17-Feb-17 15:00
EQCT-1065	Re-Connect Air & 24V Connections	2	17-Feb-17 15:00	17-Feb-17 17:00
EQCT-1070	Loop Check & Stroke test	1	17-Feb-17 17:00	17-Feb-17 18:00
EQCT-1080	Housekeeping & Close PTW	1	17-Feb-17 18:00	17-Feb-17 19:00
EQCT-1085	Mechanical Completion	0		17-Feb-17 19:00

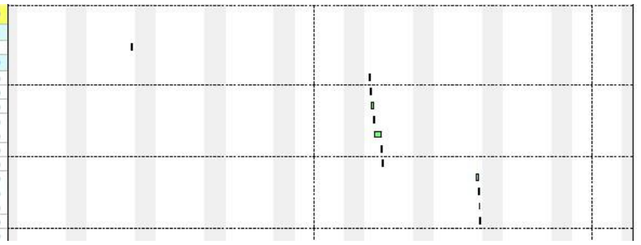

Drw Purpose Code :- R01- Educational

Status of Approval :- 01

Dimentions as Mentioned: NA

Drawing Scale :- NTS

Engg Code :- 99

Backup Info Code :- 04

Angle of Projection: NA

Sheet Size: A3

Statutory Note:
This document is prepared by rPlan and is the sole proprietory of the company.Its purpose is educational and no references within this document are for Engineering or Design corelation with the applicable codes. For any clarifications beyond the intended purpose viewers can always correspond to rPlan via its company website.This drw is not for duplication without company permission!

Drw electronic code

rPlan AT 39, MERMAID 1 CHS LTD., SEC-11, CBD-BELAPUR, NAVI MUMBAI - 400614

Legal Owner

QR CODE: NA

Description: COTROL VALVES - FRAGNET

Drawn By: DFT-01

Drawn Date: 20260804

Checked Approved by: rPlan-01

Checked Approved Date: 20260814

Drawing Number: As Barcoaded

Sheet: 1 of 1

Rev: 00