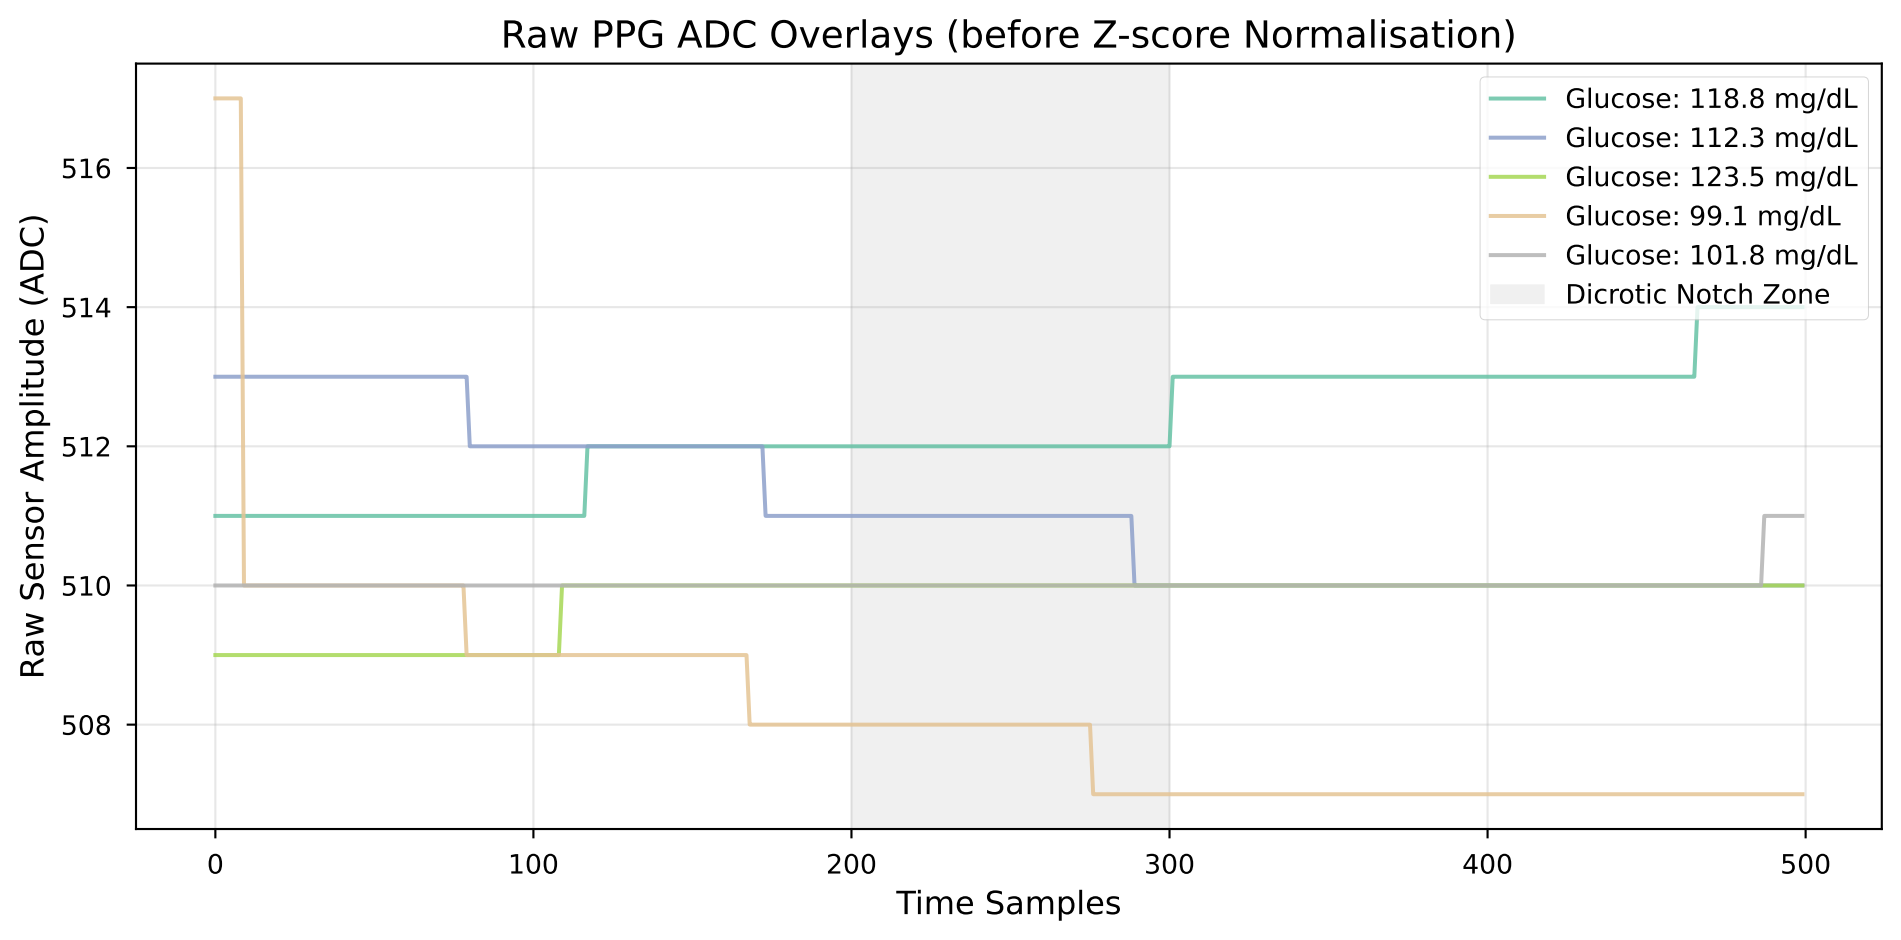
Raw PPG ADC Overlays (before Z-score Normalisation)
Glucose: 118.8 mg/dL
Glucose: 112.3 mg/dL
Glucose: 123.5 mg/dL
Glucose: 99.1 mg/dL
Glucose: 101.8 mg/dL
Dicrotic Notch Zone
Raw Sensor Amplitude (ADC)
516
514
512
510
508
0
100
200
300
400
500
Time Samples