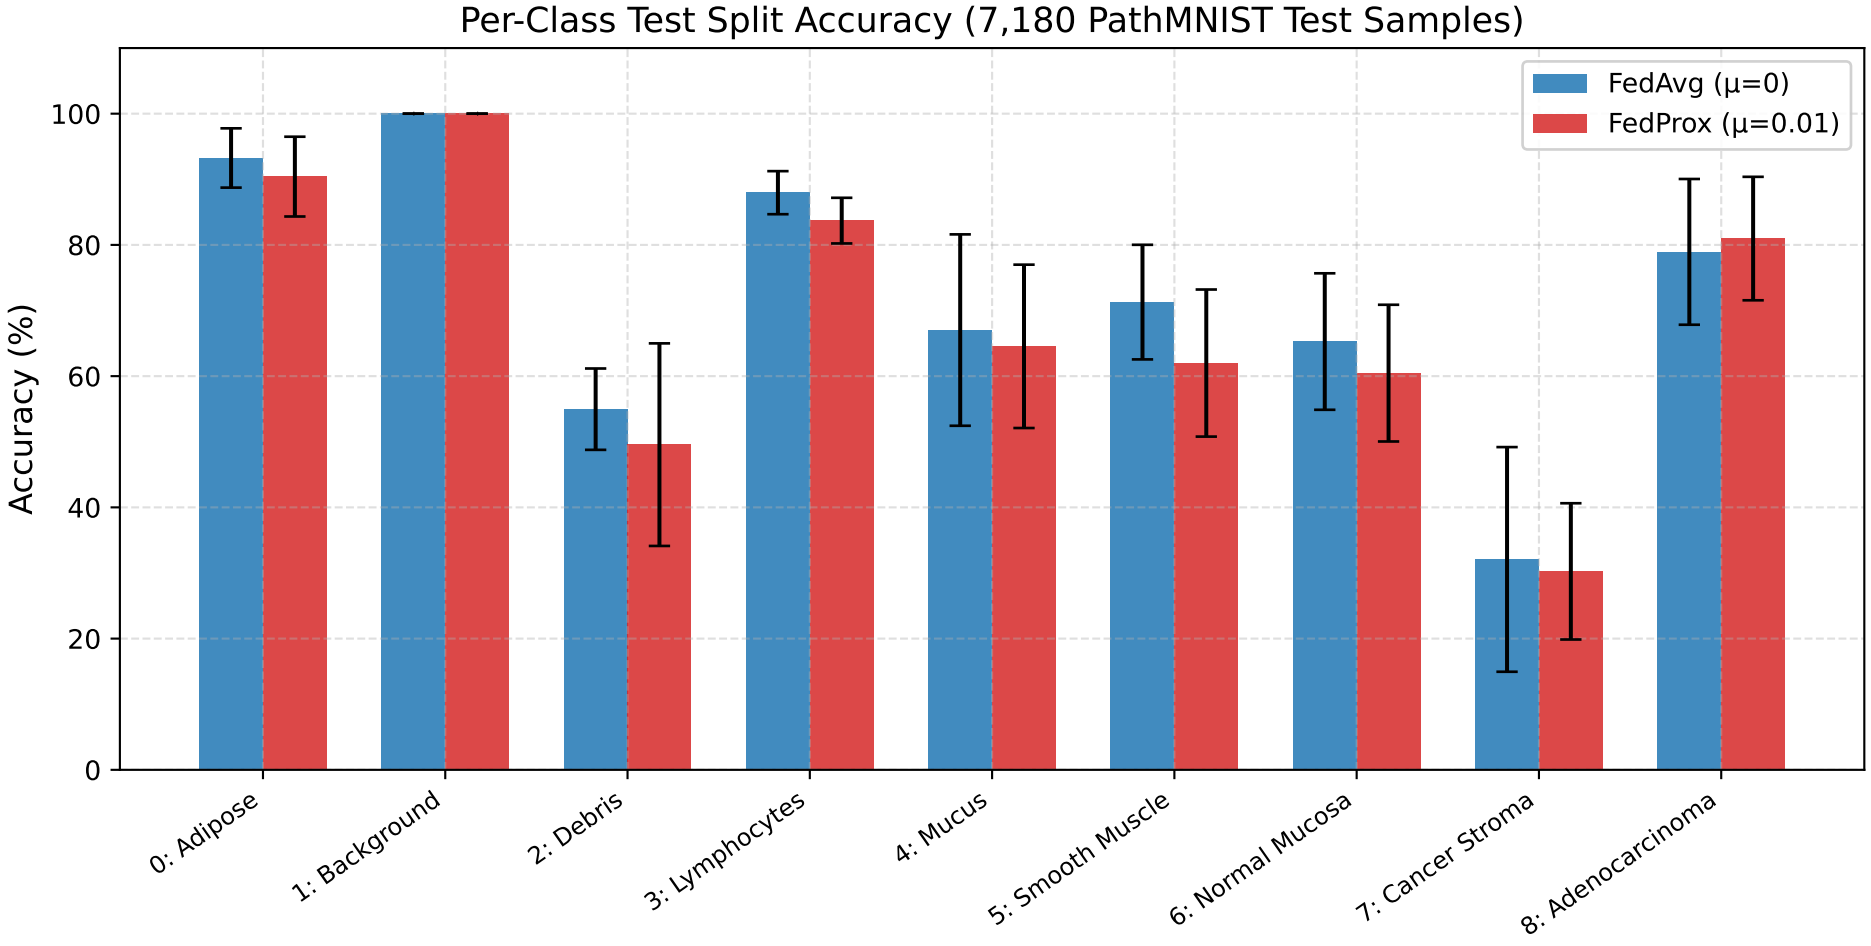
Per-Class Test Split Accuracy (7,180 PathMNIST Test Samples)
FedAvg (μ=0)
FedProx (μ=0.01)
Accuracy (%)
0
20
40
60
80
100
0: Adipose
1: Background
2: Debris
3: Lymphocytes
4: Mucus
5: Smooth Muscle
6: Normal Mucosa
7: Cancer Stroma
8: Adenocarcinoma