

STAGE 5h | VSG CONTROL + SWITCHING MOSFET INVERTER
40 V DC / 50 Hz / Ts = 100 us / 10 kHz PWM


01 ACTIVE POWER / FREQUENCY / VIRTUAL ROTOR

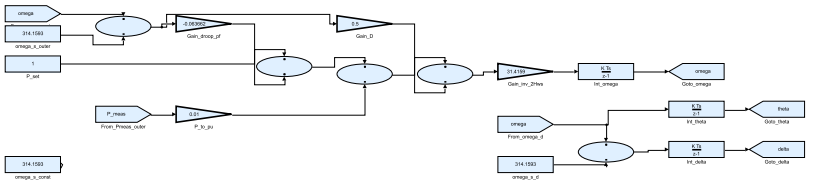


02 REACTIVE POWER / VOLTAGE DROOP




LIVE SIGNALS | Double-click a Scope, then Run
PWM channel order: AH, AL, BH, BL, CH, CL

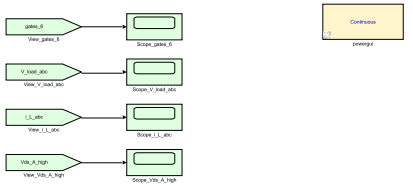


03 VOLTAGE CONTROL | d / q

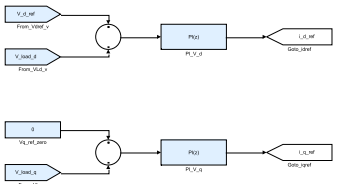


04 CURRENT CONTROL + DECOUPLING

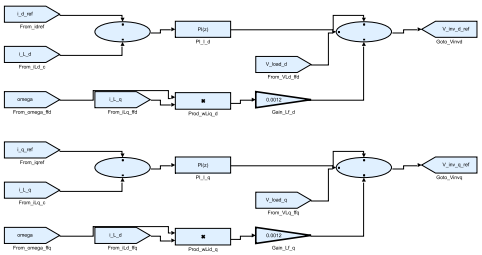


05 INVERSE PARK + ONE-TICK DELAY

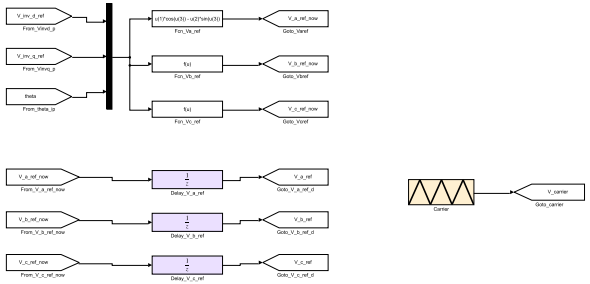


06 ELECTRICAL PLANT | Double-click to inspect MOSFETs

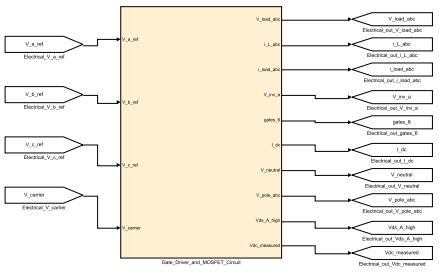


07 VOLTAGE / CURRENT MEASUREMENT | abc -> dq

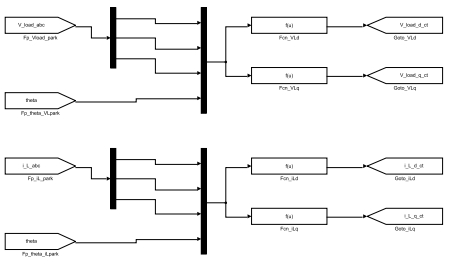


08 MEASURED ACTIVE / REACTIVE POWER

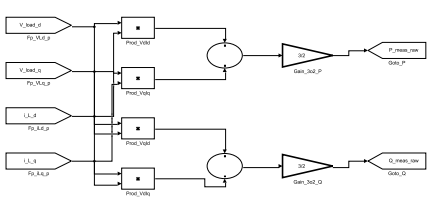

09 SAMPLED FEEDBACK + 5 Hz POWER FILTERS

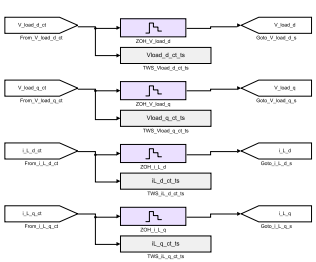



10 SAVED DATA | Workspace timeseries (separate from live Scopes)

