


Internship Program Report

By

BOLLEPOGU NARENDRA-19485A0248

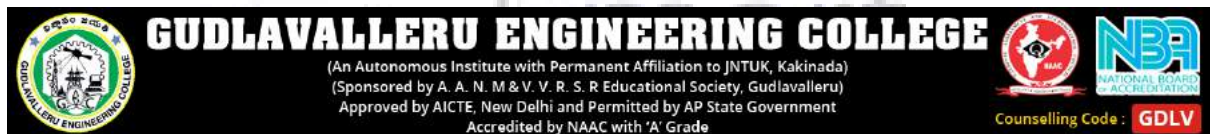

In association with



Contents

Introduction	3
Program organiser.....	3
Courtesy	3
Program details	3
Internship program	3
3 rd May2021: Introduction to EPC Industry	4
4 th May2021: Engineering documentation for EPC projects.....	5
5 th May2021: Engineering documentation for commands and formulae	6
7 th May2021: Engineering documentation for Electrical system design	7
10 th May2021: Engineering documentation for Typical diagrams.....	8
11 th May2021: Classification of Transformers and Generators	9
12 th May2021: Classification of Switchgare construction and power factor improvement	10
17 th May2021: Detailing about UPS system and Busducts.	11
18 th May2021: Detailing about Motor Starters and Sizing of motors.....	12
19 th May2021: Discribing about Earthing system and Lighting Protection.....	13
20 th May2021: Lighting or illumination systems and calculations.	14
21 th May2021: Lighting or illumination systems using DIALUX software	15
24 th May2021: Cabling and their calculations and types.....	16
25 th May2021: Cabling calculations and Cable gland selection	17
28 th May2021: Load calculations and Transformer sizing calculations	18
29th May2021: DG set calculations.	19
2nd june2021: Caluculations of Earthing and Lighting protection.....	20
5 th june 2021: Cable sizing and cable tray sizing calculations.....	21
Conclusion	22
Feedback:	22

Introduction

Internship program arranged by GUDLAVALLERU ENGINEERING COLLEGE in association with Smart Internz, Hyderabad for the benefit of 3rd year EEE batch 2018-2022 on Electrical Detailed design Engineering for Oil& Gas, Power and Utility industrial sectors.

Program organiser

Smart Bridge, Hyderabad.

Pioneer in organising Internships, knowledge workshops, debates, hackathons, Technical



sessions and Industrial Automation projects.

Courtesy

Dr. Sri B. Dasu – HOD – EEE, GEC

Mr. G. Srinivasa Rao – Internship coordinator

Mr. Ramesh V - Mentor

Mr. Vinay Kumar - System Support

Mr. Harikanth – Software/Technical Support

Program details

Smart Internz program schedule: 4 weeks starting from 3rd May 2021

Daily schedule time shall be 4PM to 6.30PM

Mode of Classes: On line through ZOOM


Presenter: Mr Ramesh V

Internship program

We have been given the opportunity to learn and interact with industry experienced engineering specialist to learn the Electrical detailed design engineering for various industrial sectors.

3rd May2021: Introduction to EPC Industry

1	EPC Industry & Electrical Detailed Engineering	EPC Industry	Introduction
		Engineering	Types of Engineering
		Procurement	Engineering role in procurement
		Construction	Engineering role during construction

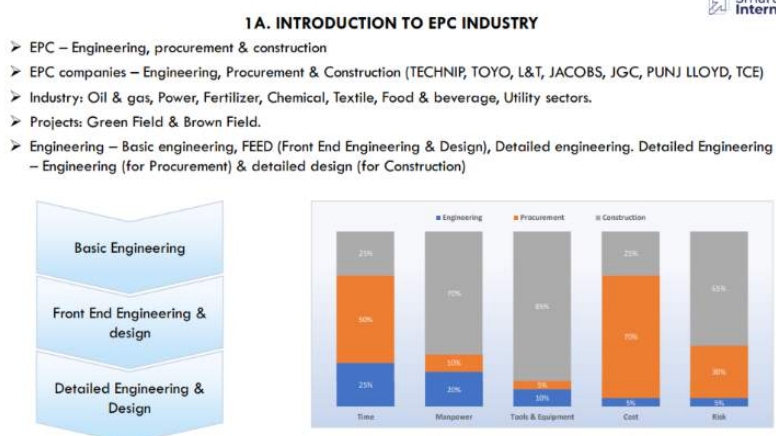


Topic details:

Engineering phases, Engineering deliverables (drawings & documents) list, Design Engineer role at various phases of project.

4th May2021: Engineering documentation for EPC projects

2	Electrical Design Documentation	Engineering Deliverables list	Sequence of deliverables
		Detailed Engineering work flow	Detailed engineering process
		Document transmission	Document submission and info exchange
		Deliverables types	Different types of deliverables

3. ELECTRICAL DESIGN & DETAILED ENGINEERING - PROCESS

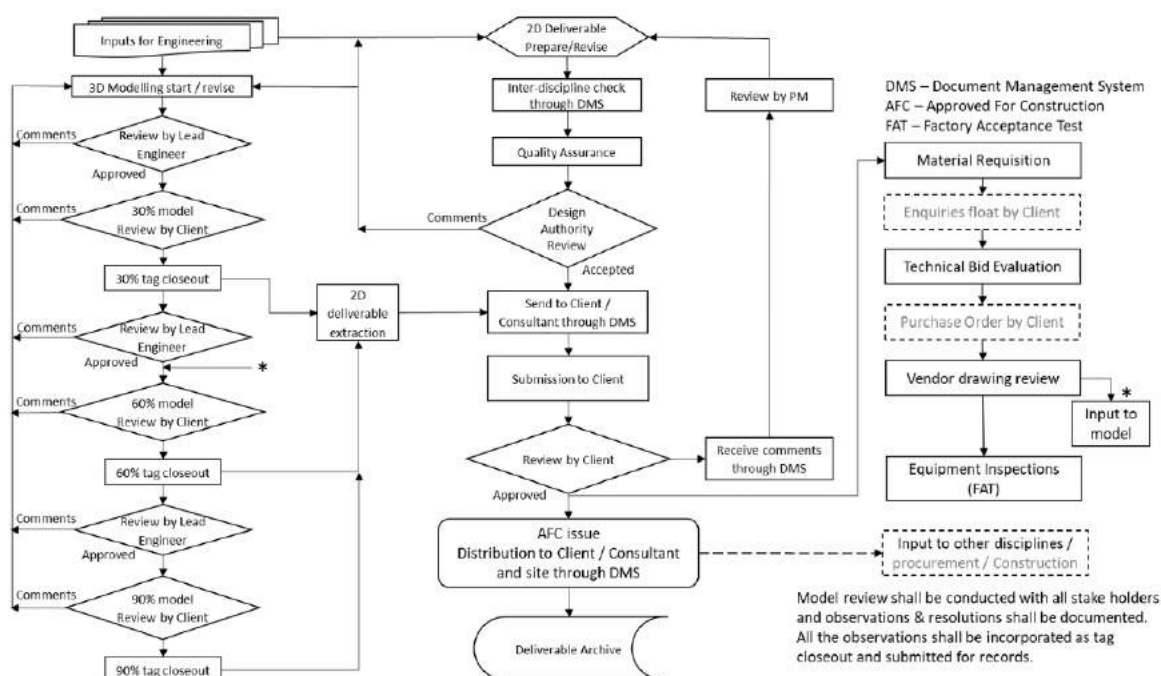

Topic details:

Engineering deliverables list, detailed engineering flow, engineering support flow, engineering support to procurements.

5 th May2021: Engineering documentation for commands and formulae

3	Document & Drawing tools	MS Word	Report / Calculations formats
		MS Excel	Basic excel commands
		Autocad	Basic line diagrams and layout commends

3C. AUTOCAD BASIC COMMANDS



A AUTOCAD BASIC KEYS							
STANDARD		DRAW		MODIFY		FORMAT	
NEW	Ctrl+N	LINE	L	ERASE	E	PROPERTIES	MO
OPEN	Ctrl+O	RAY	RAY	COPY	CO	SELECT COLOR	COL
SAVE	Ctrl+S	PLINE	PL	MIRROR	MI	LAYER	LA
PLOT	Ctrl+P	3DPOLY	3P	OFFSET	O	LINETYPE	LT
PLOT PREVIEW	PRE	POLIGONE	POL	ARRAY	AR	LINEWEIGHTS	LW
CUT	Ctrl+X	RECTANGLE	REC	MOVE	M	LT SCALE	LTS
COPY	Ctrl+C	ARC	A	ROTATE	RO	LIST	LI
PASTE	Ctrl+V	CIRCLE	C	SCALE	SC	DIMEN. STYLE	D
MATCH PROPE.	MA	SPLINE	SPL	STRECH	S	RENAME	REN
CLOSE	Ctrl+F4	ELLIPSE	EL	TRIM	TR	OPTION	OP
EXIT	Ctrl+Q	BLOCK	B	EXTENED	EX		
		POINT	PO	BRAKE	BR		
		HATCH	H	CHAMFER	CHA		
		GRADIENT	GD	FILLET	F		
		REGION	REG	EXPLODE	X		
		BOUNDARY	BO				
		DONUT	DO				

EXTRA				DRAFTING		PAPER SIZE
UNIT	UN	UCS	UCS	ORTHO	F8, Ctrl+L	A4=210*297
LIMITS	LIMITS	SINGLE TEXT	DT	OSNAP	F3, Ctrl+F	A3=297*420
(0,0;1000,1000)		MULTILINE TEXT	MT	POLAR	F10, Ctrl+U	A2=420*594
ZOOM	Z	EDIT TEXT	ED	GRID	F7, Ctrl+G	A1=594*841
ALL	A	OBJECT SNAP	OB	OTRACK	F11	A0=841*1189
PAN	P	DIMENTION	DIM	SNAP	F9	
CLEAN SCREEN	Ctrl+Q	HORIZONTAL	HOR			
COMMAND WIN	Ctrl+9	VERTICAL	VER			

Topic details:

Here we need to learn the basis of the autocadbasic keys like standard, modify,draw,format,papersize etc..


7 th May2021: Engineering documentation for Electrical system design

4	Electrical system design for a small small project	Overall plant description
		Sequence of approach
		Approach to detailed design

Topic details:



1C. DETAILED ENGINEERING

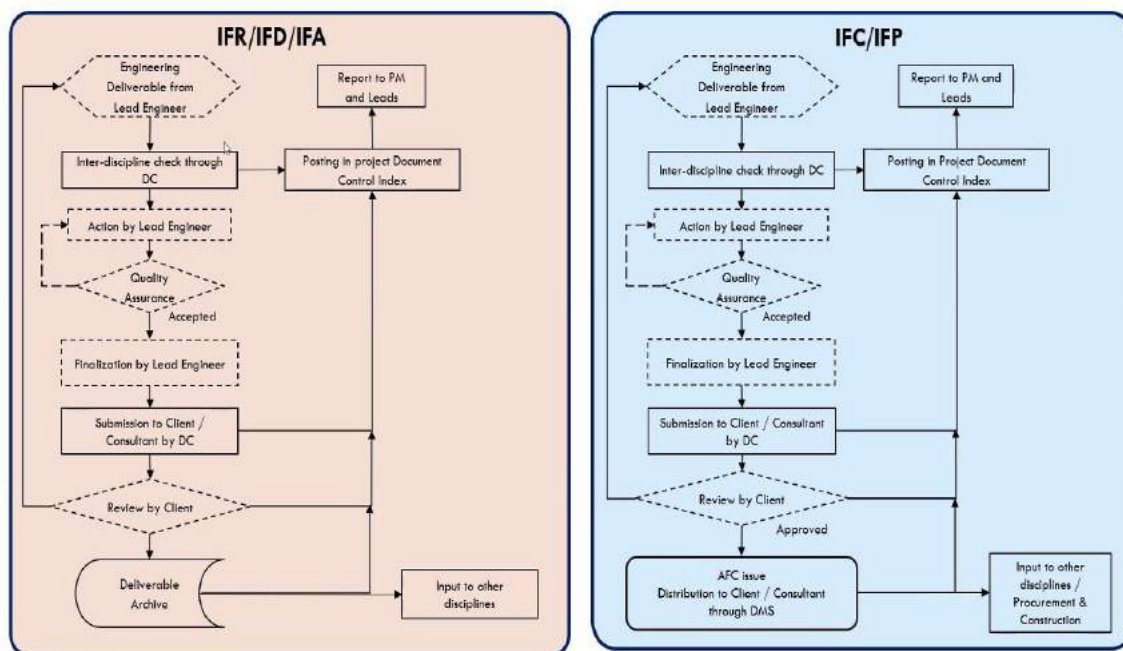

Here we observed that how to do a project and Sequence of approach, Approach to detail design and Overall plant distribution system.

10th May2021: Engineering documentation for Typical diagrams

5	Electrical system design for typical diagrams		
		Load lists shedule	Power flow diagram
		Single line diagram	Typical schematic diagram

Sl. No.	Equipment	Description	Qty	Unit	Manufacturer	Rated Voltage (V)	Rated Current (A)	Rated Power (kW)	Rated Power (kVA)	Rated Power (hp)	Notes	Remarks
1	PROCESS LOADS											
1.1	1.1.1	Process Load 1.1.1	1	Unit	1.1.1	1.1.1	1.1.1	1.1.1	1.1.1	1.1.1		
1.2	1.2.1	Process Load 1.2.1	1	Unit	1.2.1	1.2.1	1.2.1	1.2.1	1.2.1	1.2.1		
1.3	1.3.1	Process Load 1.3.1	1	Unit	1.3.1	1.3.1	1.3.1	1.3.1	1.3.1	1.3.1		
1.4	1.4.1	Process Load 1.4.1	1	Unit	1.4.1	1.4.1	1.4.1	1.4.1	1.4.1	1.4.1		
1.5	1.5.1	Process Load 1.5.1	1	Unit	1.5.1	1.5.1	1.5.1	1.5.1	1.5.1	1.5.1		
1.6	1.6.1	Process Load 1.6.1	1	Unit	1.6.1	1.6.1	1.6.1	1.6.1	1.6.1	1.6.1		
1.7	1.7.1	Process Load 1.7.1	1	Unit	1.7.1	1.7.1	1.7.1	1.7.1	1.7.1	1.7.1		
1.8	1.8.1	Process Load 1.8.1	1	Unit	1.8.1	1.8.1	1.8.1	1.8.1	1.8.1	1.8.1		
1.9	1.9.1	Process Load 1.9.1	1	Unit	1.9.1	1.9.1	1.9.1	1.9.1	1.9.1	1.9.1		
1.10	1.10.1	Process Load 1.10.1	1	Unit	1.10.1	1.10.1	1.10.1	1.10.1	1.10.1	1.10.1		
1.11	1.11.1	Process Load 1.11.1	1	Unit	1.11.1	1.11.1	1.11.1	1.11.1	1.11.1	1.11.1		
1.12	1.12.1	Process Load 1.12.1	1	Unit	1.12.1	1.12.1	1.12.1	1.12.1	1.12.1	1.12.1		
1.13	1.13.1	Process Load 1.13.1	1	Unit	1.13.1	1.13.1	1.13.1	1.13.1	1.13.1	1.13.1		
1.14	1.14.1	Process Load 1.14.1	1	Unit	1.14.1	1.14.1	1.14.1	1.14.1	1.14.1	1.14.1		
1.15	1.15.1	Process Load 1.15.1	1	Unit	1.15.1	1.15.1	1.15.1	1.15.1	1.15.1	1.15.1		
1.16	1.16.1	Process Load 1.16.1	1	Unit	1.16.1	1.16.1	1.16.1	1.16.1	1.16.1	1.16.1		
1.17	1.17.1	Process Load 1.17.1	1	Unit	1.17.1	1.17.1	1.17.1	1.17.1	1.17.1	1.17.1		
1.18	1.18.1	Process Load 1.18.1	1	Unit	1.18.1	1.18.1	1.18.1	1.18.1	1.18.1	1.18.1		
1.19	1.19.1	Process Load 1.19.1	1	Unit	1.19.1	1.19.1	1.19.1	1.19.1	1.19.1	1.19.1		
1.20	1.20.1	Process Load 1.20.1	1	Unit	1.20.1	1.20.1	1.20.1	1.20.1	1.20.1	1.20.1		
1.21	1.21.1	Process Load 1.21.1	1	Unit	1.21.1	1.21.1	1.21.1	1.21.1	1.21.1	1.21.1		
1.22	1.22.1	Process Load 1.22.1	1	Unit	1.22.1	1.22.1	1.22.1	1.22.1	1.22.1	1.22.1		
1.23	1.23.1	Process Load 1.23.1	1	Unit	1.23.1	1.23.1	1.23.1	1.23.1	1.23.1	1.23.1		
1.24	1.24.1	Process Load 1.24.1	1	Unit	1.24.1	1.24.1	1.24.1	1.24.1	1.24.1	1.24.1		
1.25	1.25.1	Process Load 1.25.1	1	Unit	1.25.1	1.25.1	1.25.1	1.25.1	1.25.1	1.25.1		
1.26	1.26.1	Process Load 1.26.1	1	Unit	1.26.1	1.26.1	1.26.1	1.26.1	1.26.1	1.26.1		
1.27	1.27.1	Process Load 1.27.1	1	Unit	1.27.1	1.27.1	1.27.1	1.27.1	1.27.1	1.27.1		
1.28	1.28.1	Process Load 1.28.1	1	Unit	1.28.1	1.28.1	1.28.1	1.28.1	1.28.1	1.28.1		
1.29	1.29.1	Process Load 1.29.1	1	Unit	1.29.1	1.29.1	1.29.1	1.29.1	1.29.1	1.29.1		
1.30	1.30.1	Process Load 1.30.1	1	Unit	1.30.1	1.30.1	1.30.1	1.30.1	1.30.1	1.30.1		
1.31	1.31.1	Process Load 1.31.1	1	Unit	1.31.1	1.31.1	1.31.1	1.31.1	1.31.1	1.31.1		
1.32	1.32.1	Process Load 1.32.1	1	Unit	1.32.1	1.32.1	1.32.1	1.32.1	1.32.1	1.32.1		
1.33	1.33.1	Process Load 1.33.1	1	Unit	1.33.1	1.33.1	1.33.1	1.33.1	1.33.1	1.33.1		
1.34	1.34.1	Process Load 1.34.1	1	Unit	1.34.1	1.34.1	1.34.1	1.34.1	1.34.1	1.34.1		
1.35	1.35.1	Process Load 1.35.1	1	Unit	1.35.1	1.35.1	1.35.1	1.35.1	1.35.1	1.35.1		
1.36	1.36.1	Process Load 1.36.1	1	Unit	1.36.1	1.36.1	1.36.1	1.36.1	1.36.1	1.36.1		
1.37	1.37.1	Process Load 1.37.1	1	Unit	1.37.1	1.37.1	1.37.1	1.37.1	1.37.1	1.37.1		
1.38	1.38.1	Process Load 1.38.1	1	Unit	1.38.1	1.38.1	1.38.1	1.38.1	1.38.1	1.38.1		
1.39	1.39.1	Process Load 1.39.1	1	Unit	1.39.1	1.39.1	1.39.1	1.39.1	1.39.1	1.39.1		
1.40	1.40.1	Process Load 1.40.1	1	Unit	1.40.1	1.40.1	1.40.1	1.40.1	1.40.1	1.40.1		
1.41	1.41.1	Process Load 1.41.1	1	Unit	1.41.1	1.41.1	1.41.1	1.41.1	1.41.1	1.41.1		
1.42	1.42.1	Process Load 1.42.1	1	Unit	1.42.1	1.42.1	1.42.1	1.42.1	1.42.1	1.42.1		
1.43	1.43.1	Process Load 1.43.1	1	Unit	1.43.1	1.43.1	1.43.1	1.43.1	1.43.1	1.43.1		
1.44	1.44.1	Process Load 1.44.1	1	Unit	1.44.1	1.44.1	1.44.1	1.44.1	1.44.1	1.44.1		
1.45	1.45.1	Process Load 1.45.1	1	Unit	1.45.1	1.45.1	1.45.1	1.45.1	1.45.1	1.45.1		
1.46	1.46.1	Process Load 1.46.1	1	Unit	1.46.1	1.46.1	1.46.1	1.46.1	1.46.1	1.46.1		
1.47	1.47.1	Process Load 1.47.1	1	Unit	1.47.1	1.47.1	1.47.1	1.47.1	1.47.1	1.47.1		
1.48	1.48.1	Process Load 1.48.1	1	Unit	1.48.1	1.48.1	1.48.1	1.48.1	1.48.1	1.48.1		
1.49	1.49.1	Process Load 1.49.1	1	Unit	1.49.1	1.49.1	1.49.1	1.49.1	1.49.1	1.49.1		
1.50	1.50.1	Process Load 1.50.1	1	Unit	1.50.1	1.50.1	1.50.1	1.50.1	1.50.1	1.50.1		
1.51	1.51.1	Process Load 1.51.1	1	Unit	1.51.1	1.51.1	1.51.1	1.51.1	1.51.1	1.51.1		
1.52	1.52.1	Process Load 1.52.1	1	Unit	1.52.1	1.52.1	1.52.1	1.52.1	1.52.1	1.52.1		
1.53	1.53.1	Process Load 1.53.1	1	Unit	1.53.1	1.53.1	1.53.1	1.53.1	1.53.1	1.53.1		
1.54	1.54.1	Process Load 1.54.1	1	Unit	1.54.1	1.54.1	1.54.1	1.54.1	1.54.1	1.54.1		
1.55	1.55.1	Process Load 1.55.1	1	Unit	1.55.1	1.55.1	1.55.1	1.55.1	1.55.1	1.55.1		
1.56	1.56.1	Process Load 1.56.1	1	Unit	1.56.1	1.56.1	1.56.1	1.56.1	1.56.1	1.56.1		
1.57	1.57.1	Process Load 1.57.1	1	Unit	1.57.1	1.57.1	1.57.1	1.57.1	1.57.1	1.57.1		
1.58	1.58.1	Process Load 1.58.1	1	Unit	1.58.1	1.58.1	1.58.1	1.58.1	1.58.1	1.58.1		
1.59	1.59.1	Process Load 1.59.1	1	Unit	1.59.1	1.59.1	1.59.1	1.59.1	1.59.1	1.59.1		
1.60	1.60.1	Process Load 1.60.1	1	Unit	1.60.1	1.60.1	1.60.1	1.60.1	1.60.1	1.60.1		
1.61	1.61.1	Process Load 1.61.1	1	Unit	1.61.1	1.61.1	1.61.1	1.61.1	1.61.1	1.61.1		
1.62	1.62.1	Process Load 1.62.1	1	Unit	1.62.1	1.62.1	1.62.1	1.62.1	1.62.1	1.62.1		
1.63	1.63.1	Process Load 1.63.1	1	Unit	1.63.1	1.63.1	1.63.1	1.63.1	1.63.1	1.63.1		
1.64	1.64.1	Process Load 1.64.1	1	Unit	1.64.1	1.64.1	1.64.1	1.64.1	1.64.1	1.64.1		
1.65	1.65.1	Process Load 1.65.1	1	Unit	1.65.1	1.65.1	1.65.1	1.65.1	1.65.1	1.65.1		
1.66	1.66.1	Process Load 1.66.1	1	Unit	1.66.1	1.66.1	1.66.1	1.66.1	1.66.1	1.66.1		
1.67	1.67.1	Process Load 1.67.1	1	Unit	1.67.1	1.67.1	1.67.1	1.67.1	1.67.1	1.67.1		
1.68	1.68.1	Process Load 1.68.1	1	Unit	1.68.1	1.68.1	1.68.1	1.68.1	1.68.1	1.68.1		
1.69	1.69.1	Process Load 1.69.1	1	Unit	1.69.1	1.69.1	1.69.1	1.69.1	1.69.1	1.69.1		
1.70	1.70.1	Process Load 1.70.1	1	Unit	1.70.1	1.70.1	1.70.1	1.70.1	1.70.1	1.70.1		
1.71	1.71.1	Process Load 1.71.1	1	Unit	1.71.1	1.71.1	1.71.1	1.71.1	1.71.1	1.71.1		
1.72	1.72.1	Process Load 1.72.1	1	Unit	1.72.1	1.72.1	1.72.1	1.72.1	1.72.1	1.72.1		
1.73	1.73.1	Process Load 1.73.1	1	Unit	1.73.1	1.73.1	1.73.1	1.73.1	1.73.1	1.73.1		
1.74	1.74.1	Process Load 1.74.1	1	Unit	1.74.1	1.74.1	1.74.1	1.74.1	1.74.1	1.74.1		
1.75	1.75.1	Process Load 1.75.1	1	Unit	1.75.1	1.75.1	1.75.1	1.75.1	1.75.1	1.75.1		
1.76	1.76.1	Process Load 1.76.1	1	Unit	1.76.1	1.76.1	1.76.1	1.76.1	1.76.1	1.76.1		
1.77	1.77.1	Process Load 1.77.1	1	Unit	1.77.1	1.77.1	1.77.1	1.77.1	1.77.1	1.77.1		
1.78	1.78.1	Process Load 1.78.1	1	Unit	1.78.1	1.78.1	1.78.1	1.78.1	1.78.1	1.78.1		
1.79	1.79.1	Process Load 1.79.1	1	Unit	1.79.1	1.79.1	1.79.1	1.79.1	1.79.1	1.79.1		
1.80	1.80.1	Process Load 1.80.1	1	Unit	1.80.1	1.80.1	1.80.1	1.80.1	1.80.1	1.80.1		
1.81	1.81.1	Process Load 1.81.1	1	Unit	1.81.1	1.81.1	1.81.1	1.81.1	1.81.1	1.81.1		
1.82	1.82.1	Process Load 1.82.1	1	Unit	1.82.1	1.82.1	1.82.1	1.82.1	1.82.1	1.82.1		
1.83	1.83.1	Process Load 1.83.1	1	Unit	1.83.1	1.83.1	1.83.1	1.83.1	1.83.1	1.83.1		
1.84	1.84.1	Process Load 1.84.1	1	Unit	1.84.1	1.84.1	1.84.1	1.84.1	1.84.1	1.84.1		
1.85	1.85.1	Process Load 1.85.1	1	Unit	1.85.1	1.85.1	1.85.1	1.85.1	1.85.1	1.85.1		
1.86	1.86.1	Process Load 1.86.1	1	Unit	1.86.1	1.86.1	1.86.1	1.86.1	1.86.1	1.86.1		
1.87	1.87.1	Process Load 1.87.1	1	Unit	1.87.1	1.87.1	1.87.1	1.87.1	1.87.1	1.87.1		
1.88	1.88.1	Process Load 1.88.1	1	Unit	1.88.1	1.88.1	1.88.1	1.88.1	1.88.1	1.88.1		
1.89	1.89.1	Process Load 1.89.1	1	Unit	1.89.1	1.89.1	1.89.1	1.89.1	1.89.1	1.89.1		
1.90	1.90.1	Process Load 1.90.1	1	Unit	1.90.1	1.90.1	1.90.1	1.90.1	1.90.1	1.90.1		
1.91	1.91.1	Process Load 1.91.1	1	Unit	1.91.1	1.91.1	1.91.1	1.91.1	1.91.1	1.91.1		
1.92	1.92.1	Process Load 1.92.1	1	Unit	1.92.1	1.92.1	1.92.1	1.92.1	1.92.1	1.92.1		
1.93	1.93.1	Process Load 1.93.1	1	Unit	1.93.1	1.93.1	1.93.1	1.93.1	1.93.1	1.93.1		
1.94	1.94.1	Process Load 1.94.1	1	Unit	1.94.1	1.94.1	1.94.1	1.94.1	1.94.1	1.94.1		
1.95	1.95.1	Process Load 1.95.1	1	Unit	1.95.1	1.95.1	1.95.1	1.95.1	1.95.1	1.95.1		
1.96	1.96.1	Process Load 1.96.1	1									

11th May2021: Classification of Transformers and Generators

6	Classification of Transformers and Generators	Different types of Transformers	Different types of Generators
---	---	---------------------------------	-------------------------------




Topic details:

Classification of Transformers and Generators

12th May2021: Classification of Switchgear construction and power factor improvement

7	Classification of Switchgear construction and power factor improvement	Different types of Switchgear assemblies	Power factor improvement
---	--	--	--------------------------

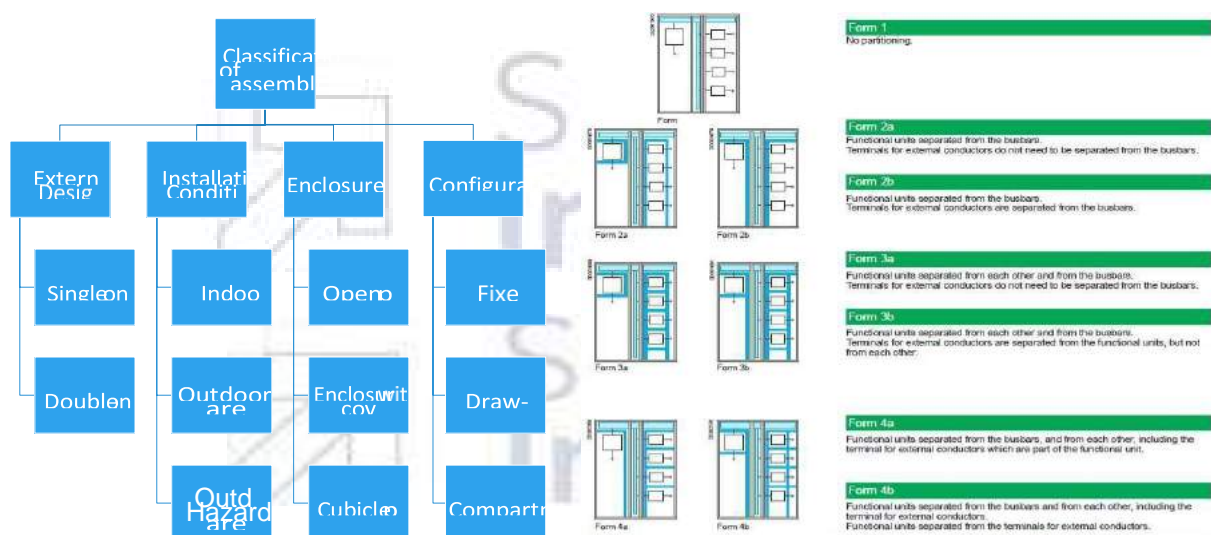


Topic details:


Classification of Switchgear construction and Power Factor Improvement

17th May2021: Detailing about UPS system and Busducts.

8	Detailing about UPS system and Busducts	Uninterruptible power supply system	Busduts of the system
---	---	-------------------------------------	-----------------------

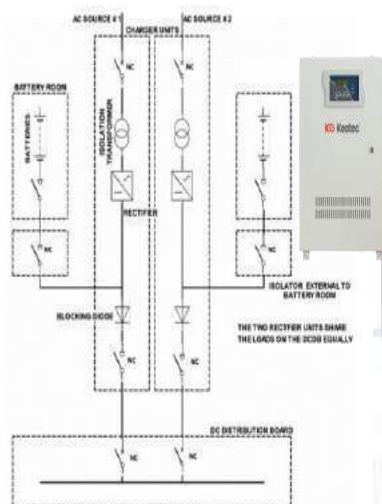

110V or 220V DC
UPS System

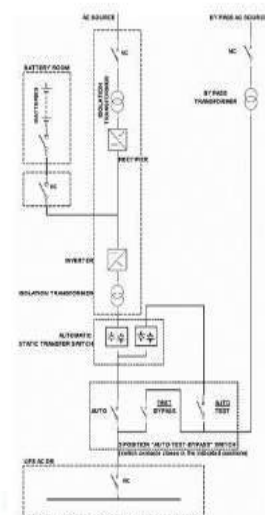


110V or 230V
AC UPS System

Topic details: Power distribution of UPS system and Busducts.

UPS systems are designed to provide continuous power to a load, even with an interruption or loss of utility supply power. UPS generally involves a balance of cost Vs need.

18th May2021: Detailing about Motor Starters and Sizing of motors.

9	Detailing about Motor Starters and Sizing of motors	Motor starters and drives	Sizing and selection of motors
---	---	---------------------------	--------------------------------

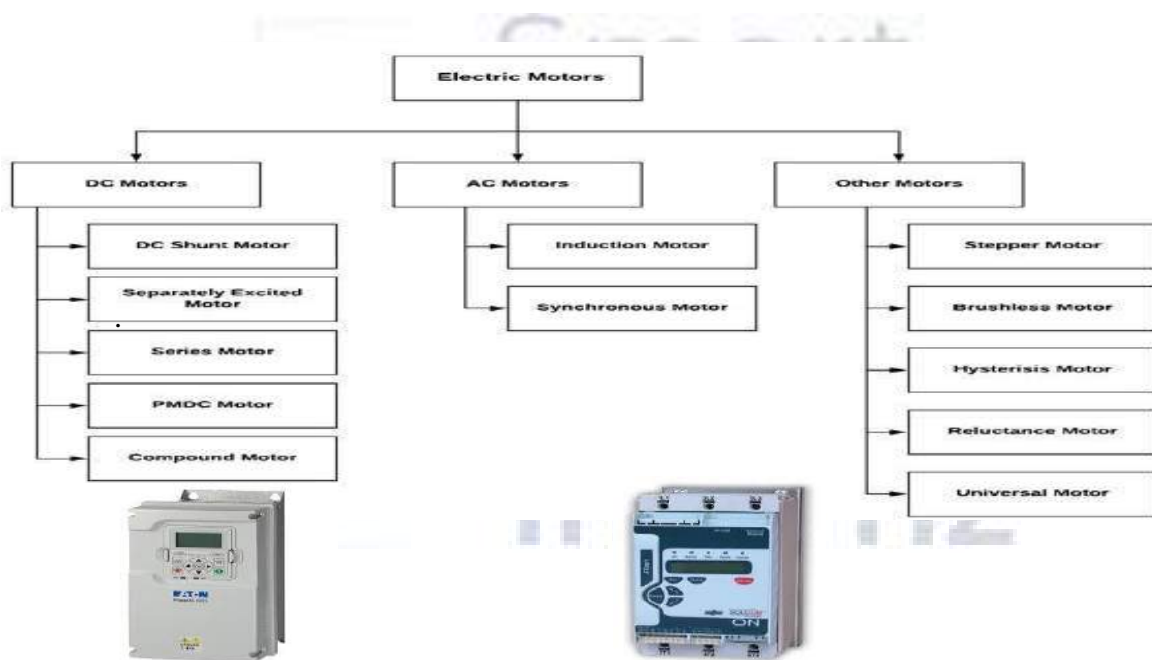

Topic details: Detailing about Motor Starter and Sizing of motors and their selection.


The principal function of a motor starter is to start and stop the respective motor connected with specially designed electromechanical switches which are similar in some ways to relays. The main difference between a relay and a starter is that a starter has overload protection for the motor that is missing in a relay.

Different types of motor starters are as follows:

- Direct-On-Line Starter
- Rotor Resistance Starter
- Stator Resistance Starter
- Auto Transformer Starter

19th May2021: Discribing about Earthing system and Lighting Protection.

10	Discribing about Earthing system and Lighting Protection.	Plant Earthing system	Lighting Protection materials
----	---	-----------------------	-------------------------------

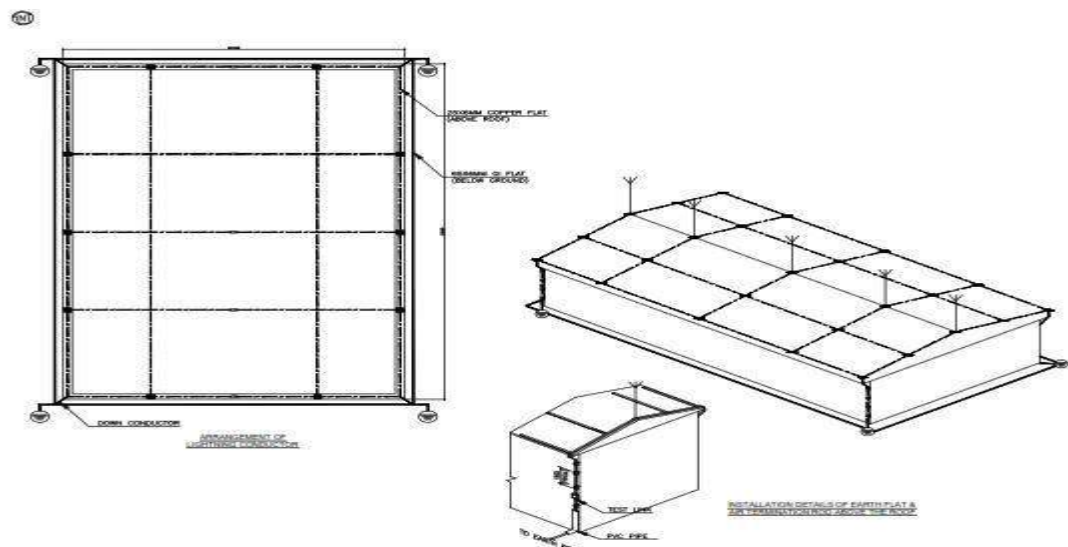

Topic details: Discribing about Earthing system and Lighting Protection.

Lightning protection required for high rise structures and important buildings against lightning currents during thunder storms. Primarily Lightning protection system calculations are done based on soil resistivity, conductor material, coverage structure / Building to determine whether lightning protection is required or not.

20th May2021: Lighting or illumination systems and calculations.

11	Lighting or Illumination systems and Calculations	Lighting or illumination systems	Lighting calculations
----	---	----------------------------------	-----------------------

Topic details: Lighting or Illumination systems and Calculations.

All outdoor lighting fittings shall be connected with armoured PVC cable of suitable no. of cores and size. Necessary type and no. of junction boxes shall be provided for branch connections. Indoor light fittings shall be connected with FRLS PVC wires laid in cable trunks or conduits.

Inputs required: Equipment and cable routing layouts, lighting calculations, Design basis for type of light fittings to be used, required lux levels

Lighting calculations software: Dialux, Chalmrite, Calculux, Relux, Luxicon,

CG Lux Applicable Standards: IS 6665: Code of practice for industrial



lighting, IS 3646: Code

of practice for interior illumination, IEC 60598: Luminaires, IEC 62493: Assessment of lighting equipment related to human exposure to electromagnetic field

Deliverables: Indoor Lighting layouts, socket outlet layouts, Street lighting and area lighting layouts. BOQ.


Types of light fittings: Industrial, flame proof type (EX d), increased safety type (Ex e).

21th May2021: Lighting or illumination systems using DIALUX software.

12	Lighting or Illumination using DIALUX software	Lighting or illumination systems	Operation of dialux software
----	--	----------------------------------	------------------------------

Topic details: Lighting or Illumination Calculations using DIALUX software.

Here we are using this Dialux evo 5.9.2 software windows to construct the power plant and we can perform the operation from this software.

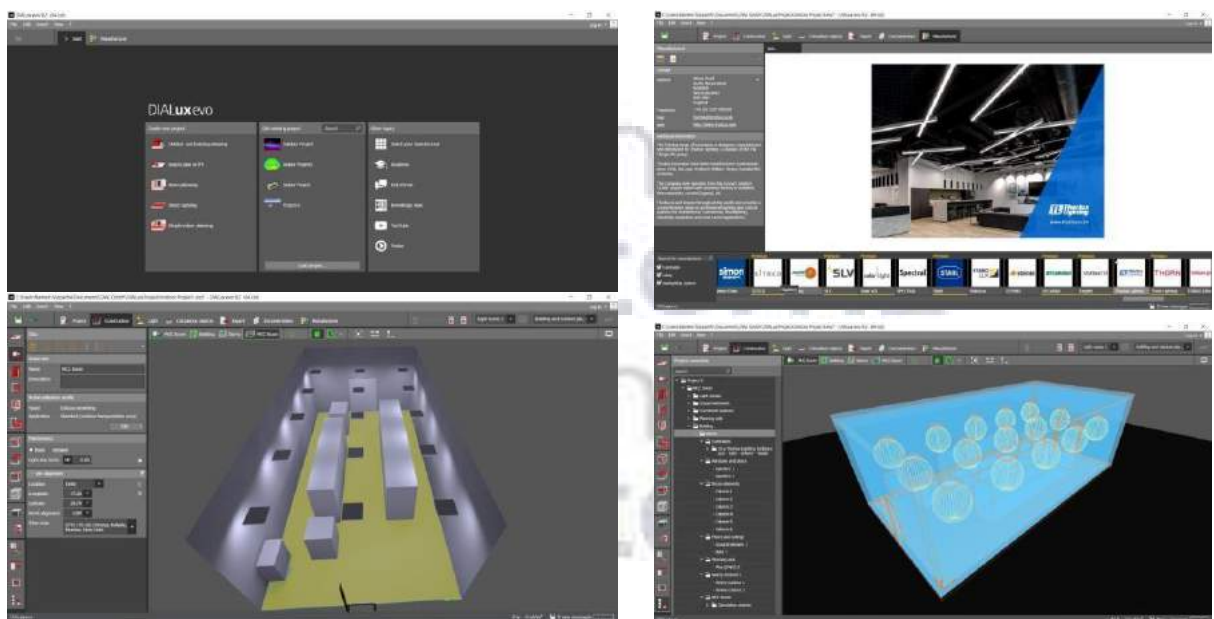

24th May2021: Cabling and their calculations and types.

13	Cabling and their types and claculations	Cabling calculations	Types of cabling materials
----	--	----------------------	----------------------------

Topic details: Cabling and their types and claculations .



Electrical cables must be properly supported to relieve mechanical stresses on the conductors, and protected from harsh conditions such as abrasion which might degrade the insulation.

Cables generally laid in the cable trays above ground, direct buried underground and in metallic or PVC conduits. Derating factors may be applicable for each type of cable laying conditions.

25th May2021: Cabling calculations and Cable gland selection.


14	Cabling calculations and cable gland selection	Cabling calculations	Cable gland selection
----	--	----------------------	-----------------------

Topic details: Cable sizing calculation and cable gland selection.

Inputs required: Load List, Design basis, Electrical equipment layout, cable schedule, vendor catalogues for cable tray.

Cable tray sizing shall be performed for each branch of cable tray routing up to the load point. Results shall be checked with specified limits mentioned in design basis.

Cable gland:

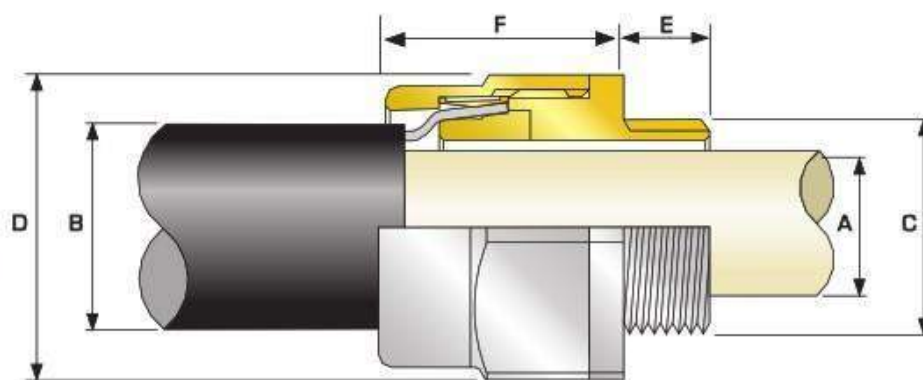

Cable Gland Selection Table

Refer to illustration at the top of the page.

Cable Gland Size	Available Entry Threads "C" (Alternate Metric Thread Lengths Available)		Cable Bedding Diameter "A"	Overall Cable Diameter "B"	Armour Range		Across Flats "D"	Across Corners "D"	Protrusion Length "F"
	Metric	Thread Length (Metric) "E"	Max	Max	Min	Max	Max	Max	
20S16	M20	10.0	8.7	13.2	0.8	1.25	24.0	26.4	35.2
20S	M20	10.0	11.7	15.9	0.8	1.25	24.0	26.4	32.2
20	M20	10.0	14.0	20.9	0.8	1.25	30.5	33.6	30.6
25	M25	10.0	20.0	26.2	1.25	1.6	36.0	39.6	36.4
32	M32	10.0	26.3	33.9	1.6	2.0	46.0	50.6	32.6
40	M40	15.0	32.2	40.4	1.6	2.0	55.0	60.5	36.6
50S	M50	15.0	38.2	46.7	2.0	2.5	60.0	66.0	39.6
50	M50	15.0	44.1	53.1	2.0	2.5	70.1	77.1	39.1
63S	M63	15.0	50.0	59.4	2.0	2.5	75.0	82.5	52.0
63	M63	15.0	56.0	65.9	2.0	2.5	80.0	88.0	49.8
75S	M75	15.0	62.0	72.1	2.0	2.5	90.0	99.0	63.7
75	M75	15.0	68.0	78.5	2.5	3.0	100.0	110.0	57.3
90	M90	24.0	80.0	90.4	3.15	4.0	114.3	125.7	66.6

28 th May2021: Load calculations and Transformer sizing calculations

15	Load calculations and TR calculations	Load calculations	TR calculations
----	---------------------------------------	-------------------	-----------------

Topic details:

List of electrical load calculations.

Assignment - 1

ELECTRICAL LOAD CALCULATIONS LV MCC

Sl. No	Equipment No.	Equipment Description	Breaker Rating	Breaker Type	Breaker No. of Poles	SLCB Rating	Absorbed Load		Motor / Load Rating	Load Factor (A) / (B)	Efficiency at Load Factor (C)	Power Factor at Load Factor (C)	Consumed Load				VVAR 7 kW x tan φ		Remarks
							(A) kW	(B) kW					Continuous		Intermittent		Standby		
			A			mva							kW	kVAR	kW	kVAR	kW	kVAR	
1	PU2315	Slack filter feed pump					88.18	98.30	0.95	0.93	0.80		84.82	95.16					
2	PU 2314 A	Assoil pump/Feed oil pump (10)					22.63	25.40	0.95	0.91	0.75		21.7	24.2					
3	PU 2314 B	Assoil pump/Feed oil pump (5)					22.63	25.40	0.73	0.81	0.75						24.3	19.4	
4	PU2308	Feed Pump (10separator)					86.89	97.9	0.95	0.93	0.80		82.9	93.9					
5	MX2308	MOVER (3)					86.78	96.30	1.00	0.93	0.80		86.8	97.4					
6	MX 2308	MOVER (2)					86.78	96.30	1.00	0.93	0.80								96.8 87.4
7	PU2313	Slack					98.63	110.9	0.95	0.91	0.75		94.3	106.0					
8	Revers valve	1x 23138 W					0.60	0.67	0.95	0.93	0.80								
9	PU2314	Slack separator (1)					3.74	4.21	0.95	0.93	0.80						4.4	4.1	
10	AD 2324A	Clutch and fan agitator (10)					8.60	9.60	0.95	0.93	0.80								
11	AD 2324B	Clutch and fan agitator (5)					8.60	9.60	0.73	0.81	0.75		7.88	7.16					
12	AD 2309	Clutch and motor, vessel agitator					0.60	0.67	0.95	0.93	0.80								7.8 7.2
13	AD 2309	Clutch and motor, vessel agitator					0.60	0.67	0.95	0.93	0.80		20.87	20.89					
14	AD 2319	Clutch and motor, vessel agitator					0.60	0.67	0.95	0.93	0.80		10.12	8.49					
15	AD 2314	Slack Separator Tank Agitator					16.04	18.30	0.81	0.86	0.75		17.09	19.07					

T/F calculation:

Assignment - 2
Calculation for Transformer Capacity

1.0 Example of calculation for Transformer Capacity

1.1 Calculation for consumed load
Consumed loads used for this example are as follows:

	kW	kVAR	kVA	
a. Continuous load	429.12	320.45	535.57	(1)
b. Intermittent load / Diversity Factor	14.58	13.05	19.67	(2)
c. Stand-by load required as consumed load	128.38	63.94	139.05	(3)

Max. consumed load = (1) + 30% (2) + 10% (3) = **557.4**
 Future expansion load (20% capacity) = **66.8**
 Total Load = **624.2**

1.2 Calculation for 3.3kV / 0.433 kV transformer capacity

Max. consumed load = **557.4 kVA**
 Spare capacity = **111.8 kVA**
 Required capacity = **669.2 kVA**
 Transformer rated capacity = **750 kVA**

1.3 Voltage regulation check
During starting or reacceleration or max. capacity motor (330 kW), while all the other loads running, the voltage regulation is as follows:

$P_s = 750 \text{ kVA}$, $(\%) = 5.1\%$ & Ratio $kV = 3.3$
 Hence, $\%R = 0.94\%$
 $\%X = 3.16\%$
 $P_u = 60 \text{ kW}$ having $\cos \phi = 0.8$ & $C = 1$ & $\cos \phi_s = 0.78$ & $\sin \phi_s = 0.62$ & $\cos \phi_u = 0.81$
 $P_s = 607.438 \text{ kVA}$
 $\cos \phi_s = 0.81$, corresponding to Angle $\phi_s = 37.872^\circ$ Degrees for which $\sin \phi_s = 0.62$
 $P_s = 423.75 \text{ kVA}$ & $\cos \phi_u$ in kW is 330.7 & P_u in kVAR = 66.15 & $\cos \phi_u = 0.850$
 $\cos \phi_u = 0.85$, corresponding to Angle $\phi_u = 31.7553^\circ$ Degrees, for which $\sin \phi_u = 0.55$
 $P_{cu} = 625.768 \text{ kW}$
 $P_{cu} = 665.565 \text{ kVAR}$
 $P_{cu} = 1505.31 \text{ kVA}$
 $\cos \phi_c = 0.39542$, where $\sin \phi_c = 0.919$
 Voltage Regulation = **6.5 %**

Result: During starting of max. capacity motor, while all other loads are running, the voltage regulation at Transformer secondary terminals is approx. 6.5%, which meets the criteria to maintain less than 10% voltage regulation.

1.4 Selection of rated capacity
750 kVA transformer selected.

29th May2021: DG set calculations

16	DG set calculations
----	---------------------

Topic details:

Transformer and DG set calculations,types ,sizing or selections

Assignment -3		
DG SIZING CALCULATIONS		
Design Data		
Rated Voltage	415	KV
Power factor (Cos ϕ)	0.94	Avg
Efficiency	0.7673	Avg
Total operating load on DG set in kVA at 0.94 power factor	541.5	
Largest motor to start in the sequence - load in KW	90	KW
Running kVA of last motor (Cos ϕ = 0.91)	125	KVA
Starting current ratio of motor	6	(Considering starting method as Soft starter)
Starting KVA of the largest motor (Running kVA of last motor X Starting current ratio of motor)	749	KVA
Base load of DG set in KVA (Total operating load in kVA – Running kVA of last motor)	417	KVA
A. Continuous operation under load -P1		
Capacity of DG set based on continuous operation under load P1	417	KVA
B. Transient Voltage dip during starting of Last motor P2		
Total momentary load in KVA (Starting KVA of the last motor+Base load of DG set in KVA)	1165	KVA
Subtransient Reactance of Generator (X_d'')	7.91%	[Assumed]
Transient Reactance of Generator (X_d')	10.065%	[Assumed]
$X_d''' = (X_d'' + X_d')/2$	0.089875	
Transient Voltage Dip	15%	(Max)
Transient Voltage dip during Soft starter starting of Last motor $P2 = \text{Total momentary load in KVA} \times X_d''' \times \frac{(1 - \text{Transient Voltage Dip})}{(\text{Transient Voltage Dip})}$	594	KVA
C. Overload capacity P3		
Capacity of DG set required considering overload capacity		
Total momentary load in KVA	1165	KVA
overcurrent capacity of DG (K) (Ref: IS/IEC 60034-1, Clause 9.3.2)	150%	
Capacity of DG set required considering overload capacity (P3) = $\frac{\text{Total momentary load in KVA}}{\text{overcurrent capacity of DG (K)}}$	777	KVA
Considering the last value amongst P1, P2 and P3		
Continuous operation under load - P1	417	KVA
Transient Voltage dip during Soft starter starting of Last motor P2	594	KVA
Overload capacity P3	777	KVA
Considering the last value amongst P1, P2 and P3	777	KVA
Hence, Existing Generator 777 KVA is adequate to cater the loads as per re-		

2nd june2021: Caluculations of Earthing and Lighting protection.

17	Calculation of Earthing and Lighting protection calculations	Earthing calculations	Lighting protection calculation
----	--	-----------------------	---------------------------------

Topic details:

Calculation of Earthing and Lighting protection calculations

Assignment - 4

Earthing calculations inputs	TERM	VALUE	FORMULA	VALUE
Maximum line-to-ground fault in kA for 1 sec	IS	Duried length(L)	$1+1/1+hw(2Q/A)$	1.034807233
Earthing material (Earth rod & earth strip)	GI	area(A)	$1/4\pi(20^2A)^2(1+1/1+hw(2Q/A))$	0.004559004
Average depth of Earth rod	4.0	soil resistivity(ρ)	$1/4\pi(1+1/1+hw(2Q/A))^2(1+1/1+hw(2Q/A))$	0.007102183
Soil resistivity 0-meter	9	depth of burial (B)	$\rho^2(1/1+1/4\pi(20^2A)^2(1+1/1+hw(2Q/A)))$	0.064339649
Ambient temperature in deg C	50			
Plot dimensions (earth grid) L x B	65 125		Grid resistance in (R_g)	0.064339649
Number of earth rods in nos.	6			

Earthing calculation

Assignment - 5

Location	IS		
Building	Rajkot		
Type of Building	Concrete, School		
Building Length (L)	Triangle Roofs (c)		
Building breadth (W)	13		
Building Height (H)	6		
Risk factor calculation			
1 connection area (A_c)			
A_c		$= 2.5 \times 10^6 \times H + 3(n \times l)$	240.96
2 Probability of Being Struck (P)		$= A_c \times N_s \times 10^{-5}$	0.000165672
3 Overall weighing factor			
a) Use of structure (A)			1.7
b) Type of construction (B)			0.4
c) Contents or consequential effects (C)			1.0
d) Degree of isolation (D)			0.4
e) Type of country (E)			0.3
W_o - Overall weighing factor		$= A \times B \times C \times D \times E$	0.082
4 Overall Risk Factor			
	P_o	$= P \times W_o$	1.376266×10^{-5}
	P_R		
As per clause no. 9.7 of IS- 6458, suggested acceptable risk factor (P_o) has been taken as 10^{-5}			
Since $P_o > P_R$ lightning protection required.			
air terminations			
Perimeter of the building		$= 2(L+W)$	40
			Mts.
Down Conductors			
Perimeter of building			40
No. of down conductors based on perimeter			3
			Mts.
			Nos.
Hence 2 nos. of down conductors have been selected.			
Size of down conductor			20 X 2.5 mm Galvanized steel strip
[As per IS:6458, lightning currents have very short duration, therefore thermal factors are of little consequence in deciding the cross-section of the conductor. The minimum size of Down conductors - 20mm X 2.5 mm Galvanized Steel Strip]			

18	Cable sizing and cable tray sizing calculations	Cable sizing calculations	Cable tray calculation
----	---	---------------------------	------------------------

Cable sizing and cable tray sizing calculations for LV cables and MV/HV cables.

[illegible]

Table 1.

1. Overall steering factor: $1.0 \times 1.0 \times 1.0 \times 1.0$	2.5 Rating factor for steering to dry/poorly represented
2. Rating factor for depth of testing	3.0 Rating factor for accuracy between two circuits
3. Rating factor for steering between two circuits	4.5 Rating factor for accuracy to overall consensus of DSC and steering (steering step = 70%, steering change step = 10%)
4. Rating factor	
5. Effect of frequency (within 1 Hz)	
6. Combined effect of Voltage & Frequency Variation (0.5%)	

[illegible]

Conclusion

We have been taught many aspects of engineering activities during the EPC stages for all electrical and related other disciplines also.

Feedback

Smart Bridge

They conduct summer internships, work shops, debates, hackthons, technical sessions.

Method of conducting program

Online virtual program with presentation slides and explanation on the topic and practical usage of topic and with some examples.

Program highlights

It is for the detailed design of any industrial sectors.

Material

The material was good .

Benefits

It has been given the opportunity to learn and interact with industry experienced engineering specialist to learn the Electrical detailed design engineering for various industrial sectors.

Assignment - 1

ELECTRICAL LOAD CALCULATIONS LV MCC

[illegible]

Assignment -2

Calculation for Transformer Capacity

1.0 Example of calculation for Transformer Capacity

1.1 Calculation for consumed load

Consumed loads used for this example are as follows :

	kW	kVar	kVA	
a. Continuous load	429.12	320.5	535.57	--- (i)
b. Intermittent load / Diversity Factor	14.58	13.7	19.97	--- (ii)
c. Stand-by load required as consumed load	128.36	93.9	159.06	--- (iii)
Max. Consumed load = ((i) + 30% (ii) + 10% (iii)) =	446.3	333.9	557.43	
Future expansion load (20% capacity)	89.3	66.8	111.49	
Total Load =	535.6	400.7	668.91	

1.2 Calculation for 3.3kV / 0.433 kV transformer capacity

Max. Consumed load	=	557.4 kVA
Spare capacity	=	111.5 kVA
Required capacity	=	668.9 kVA
Transformer rated capacity	=	750 kVA

1.3 Voltage regulation check

During starting or reacceleration of max. capacity motor (3400 kW) , while all the other loads running , the voltage regulation is as follows :

$$P_T = 750 \text{ KVA} \quad (\%Z) = 5.19 \quad \& \text{ Ratio X/R} = 5.4$$

$$\text{Hence, } \%R = 0.941 \%$$

$$\%X = 5.10 \%$$

$$P_M = 90 \text{ KW having } (K = 6 \& C = 1 \& \cos \theta = 0.76 \& \text{Eff.} \eta = 0.88 \& \cos \theta_s = 0.21)$$

$$P_S = 807.416 \text{ KVA}$$

$$\cos \theta_s = 0.25, \text{Corresponding to Angle } \theta_s = 77.8776 \text{ Degrees for which } \sin \theta_s = 0.98$$

$$P_B = 423.75 \text{ KVA} \& \text{ PB in KW is } 360.188 \& P_B \text{ in Kvar} = 66.18 \therefore \cos \theta_B = 0.850$$

$$\cos \theta_B = 0.85, \text{Corresponding to Angle } \theta_s = 31.7883 \text{ Degrees, for which } \sin \theta_s = 0.53$$

$$P_{CP} = 529.745 \text{ KW}$$

$$P_{CQ} = 855.592 \text{ KVAR}$$

$$P_C = 1006.31 \text{ KVA}$$

$$\cos \theta_C = 0.52642, \text{ where as } \sin \theta_C = 0.850$$

$$\text{Voltage Regulation } \varepsilon = 6.5 \%$$

Result: During starting of max. capacity motor, while all other loads are running , the voltage regulation at Transformer secondary terminals is approx. 6.5% , which meets the criteria to maintain less than 15% voltage regulation.

1.4 Selection of rated capacity

750 kVA transformer selected.

Assignment -3

DG SIZING CALCULATIONS		
Design Data		
Rated Voltage	415	KV
Power factor (CosØ)	0.94	Avg
Efficiency	0.7673	Avg
Total operating load on DG set in kVA at 0.94 power factor	541.5	
Largest motor to start in the sequence - load in KW	90	KW
Running kVA of last motor (CosØ= 0.91)	125	KVA
Starting current ratio of motor	6	(Considering starting method as Soft starter)
Starting KVA of the largest motor (Running kVA of last motor X Starting current ratio of motor)	749	KVA
Base load of DG set in KVA (Total operating load in kVA – Running kVA of last motor)	417	KVA
A Continuous operation under load -P1		
Capacity of DG set based on continuous operation under load P1	417	KVA
B Transient Voltage dip during starting of Last motor P2		
Total momentary load in KVA (Starting KVA of the last motor+Base load of DG set in KVA)	1165	KVA
Subtransient Reactance of Generator (Xd'')	7.91%	(Assumed)
Transient Reactance of Generator (Xd')	10.065%	(Assumed)
$X_d''' = (X_d'' + X_d')/2$	0.089875	
Transient Voltage Dip	15%	(Max)
Transient Voltage dip during Soft starter starting of Last motor $P2 = \text{Total momentary load in KVA} \times X_d''' \times \frac{(1 - \text{Transient Voltage Dip})}{1}$ (Transient Voltage Dip)	594	KVA
C Overload capacity P3		
Capacity of DG set required considering overload capacity	1165	KVA
overcurrent capacity of DG (K) (Ref: IS/IEC 60034-1, Clause 9.3.2)	150%	
Capacity of DG set required considering overload capacity (P3) = $\frac{\text{Total momentary load in KVA}}{\text{overcurrent capacity of DG (K)}}$	777	KVA
Considering the last value amongst P1, P2 and P3		
Continuous operation under load -P1	417	KVA
Transient Voltage dip during Soft starter starting of Last motor P2	594	KVA
Overload capacity P3	777	KVA
Considering the last value amongst P1, P2 and P3	777	KVA
Hence, Existing Generator 777 KVA is adequate to cater the loads as per re-		

Assignment - 4

Earthing calculations inputs

Maximum line-to-ground fault in kA for 1 sec	18		TERM	VALUE	FORMULA	VALUE
Earthing material (Earth rod & earth strip)	GI		Buried length(L)	380	$1 + \{1 / (1 + hv(20/A))\}$	1.834407233
Average depth of Earth rod	4.0		area(A)	8125	$\{1 / v(20^*A)\} * \{1 + \{1 / (1 + hv(20/A))\}\}$	0.004550604
Soil resistivity Ω-meter	9		soil resistivity(p)	9	$(1/L) + \{1 / v(20^*A)\} * \{1 + \{1 / (1 + hv(20/A))\}\}$	0.007182183
Ambient temperature in deg C	50		depth of burial (h)	4	$\rho^* \{1/L\} + \{1 / v(20^*A)\} * \{1 + \{1 / (1 + hv(20/A))\}\}$	0.064639649
Plot dimensions (earth grid) L x B	65	125			Grid resistance is (R_g)	0.064639649
Number of earth rods in nos.	6					

Assignment -5

	16
Location	Rajkot
Building	Concrete, School
Type of Building	Triangle Roofs (c)
Building Length (L)	12
Building breadth (W)	6
Building Height (H)	8

Risk Factor Calculation

1 Collection Area (A_c)

$$A_c = 3.14 * h * h + 2(h * l) = 240.96$$

2 Probability of Being Struck (P)

$$P = A_c * N_g * 10^{-6} = 0.000168672$$

3 Overall weighing factor

a) Use of structure (A)	=	1.7
b) Type of construction (B)	=	0.4
c) Contents or consequential effects (C)	=	1.0
d) Degree of isolation (D)	=	0.4
e) Type of country (E)	=	0.3
Wo - Overall weighing factor	=	$A * B * C * D * E$
	=	0.082

4 Overall Risk Factor

$$P_o = P * W_o = 1.37636E-05$$

$$P_a = 10^{-5}$$

As per clause no. 9.7 of BS- 6651, suggested acceptable risk factor (P_o) has been taken as 10^{-5}
 Since $P_o > P_a$ lightning protection required.

5 Air Terminations

Perimeter of the building	=	$2(L+W)$	
	=	36	Mts.

6 Down Conductors

Perimeter of building	=	36	Mts.
No. of down conductors based on perimeter	=	2	Nos.

Hence 2 nos. of Down conductors have been selected.

$$\text{Size of Down conductor} = 20 \times 2.5 \text{ mm Galvanized Steel Strip}$$

(As per BS6651, lightning currents have very short duration, therefore thermal factors are of little consequence in deciding the cross-section of the conductor. The minimum size of Down conductors - 20mm X 2.5 mm Galvanized Steel Strip)

Assignment -6

S.NO.	Description	Equipment No.	Description	Consumed Load KW	Load Rating KW	Voltage (V)	No. of ph	Full Load Current (A)	Motor Starting Current (A)	Load P.F. Running	SIN Φ Running	Motor P.F Staring	SIN Φ Staring	Type	No. of Runs	No. of Cores	Size (mm2)	Current Rating (A)	Derating factor k1	Derating factor k2	Derating factor k3	Derating factor k4	Overall Derating factor k	Derated Current (A)	Cable Length (M)	Cable Resistance (Ohms/kM)	Cable Reactance (Ohms/kM)	Voltage drop (Running) (V)	Voltage drop (Running) (%)	Voltage drop (Starting) (V)	Voltage drop (starting) (%)	Cable size result	OD of Cable (mm)	Gland size
1	LV MCC	PU2315	Silica filter feed pump	88.18	90	415	3	153.4	920.10	0.8	0.6	0.8	0.5	2	1	4.0	95	#REF!	0.98	0.9	1	1	0.882	#REF!	95	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20
2	LV MCC	PU 2314A	Absorbesnt/Neutral oil pump	25.62	30	415	3	44.6	267.33	0.8	0.6	0.8	0.5	2	1	4.0	25	#REF!	0.98	0.9	1	1	0.882	#REF!	60	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
3	LV MCC	PU2324	Citric Acid Tank pump	6.50	7.5	415	3	11.3	67.82	0.8	0.6	0.8	0.5	2	1	4.0	6	#REF!	0.98	0.9	1	1	0.882	#REF!	85	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
4	LV MCC	PU2305	Feed Pump(Seperator)	89.06	90	415	3	154.9	929.28	0.8	0.6	0.8	0.5	2	1	4.0	70	#REF!	0.98	0.9	1	1	0.882	#REF!	75	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20
5	LV MCC	MX2305	Mixer	89.75	90	415	3	156.1	936.48	0.8	0.6	0.8	0.5	2	1	4.0	70	#REF!	0.98	0.9	1	1	0.882	#REF!	75	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20
6	LV MCC	MX2308	Mixer	89.75	90	415	3	156.1	936.48	0.8	0.6	0.8	0.5	2	1	4.0	70	#REF!	0.98	0.9	1	1	0.882	#REF!	105	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20
7	LV MCC	BW2313	Blower	38.53	45	415	3	67.0	402.04	0.8	0.6	0.8	0.5	2	1	4.0	35	#REF!	0.98	0.9	1	1	0.882	#REF!	95	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
8	LV MCC	SC2314	Screw conveyor	8.65	9.2	415	3	15.0	90.26	0.8	0.6	0.8	0.5	2	1	4.0	10	#REF!	0.98	0.9	1	1	0.882	#REF!	65	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
9	LV MCC	AG2324A	citric acid tan agitator	6.50	7.5	415	3	11.3	67.82	0.8	0.6	0.8	0.5	2	1	4.0	6	#REF!	0.98	0.9	1	1	0.882	#REF!	85	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
10	LV MCC	AG2305	citric oil rection vessol agitator	23.63	30	415	3	41.1	246.56	0.8	0.6	0.8	0.5	2	1	4.0	25	#REF!	0.98	0.9	1	1	0.882	#REF!	75	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
11	LV MCC	AG2309	lye oil reaction vessel agitator	8.60	9.2	415	3	15.0	89.74	0.8	0.6	0.8	0.5	2	1	4.0	10	#REF!	0.98	0.9	1	1	0.882	#REF!	65	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
12	LV MCC	AG2310	lye oil reaction vessel agitator	8.60	9.2	415	3	15.0	89.74	0.8	0.6	0.8	0.5	2	1	4.0	10	#REF!	0.98	0.9	1	1	0.882	#REF!	65	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
13	LV MCC	AG2314	Soap adsorbant tank agitator	11.37	18.5	415	3	19.8	118.64	0.8	0.6	0.8	0.5	2	1	4.0	16	#REF!	0.98	0.9	1	1	0.882	#REF!	65	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!	20s
																			</															

Basis:

1. Overall derating factor k = k1 x k2 x k3 x k4
- K1=Rating factor for variation in air/ground temperature

K2=Rating factor for depth of laying

K3=Rating factor for spacing between two circuits

K4=Rating factor for variation in thermal resistivity of the soil
2. LT Motors : Running Voltage Drop = 3%, Starting Voltage Drop = 15%
3. Cable type:
- TYPE 1: Al Conductor, XLPE Insulated, Armoured, PVC outer sheathed

TYPE 2: Cu Conductor, XLPE Insulated, Armoured, PVC outer sheathed
4. Effect of Frequency Variation ± 5%
5. Combined Effect of Voltage & Frequency Variation ±10%

