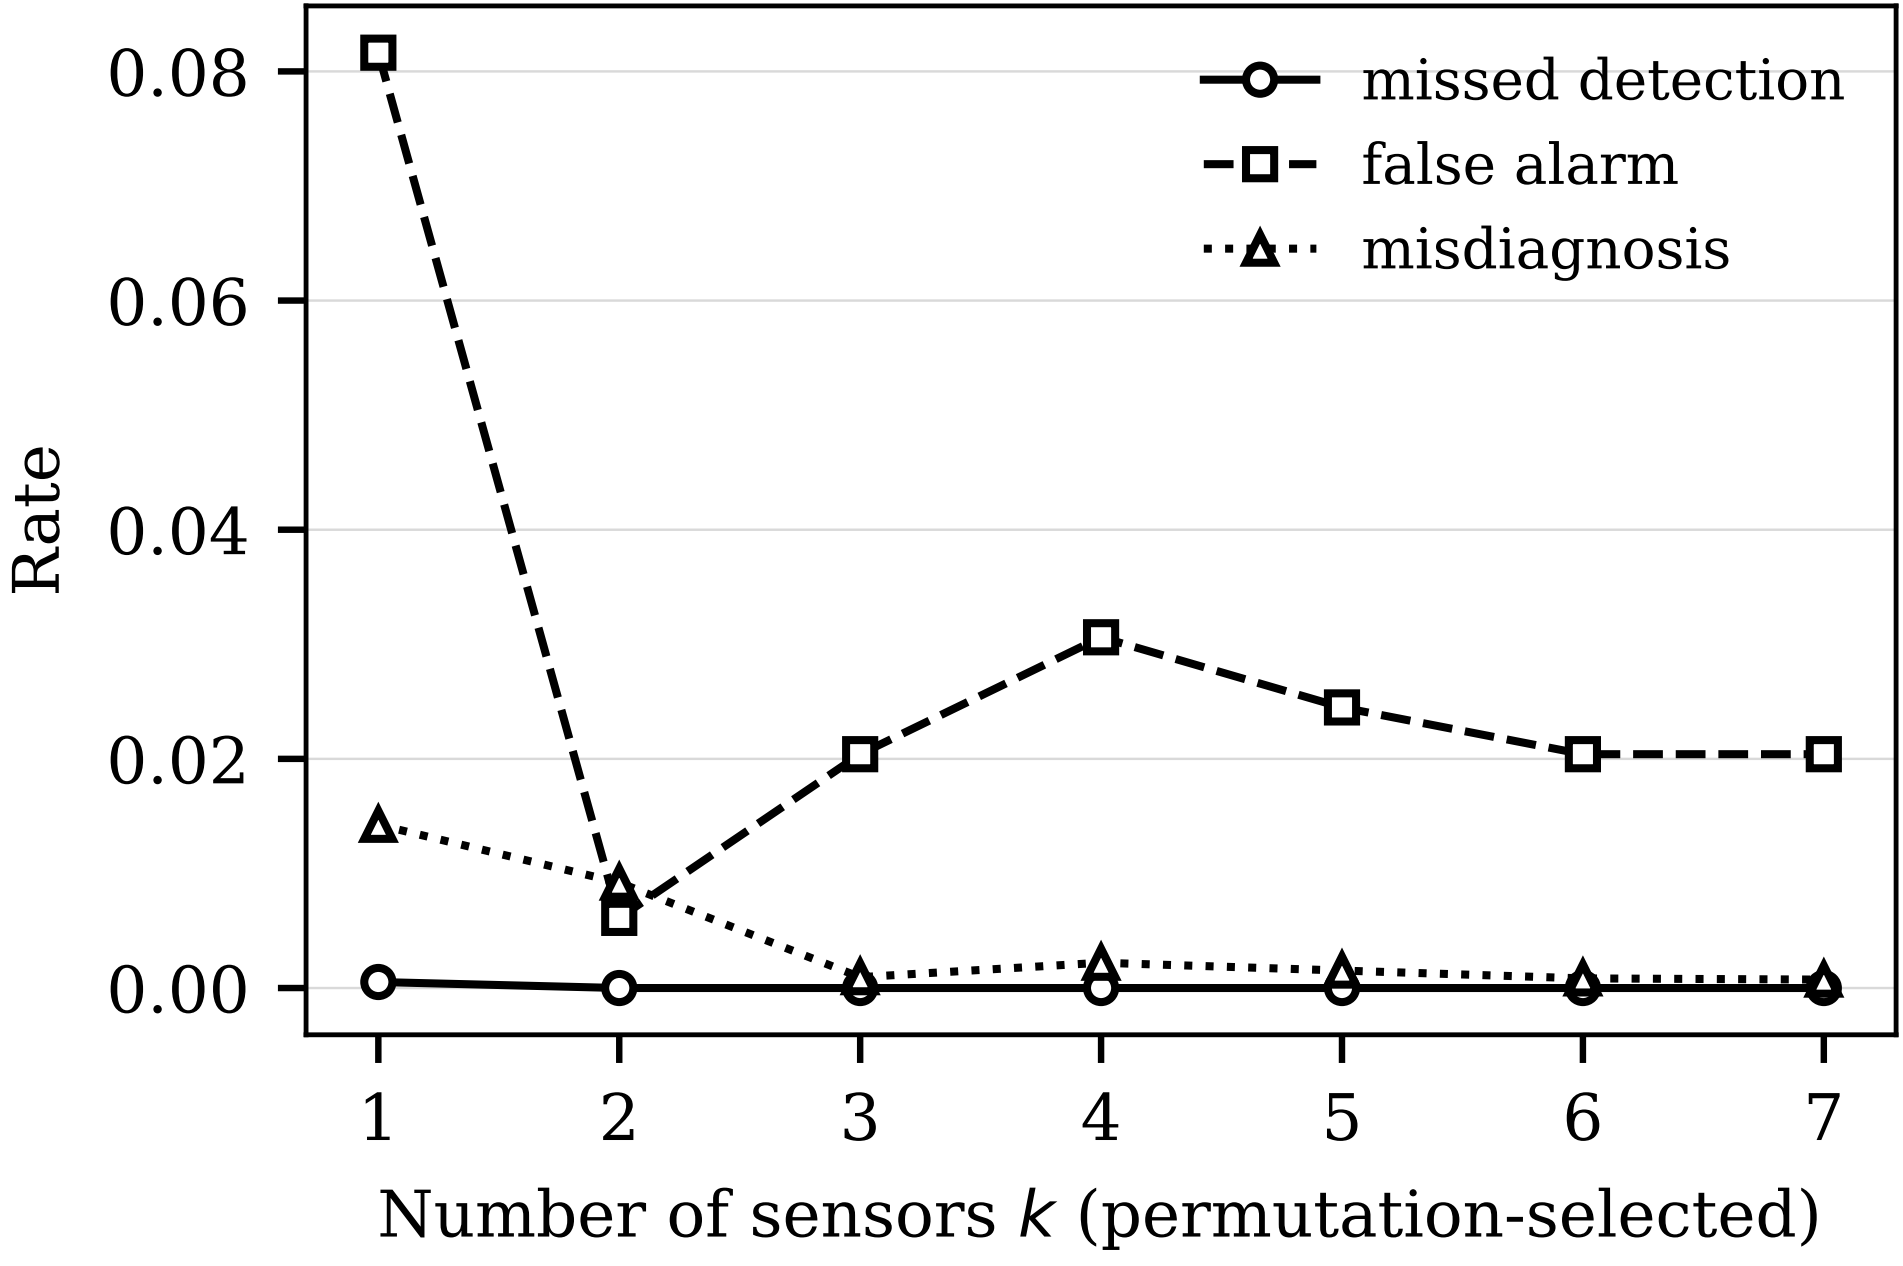
0.08
0.06
0.04
0.02
0.00
Rate
missed detection
false alarm
misdiagnosis
1
2
3
4
5
6
7
Number of sensors k (permutation-selected)